

VISUAL CUYAHOGA COUNTY DAMPER INSPECTION REPORT

Date of Inspection

2022-11-30

Facility Location

County Board of Elections

Damper Location

Basement

Inspector Name

Dan Tulcewicz

Damper I.D. #

AHU1-B-R

Damper Type

Vertical Fire Damper

Damper Size

36x24

Damper Manufacturer

Safe Air

Damper Model #

Unknown

Fusible Link Temperature

165 Degrees

Access Door Size

Open in wall sleeve.

Pass / Fail / Abandoned

Pass

Comments / Corrections

None


Exterior Picture of Damper



Interior Picture of Damper



Picture of Damper I.D. Label

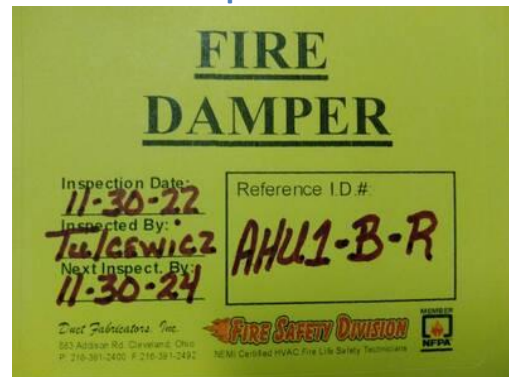

Duct Fabricators, Inc.

883 Addison Rd. Cleveland, Ohio
P: 216-391-2400 F: 216-391-2492

FIRE SAFETY DIVISION

NEMI Certified HVAC Fire Life Safety Technicians



VISUAL CUYAHOGA COUNTY DAMPER INSPECTION REPORT

Date of Inspection

2022-11-30

Facility Location

County Board of Elections

Damper Location

Basement outside of mechanical room.

Inspector Name

Dan Tulcewicz

Damper I.D.

AHU1-B-S

Damper Type

Vertical Fire Damper

Damper Size

20x7 Oval

Damper Manufacturer

Safe Air

Damper Model

Unknown

Fusible Link Temperature

165 Degrees

Access Door Size

14x14

Pass / Fail / Abandoned

Pass

Comments / Corrections

None

Exterior Picture of Damper



Interior Picture of Damper



Picture of Damper I.D. Label



VISUAL CUYAHOGA COUNTY DAMPER INSPECTION REPORT

Date of Inspection

2022-11-30

Facility Location

County Board of Elections

Damper Location

Outside Mechanical Room

Inspector Name

Dan Tulcewicz

Damper I.D. #

AHU1-1-R

Damper Type

Vertical Fire Damper

Damper Size

52x15

Damper Manufacturer

Safe Air

Damper Model #

Unknown

Fusible Link Temperature

165 Degrees

Access Door Size

Open in the ceiling

Pass / Fail / Abandoned

Pass

Comments / Corrections

None


Exterior Picture of Damper



Interior Picture of Damper



Picture of Damper I.D. Label

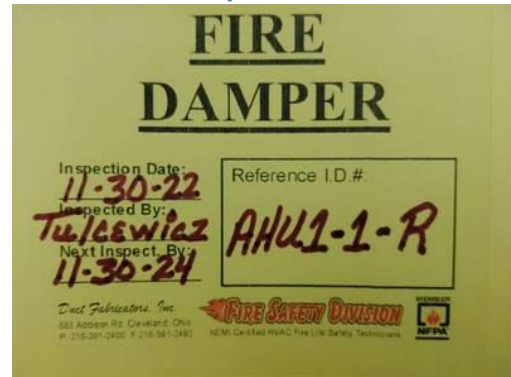

VISUAL CUYAHOGA COUNTY DAMPER INSPECTION REPORT

Date of Inspection

2022-11-30

Facility Location

County Board of Elections

Damper Location

1st floor

Inspector Name

Dan Tulcewicz

Damper I.D. #

AHU1-1-S

Damper Type

Vertical Fire Damper

Damper Size

52x14 Oval

Damper Manufacturer

Safe Air

Damper Model #

Unknown

Fusible Link Temperature

165 Degrees

Access Door Size

18" Round

Pass / Fail / Abandoned

Pass

Comments / Corrections

None

Exterior Picture of Damper



Interior Picture of Damper



Picture of Damper I.D. Label



Duct Fabricators, Inc.

883 Addison Rd. Cleveland, Ohio
P: 216-391-2400 F: 216-391-2492

FIRE SAFETY DIVISION
NEMI Certified HVAC Fire Life Safety Technicians



VISUAL CUYAHOGA COUNTY DAMPER INSPECTION REPORT

Date of Inspection

2022-11-30

Facility Location

County Board of Elections

Damper Location

2nd floor

Inspector Name

Dan Tulcewicz

Damper I.D. #

AHU1-2-R1

Damper Type

Vertical Fire Damper

Damper Size

70x14

Damper Manufacturer

Safe Air

Damper Model #

Unknown

Fusible Link Temperature

165 Degrees

Access Door Size

Open Duct


Pass / Fail / Abandoned

Pass

Comments / Corrections

None


Exterior Picture of Damper

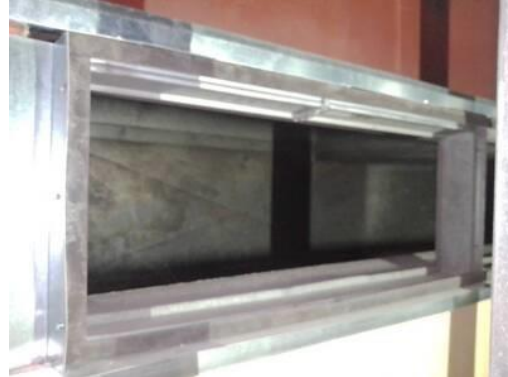

Interior Picture of Damper



Picture of Damper I.D. Label

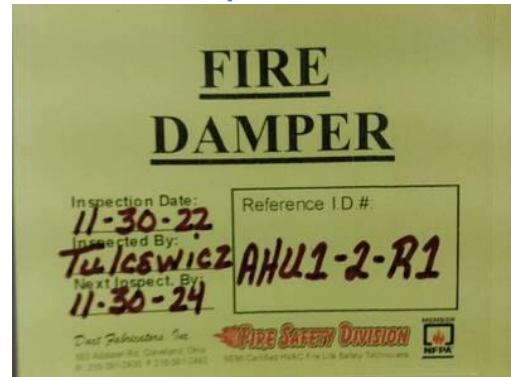

Duct Fabricators, Inc.

883 Addison Rd. Cleveland, Ohio
P: 216-391-2400 F: 216-391-2492



NEMI Certified HVAC Fire Life Safety Technicians



VISUAL CUYAHOGA COUNTY DAMPER INSPECTION REPORT

Date of Inspection

2022-11-30

Facility Location

County Board of Elections

Damper Location

2nd floor

Inspector Name

Dan Tulcewicz

Damper I.D.

AHU1-2-R2

Damper Type

Vertical Fire Damper

Damper Size

70x14

Damper Manufacturer

Safe Air

Damper Model

Unknown

Fusible Link Temperature

165 Degrees

Access Door Size

Open Duct

Pass / Fail / Abandoned

Pass

Comments / Corrections

None


Exterior Picture of Damper



Interior Picture of Damper



Picture of Damper I.D. Label

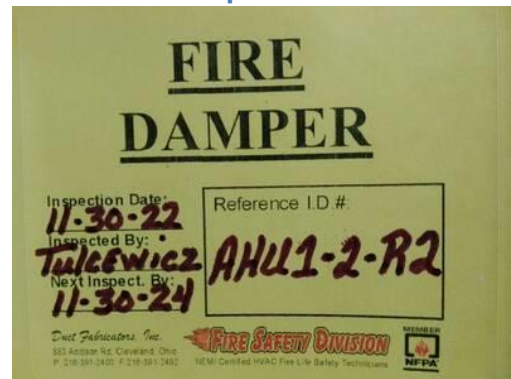

VISUAL CUYAHOGA COUNTY DAMPER INSPECTION REPORT

Date of Inspection

2022-11-30

Facility Location

County Board of Elections

Damper Location

2nd floor

Inspector Name

Dan Tulcewicz

Damper I.D. #

AHU1-2-S

Damper Type

Vertical Fire Damper

Damper Size

64x14 Oval

Damper Manufacturer

Safe Air

Damper Model #

Unknown

Fusible Link Temperature

165 Degrees

Access Door Size

18"Round

Pass / Fail / Abandoned

Pass

Comments / Corrections

None


Exterior Picture of Damper



Interior Picture of Damper



Picture of Damper I.D. Label

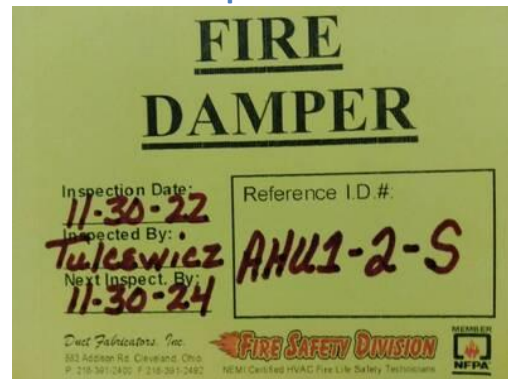

VISUAL CUYAHOGA COUNTY DAMPER INSPECTION REPORT

Date of Inspection

2022-11-30

Facility Location

County Board of Elections

Damper Location

Outside of kitchen area

Inspector Name

Dan Tulcewicz

Damper I.D. #

AHU1-3-R1

Damper Type

Vertical Fire Damper

Damper Size

68x14

Damper Manufacturer

Safe Air

Damper Model #

Unknown

Fusible Link Temperature

165 Degrees

Access Door Size

Ceiling access door

Pass / Fail / Abandoned

Pass

Comments / Corrections

None


Exterior Picture of Damper



Interior Picture of Damper



Picture of Damper I.D. Label

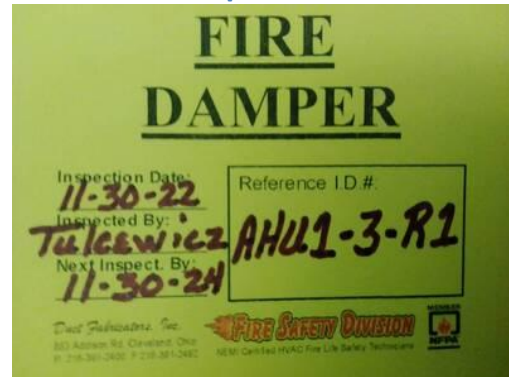

VISUAL CUYAHOGA COUNTY DAMPER INSPECTION REPORT

Date of Inspection

2022-11-30

Facility Location

County Board of Elections

Damper Location

3rd floor

Inspector Name

Dan Tulcewicz

Damper I.D. #

AHU1-3-R2

Damper Type

Vertical Fire Damper

Damper Size

69x14

Damper Manufacturer

Safe Air

Damper Model #

Unknown

Fusible Link Temperature

165 Degrees

Access Door Size

Open Duct

Pass / Fail / Abandoned

Pass

Comments / Corrections

None

Exterior Picture of Damper



Interior Picture of Damper



Picture of Damper I.D. Label



Duct Fabricators, Inc.

883 Addison Rd. Cleveland, Ohio
P: 216-391-2400 F: 216-391-2492

FIRE SAFETY DIVISION
NEMI Certified HVAC Fire Life Safety Technicians



VISUAL CUYAHOGA COUNTY DAMPER INSPECTION REPORT

Date of Inspection

2022-11-30

Facility Location

County Board of Elections

Damper Location

3rd floor

Inspector Name

Dan Tulcewicz

Damper I.D. #

AHU1-3-S

Damper Type

Vertical Fire Damper

Damper Size

32" Round

Damper Manufacturer

Safe Air

Damper Model #

Unknown

Fusible Link Temperature

165 Degrees

Access Door Size

18" Round

Pass / Fail / Abandoned

Pass

Comments / Corrections

None


Exterior Picture of Damper



Interior Picture of Damper



Picture of Damper I.D. Label

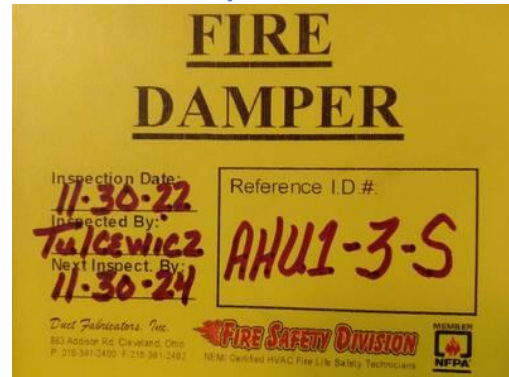

Duct Fabricators, Inc.

883 Addison Rd. Cleveland, Ohio
P: 216-391-2400 F: 216-391-2492

FIRE SAFETY DIVISION
NEMI Certified HVAC Fire Life Safety Technicians



VISUAL CUYAHOGA COUNTY DAMPER INSPECTION REPORT

Date of Inspection

2022-11-30

Facility Location

County Board of Elections

Damper Location

4th floor closet

Inspector Name

Dan Tulcewicz

Damper I.D.

AHU1-4-R1

Damper Type

Vertical Fire Damper

Damper Size

75x14

Damper Manufacturer

Safe Air

Damper Model

Unknown

Fusible Link Temperature

165 Degrees

Access Door Size

24x24 drywall ceiling access door

Pass / Fail / Abandoned

Pass

Comments / Corrections

None


Exterior Picture of Damper



Interior Picture of Damper



Picture of Damper I.D. Label

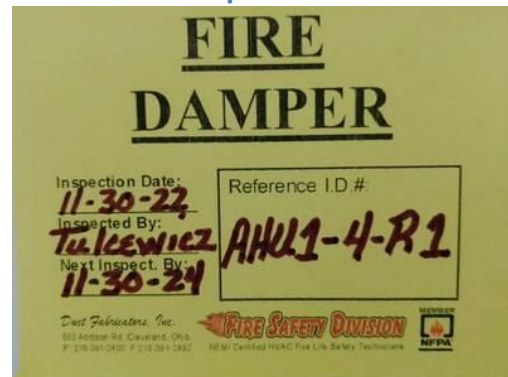

Duct Fabricators, Inc.

883 Addison Rd. Cleveland, Ohio
P: 216-391-2400 F: 216-391-2492

FIRE SAFETY DIVISION

NEMI Certified HVAC Fire Life Safety Technicians



VISUAL CUYAHOGA COUNTY DAMPER INSPECTION REPORT

Date of Inspection

2022-11-30

Facility Location

County Board of Elections

Damper Location

4th floor kitchen area

Inspector Name

Dan Tulcewicz

Damper I.D.

AHU1-4-R2

Damper Type

Vertical Fire Damper

Damper Size

30x14

Damper Manufacturer

Ruskin

Damper Model

IBD2

Fusible Link Temperature

165 Degrees

Access Door Size

Open

Pass / Fail / Abandoned

Pass

Comments / Corrections

None


Exterior Picture of Damper



Interior Picture of Damper



Picture of Damper I.D. Label

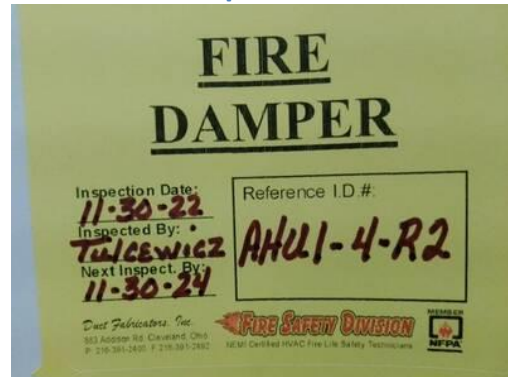

VISUAL CUYAHOGA COUNTY DAMPER INSPECTION REPORT

Date of Inspection

2022-11-30

Facility Location

County Board of Elections

Damper Location

4th floor Room #408

Inspector Name

Dan Tulcewicz

Damper I.D. #

AHU1-4-S

Damper Type

Vertical Fire Damper

Damper Size

32" Round

Damper Manufacturer

Safe Air

Damper Model #

Unknown

Fusible Link Temperature

165 Degrees

Access Door Size

16x16

Pass / Fail / Abandoned

Pass

Comments / Corrections

None

Exterior Picture of Damper



Interior Picture of Damper



Picture of Damper I.D. Label



Duct Fabricators, Inc.
 883 Addison Rd. Cleveland, Ohio
 P: 216-391-2400 F: 216-391-2492



Fire / Smoke / Fire & Smoke Damper
Composite Inspection Report

	<u>FD/SD/FSD</u>	<u>I.D.#</u>	<u>Size</u>	<u>Manufacturer</u>	<u>Model</u>	<u>Visual</u>	<u>Functional</u>	<u>Comments</u>
1	FD	AHU1-1-R	52X15	Safe Air	Unknown	Pass	N/A	None
2	FD	AHU1-1-S	52x14 Oval	Safe Air	Unknown	Pass	N/A	None
3	FD	AHU1-2-R1	70x14	Safe Air	Unknown	Pass	N/A	None
4	FD	AHU1-2-R2	70x14	Safe Air	Unknown	Pass	N/A	None
5	FD	AHU1-2-S	64x14 Oval	Safe Air	Unknown	Pass	N/A	None
6	FD	AHU1-3-R1	68x14	Safe Air	Unknown	Pass	N/A	None
7	FD	AHU1-3-R1	69x14	Safe Air	Unknown	Pass	N/A	None
8	FD	AHU1-3-S	32 Round	Safe Air	Unknown	Pass	N/A	None
9	FD	AHU1-4-R1	75x14	Safe Air	Unknown	Pass	N/A	None
10	FD	AHU1-4-R2	30x14	Safe Air	Unknown	Pass	N/A	None
11	FD	AHU1-4-S	32 Round	Safe Air	Unknown	Pass	N/A	None
12	FD	AHU1-B-R	36x24	Safe Air	Unknown	Pass	N/A	None
13	FD	AHU1-B-S	20x7 Oval	Safe Air	Unknown	Pass	N/A	None
14								
15								
16								
17								
18								
19								
20								

Inspector: Julie Gue/Dan Tulcewicz/Larry Coreno
Inspection Dates: Oct-30-2022
Facility: Board of Elections

S= Supply Air FD = Fire Damper
 R = Return Air SD = Smoke Damper
 EA = Exhaust Air FSD = Fire Smoke Damper

VISUAL CUYAHOGA COUNTY DAMPER INSPECTION REPORT

Date of Inspection

2022-11-30

Facility Location

County Board of Elections

Damper Location

Basement

Inspector Name

Dan Tulcewicz

Damper I.D. #

AHU1-B-R

Damper Type

Vertical Fire Damper

Damper Size

36x24

Damper Manufacturer

Safe Air

Damper Model #

Unknown

Fusible Link Temperature

165 Degrees

Access Door Size

Open in wall sleeve.

Pass / Fail / Abandoned

Pass

Comments / Corrections

None


Exterior Picture of Damper



Interior Picture of Damper



Picture of Damper I.D. Label

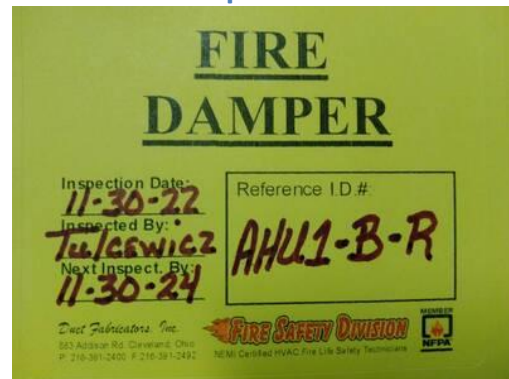

Duct Fabricators, Inc.

883 Addison Rd. Cleveland, Ohio
P: 216-391-2400 F: 216-391-2492

FIRE SAFETY DIVISION

NEMI Certified HVAC Fire Life Safety Technicians



VISUAL CUYAHOGA COUNTY DAMPER INSPECTION REPORT

Date of Inspection

2022-11-30

Facility Location

County Board of Elections

Damper Location

Basement outside of mechanical room.

Inspector Name

Dan Tulcewicz

Damper I.D.

AHU1-B-S

Damper Type

Vertical Fire Damper

Damper Size

20x7 Oval

Damper Manufacturer

Safe Air

Damper Model

Unknown

Fusible Link Temperature

165 Degrees

Access Door Size

14x14

Pass / Fail / Abandoned

Pass

Comments / Corrections

None

Exterior Picture of Damper



Interior Picture of Damper



Picture of Damper I.D. Label



Duct Fabricators, Inc.

883 Addison Rd. Cleveland, Ohio
P: 216-391-2400 F: 216-391-2492

FIRE SAFETY DIVISION
NEMI Certified HVAC Fire Life Safety Technicians



VISUAL CUYAHOGA COUNTY DAMPER INSPECTION REPORT

Date of Inspection

2022-11-30

Facility Location

County Board of Elections

Damper Location

Outside Mechanical Room

Inspector Name

Dan Tulcewicz

Damper I.D.

AHU1-1-R

Damper Type

Vertical Fire Damper

Damper Size

52x15

Damper Manufacturer

Safe Air

Damper Model

Unknown

Fusible Link Temperature

165 Degrees

Access Door Size

Open in the ceiling

Pass / Fail / Abandoned

Pass

Comments / Corrections

None


Exterior Picture of Damper



Interior Picture of Damper



Picture of Damper I.D. Label

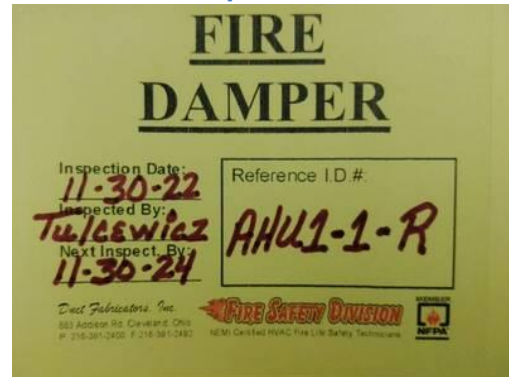

VISUAL CUYAHOGA COUNTY DAMPER INSPECTION REPORT

Date of Inspection

2022-11-30

Facility Location

County Board of Elections

Damper Location

1st floor

Inspector Name

Dan Tulcewicz

Damper I.D. #

AHU1-1-S

Damper Type

Vertical Fire Damper

Damper Size

52x14 Oval

Damper Manufacturer

Safe Air

Damper Model #

Unknown

Fusible Link Temperature

165 Degrees

Access Door Size

18" Round

Pass / Fail / Abandoned

Pass

Comments / Corrections

None


Exterior Picture of Damper



Interior Picture of Damper



Picture of Damper I.D. Label

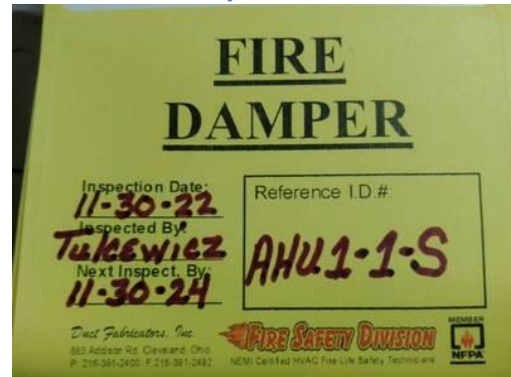

Duct Fabricators, Inc.

883 Addison Rd. Cleveland, Ohio
P: 216-391-2400 F: 216-391-2492

FIRE SAFETY DIVISION

NEMI Certified HVAC Fire Life Safety Technicians



VISUAL CUYAHOGA COUNTY DAMPER INSPECTION REPORT

Date of Inspection

2022-11-30

Facility Location

County Board of Elections

Damper Location

2nd floor

Inspector Name

Dan Tulcewicz

Damper I.D. #

AHU1-2-R1

Damper Type

Vertical Fire Damper

Damper Size

70x14

Damper Manufacturer

Safe Air

Damper Model #

Unknown

Fusible Link Temperature

165 Degrees

Access Door Size

Open Duct


Pass / Fail / Abandoned

Pass

Comments / Corrections

None


Exterior Picture of Damper

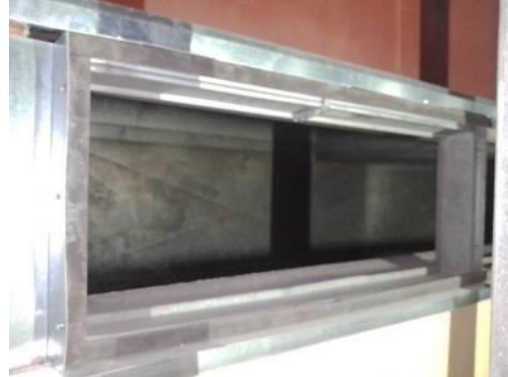

Interior Picture of Damper



Picture of Damper I.D. Label

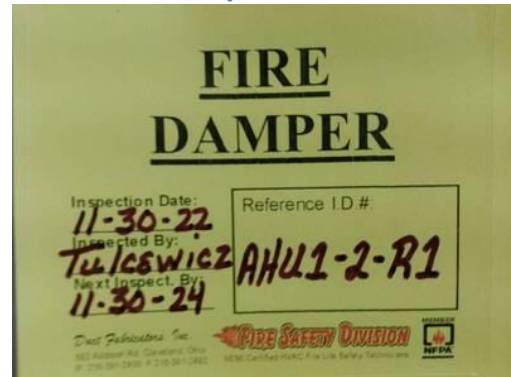

Duct Fabricators, Inc.

883 Addison Rd. Cleveland, Ohio
P: 216-391-2400 F: 216-391-2492



NEMI Certified HVAC Fire Life Safety Technicians



VISUAL CUYAHOGA COUNTY DAMPER INSPECTION REPORT

Date of Inspection

2022-11-30

Facility Location

County Board of Elections

Damper Location

2nd floor

Inspector Name

Dan Tulcewicz

Damper I.D.

AHU1-2-R2

Damper Type

Vertical Fire Damper

Damper Size

70x14

Damper Manufacturer

Safe Air

Damper Model

Unknown

Fusible Link Temperature

165 Degrees

Access Door Size

Open Duct

Pass / Fail / Abandoned

Pass

Comments / Corrections

None


Exterior Picture of Damper



Interior Picture of Damper



Picture of Damper I.D. Label

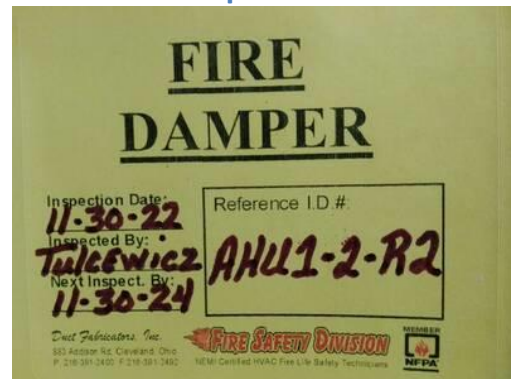

VISUAL CUYAHOGA COUNTY DAMPER INSPECTION REPORT

Date of Inspection

2022-11-30

Facility Location

County Board of Elections

Damper Location

2nd floor

Inspector Name

Dan Tulcewicz

Damper I.D. #

AHU1-2-S

Damper Type

Vertical Fire Damper

Damper Size

64x14 Oval

Damper Manufacturer

Safe Air

Damper Model #

Unknown

Fusible Link Temperature

165 Degrees

Access Door Size

18" Round

Pass / Fail / Abandoned

Pass

Comments / Corrections

None


Exterior Picture of Damper



Interior Picture of Damper



Picture of Damper I.D. Label

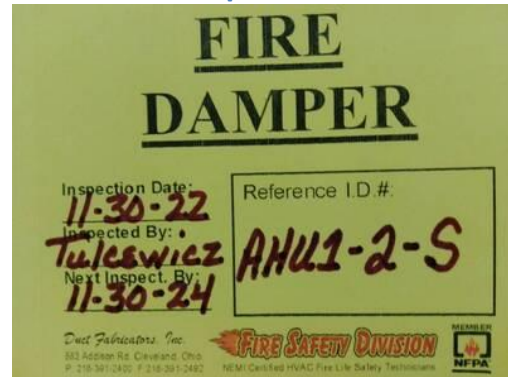

Duct Fabricators, Inc.

883 Addison Rd. Cleveland, Ohio
P: 216-391-2400 F: 216-391-2492

FIRE SAFETY DIVISION
NEMI Certified HVAC Fire Life Safety Technicians



VISUAL CUYAHOGA COUNTY DAMPER INSPECTION REPORT

Date of Inspection

2022-11-30

Facility Location

County Board of Elections

Damper Location

Outside of kitchen area

Inspector Name

Dan Tulcewicz

Damper I.D.

AHU1-3-R1

Damper Type

Vertical Fire Damper

Damper Size

68x14

Damper Manufacturer

Safe Air

Damper Model

Unknown

Fusible Link Temperature

165 Degrees

Access Door Size

Ceiling access door

Pass / Fail / Abandoned

Pass

Comments / Corrections

None


Exterior Picture of Damper



Interior Picture of Damper



Picture of Damper I.D. Label

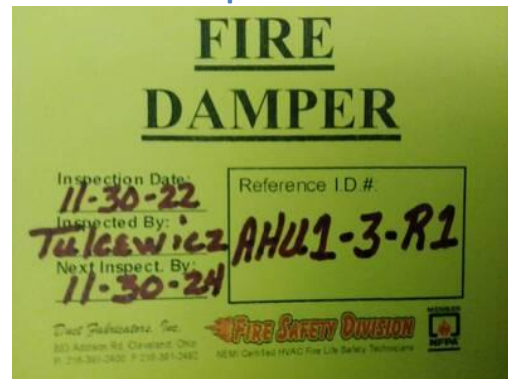

VISUAL CUYAHOGA COUNTY DAMPER INSPECTION REPORT

Date of Inspection

2022-11-30

Facility Location

County Board of Elections

Damper Location

3rd floor

Inspector Name

Dan Tulcewicz

Damper I.D. #

AHU1-3-R2

Damper Type

Vertical Fire Damper

Damper Size

69x14

Damper Manufacturer

Safe Air

Damper Model #

Unknown

Fusible Link Temperature

165 Degrees

Access Door Size

Open Duct

Pass / Fail / Abandoned

Pass

Comments / Corrections

None

Exterior Picture of Damper



Interior Picture of Damper



Picture of Damper I.D. Label



Duct Fabricators, Inc.

883 Addison Rd. Cleveland, Ohio
P: 216-391-2400 F: 216-391-2492

FIRE SAFETY DIVISION
NEMI Certified HVAC Fire Life Safety Technicians



VISUAL CUYAHOGA COUNTY DAMPER INSPECTION REPORT

Date of Inspection

2022-11-30

Facility Location

County Board of Elections

Damper Location

3rd floor

Inspector Name

Dan Tulcewicz

Damper I.D. #

AHU1-3-S

Damper Type

Vertical Fire Damper

Damper Size

32" Round

Damper Manufacturer

Safe Air

Damper Model #

Unknown

Fusible Link Temperature

165 Degrees

Access Door Size

18" Round

Pass / Fail / Abandoned

Pass

Comments / Corrections

None


Exterior Picture of Damper



Interior Picture of Damper



Picture of Damper I.D. Label

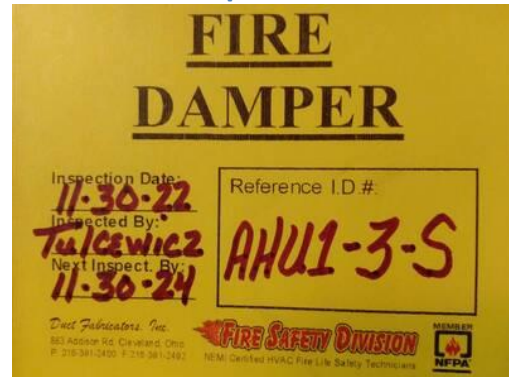

Duct Fabricators, Inc.

883 Addison Rd. Cleveland, Ohio
P: 216-391-2400 F: 216-391-2492

FIRE SAFETY DIVISION
NEMI Certified HVAC Fire Life Safety Technicians



VISUAL CUYAHOGA COUNTY DAMPER INSPECTION REPORT

Date of Inspection

2022-11-30

Facility Location

County Board of Elections

Damper Location

4th floor closet

Inspector Name

Dan Tulcewicz

Damper I.D.

AHU1-4-R1

Damper Type

Vertical Fire Damper

Damper Size

75x14

Damper Manufacturer

Safe Air

Damper Model

Unknown

Fusible Link Temperature

165 Degrees

Access Door Size

24x24 drywall ceiling access door

Pass / Fail / Abandoned

Pass

Comments / Corrections

None


Exterior Picture of Damper



Interior Picture of Damper



Picture of Damper I.D. Label

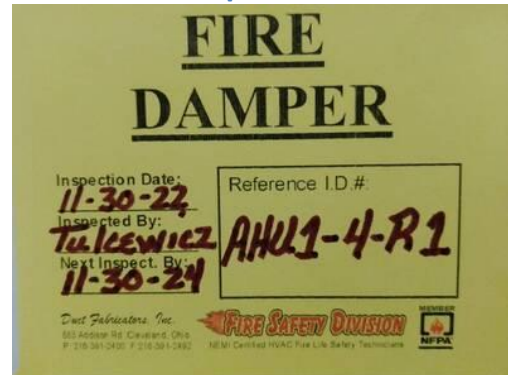

Duct Fabricators, Inc.

883 Addison Rd. Cleveland, Ohio
P: 216-391-2400 F: 216-391-2492

FIRE SAFETY DIVISION
NEMI Certified HVAC Fire Life Safety Technicians



VISUAL CUYAHOGA COUNTY DAMPER INSPECTION REPORT

Date of Inspection

2022-11-30

Facility Location

County Board of Elections

Damper Location

4th floor kitchen area

Inspector Name

Dan Tulcewicz

Damper I.D.

AHU1-4-R2

Damper Type

Vertical Fire Damper

Damper Size

30x14

Damper Manufacturer

Ruskin

Damper Model

IBD2

Fusible Link Temperature

165 Degrees

Access Door Size

Open

Pass / Fail / Abandoned

Pass

Comments / Corrections

None


Exterior Picture of Damper



Interior Picture of Damper



Picture of Damper I.D. Label

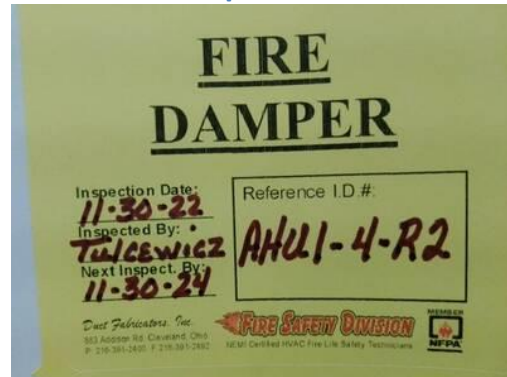

VISUAL CUYAHOGA COUNTY DAMPER INSPECTION REPORT

Date of Inspection

2022-11-30

Facility Location

County Board of Elections

Damper Location

4th floor Room #408

Inspector Name

Dan Tulcewicz

Damper I.D. #

AHU1-4-S

Damper Type

Vertical Fire Damper

Damper Size

32" Round

Damper Manufacturer

Safe Air

Damper Model #

Unknown

Fusible Link Temperature

165 Degrees

Access Door Size

16x16

Pass / Fail / Abandoned

Pass

Comments / Corrections

None

Exterior Picture of Damper



Interior Picture of Damper



Picture of Damper I.D. Label



Duct Fabricators, Inc.
 883 Addison Rd. Cleveland, Ohio
 P: 216-391-2400 F: 216-391-2492



Fire / Smoke / Fire & Smoke Damper
Composite Inspection Report

	<u>FD/SD/FSD</u>	<u>I.D.#</u>	<u>Size</u>	<u>Manufacturer</u>	<u>Model</u>	<u>Visual</u>	<u>Functional</u>	<u>Comments</u>
1	FD	AHU1-1-R	52X15	Safe Air	Unknown	Pass	N/A	None
2	FD	AHU1-1-S	52x14 Oval	Safe Air	Unknown	Pass	N/A	None
3	FD	AHU1-2-R1	70x14	Safe Air	Unknown	Pass	N/A	None
4	FD	AHU1-2-R2	70x14	Safe Air	Unknown	Pass	N/A	None
5	FD	AHU1-2-S	64x14 Oval	Safe Air	Unknown	Pass	N/A	None
6	FD	AHU1-3-R1	68x14	Safe Air	Unknown	Pass	N/A	None
7	FD	AHU1-3-R1	69x14	Safe Air	Unknown	Pass	N/A	None
8	FD	AHU1-3-S	32 Round	Safe Air	Unknown	Pass	N/A	None
9	FD	AHU1-4-R1	75x14	Safe Air	Unknown	Pass	N/A	None
10	FD	AHU1-4-R2	30x14	Safe Air	Unknown	Pass	N/A	None
11	FD	AHU1-4-S	32 Round	Safe Air	Unknown	Pass	N/A	None
12	FD	AHU1-B-R	36x24	Safe Air	Unknown	Pass	N/A	None
13	FD	AHU1-B-S	20x7 Oval	Safe Air	Unknown	Pass	N/A	None
14								
15								
16								
17								
18								
19								
20								

Inspector: Julie Gue/Dan Tulcewicz/Larry Coreno
Inspection Dates: Oct-30-2022
Facility: Board of Elections

S= Supply Air FD = Fire Damper
 R = Return Air SD = Smoke Damper
 EA = Exhaust Air FSD = Fire Smoke Damper

Report Date: November 23, 2022

Project: Cuyahoga County
Board of Elections

Inspector(s):
Julianne Gue, Certified Technician
Dan Tulcewicz, Certified Technician
Larry Coreno, Certified Technician

Inspection and Test Date(s):
October 30, 2022

Duct Fabricators, Inc. "Fire Safety Division" visually inspected Thirteen Dampers for proper installation. The exterior and interior of each damper was photographed to confirm that the dampers were free of any obstructions or modifications. Preventative maintenance was performed to enhance the longevity and reliability of the damper.

NOTES: NFPA 80 and NFPA 105 require newly installed dampers to be inspected and tested one year after initial installation. Thereafter, dampers located in patient care facilities are to be inspected and tested every six years.

Additionally, the information contained herein verified whether the dampers were functional at the time of testing. This verification process does not represent any form of a guarantee that the dampers will properly perform in the future.