

Duct Fabricators, Inc.
 883 Addison Rd. Cleveland, Ohio
 P: 216-391-2400 F: 216-391-2492



Fire / Smoke / Fire & Smoke Damper
Composite Inspection Report

	<u>FD/SD/FSD</u>	<u>I.D.#</u>	<u>Size</u>	<u>Manufacturer</u>	<u>Model</u>	<u>Visual</u>	<u>Functional</u>	<u>Comments</u>
38	FD	4FL-FD1 North	36x12	Air Balance	Unknown	Pass	Pass	None
39	FD	4FL-FD2 North	28x12	Air Balance	Unknown	Pass	Pass	Changed Fusible Link
40	FD	4FL-FD3 North	24x18	Ruskin	IBD60	Pass	Pass	None
41	FD	4FL-FD4 North	12x8	Air Balance	Unknown	Pass	Pass	None
42	FD	4FL-FD 5 North	22x10	Air Balance	Unknown	Pass	Pass	None
43	FD	4FL-FD6 North	6" R	Air Balance	Unknown	Pass	Pass	None
44	FD	4FL-FD7 North	14x6	Air Balance	Unknown	Pass	Pass	None
45	FD	4FL-FD8 North	72x12	Air Balance	Unknown	Pass	Pass	None
46	FD	4FL-FD9 North	60x6	Air Balance	Unknown	Pass	Pass	None
47	FD	4FL-FD10 North	8" R	Air Balance	Unknown	Pass	Pass	None
48	FD	4FL-FD11 North	60x6	Air Balance	Unknown	Pass	Pass	None
49	FD	4FL-FD12 North	12" R	Ruskin	IBD60	Pass	Pass	None
50	FD	4FL-FD13 North	64x14	Air Balance	Unknown	Pass	Pass	None
51	FD	4FL-FD14 North	56x14	Air Balance	Unknown	Pass	Pass	None
52	FD	4FL-FD15 North	10x6	Air Balance	Unknown	Pass	Pass	None
53	FD	4FL-FD16 North	10x8 Oval	Air Balance	Unknown	Pass	Pass	None
54	FD	4FL-FD17 North	6x6	Air Balance	Unknown	Pass	Pass	None
55	FD	4FL-FD18 North	18x12 Oval	Air Balance	Unknown	Pass	Pass	None
56	FD	4FL-FD19 North	28x12	Air Balance	Unknown	Pass	Pass	Installed larger access

Inspector: Julie Gue
Inspection Dates: 2/14/2022-3/01/2022
Facility: Court Tower 2 Old Police Headquarters

SA = Supply Air FD = Fire Damper
 RA = Return Air SD = Smoke Damper
 EA = Exhaust Air FSD = Fire Smoke Damper

CUYAHOGA COUNTY DAMPER INSPECTION REPORT

Date of Inspection

2022-02-14

Facility Location

Old Police Dept Building

Damper Location

Break room

Inspector Name

Julie Gue

Damper I.D. #

1FL-FD2

Damper Type

Vertical Fire Damper

Damper Size

16x14

Damper Manufacturer

Air Balance

Damper Model #

Unknown

Fusible Link Temperature

165 Degrees

Access Door Size

12x10

Pass / Fail / Abandoned

Pass

Comments / Corrections

None


Picture of Damper in Open Position



Picture of Damper in Closed Position



Picture of Damper I.D. Label

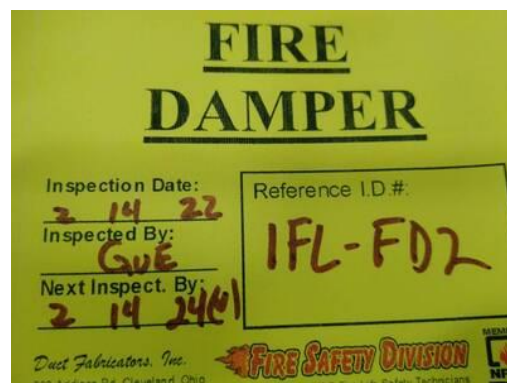

CUYAHOGA COUNTY DAMPER INSPECTION REPORT

Date of Inspection

2022-02-14

Facility Location

Old Police Dept Building

Damper Location

Labs lobby

Inspector Name

Julie Gue

Damper I.D. #

1FL-FD3

Damper Type

Vertical Fire Damper

Damper Size

12x12

Damper Manufacturer

Ruskin

Damper Model #

IBD20

Fusible Link Temperature

165 Degrees

Access Door Size

10x10

Pass / Fail / Abandoned

Pass


Comments / Corrections

None


Picture of Damper in Open Position



Picture of Damper in Closed Position

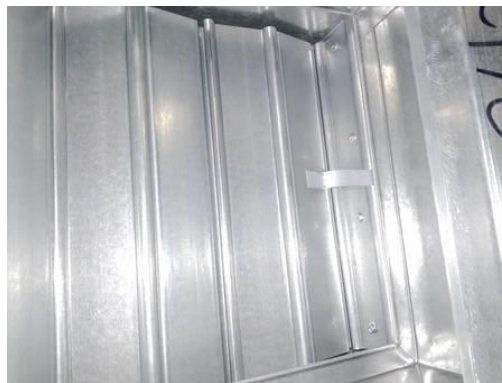

Picture of Damper I.D. Label

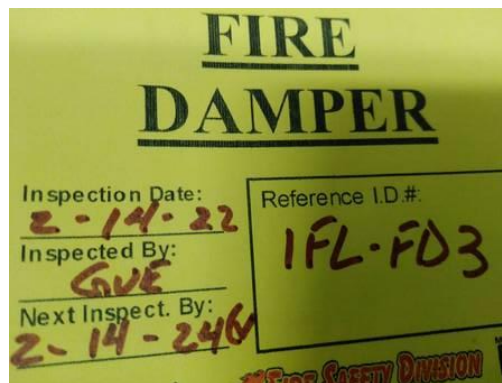

CUYAHOGA COUNTY DAMPER INSPECTION REPORT

Date of Inspection
2022-02-14

Facility Location
Old Police Dept Building

Damper Location
Labs lobby

Inspector Name
Julie Gue

Damper I.D. #
1FL-FD4

Damper Type
Vertical Fire Damper

Damper Size
6x6

Damper Manufacturer
Air Balance

Damper Model #
Unknown

Fusible Link Temperature
165 Degrees

Access Door Size
8x6

Pass / Fail / Abandoned
Pass

Comments / Corrections
None


Picture of Damper in Open Position



Picture of Damper in Closed Position



Picture of Damper I.D. Label

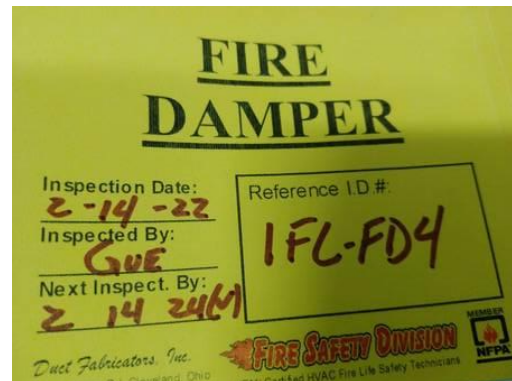

CUYAHOGA COUNTY DAMPER INSPECTION REPORT

Date of Inspection

2022-02-14

Facility Location

Old Police Dept Building

Damper Location

Labs lobby

Inspector Name

Julie Gue

Damper I.D. #

1FL-FD5

Damper Type

Vertical Fire Damper

Damper Size

16x12

Damper Manufacturer

Air Balance

Damper Model #

Unknown

Fusible Link Temperature

165 Degrees

Access Door Size

10x12

Pass / Fail / Abandoned

Pass

Comments / Corrections

None

Picture of Damper in Open Position



Picture of Damper in Closed Position



Picture of Damper I.D. Label



CUYAHOGA COUNTY DAMPER INSPECTION REPORT

Date of Inspection

2022-02-14

Facility Location

Old Police Dept Building

Damper Location

Labs lobby

Inspector Name

Julie Gue

Damper I.D. #

1FL-FD6

Damper Type

Vertical Fire Damper

Damper Size

19" Round

Damper Manufacturer

Air Balance

Damper Model #

Unknown

Fusible Link Temperature

165 Degrees

Access Door Size

12" Round

Pass / Fail / Abandoned

Pass

Comments / Corrections

None


Picture of Damper in Open Position



Picture of Damper in Closed Position



Picture of Damper I.D. Label

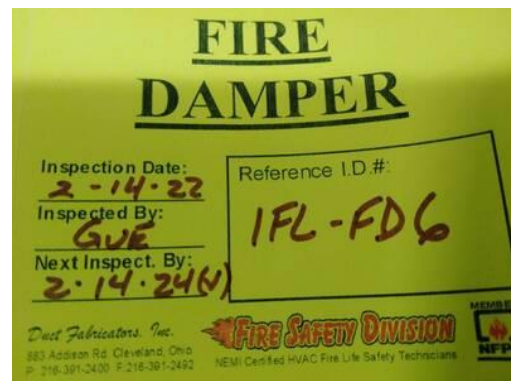

Duct Fabricators, Inc.

883 Addison Rd. Cleveland, Ohio
P: 216-391-2400 F: 216-391-2492

FIRE SAFETY DIVISION

NEMI Certified HVAC Fire Life Safety Technicians



CUYAHOGA COUNTY DAMPER INSPECTION REPORT

Date of Inspection

2022-03-04

Facility Location

Old Police Dept Building

Damper Location

Museum office

Inspector Name

Julie Gue

Damper I.D.

1FL-FD7 m

Damper Type

Vertical Fire Damper

Damper Size

20x8

Damper Manufacturer

Ruskin

Damper Model

IBD60

Fusible Link Temperature

165 Degrees

Access Door Size

16x16

Pass / Fail / Abandoned

Pass

Comments / Corrections

A Carpenter stud screw was found screwed into damper track


Picture of Damper in Open Position



Picture of Damper in Closed Position



Picture of Damper I.D. Label

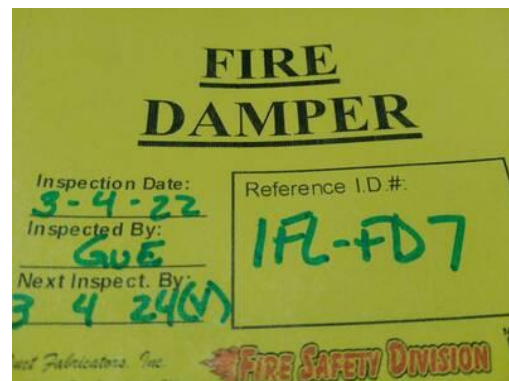

CUYAHOGA COUNTY DAMPER INSPECTION REPORT

Date of Inspection

2022-03-04

Facility Location

Old Police Dept Building

Damper Location

Museum storage

Inspector Name

Julie Gue

Damper I.D. #

1FL-FD9

Damper Type

Vertical Fire Damper

Damper Size

16x12

Damper Manufacturer

Ruskin

Damper Model #

IBD60

Fusible Link Temperature

165 Degrees

Access Door Size

12x12

Pass / Fail / Abandoned

Pass

Comments / Corrections

None

Picture of Damper in Open Position



Picture of Damper in Closed Position



Picture of Damper I.D. Label



CUYAHOGA COUNTY DAMPER INSPECTION REPORT

Date of Inspection

2022-03-04

Facility Location

Old Police Dept Building

Damper Location

Museum office

Inspector Name

Julie Gue

Damper I.D. #

1FL-FD10

Damper Type

Vertical Fire Damper

Damper Size

15" Round

Damper Manufacturer

Air Balance

Damper Model #

Unknown

Fusible Link Temperature

165 Degrees

Access Door Size

12" Round

Pass / Fail / Abandoned

Pass

Comments / Corrections

Changed link


Picture of Damper in Open Position



Picture of Damper in Closed Position



Picture of Damper I.D. Label

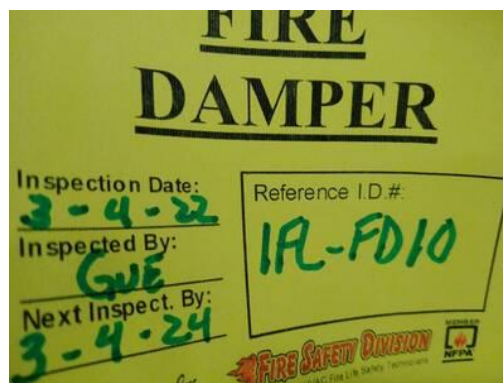

CUYAHOGA COUNTY DAMPER INSPECTION REPORT

Date of Inspection

2022-03-04

Facility Location

Old Police Dept Building

Damper Location

Museum

Inspector Name

Julie Gue

Damper I.D. #

1FL-FD11

Damper Type

Vertical Fire Damper

Damper Size

48x16

Damper Manufacturer

Air Balance

Damper Model #

Unknown

Fusible Link Temperature

165 Degrees

Access Door Size

Grille access

Pass / Fail / Abandoned

Pass

Comments / Corrections

None

Picture of Damper in Open Position



Picture of Damper in Closed Position



Picture of Damper I.D. Label



Duct Fabricators, Inc.

883 Addison Rd. Cleveland, Ohio
P: 216-391-2400 F: 216-391-2492

FIRE SAFETY DIVISION
NEMI Certified HVAC Fire Life Safety Technicians



CUYAHOGA COUNTY DAMPER INSPECTION REPORT

Date of Inspection

2022-03-04

Facility Location

Old Police Dept Building

Damper Location

Museum

Inspector Name

Julie Gue

Damper I.D. #

1FL-FD12

Damper Type

Vertical Fire Damper

Damper Size

36x12

Damper Manufacturer

Ruskin

Damper Model #

IBD20

Fusible Link Temperature

165 Degrees

Access Door Size

Grille access

Pass / Fail / Abandoned

Pass

Comments / Corrections

None


Picture of Damper in Open Position



Picture of Damper in Closed Position



Picture of Damper I.D. Label

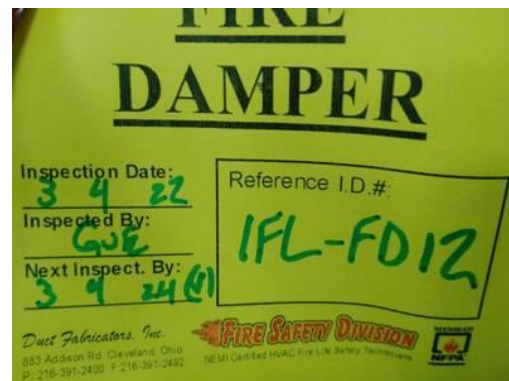

CUYAHOGA COUNTY DAMPER INSPECTION REPORT

Date of Inspection

2022-01-31

Facility Location

Old Police Dept Building

Damper Location

North East corridor

Inspector Name

Julie Gue

Damper I.D.

2FL-FD1 North

Damper Type

Vertical Fire Damper

Damper Size

25x12 oval

Damper Manufacturer

Air Balance

Damper Model

Unknown

Fusible Link Temperature

165 Degrees

Access Door Size

12" Round

Pass / Fail / Abandoned

Pass

Comments / Corrections

None

Picture of Damper in Open Position



Picture of Damper in Closed Position



Picture of Damper I.D. Label

FIRE DAMPER	
Inspection Date: 1 31 22	Reference I.D.#: 2FL-FD1
Inspected By: GUE	
Next Inspect. By: 1 31 24	NORTH

Duct Fabricators, Inc.
883 Addison Rd. Cleveland, Ohio
P: 216-391-2400 F: 216-391-2492

FIRE SAFETY DIVISION
NEMI Certified HVAC Fire Life Safety Technicians

CUYAHOGA COUNTY DAMPER INSPECTION REPORT

Date of Inspection

2022-01-28

Facility Location

Old Police Dept Building

Damper Location

RM 206

Inspector Name

Julie Gue

Damper I.D.

2FL-FD1 South

Damper Type

Vertical Fire Damper

Damper Size

18x12

Damper Manufacturer

Air Balance

Damper Model

Unknown

Fusible Link Temperature

165 Degrees

Access Door Size

12x12

Pass / Fail / Abandoned

Pass

Comments / Corrections

None

Picture of Damper in Open Position



Picture of Damper in Closed Position



Picture of Damper I.D. Label



CUYAHOGA COUNTY DAMPER INSPECTION REPORT

Date of Inspection

2022-01-31

Facility Location

Old Police Dept Building

Damper Location

NE corridor

Inspector Name

Julie Gue

Damper I.D. #

2FL-FD2 North

Damper Type

Vertical Fire Damper

Damper Size

50x14

Damper Manufacturer

Air Balance

Damper Model #

Unknown

Fusible Link Temperature

165 Degrees

Access Door Size

14x14

Pass / Fail / Abandoned

Pass

Comments / Corrections

None

Picture of Damper in Open Position



Picture of Damper in Closed Position



Picture of Damper I.D. Label

FIRE DAMPER	
Inspection Date: 1-31-22	Reference I.D.#: 2FL-FD2
Inspected By: GUE	North
Next Inspect. By: 1-31-24	

Duct Fabricators, Inc.
883 Addison Rd. Cleveland, Ohio
P: 216-391-2400 F: 216-391-2492

FIRE SAFETY DIVISION
NEMI Certified HVAC Fire Life Safety Technicians

MEMBER
NFPA

Duct Fabricators, Inc.

883 Addison Rd. Cleveland, Ohio
P: 216-391-2400 F: 216-391-2492

FIRE SAFETY DIVISION

NEMI Certified HVAC Fire Life Safety Technicians



CUYAHOGA COUNTY DAMPER INSPECTION REPORT

Date of Inspection

2022-01-28

Facility Location

Old Police Dept Building

Damper Location

SE Corner of hallway

Inspector Name

Julie Gue

Damper I.D. #

2FL-FD2 South

Damper Type

Vertical Fire Damper

Damper Size

18x12

Damper Manufacturer

Air Balance

Damper Model #

Unknown

Fusible Link Temperature

165 Degrees

Access Door Size

14x14

Pass / Fail / Abandoned

Pass

Comments / Corrections

None


Picture of Damper in Open Position



Picture of Damper in Closed Position



Picture of Damper I.D. Label

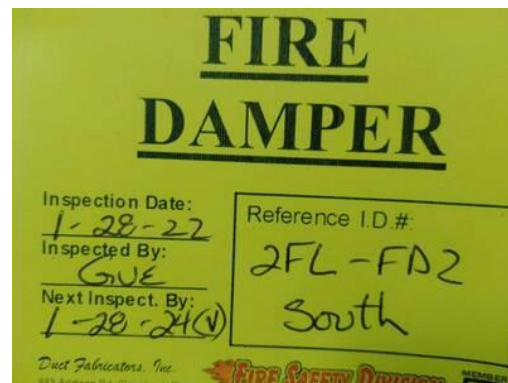

CUYAHOGA COUNTY DAMPER INSPECTION REPORT

Date of Inspection
2022-01-31

Facility Location
Old Police Dept Building

Damper Location
NW corridor

Inspector Name
Julie Gue

Damper I.D. #
2FL-FD3 North

Damper Type
Vertical Fire Damper

Damper Size
6" Round

Damper Manufacturer
Air Balance

Damper Model #
Unknown

Fusible Link Temperature
165 Degrees

Access Door Size
7x4

Pass / Fail / Abandoned
Pass

Comments / Corrections
Changed link

Picture of Damper in Open Position



Picture of Damper in Closed Position



Picture of Damper I.D. Label

FIRE DAMPER	
Inspection Date: 1-31-22	Reference I.D.# 2FL-FD3
Inspected By: GUE	NORTH
Next Inspect. By: 1-31-24(M)	

Duct Fabricators, Inc.
883 Addison Rd. Cleveland, Ohio
P: 216-391-2400 F: 216-391-2492

FIRE SAFETY DIVISION
NEMI Certified HVAC Fire Life Safety Technicians

MEMBER
NFPA

CUYAHOGA COUNTY DAMPER INSPECTION REPORT

Date of Inspection

2022-01-28

Facility Location

Old Police Dept Building

Damper Location

RM 222

Inspector Name

Julie Gue

Damper I.D. #

2FL-FD3 South

Damper Type

Vertical Fire Damper

Damper Size

28x11 oval

Damper Manufacturer

Air Balance

Damper Model #

Unknown

Fusible Link Temperature

165 Degrees

Access Door Size

12" Round

Pass / Fail / Abandoned

Pass

Comments / Corrections

None

Picture of Damper in Open Position



Picture of Damper in Closed Position



Picture of Damper I.D. Label

FIRE DAMPER

Inspection Date: 1-28-22	Reference I.D.#: 2FL-FD3 South
Inspected By: JUE	
Next Inspect. By: 1-28-24(N)	

Duct Fabricators, Inc. **FIRE SAFETY DIVISION** MEMBER **NFPA**

CUYAHOGA COUNTY DAMPER INSPECTION REPORT

Date of Inspection

2022-01-31

Facility Location

Old Police Dept Building

Damper Location

Women's toilet

Inspector Name

Julie Gue

Damper I.D. #

2FL-FD4 North

Damper Type

Vertical Fire Damper

Damper Size

10" Round

Damper Manufacturer

Ruskin

Damper Model #

IBD60

Fusible Link Temperature

165 Degrees

Access Door Size

9x5 oval

Pass / Fail / Abandoned

Pass

Comments / Corrections

None

Picture of Damper in Open Position



Picture of Damper in Closed Position



Picture of Damper I.D. Label

FIRE DAMPER

Inspection Date: 1/31/22	Reference I.D.#: 2FL-FD4
Inspected By: GUE	North
Next Inspect. By: 1/31/24(N)	

Duct Fabricators, Inc.
883 Addison Rd. Cleveland, Ohio
P: 216-391-2400 F: 216-391-2492

FIRE SAFETY DIVISION
NEMI Certified HVAC Fire Life Safety Technicians

MEMBER
NFPA

CUYAHOGA COUNTY DAMPER INSPECTION REPORT

Date of Inspection

2022-01-31

Facility Location

Old Police Dept Building

Damper Location

Southeast corridor

Inspector Name

Julie Gue

Damper I.D. #

2FL-FD4 South

Damper Type

Vertical Fire Damper

Damper Size

28x12 oval

Damper Manufacturer

Air Balance

Damper Model #

Unknown

Fusible Link Temperature

165 Degrees

Access Door Size

16x16

Pass / Fail / Abandoned

Pass

Comments / Corrections

None

Picture of Damper in Open Position



Picture of Damper in Closed Position



Picture of Damper I.D. Label



CUYAHOGA COUNTY DAMPER INSPECTION REPORT

Date of Inspection

2022-01-31

Facility Location

Old Police Dept Building

Damper Location

Women's toilet

Inspector Name

Julie Gue

Damper I.D. #

2FL-FD5 North

Damper Type

Vertical Fire Damper

Damper Size

12x8

Damper Manufacturer

Air Balance

Damper Model #

Unknown

Fusible Link Temperature

165 Degrees

Access Door Size

12x12

Pass / Fail / Abandoned

Pass

Comments / Corrections

None


Picture of Damper in Open Position



Picture of Damper in Closed Position



Picture of Damper I.D. Label

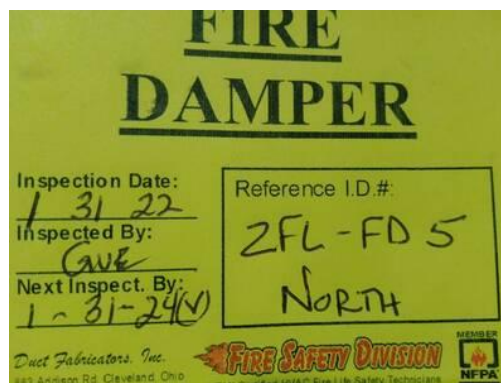

CUYAHOGA COUNTY DAMPER INSPECTION REPORT

Date of Inspection

2022-01-28

Facility Location

Old Police Dept Building

Damper Location

Waiting room

Inspector Name

Julie Gue

Damper I.D. #

2FL-FD5 South

Damper Type

Vertical Fire Damper

Damper Size

28x12

Damper Manufacturer

Air Balance

Damper Model #

Unknown

Fusible Link Temperature

165 Degrees

Access Door Size

12" Round

Pass / Fail / Abandoned

Pass

Comments / Corrections

None

Picture of Damper in Open Position



Picture of Damper in Closed Position



Picture of Damper I.D. Label

FIRE DAMPER	
Inspection Date: 1-28-22	Reference I.D.#: 2FL-FD5
Inspected By: Gue	South
Next Inspect. By: 1-28-24	

Duct Fabricators, Inc.
Addison Rd. Cleveland, Ohio

FIRE SAFETY DIVISION
NEMI Certified HVAC Fire Life Safety Technicians

CUYAHOGA COUNTY DAMPER INSPECTION REPORT

Date of Inspection

2022-01-31

Facility Location

Old Police Dept Building

Damper Location

Women's toilet

Inspector Name

Julie Gue

Damper I.D. #

2FL-FD6 North

Damper Type

Vertical Fire Damper

Damper Size

16x12

Damper Manufacturer

Air Balance

Damper Model #

Unknown

Fusible Link Temperature

165 Degrees

Access Door Size

12x12

Pass / Fail / Abandoned

Pass

Comments / Corrections

None


Picture of Damper in Open Position



Picture of Damper in Closed Position



Picture of Damper I.D. Label

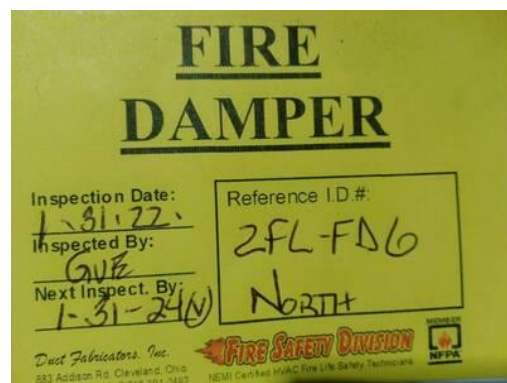

Duct Fabricators, Inc.

883 Addison Rd. Cleveland, Ohio
P: 216-391-2400 F: 216-391-2492



NEMI Certified HVAC Fire Life Safety Technicians



CUYAHOGA COUNTY DAMPER INSPECTION REPORT

Date of Inspection

2022-01-28

Facility Location

Old Police Dept Building

Damper Location

East elevator lobby

Inspector Name

Julie Gue

Damper I.D.

2FL-FD6 South

Damper Type

Vertical Fire Damper

Damper Size

60x6

Damper Manufacturer

Air Balance

Damper Model

Unknown

Fusible Link Temperature

165 Degrees

Access Door Size

16x16

Pass / Fail / Abandoned

Pass

Comments / Corrections

None

Picture of Damper in Open Position



Picture of Damper in Closed Position



Picture of Damper I.D. Label

FIRE DAMPER	
Inspection Date: 1-28-22	Reference I.D.#: 2FL-FD6
Inspected By: GUE	South
Next Inspect. By: 1-28-24(G)	

Duct Fabricators, Inc.
883 Addison Rd. Cleveland, Ohio
P: 216-391-2400 F: 216-391-2492

FIRE SAFETY DIVISION
NEMI Certified HVAC Fire Life Safety Technicians

CUYAHOGA COUNTY DAMPER INSPECTION REPORT

Date of Inspection

2022-01-31

Facility Location

Old Police Dept Building

Damper Location

NW corridor

Inspector Name

Julie Gue

Damper I.D. #

2FL-FD7 North

Damper Type

Vertical Fire Damper

Damper Size

25x12 Oval

Damper Manufacturer

Air Balance

Damper Model #

Unknown

Fusible Link Temperature

165 Degrees

Access Door Size

11x6

Pass / Fail / Abandoned

Pass

Comments / Corrections

None

Picture of Damper in Open Position



Picture of Damper in Closed Position



Picture of Damper I.D. Label

FIRE
DAMPER

Inspection Date: 1-31-22	Reference I.D.# 2FL-FD7
Inspected By: GUE	NORTH
Next Inspect. By: 1-31-24(y)	

Duct Fabricators, Inc.
883 Addison Rd. Cleveland, Ohio
P: 216-391-2400 F: 216-391-2492

FIRE SAFETY DIVISION
NEMI Certified HVAC Fire Life Safety Technicians

MEMBER
NFPA

CUYAHOGA COUNTY DAMPER INSPECTION REPORT

Date of Inspection

2022-01-31

Facility Location

Old Police Dept Building

Damper Location

NW corridor

Inspector Name

Julie Gue

Damper I.D. #

2FL-FD7 South

Damper Type

Vertical Fire Damper

Damper Size

25x12 Oval

Damper Manufacturer

Air Balance

Damper Model #

Unknown

Fusible Link Temperature

165 Degrees

Access Door Size

11x6

Pass / Fail / Abandoned

Pass

Comments / Corrections

Label Mismarked North

Picture of Damper in Open Position



Picture of Damper in Closed Position



Picture of Damper I.D. Label

FIRE DAMPER	
Inspection Date: 1-31-22	Reference I.D.# 2FL-FD7
Inspected By: GUE	NORTH
Next Inspect. By: 1-31-24(y)	

Duct Fabricators, Inc.
883 Addison Rd. Cleveland, Ohio
P: 216-391-2400 F: 216-391-2492

FIRE SAFETY DIVISION
NEMI Certified HVAC Fire Life Safety Technicians

MEMBER
NFPA

CUYAHOGA COUNTY DAMPER INSPECTION REPORT

Date of Inspection
2022-01-31

Facility Location
Old Police Dept Building

Damper Location
Room 254

Inspector Name
Julie Gue

Damper I.D. #
2FL-FD8 North

Damper Type
Vertical Fire Damper

Damper Size
8" Round

Damper Manufacturer
Air Balance

Damper Model #
Unknown

Fusible Link Temperature
165 Degrees

Access Door Size
6" Round

Pass / Fail / Abandoned
Pass

Comments / Corrections
Changed link

Picture of Damper in Open Position



Picture of Damper in Closed Position



Picture of Damper I.D. Label

FIRE DAMPER	
Inspection Date: 1 31 22	Reference I.D.# 2FL-FD8
Inspected By: GUE	
Next Inspect. By: 1 31 24(V)	NORTH

Duct Fabricators, Inc. **FIRE SAFETY DIVISION**

Duct Fabricators, Inc.

883 Addison Rd. Cleveland, Ohio
P: 216-391-2400 F: 216-391-2492



NEMI Certified HVAC Fire Life Safety Technicians



CUYAHOGA COUNTY DAMPER INSPECTION REPORT

Date of Inspection

2022-01-31

Facility Location

Old Police Dept Building

Damper Location

South hallway

Inspector Name

Julie Gue

Damper I.D. #

2FL-FD8 South

Damper Type

Vertical Fire Damper

Damper Size

36x12

Damper Manufacturer

Air Balance

Damper Model #

Unknown

Fusible Link Temperature

165 Degrees

Access Door Size

12x12

Pass / Fail / Abandoned

Pass

Comments / Corrections

None


Picture of Damper in Open Position



Picture of Damper in Closed Position



Picture of Damper I.D. Label

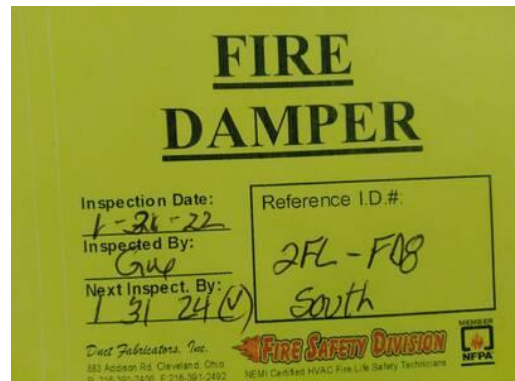

CUYAHOGA COUNTY DAMPER INSPECTION REPORT

Date of Inspection
2022-01-31

Facility Location
Old Police Dept Building

Damper Location
Room 253

Inspector Name
Julie Gue

Damper I.D. #
2FL-FD9 North

Damper Type
Vertical Fire Damper

Damper Size
10" Round

Damper Manufacturer
Ruskin

Damper Model #
IBD60

Fusible Link Temperature
165 Degrees

Access Door Size
9x5 Oval


Pass / Fail / Abandoned
Pass

Comments / Corrections
None

Picture of Damper in Open Position



Picture of Damper in Closed Position

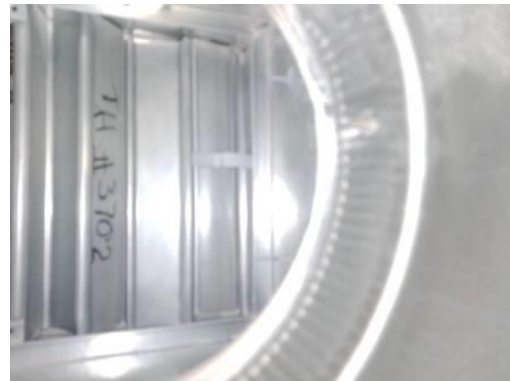

Picture of Damper I.D. Label

FIRE
DAMPER

Inspection Date: 1-31-22	Reference I.D. #: 2FL-FD9
Inspected By: Gue	NORTH
Next Inspect. By: 1-31-24(Y)	

Duct Fabricators, Inc. 883 Addison Rd. Cleveland, Ohio P: 216-391-2400 F: 216-391-2492

FIRE SAFETY DIVISION
NEMI Certified HVAC Fire Life Safety Technicians

MEMBER
NFPA

Duct Fabricators, Inc.

883 Addison Rd. Cleveland, Ohio
P: 216-391-2400 F:216-391-2492



NEMI Certified HVAC Fire Life Safety Technicians

MEMBER



CUYAHOGA COUNTY DAMPER INSPECTION REPORT

Date of Inspection

2022-01-31

Facility Location

Old Police Dept Building

Damper Location

Room 249

Inspector Name

Julie Gue

Damper I.D.

2FL-FD10 North

Damper Type

Vertical Fire Damper

Damper Size

21x12 Oval

Damper Manufacturer

Air Balance

Damper Model

Unknown

Fusible Link Temperature

165 Degrees

Access Door Size

6" Round


Pass / Fail / Abandoned

Pass

Comments / Corrections

None

Picture of Damper in Open Position

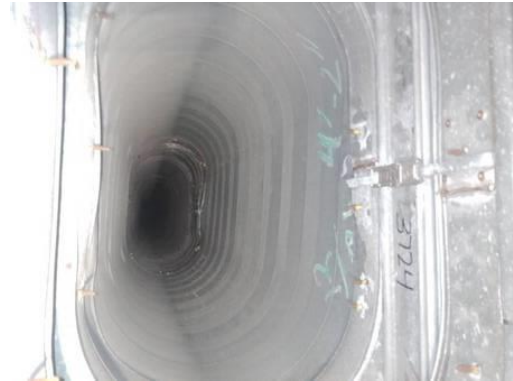

Picture of Damper in Closed Position



Picture of Damper I.D. Label

FIRE DAMPER	
Inspection Date: 1-31-22	Reference I.D.# 2FL-FD10
Inspected By: Gue	North
Next Inspect. By: 1-31-24(C)	
Duct Fabricators, Inc. 883 Addison Rd. Cleveland, Ohio P. 216-391-2400 F.216-391-2492	
FIRE SAFETY DIVISION NEMI Certified HVAC Fire Life Safety Technicians	

CUYAHOGA COUNTY DAMPER INSPECTION REPORT

Date of Inspection

2022-02-09

Facility Location

Old Police Dept Building

Damper Location

South corridor

Inspector Name

Julie Gue

Damper I.D. #

2FL-FD10 South

Damper Type

Vertical Fire Damper

Damper Size

48x24

Damper Manufacturer

Air Balance

Damper Model #

Unknown

Fusible Link Temperature

165 Degrees

Access Door Size

Grille access

Pass / Fail / Abandoned

Pass

Comments / Corrections

Carpenter removed trim
Very dirty


Picture of Damper in Open Position



Picture of Damper in Closed Position



Picture of Damper I.D. Label

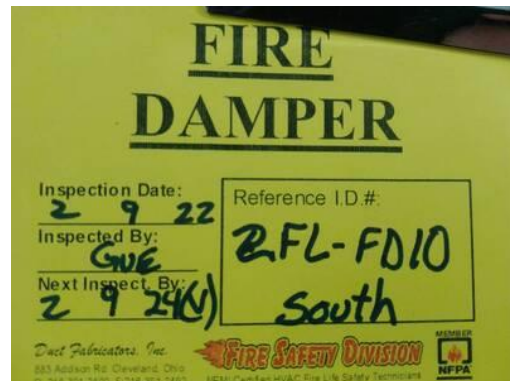

Duct Fabricators, Inc.

883 Addison Rd. Cleveland, Ohio
P: 216-391-2400 F: 216-391-2492



NEMI Certified HVAC Fire Life Safety Technicians



CUYAHOGA COUNTY DAMPER INSPECTION REPORT

Date of Inspection

2022-02-01

Facility Location

Old Police Dept Building

Damper Location

NE closet

Inspector Name

Julie Gue

Damper I.D.

2FL-FD11 North

Damper Type

Vertical Fire Damper

Damper Size

18x12 oval

Damper Manufacturer

Air Balance

Damper Model

Unknown

Fusible Link Temperature

165 Degrees

Access Door Size

6" Round

Pass / Fail / Abandoned

Pass

Comments / Corrections

Changed link


Picture of Damper in Open Position



Picture of Damper in Closed Position



Picture of Damper I.D. Label

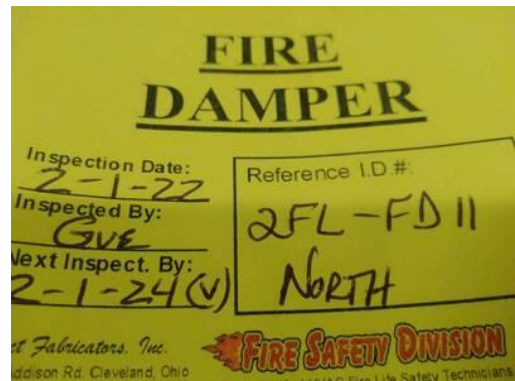

Duct Fabricators, Inc.

883 Addison Rd. Cleveland, Ohio
P: 216-391-2400 F: 216-391-2492



NEMI Certified HVAC Fire Life Safety Technicians



CUYAHOGA COUNTY DAMPER INSPECTION REPORT

Date of Inspection

2022-01-31

Facility Location

Old Police Dept Building

Damper Location

Room 230

Inspector Name

Julie Gue

Damper I.D. #

2FL-FD12 North

Damper Type

Vertical Fire Damper

Damper Size

64x14

Damper Manufacturer

Air Balance

Damper Model #

Unknown

Fusible Link Temperature

165 Degrees

Access Door Size

Open duct

Pass / Fail / Abandoned

Pass

Comments / Corrections

None


Picture of Damper in Open Position



Picture of Damper in Closed Position



Picture of Damper I.D. Label

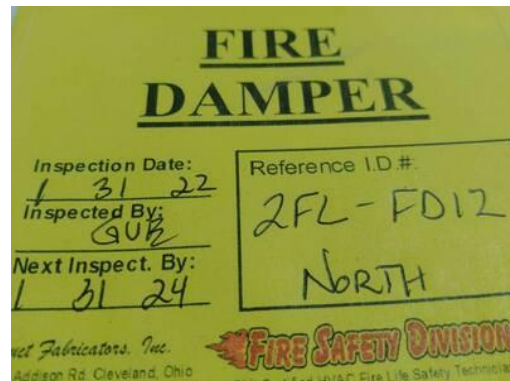

CUYAHOGA COUNTY DAMPER INSPECTION REPORT

Date of Inspection

2022-01-31

Facility Location

Old Police Dept Building

Damper Location

Room 228

Inspector Name

Julie Gue

Damper I.D. #

2FL-FD13 North

Damper Type

Vertical Fire Damper

Damper Size

50x14

Damper Manufacturer

Air Balance

Damper Model #

Unknown

Fusible Link Temperature

165 Degrees

Access Door Size

12x12

Pass / Fail / Abandoned

Pass

Comments / Corrections

None


Picture of Damper in Open Position



Picture of Damper in Closed Position



Picture of Damper I.D. Label

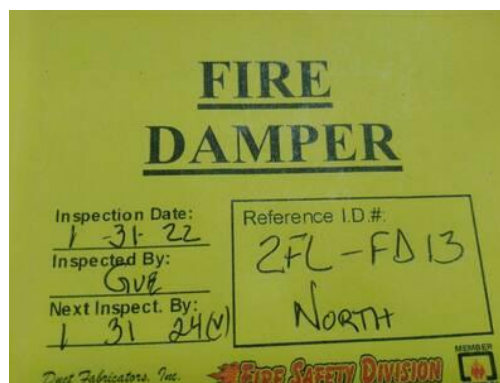

CUYAHOGA COUNTY DAMPER INSPECTION REPORT

Date of Inspection

2022-02-01

Facility Location

Old Police Dept Building

Damper Location

Room 227

Inspector Name

Julie Gue

Damper I.D. #

2FL-FD14 North

Damper Type

Vertical Fire Damper

Damper Size

60x6

Damper Manufacturer

Air Balance

Damper Model #

Unknown

Fusible Link Temperature

165 Degrees

Access Door Size

11x11

Pass / Fail / Abandoned

Pass

Comments / Corrections

None

Picture of Damper in Open Position



Picture of Damper in Closed Position



Picture of Damper I.D. Label



CUYAHOGA COUNTY DAMPER INSPECTION REPORT

Date of Inspection

2022-02-01

Facility Location

Old Police Dept Building

Damper Location

RM 225

Inspector Name

Julie Gue

Damper I.D. #

2FL-FD15 North

Damper Type

Vertical Fire Damper

Damper Size

16x10 oval

Damper Manufacturer

Air Balance

Damper Model #

Unknown

Fusible Link Temperature

165 Degrees

Access Door Size

12" Round

Pass / Fail / Abandoned

Pass

Comments / Corrections

Changed link


Picture of Damper in Open Position



Picture of Damper in Closed Position



Picture of Damper I.D. Label

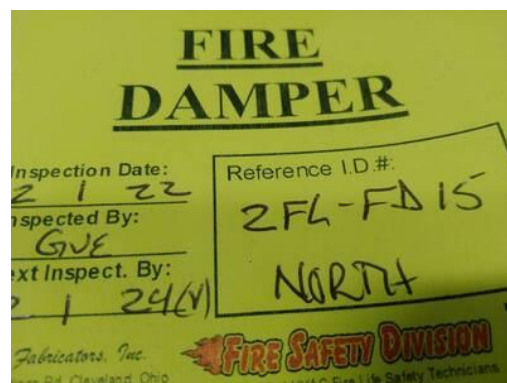

Duct Fabricators, Inc.

883 Addison Rd. Cleveland, Ohio
P: 216-391-2400 F: 216-391-2492



NEMI Certified HVAC Fire Life Safety Technicians



CUYAHOGA COUNTY DAMPER INSPECTION REPORT

Date of Inspection

2022-02-07

Facility Location

Old Police Dept Building

Damper Location

West waiting room

Inspector Name

Julie Gue

Damper I.D. #

4 FL-FD14 North

Damper Type

Vertical Fire Damper

Damper Size

56x14

Damper Manufacturer

Air Balance

Damper Model #

Unknown

Fusible Link Temperature

165 Degrees

Access Door Size

Screen

Pass / Fail / Abandoned

Pass

Comments / Corrections

None


Picture of Damper in Open Position



Picture of Damper in Closed Position



Picture of Damper I.D. Label

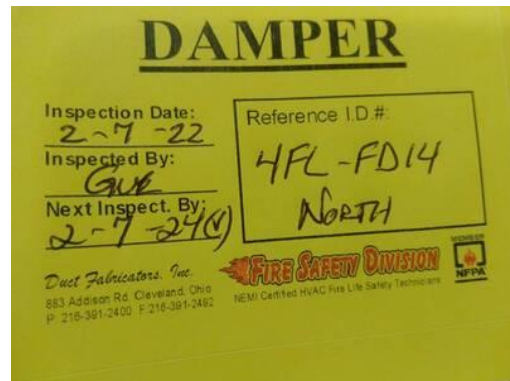

CUYAHOGA COUNTY DAMPER INSPECTION REPORT

Date of Inspection

2022-02-01

Facility Location

Old Police Dept Building

Damper Location

West corridor

Inspector Name

Julie Gue

Damper I.D.

4FL-FD1 North

Damper Type

Vertical Fire Damper

Damper Size

36x12

Damper Manufacturer

Air Balance

Damper Model

Unknown

Fusible Link Temperature

165 Degrees

Access Door Size

12x12

Pass / Fail / Abandoned

Pass

Comments / Corrections

None


Picture of Damper in Open Position



Picture of Damper in Closed Position



Picture of Damper I.D. Label

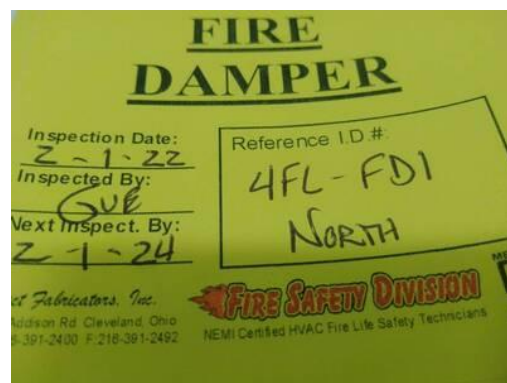

CUYAHOGA COUNTY DAMPER INSPECTION REPORT

Date of Inspection

2022-02-01

Facility Location

Old Police Dept Building

Damper Location

SE corridor

Inspector Name

Julie Gue

Damper I.D. #

4FL-FD1 South

Damper Type

Vertical Fire Damper

Damper Size

16x10 oval

Damper Manufacturer

Ruskin

Damper Model #

IBD60

Fusible Link Temperature

165 Degrees

Access Door Size

8x8

Pass / Fail / Abandoned

Pass

Comments / Corrections

None


Picture of Damper in Open Position



Picture of Damper in Closed Position



Picture of Damper I.D. Label

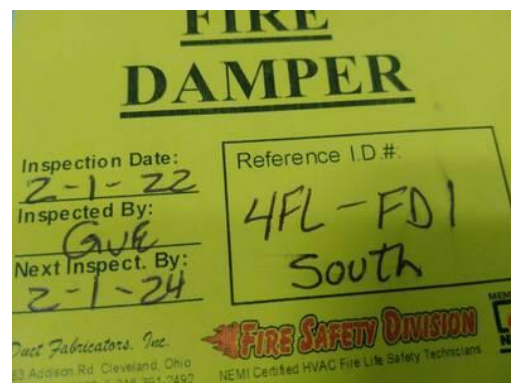

CUYAHOGA COUNTY DAMPER INSPECTION REPORT

Date of Inspection

2022-02-01

Facility Location

Old Police Dept Building

Damper Location

West corridor

Inspector Name

Julie Gue

Damper I.D.

4FL-FD2 North

Damper Type

Vertical Fire Damper

Damper Size

28x12

Damper Manufacturer

Air Balance

Damper Model

Unknown

Fusible Link Temperature

165 Degrees

Access Door Size

11" Round

Pass / Fail / Abandoned

Pass

Comments / Corrections

Changed link

Picture of Damper in Open Position



Picture of Damper in Closed Position



Picture of Damper I.D. Label

FIRE DAMPER	
Inspection Date: 2-1-22	Reference I.D. # 4FL-FD2
Inspected By: GUE	NORTH
Next Inspect. By: 2-1-24(N)	

Duct Fabricators, Inc.
883 Addison Rd. Cleveland, Ohio
P: 216-391-2400 F: 216-391-2492

FIRE SAFETY DIVISION
NEMI Certified HVAC Fire Life Safety Technicians

CUYAHOGA COUNTY DAMPER INSPECTION REPORT

Date of Inspection

2022-02-01

Facility Location

Old Police Dept Building

Damper Location

SE corridor

Inspector Name

Julie Gue

Damper I.D. #

4FL-FD2 South

Damper Type

Vertical Fire Damper

Damper Size

28x12 oval

Damper Manufacturer

Air Balance

Damper Model #

Unknown

Fusible Link Temperature

165 Degrees

Access Door Size

12" Round


Pass / Fail / Abandoned

Pass

Comments / Corrections

None


Picture of Damper in Open Position

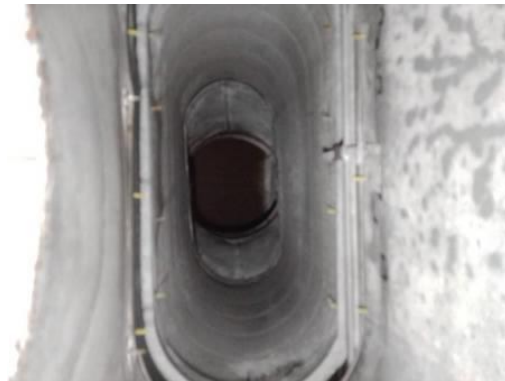

Picture of Damper in Closed Position



Picture of Damper I.D. Label

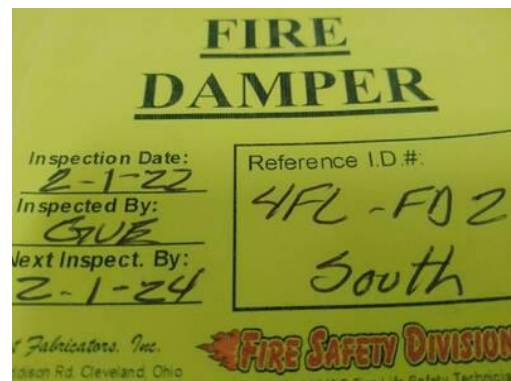

CUYAHOGA COUNTY DAMPER INSPECTION REPORT

Date of Inspection
2022-02-02

Facility Location
Old Police Dept Building

Damper Location
NW corridor

Inspector Name
Julie Gue

Damper I.D. #
4FL-FD3 North

Damper Type
Vertical Fire Damper

Damper Size
24x18

Damper Manufacturer
Ruskin

Damper Model #
IBD60


Fusible Link Temperature
165 Degrees

Access Door Size
14x14

Pass / Fail / Abandoned
Pass

Comments / Corrections
None


Picture of Damper in Open Position

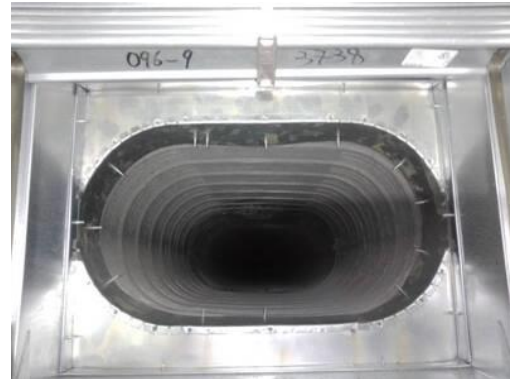

Picture of Damper in Closed Position



Picture of Damper I.D. Label

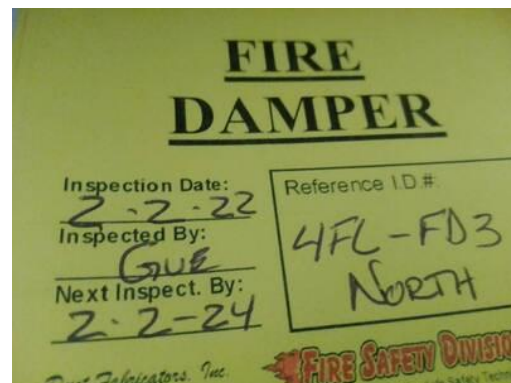

CUYAHOGA COUNTY DAMPER INSPECTION REPORT

Date of Inspection

2022-02-01

Facility Location

Old Police Dept Building

Damper Location

SE corridor

Inspector Name

Julie Gue

Damper I.D. #

4FL-FD3 South

Damper Type

Vertical Fire Damper

Damper Size

24x18

Damper Manufacturer

Ruskin

Damper Model #

IBD60

Fusible Link Temperature

165 Degrees

Access Door Size

14x14


Pass / Fail / Abandoned

Pass

Comments / Corrections

None

Picture of Damper in Open Position

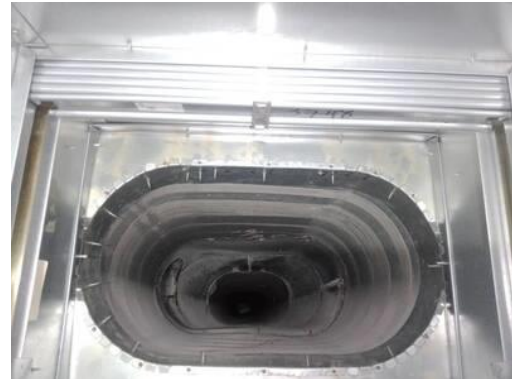

Picture of Damper in Closed Position



Picture of Damper I.D. Label

FIRE DAMPER	
Inspection Date: 2-1-22	Reference I.D. #: 4FL-FD3
Inspected By: GUE	South
Next Inspect. By: 2-1-24(G)	

Duct Fabricators, Inc.
883 Addison Rd. Cleveland, Ohio
216-391-2400 F: 216-391-2492

FIRE SAFETY DIVISION
NEMI Certified HVAC Fire Life Safety Technicians

CUYAHOGA COUNTY DAMPER INSPECTION REPORT

Date of Inspection

2022-02-02

Facility Location

Old Police Dept Building

Damper Location

Women's toilet

Inspector Name

Julie Gue

Damper I.D. #

4FL-FD4 North

Damper Type

Vertical Fire Damper

Damper Size

12x8

Damper Manufacturer

Air Balance

Damper Model #

Unknown

Fusible Link Temperature

165 Degrees

Access Door Size

7x5

Pass / Fail / Abandoned

Pass

Comments / Corrections

None

Picture of Damper in Open Position



Picture of Damper in Closed Position



Picture of Damper I.D. Label

FIRE DAMPER

Inspection Date: 2-2-22	Reference I.D.#: 4FL-FD4
Inspected By: GUE	NORTH
Next Inspect. By: 2-2-24	

Duct Fabricators, Inc.
883 Addison Rd. Cleveland, Ohio
P: 216-391-2400 F: 216-391-2492

FIRE SAFETY DIVISION
NEMI Certified HVAC Fire Life Safety Technicians

MEMBER
NFPA

CUYAHOGA COUNTY DAMPER INSPECTION REPORT

Date of Inspection

2022-02-01

Facility Location

Old Police Dept Building

Damper Location

SE Infront of stairwell A

Inspector Name

Julie Gue

Damper I.D. #

4FL-FD4 South

Damper Type

Vertical Fire Damper

Damper Size

18x12

Damper Manufacturer

Air Balance

Damper Model #

Unknown

Fusible Link Temperature

165 Degrees

Access Door Size

12x12

Pass / Fail / Abandoned

Pass

Comments / Corrections

None

Picture of Damper in Open Position



Picture of Damper in Closed Position



Picture of Damper I.D. Label

FIRE DAMPER	
Inspection Date: 2-1-22	Reference I.D.#: 4FL-FD4
Inspected By: Gue	South
Next Inspect. By: 2-1-24(N)	

Duct Fabricators, Inc. 883 Addison Rd. Cleveland, Ohio
NEMI Certified HVAC Fire Life Safety Technicians

CUYAHOGA COUNTY DAMPER INSPECTION REPORT

Date of Inspection

2022-02-02

Facility Location

Old Police Dept Building

Damper Location

Women's toilet

Inspector Name

Julie Gue

Damper I.D. #

4FL-FD5 North

Damper Type

Vertical Fire Damper

Damper Size

22x10

Damper Manufacturer

Air Balance

Damper Model #

Unknown

Fusible Link Temperature

165 Degrees

Access Door Size

11x9

Pass / Fail / Abandoned

Pass

Comments / Corrections

None


Picture of Damper in Open Position



Picture of Damper in Closed Position



Picture of Damper I.D. Label

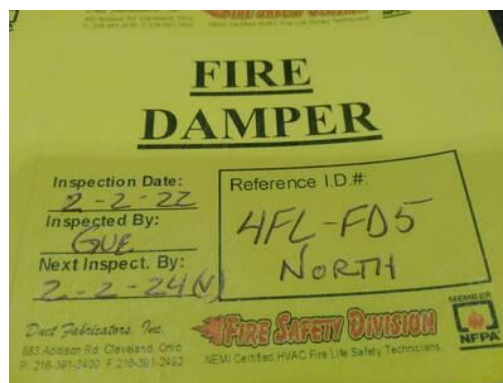

CUYAHOGA COUNTY DAMPER INSPECTION REPORT

Date of Inspection

2022-02-01

Facility Location

Old Police Dept Building

Damper Location

South corridor

Inspector Name

Julie Gue

Damper I.D. #

4FL-FD5 South

Damper Type

Vertical Fire Damper

Damper Size

50x10

Damper Manufacturer

Air Balance

Damper Model #

Unknown

Fusible Link Temperature

165 Degrees

Access Door Size

10x9

Pass / Fail / Abandoned

Pass

Comments / Corrections

None


Picture of Damper in Open Position



Picture of Damper in Closed Position



Picture of Damper I.D. Label

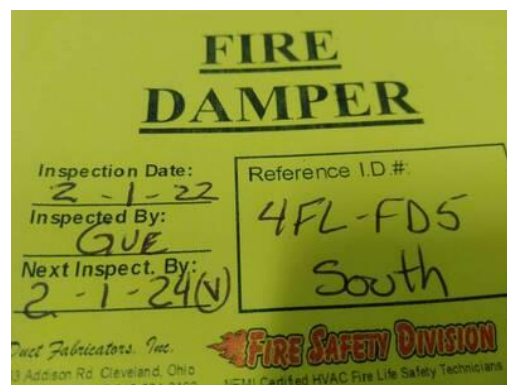

CUYAHOGA COUNTY DAMPER INSPECTION REPORT

Date of Inspection
2022-02-02

Facility Location
Old Police Dept Building

Damper Location
Women's toilet

Inspector Name
Julie Gue

Damper I.D. #
4FL-FD6 North

Damper Type
Vertical Fire Damper

Damper Size
6" Round

Damper Manufacturer
Air Balance

Damper Model #
Unknown

Fusible Link Temperature
165 Degrees

Access Door Size
7x5

Pass / Fail / Abandoned
Pass

Comments / Corrections
None

Picture of Damper in Open Position



Picture of Damper in Closed Position



Picture of Damper I.D. Label

<u>FIRE</u>	
<u>DAMPER</u>	
Inspection Date: 2-2-22	Reference I.D.# 4FL-FD6
Inspected By: GJZ	NORTH
Next Inspect. By: 2-2-24	

Duct Fabricators, Inc. **FIRE SAFETY DIVISION** MEMBER **NFPA**

CUYAHOGA COUNTY DAMPER INSPECTION REPORT

Date of Inspection

2022-02-01

Facility Location

Old Police Dept Building

Damper Location

SW corridor

Inspector Name

Julie Gue

Damper I.D. #

4FL-FD6 South

Damper Type

Vertical Fire Damper

Damper Size

16x10

Damper Manufacturer

Air Balance

Damper Model #

Unknown

Fusible Link Temperature

165 Degrees

Access Door Size

6" Round

Pass / Fail / Abandoned

Pass


Comments / Corrections

None


Picture of Damper in Open Position



Picture of Damper in Closed Position

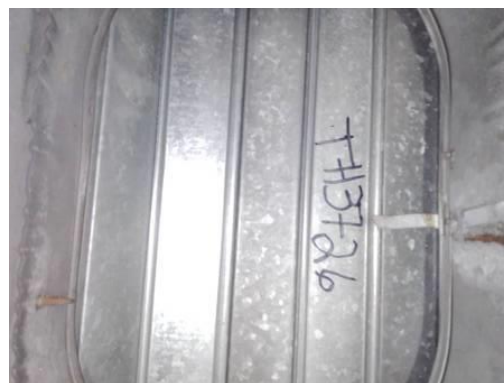

Picture of Damper I.D. Label

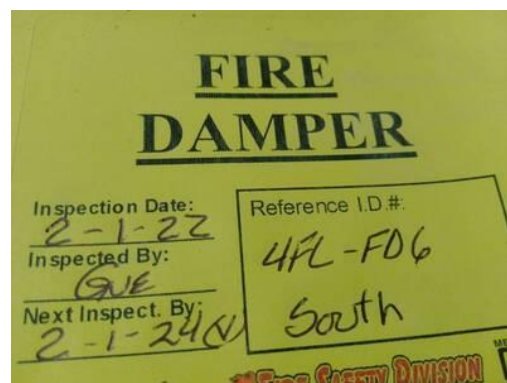

CUYAHOGA COUNTY DAMPER INSPECTION REPORT

Date of Inspection

2022-02-02

Facility Location

Old Police Dept Building

Damper Location

NE corridor

Inspector Name

Julie Gue

Damper I.D. #

4FL-FD7 North

Damper Type

Vertical Fire Damper

Damper Size

14x6

Damper Manufacturer

Air Balance

Damper Model #

Unknown

Fusible Link Temperature

165 Degrees

Access Door Size

7x4

Pass / Fail / Abandoned

Pass

Comments / Corrections

None


Picture of Damper in Open Position



Picture of Damper in Closed Position



Picture of Damper I.D. Label

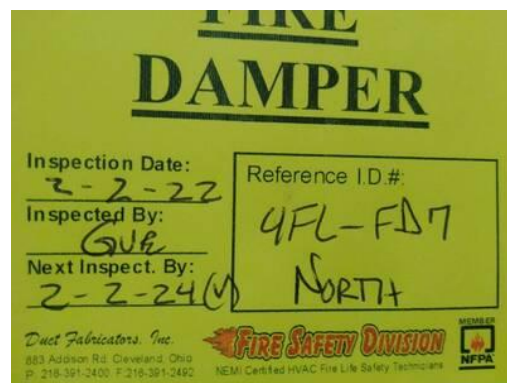

CUYAHOGA COUNTY DAMPER INSPECTION REPORT

Date of Inspection

2022-02-01

Facility Location

Old Police Dept Building

Damper Location

SW corridor

Inspector Name

Julie Gue

Damper I.D. #

4FL-FD7 South

Damper Type

Vertical Fire Damper

Damper Size

30x14

Damper Manufacturer

Air Balance

Damper Model #

Unknown

Fusible Link Temperature

165 Degrees

Access Door Size

16x16

Pass / Fail / Abandoned

Pass

Comments / Corrections

None

Picture of Damper in Open Position



Picture of Damper in Closed Position



Picture of Damper I.D. Label



Duct Fabricators, Inc.

883 Addison Rd. Cleveland, Ohio
P: 216-391-2400 F: 216-391-2492



NEMI Certified HVAC Fire Life Safety Technicians



CUYAHOGA COUNTY DAMPER INSPECTION REPORT

Date of Inspection

2022-02-02

Facility Location

Old Police Dept Building

Damper Location

NE corridor

Inspector Name

Julie Gue

Damper I.D. #

4FL-FD8 North

Damper Type

Vertical Fire Damper

Damper Size

72x12

Damper Manufacturer

Air Balance

Damper Model #

Unknown

Fusible Link Temperature

165 Degrees

Access Door Size

16x16

Pass / Fail / Abandoned

Pass

Comments / Corrections

None

Picture of Damper in Open Position



Picture of Damper in Closed Position



Picture of Damper I.D. Label

FIRE DAMPER	
Inspection Date: <u>2-2-22</u>	Reference I.D.#: <u>4FL-FD8</u>
Inspected By: <u>GUE</u>	<u>NORTH</u>
Next Inspect. By: <u>2 2 24</u>	

Duct Fabricators, Inc. 883 Addison Rd. Cleveland, Ohio P: 216-391-2400 F: 216-391-2492

FIRE SAFETY DIVISION
NEMI Certified HVAC Fire Life Safety Technicians

Duct Fabricators, Inc.

883 Addison Rd. Cleveland, Ohio
P: 216-391-2400 F: 216-391-2492



NEMI Certified HVAC Fire Life Safety Technicians



CUYAHOGA COUNTY DAMPER INSPECTION REPORT

Date of Inspection

2022-02-01

Facility Location

Old Police Dept Building

Damper Location

Waiting room

Inspector Name

Julie Gue

Damper I.D.

4FL-FD8 South

Damper Type

Vertical Fire Damper

Damper Size

12x8 oval

Damper Manufacturer

Air Balance

Damper Model

Unknown

Fusible Link Temperature

165 Degrees

Access Door Size

6" Round

Pass / Fail / Abandoned

Pass

Comments / Corrections

None

Picture of Damper in Open Position



Picture of Damper in Closed Position



Picture of Damper I.D. Label



CUYAHOGA COUNTY DAMPER INSPECTION REPORT

Date of Inspection

2022-02-02

Facility Location

Old Police Dept Building

Damper Location

File room

Inspector Name

Julie Gue

Damper I.D. #

4FL-FD9 North

Damper Type

Vertical Fire Damper

Damper Size

60x6

Damper Manufacturer

Air Balance

Damper Model #

Unknown

Fusible Link Temperature

165 Degrees

Access Door Size

16x16

Pass / Fail / Abandoned

Pass

Comments / Corrections

None

Picture of Damper in Open Position



Picture of Damper in Closed Position



Picture of Damper I.D. Label

FIRE DAMPER	
Inspection Date: <u>2-2-22</u>	Reference I.D.#: <u>4FL-FD9</u>
Inspected By: <u>GUE</u>	<u>NORTH</u>
Next Inspect. By: <u>2-2-24</u>	

Duct Fabricators, Inc. 883 Addison Rd. Cleveland, Ohio P: 216-391-2400 F: 216-391-2492 NEMI Certified HVAC Fire Life Safety Technicians

CUYAHOGA COUNTY DAMPER INSPECTION REPORT

Date of Inspection
2022-02-01

Facility Location
Old Police Dept Building

Damper Location
Waiting room

Inspector Name
Julie Gue

Damper I.D. #
4FL-FD9 South

Damper Type
Vertical Fire Damper

Damper Size
28x12 Oval

Damper Manufacturer
Air Balance

Damper Model #
Unknown

Fusible Link Temperature
165 Degrees

Access Door Size
9" Round

Pass / Fail / Abandoned
Pass

Comments / Corrections
None

Picture of Damper in Open Position



Picture of Damper in Closed Position



Picture of Damper I.D. Label



CUYAHOGA COUNTY DAMPER INSPECTION REPORT

Date of Inspection

2022-02-02

Facility Location

Old Police Dept Building

Damper Location

File room

Inspector Name

Julie Gue

Damper I.D. #

4FL-FD10 North

Damper Type

Vertical Fire Damper

Damper Size

8" Round

Damper Manufacturer

Air Balance

Damper Model #

Unknown

Fusible Link Temperature

165 Degrees

Access Door Size

6" Round

Pass / Fail / Abandoned

Pass

Comments / Corrections

None

Picture of Damper in Open Position




Picture of Damper in Closed Position



Picture of Damper I.D. Label

FIRE
DAMPER

Inspection Date: 2-2-22	Reference I.D.#: 4FL-FD10
Inspected By: Gue	NORTH
Next Inspect. By: 2-2-24(M)	

Duct Fabricators, Inc. **FIRE SAFETY DIVISION** 
883 Addison Rd. Cleveland, Ohio
P: 216-391-2400 F: 216-391-2492 NEMI Certified HVAC Fire Life Safety Technicians

CUYAHOGA COUNTY DAMPER INSPECTION REPORT

Date of Inspection

2022-02-08

Facility Location

Old Police Dept Building

Damper Location

Corridor

Inspector Name

Julie Gue

Damper I.D. #

4FL-FD10 South

Damper Type

Vertical Fire Damper

Damper Size

28x12

Damper Manufacturer

Air Balance

Damper Model #

Unknown

Fusible Link Temperature

165 Degrees

Access Door Size

14x14

Pass / Fail / Abandoned

Pass

Comments / Corrections

Installed larger access door


Picture of Damper in Open Position



Picture of Damper in Closed Position



Picture of Damper I.D. Label

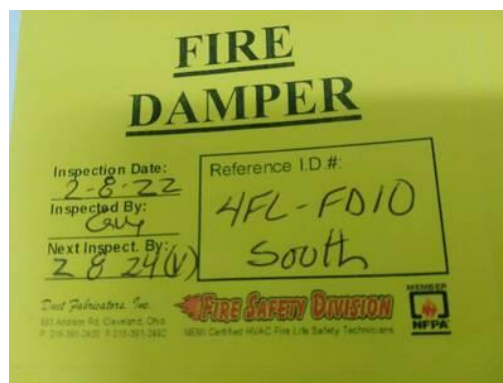

CUYAHOGA COUNTY DAMPER INSPECTION REPORT

Date of Inspection

2022-02-02

Facility Location

Old Police Dept Building

Damper Location

File room

Inspector Name

Julie Gue

Damper I.D. #

4FL-FD11 North

Damper Type

Vertical Fire Damper

Damper Size

60x6

Damper Manufacturer

Air Balance

Damper Model #

Unknown

Fusible Link Temperature

165 Degrees

Access Door Size

16x16

Pass / Fail / Abandoned

Pass

Comments / Corrections

None


Picture of Damper in Open Position



Picture of Damper in Closed Position



Picture of Damper I.D. Label

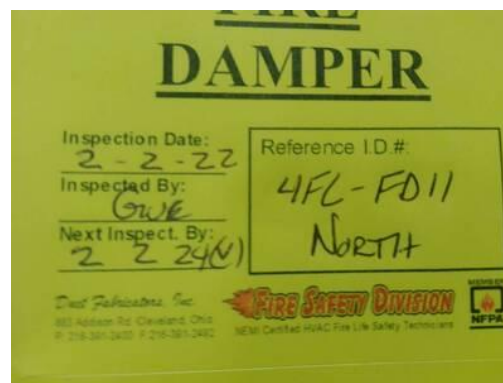

CUYAHOGA COUNTY DAMPER INSPECTION REPORT

Date of Inspection
2022-02-02

Picture of Damper in Open Position

Facility Location
Old Police Dept Building



Damper Location
Storage room

Inspector Name
Julie Gue

Damper I.D. #
4FL-FD12 North

Picture of Damper in Closed Position

Damper Type
Vertical Fire Damper



Damper Size
12" Round

Damper Manufacturer
Ruskin

Damper Model #
IBD60

Fusible Link Temperature
165 Degrees

Picture of Damper I.D. Label

Access Door Size
9x6

Pass / Fail / Abandoned
Pass

Comments / Corrections
None

FIRE DAMPER	
Inspection Date: 2-2-22	Reference I.D.# 4FL-FD12
Inspected By: GUG	NORTH
Next Inspect. By: 2-2-24(V)	

Duct Fabricators, Inc.
883 Addison Rd. Cleveland, Ohio
P: 216-391-2400 F: 216-391-2492

FIRE SAFETY DIVISION
NEMI Certified HVAC Fire Life Safety Technicians

MEMBER
NFPA

CUYAHOGA COUNTY DAMPER INSPECTION REPORT

Date of Inspection

2022-02-07

Facility Location

Old Police Dept Building

Damper Location

Files

Inspector Name

Julie Gue

Damper I.D. #

4FL-FD12 South

Damper Type

Vertical Fire Damper

Damper Size

34x12

Damper Manufacturer

Air Balance

Damper Model #

Unknown

Fusible Link Temperature

165 Degrees

Access Door Size

16x16

Pass / Fail / Abandoned

Pass

Comments / Corrections

Installed larger access


Picture of Damper in Open Position



Picture of Damper in Closed Position



Picture of Damper I.D. Label

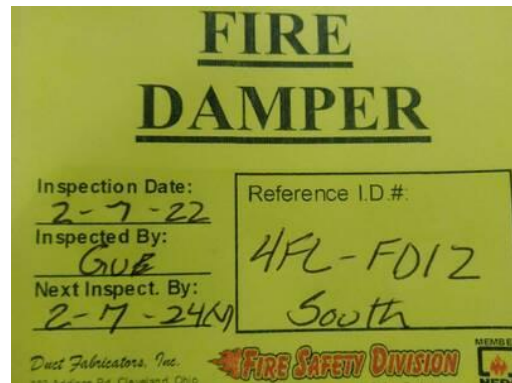

CUYAHOGA COUNTY DAMPER INSPECTION REPORT

Date of Inspection

2022-02-07

Facility Location

Old Police Dept Building

Damper Location

Storage room

Inspector Name

Julie Gue

Damper I.D. #

4FL-FD13 North

Damper Type

Vertical Fire Damper

Damper Size

64x14

Damper Manufacturer

Air Balance

Damper Model #

Unknown

Fusible Link Temperature

165 Degrees

Access Door Size

Screen

Pass / Fail / Abandoned

Pass

Comments / Corrections

None


Picture of Damper in Open Position



Picture of Damper in Closed Position



Picture of Damper I.D. Label

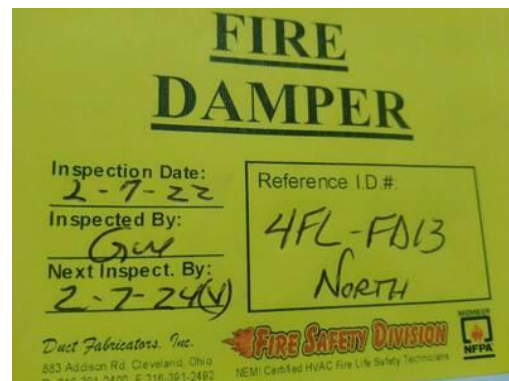

CUYAHOGA COUNTY DAMPER INSPECTION REPORT

Date of Inspection
2022-02-07

Facility Location
Old Police Dept Building

Damper Location
Files

Inspector Name
Julie Gue

Damper I.D. #
4FL-FD13 South

Damper Type
Vertical Fire Damper

Damper Size
20x14

Damper Manufacturer
Ruskin

Damper Model #
IBD20

Fusible Link Temperature
165 Degrees

Access Door Size
Screen

Pass / Fail / Abandoned
Pass

Comments / Corrections
None

Picture of Damper in Open Position



Picture of Damper in Closed Position



Picture of Damper I.D. Label



CUYAHOGA COUNTY DAMPER INSPECTION REPORT

Date of Inspection

2022-02-09

Facility Location

Old Police Dept Building

Damper Location

South corridor

Inspector Name

Julie Gue

Damper I.D. #

4FL-FD14 South

Damper Type

Vertical Fire Damper

Damper Size

48x24

Damper Manufacturer

Air Balance

Damper Model #

Unknown

Fusible Link Temperature

165 Degrees

Access Door Size

Grille access

Pass / Fail / Abandoned

Pass

Comments / Corrections

Carpenter needed dirty


Picture of Damper in Open Position



Picture of Damper in Closed Position



Picture of Damper I.D. Label

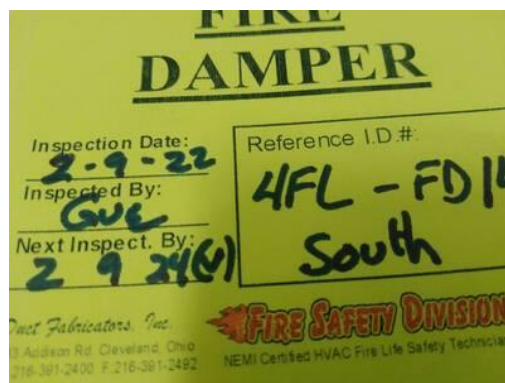

CUYAHOGA COUNTY DAMPER INSPECTION REPORT

Date of Inspection

2022-02-07

Facility Location

Old Police Dept Building

Damper Location

Storage room

Inspector Name

Julie Gue

Damper I.D. #

4FL-FD15 North

Damper Type

Vertical Fire Damper

Damper Size

10x6

Damper Manufacturer

Air Balance

Damper Model #

Unknown

Fusible Link Temperature

165 Degrees

Access Door Size

7x5

Pass / Fail / Abandoned

Pass

Comments / Corrections

None


Picture of Damper in Open Position



Picture of Damper in Closed Position



Picture of Damper I.D. Label

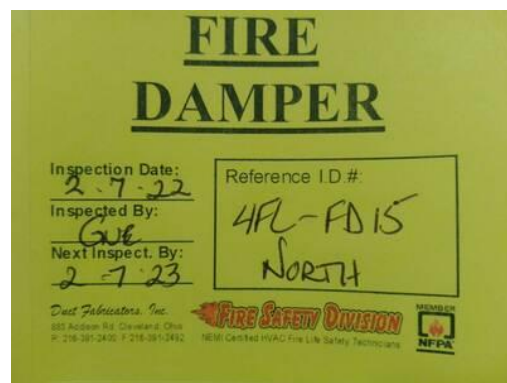

CUYAHOGA COUNTY DAMPER INSPECTION REPORT

Date of Inspection

2022-02-08

Facility Location

Old Police Dept Building

Damper Location

Storage room

Inspector Name

Julie Gue

Damper I.D. #

4FL-FD16 North

Damper Type

Vertical Fire Damper

Damper Size

10x8 oval

Damper Manufacturer

Air Balance

Damper Model #

Unknown

Fusible Link Temperature

165 Degrees

Access Door Size

8" Round

Pass / Fail / Abandoned

Pass

Comments / Corrections

None


Picture of Damper in Open Position



Picture of Damper in Closed Position



Picture of Damper I.D. Label

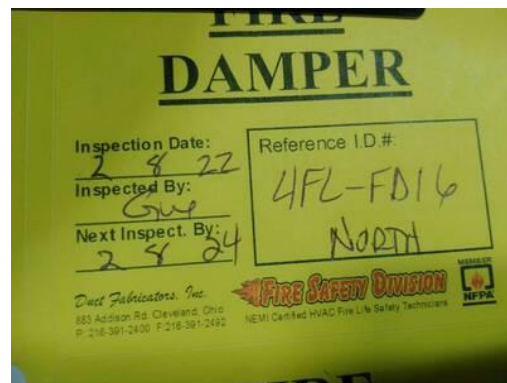

CUYAHOGA COUNTY DAMPER INSPECTION REPORT

Date of Inspection

2022-02-07

Facility Location

Old Police Dept Building

Damper Location

Cleaning closet

Inspector Name

Julie Gue

Damper I.D. #

4FL-FD17 North

Damper Type

Vertical Fire Damper

Damper Size

6x6

Damper Manufacturer

Air Balance

Damper Model #

Unknown

Fusible Link Temperature

165 Degrees

Access Door Size

5x7

Pass / Fail / Abandoned

Pass

Comments / Corrections

None

Picture of Damper in Open Position



Picture of Damper in Closed Position



Picture of Damper I.D. Label

FIRE
DAMPER

Inspection Date: 2-7-22	Reference I.D. #:
Inspected By: GUE	4FL-FD17
Next Inspect. By: 2-7-24	NORTH

Duct Fabricators, Inc.
883 Addison Rd. Cleveland, Ohio

FIRE SAFETY DIVISION

MEMBER
NFPA

CUYAHOGA COUNTY DAMPER INSPECTION REPORT

Date of Inspection

2022-02-07

Facility Location

Old Police Dept Building

Damper Location

Cleaning closet

Inspector Name

Julie Gue

Damper I.D. #

4FL-FD18 North

Damper Type

Vertical Fire Damper

Damper Size

18x12 Oval

Damper Manufacturer

Air Balance

Damper Model #

Unknown

Fusible Link Temperature

165 Degrees

Access Door Size

6" Round

Pass / Fail / Abandoned

Pass

Comments / Corrections

None


Picture of Damper in Open Position



Picture of Damper in Closed Position



Picture of Damper I.D. Label

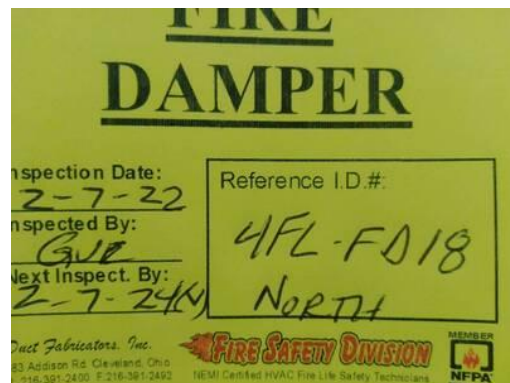

CUYAHOGA COUNTY DAMPER INSPECTION REPORT

Date of Inspection

2022-02-08

Facility Location

Old Police Dept Building

Damper Location

East corridor

Inspector Name

Julie Gue

Damper I.D.

4FL-FD19 North

Damper Type

Vertical Fire Damper

Damper Size

28x12 Oval

Damper Manufacturer

Air Balance

Damper Model

Unknown

Fusible Link Temperature

165 Degrees

Access Door Size

14x14

Pass / Fail / Abandoned

Pass

Comments / Corrections

Installed larger access.

Picture of Damper in Open Position



Picture of Damper in Closed Position



Picture of Damper I.D. Label

FIRE DAMPER	
Inspection Date: 2-8-22	Reference I.D.#: 4FL-FD19
Inspected By: Gue	
Next Inspect. By: 2-8-24	NORTH

Duct Fabricators, Inc.
883 Addison Rd. Cleveland, Ohio
P: 216-391-2400 F: 216-391-2492

FIRE SAFETY DIVISION
NEMI Certified HVAC Fire Life Safety Technicians

MEMBER
NFPA

CUYAHOGA COUNTY DAMPER INSPECTION REPORT

Date of Inspection

2022-01-20

Facility Location

Justice Center Court Towers

Damper Location

Above kitchen cooler

Inspector Name

Julie Gue

Damper I.D. #

4FL-SD1 South

Damper Type

Vertical Smoke Damper

Damper Size

12" Round

Damper Manufacturer

Air Balance

Damper Model #

Unknown

Fusible Link Temperature

N/A

Access Door Size

10" Round

Pass / Fail / Abandoned

Pass

Comments / Corrections

Zone 1


Picture of Damper in Open Position



Picture of Damper in Closed Position



Picture of Damper I.D. Label

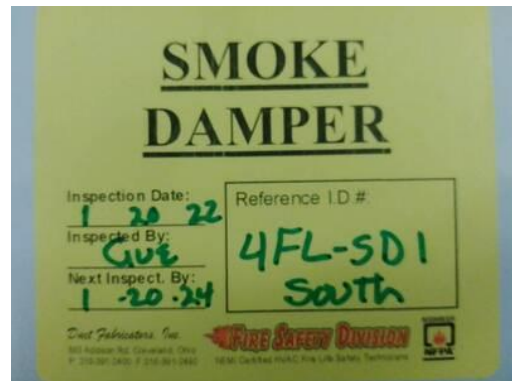

Duct Fabricators, Inc.
 883 Addison Rd. Cleveland, Ohio
 P: 216-391-2400 F: 216-391-2492



Fire / Smoke / Fire & Smoke Damper
Composite Inspection Report

	<u>FD/SD/FSD</u>	<u>I.D.#</u>	<u>Size</u>	<u>Manufacturer</u>	<u>Model</u>	<u>Visual</u>	<u>Functional</u>	<u>Comments</u>
1	FD	1FL-FD1	16X14	Air Balance	Unknown	Pass	Pass	None
2	FD	1FL-FD2	16X14	Air Balance	Unknown	Pass	Pass	None
3	FD	1FL-FD3	12x12	Ruskin	IBD20	Pass	Pass	None
4	FD	1FL-FD4	6x6	Air Balance	Unknown	Pass	Pass	None
5	FD	1FL-FD5	16x12	Air Balance	Unknown	Pass	Pass	None
6	FD	1FL-FD6	19" R	Air Balance	Unknown	Pass	Pass	None
7	FD	1FL-FD7	20x8	Ruskin	IBD20	Pass	Pass	Removed stud screw from damper track
8	FD	1FL-FD8	20x12	Ruskin	IBD20	Pass	Pass	Dowl found propping curtain open
9	FD	1FL-FD9	16x12	Ruskin	IBD20	Pass	Pass	None
10	FD	1FL-FD10	15" R	Air Balance	Unknown	Pass	Pass	Changed Fusible Link
11	FD	1FL-FD11	48x16	Air Balance	Unknown	Pass	Pass	None
12	FD	1FL-FD12	36x12	Ruskin	IBD20	Pass	Pass	None

Inspector: Julie Gue
Inspection Dates: 2/14/2022-3/4/2022
Facility: Court Tower 2 (Old Police Headquarters)

SA = Supply Air FD = Fire Damper
 RA = Return Air SD = Smoke Damper
 EA = Exhaust Air FSD = Fire Smoke Damper

Duct Fabricators, Inc.

883 Addison Rd. Cleveland, Ohio
P: 216-391-2400 F: 216-391-2492

FIRE SAFETY DIVISION

NEMI Certified HVAC Fire Life Safety Technicians



CUYAHOGA COUNTY DAMPER INSPECTION REPORT

Date of Inspection

2022-03-04

Facility Location

Old Police Dept Building

Damper Location

Museum office

Inspector Name

Julie Gue

Damper I.D. #

1FD-FD8

Damper Type

Vertical Fire Damper

Damper Size

20x12

Damper Manufacturer

Ruskin

Damper Model #

IBD60

Fusible Link Temperature

165 Degrees

Access Door Size

12x12

Pass / Fail / Abandoned

Pass

Comments / Corrections

Dowl was found Propping damper open and link broke when it was touched. New link installed

Picture of Damper in Open Position



Picture of Damper in Closed Position



Picture of Damper I.D. Label



Duct Fabricators, Inc.
 883 Addison Rd. Cleveland, Ohio
 P: 216-391-2400 F: 216-391-2492



Fire / Smoke / Fire & Smoke Damper
Composite Inspection Report

	<u>FD/SD/FSD</u>	<u>I.D.#</u>	<u>Size</u>	<u>Manufacturer</u>	<u>Model</u>	<u>Visual</u>	<u>Functional</u>	<u>Comments</u>
57	FD	4FL-FD1 South	16x10 Oval	Air Balance	Unknown	Pass	Pass	None
58	FD	4FL-FD2 South	28x12	Air Balance	Unknown	Pass	Pass	None
59	FD	4FL-FD3 South	24x18	Ruskin	IBD60	Pass	Pass	None
60	FD	4FL-FD4 South	18x12	Air Balance	Unknown	Pass	Pass	None
61	FD	4FL-FD5 South	50x10	Air Balance	Unknown	Pass	Pass	None
62	FD	4FL-FD6 South	16x11	Air Balance	Unknown	Pass	Pass	None
63	FD	4FL-FD7 South	30x14	Air Balance	Unknown	Pass	Pass	None
64	FD	4FL-FD8 South	12x8 Oval	Air Balance	Unknown	Pass	Pass	None
65	FD	4FL-FD9 South	28x12 Oval	Air Balance	Unknown	Pass	Pass	None
66	FD	4FL-FD10 South	28x12 Oval	Air Balance	Unknown	Pass	Pass	Installed larger access door
67	FD	4FL-FD11 South	48x24	Air Balance	Unknown	Pass	Pass	None
68	FD	4FL-FD12 South	34x12	Air Balance	Unknown	Pass	Pass	Installed larger access door
69	FD	4FL-FD13 South	20x14	Ruskin	IBD60	Pass	Pass	None

Inspector: Julie Gue
Inspection Dates: 2/14/2022-3/01/2022
Facility: Court Tower 2 Old Police Headquarters

SA = Supply Air FD = Fire Damper
 RA = Return Air SD = Smoke Damper
 EA = Exhaust Air FSD = Fire Smoke Damper

Duct Fabricators, Inc.
 883 Addison Rd. Cleveland, Ohio
 P: 216-391-2400 F: 216-391-2492



Fire / Smoke / Fire & Smoke Damper
Composite Inspection Report

	<u>FD/SD/FSD</u>	<u>I.D.#</u>	<u>Size</u>	<u>Manufacturer</u>	<u>Model</u>	<u>Visual</u>	<u>Functional</u>	<u>Comments</u>
13	FD	2FL-FD1 North	25x12Oval	Air Balance	Unknown	Pass	Pass	None
14	FD	2FL-FD2 North	54x14	Air Balance	Unknown	Pass	Pass	None
15	FD	2FL-FD3 North	6"R	Air Balance	Unknown	Pass	Pass	Changed Fusible Link
16	FD	2FL-FD4 North	10" R	Ruskin	IBD60	Pass	Pass	None
17	FD	2FL-FD5 North	12x8	Air Balance	Unknown	Pass	Pass	None
18	FD	2FL-FD6 North	16x12	Air Balance	Unknown	Pass	Pass	None
19	FD	2FL-FD7 North	24x12 Oval	Air Balance	Unknown	Pass	Pass	None
20	FD	2FL-FD8 North	8" R	Air Balance	Unknown	Pass	Pass	Changed Fusible Link
21	FD	2FL-FD9 North	10" R	Ruskin	IBD60	Pass	Pass	None
22	FD	2FL-FD10 North	21x12 Oval	Air Balance	Unknown	Pass	Pass	None
23	FD	2FL-FD11 North	18x12 Oval	Air Balance	Unknown	Pass	Pass	Changed Fusible Link
24	FD	2FL-FD12 North	64x14	Air Balance	Unknown	Pass	Pass	None
25	FD	2FL-FD13 North	54x14	Air Balance	Unknown	Pass	Pass	None
26	FD	2FL-FD14 North	60x6	Air Balance	Unknown	Pass	Pass	None
27	FD	2FL-FD15 North	16x10 Oval	Air Balance	Unknown	Pass	Pass	Changed Fusible Link

Inspector: Julie Gue
Inspection Dates: 2/14/2022-3/4/2022
Facility: Court Tower 2 Old Police Headquarters

SA = Supply Air FD = Fire Damper
 RA = Return Air SD = Smoke Damper
 EA = Exhaust Air FSD = Fire Smoke Damper

Report Date: May 6, 2022

Project: Cuyahoga County
Justice Center Tower Two

Inspector(s):

- Julianne Gue, Certified Technician
- Dan Tulcewicz, Certified Technician

Inspection and Test Date(s):

- January 14, 2022-March 4, 2022

Duct Fabricators, Inc. "Fire Safety Division" inspected floors one through 24, excluding the fourth floor and Galleria. The dampers were then tested and photographed in the "open" and "closed" positions to confirm that they were functioning as designed. We are in the process of completing punch list items and repairs within the Court Tower.

All of the dampers passed the inspection and functional testing unless otherwise noted.

NOTES: NFPA 80 and NFPA 105 require newly installed dampers to be inspected and tested one year after initial installation. Thereafter, dampers located in patient care facilities are to be inspected and tested every six years.

Additionally, the information contained herein verified whether the dampers were functional at the time of testing. This verification process does not represent any form of a guarantee that the dampers will properly perform in the future.

Cuyahoga County
Justice Center
Tower Two

1300 Ontario Street
Cleveland, Ohio 44113

Fire Damper Inspection Report
May 6, 2022

Duct Fabricators, Inc.

 **FIRE SAFETY DIVISION**

MEMBER



Duct Fabricators, Inc.
 883 Addison Rd. Cleveland, Ohio
 P: 216-391-2400 F: 216-391-2492



Fire / Smoke / Fire & Smoke Damper
Composite Inspection Report

	<u>FD/SD/FSD</u>	<u>I.D.#</u>	<u>Size</u>	<u>Manufacturer</u>	<u>Model</u>	<u>Visual</u>	<u>Functional</u>	<u>Comments</u>
28	FD	2FL-FD1 South	18x12	Air Balance	Unknown	Pass	Pass	None
29	FD	2FL-FD2 South	18x12	Air Balance	Unknown	Pass	Pass	None
30	FD	2FL-FD3 South	28x11 Oval	Air Balance	Unknown	Pass	Pass	None
31	FD	2FL-FD4 South	28x12 Oval	Air Balance	Unknown	Pass	Pass	None
32	FD	2FL-FD5 South	28x12 Oval	Air Balance	Unknown	Pass	Pass	None
33	FD	2FL-FD6 South	60x6	Air Balance	Unknown	Pass	Pass	None
34	FD	2FL-FD7 South	24x12 Oval	Air Balance	Unknown	Pass	Pass	None
35	FD	2FL-FD8 South	36x12	Air Balance	Unknown	Pass	Pass	None
36	FD	2FL-FD9 South	10" R	Ruskin	IBD2	Pass	Pass	None
37	FD	2FL-FD10 South	48x24	Air Balance	Unknown	Pass	Pass	None

Inspector: Julie Gue
Inspection Dates: 2/14/2022-3/4/2022
Facility: Court Tower 2 Old Police Headquarters

SA = Supply Air FD = Fire Damper
 RA = Return Air SD = Smoke Damper
 EA = Exhaust Air FSD = Fire Smoke Damper