

VISUAL CUYAHOGA COUNTY DAMPER INSPECTION REPORT

Date of Inspection

2023-03-15

Facility Location

Courthouse Square

Damper Location

Basement

Inspector Name

Dan Tulcewicz

Damper I.D. #

CHS-B-Gen Ex

Damper Type

Horizontal Fire Damper

Damper Size

14"x10"

Damper Manufacturer

Prefco Products

Damper Model #

Unknown

Fusible Link Temperature

165 Degrees

Access Door Size

6"x6"

Pass / Fail / Abandoned

Pass

Comments / Corrections

None


Exterior Picture of Damper



Interior Picture of Damper



Picture of Damper I.D. Label

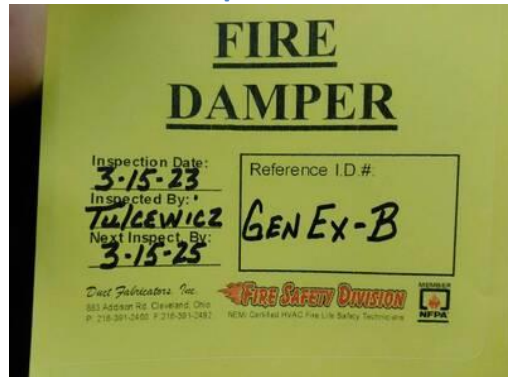

Duct Fabricators, Inc.

883 Addison Rd. Cleveland, Ohio
P: 216-391-2400 F: 216-391-2492

FIRE SAFETY DIVISION

NEMI Certified HVAC Fire Life Safety Technicians



VISUAL CUYAHOGA COUNTY DAMPER INSPECTION REPORT

Date of Inspection

2023-03-15

Facility Location

Courthouse Square

Damper Location

Basement

Inspector Name

Dan Tulcewicz

Damper I.D.

CHS-B-OA

Damper Type

Horizontal Fire Damper

Damper Size

14"x24"

Damper Manufacturer

Prefco Products

Damper Model

Unknown

Fusible Link Temperature

165 Degrees

Access Door Size

18"x8"

Pass / Fail / Abandoned

Pass

Comments / Corrections

None


Exterior Picture of Damper



Interior Picture of Damper



Picture of Damper I.D. Label

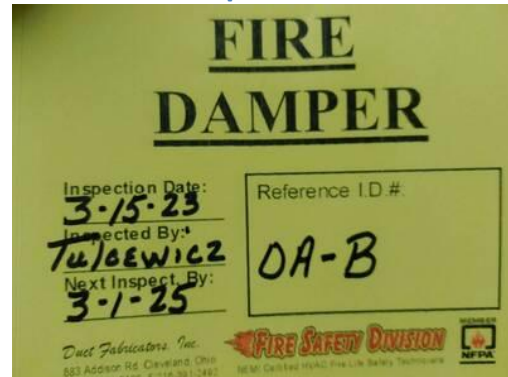

Duct Fabricators, Inc.

883 Addison Rd. Cleveland, Ohio
P: 216-391-2400 F: 216-391-2492

FIRE SAFETY DIVISION

NEMI Certified HVAC Fire Life Safety Technicians



VISUAL CUYAHOGA COUNTY DAMPER INSPECTION REPORT

Date of Inspection

2023-03-15

Facility Location

Courthouse Square

Damper Location

Basement

Inspector Name

Dan Tulcewicz

Damper I.D.

CHS-B-Toilet EX

Damper Type

Horizontal Fire Damper

Damper Size

14"x10"

Damper Manufacturer

Prefco Products

Damper Model

Unknown

Fusible Link Temperature

165 Degrees

Access Door Size

8"x8"

Pass / Fail / Abandoned

Pass

Comments / Corrections

None


Exterior Picture of Damper



Interior Picture of Damper



Picture of Damper I.D. Label

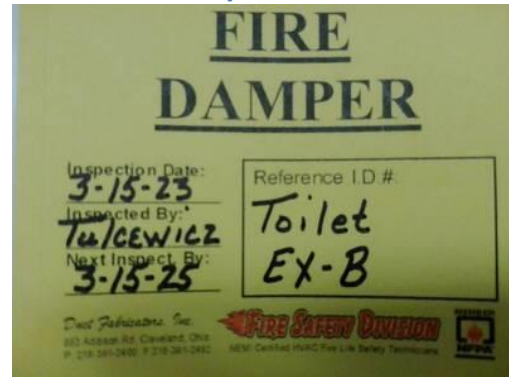

VISUAL CUYAHOGA COUNTY DAMPER INSPECTION REPORT

Date of Inspection

2023-03-16

Facility Location

Courthouse Square

Damper Location

2nd floor

Inspector Name

Dan Tulcewicz

Damper I.D. #

CHS-2-Gen Ex

Damper Type

Vertical Fire Damper

Damper Size

14"x10"

Damper Manufacturer

Prefco Products

Damper Model #

Unknown

Fusible Link Temperature

165 Degrees

Access Door Size

8"x18"

Pass / Fail / Abandoned

Pass

Comments / Corrections

None


Exterior Picture of Damper



Interior Picture of Damper



Picture of Damper I.D. Label

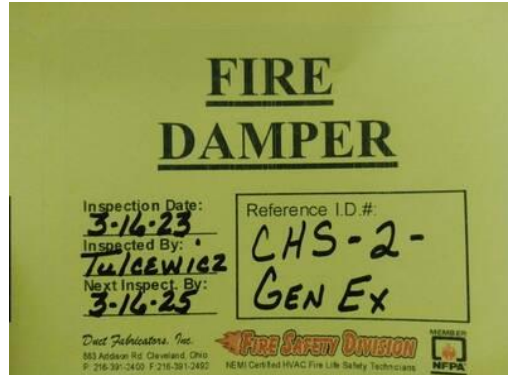

Duct Fabricators, Inc.

883 Addison Rd. Cleveland, Ohio
P: 216-391-2400 F: 216-391-2492

FIRE SAFETY DIVISION

NEMI Certified HVAC Fire Life Safety Technicians



VISUAL CUYAHOGA COUNTY DAMPER INSPECTION REPORT

Date of Inspection

2023-03-15

Facility Location

Courthouse Square

Damper Location

2FL

Inspector Name

Dan Tulcewicz

Damper I.D. #

CHS-2 OA

Damper Type

Vertical Fire Damper

Damper Size

24x10

Damper Manufacturer

Prefco Products

Damper Model #

Unknown

Fusible Link Temperature

165 Degrees

Access Door Size

12x12

Pass / Fail / Abandoned

Pass

Comments / Corrections

None


Exterior Picture of Damper



Interior Picture of Damper



Picture of Damper I.D. Label

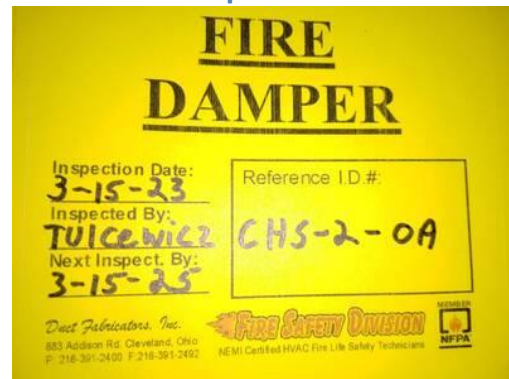

Duct Fabricators, Inc.

883 Addison Rd. Cleveland, Ohio
P: 216-391-2400 F: 216-391-2492

FIRE SAFETY DIVISION
NEMI Certified HVAC Fire Life Safety Technicians



VISUAL CUYAHOGA COUNTY DAMPER INSPECTION REPORT

Date of Inspection

2023-03-15

Facility Location

Courthouse Square

Damper Location

2FL men's room

Inspector Name

Dan Tulcewicz

Damper I.D. #

CHS-2- Toilet EX

Damper Type

Vertical Fire Damper

Damper Size

14"x10"

Damper Manufacturer

Prefco Products

Damper Model #

Unknown

Fusible Link Temperature

165 Degrees

Access Door Size

12"x6"

Pass / Fail / Abandoned

Pass

Comments / Corrections

None

Exterior Picture of Damper



Interior Picture of Damper



Picture of Damper I.D. Label



Duct Fabricators, Inc.

883 Addison Rd. Cleveland, Ohio
P: 216-391-2400 F: 216-391-2492

FIRE SAFETY DIVISION

NEMI Certified HVAC Fire Life Safety Technicians



VISUAL CUYAHOGA COUNTY DAMPER INSPECTION REPORT

Date of Inspection

2023-03-16

Facility Location

Courthouse Square

Damper Location

3rd Floor

Inspector Name

Dan Tulcewicz

Damper I.D.

CHS-3-Gen Ex

Damper Type

Vertical Fire Damper

Damper Size

14"x10"

Damper Manufacturer

Prefco Products

Damper Model

Unknown

Fusible Link Temperature

165 Degrees

Access Door Size

10"x8'

Pass / Fail / Abandoned

Pass

Comments / Corrections

Left side of wall needs repair so retaining angle can be installed.


Exterior Picture of Damper



Interior Picture of Damper



Picture of Damper I.D. Label

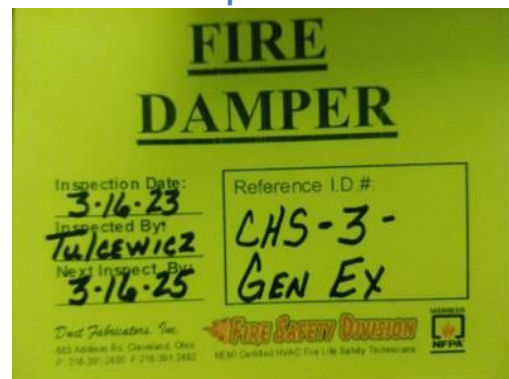

VISUAL CUYAHOGA COUNTY DAMPER INSPECTION REPORT

Date of Inspection

2023-03-16

Facility Location

Courthouse Square

Damper Location

3rd floor

Inspector Name

Dan Tulcewicz

Damper I.D. #

CHS-3-OA

Damper Type

Vertical Fire Damper

Damper Size

24"x10"

Damper Manufacturer

Prefco Products

Damper Model #

Unknown

Fusible Link Temperature

165 Degrees

Access Door Size

12"x12"

Pass / Fail / Abandoned

Pass

Comments / Corrections

Needs Retaining angle


Exterior Picture of Damper



Interior Picture of Damper



Picture of Damper I.D. Label

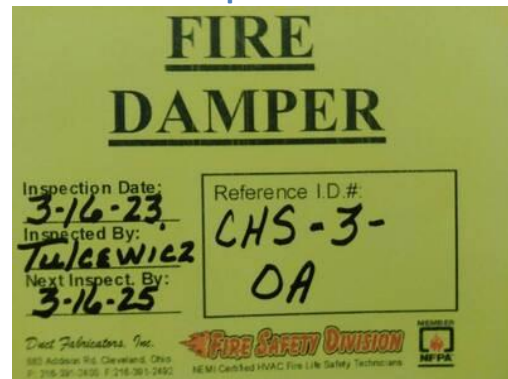

Duct Fabricators, Inc.

883 Addison Rd. Cleveland, Ohio
P: 216-391-2400 F: 216-391-2492



NEMI Certified HVAC Fire Life Safety Technicians



VISUAL CUYAHOGA COUNTY DAMPER INSPECTION REPORT

Date of Inspection

2023-03-15

Facility Location

Courthouse Square

Damper Location

3rd Floor

Inspector Name

Dan Tulcewicz

Damper I.D.

CHS-3-Toilet EX

Damper Type

Vertical Fire Damper

Damper Size

14"x10"

Damper Manufacturer

Prefco Products

Damper Model

Unknown

Fusible Link Temperature

165 Degrees

Access Door Size

14"x14"

Pass / Fail / Abandoned

Pass

Comments / Corrections

None


Exterior Picture of Damper



Interior Picture of Damper



Picture of Damper I.D. Label

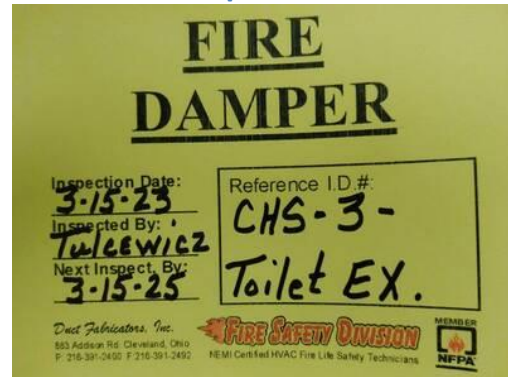

Duct Fabricators, Inc.

883 Addison Rd. Cleveland, Ohio
P: 216-391-2400 F: 216-391-2492

FIRE SAFETY DIVISION

NEMI Certified HVAC Fire Life Safety Technicians



VISUAL CUYAHOGA COUNTY DAMPER INSPECTION REPORT

Date of Inspection

2023-03-15

Facility Location

Courthouse Square

Damper Location

4th fl

Inspector Name

Dan Tulcewicz

Damper I.D. #

CHS-4-General Exhaust

Damper Type

Vertical Fire Damper

Damper Size

14x10

Damper Manufacturer

Prefco Products

Damper Model #

Unknown

Fusible Link Temperature

165 Degrees

Access Door Size

8x8

Pass / Fail / Abandoned

Pass

Comments / Corrections

None


Exterior Picture of Damper



Interior Picture of Damper



Picture of Damper I.D. Label

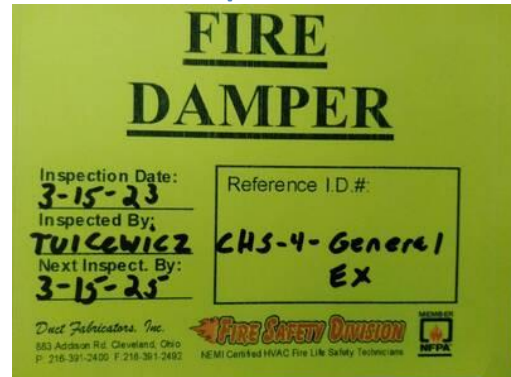

VISUAL CUYAHOGA COUNTY DAMPER INSPECTION REPORT

Date of Inspection

2023-03-15

Facility Location

Courthouse Square

Damper Location

4th fl

Inspector Name

Dan Tulcewicz

Damper I.D. #

CHS-4-OA

Damper Type

Vertical Fire Damper

Damper Size

24x10

Damper Manufacturer

Prefco Products

Damper Model #

Unknown

Fusible Link Temperature

165 Degrees

Access Door Size

20x8

Pass / Fail / Abandoned

Pass

Comments / Corrections

None


Exterior Picture of Damper



Interior Picture of Damper



Picture of Damper I.D. Label

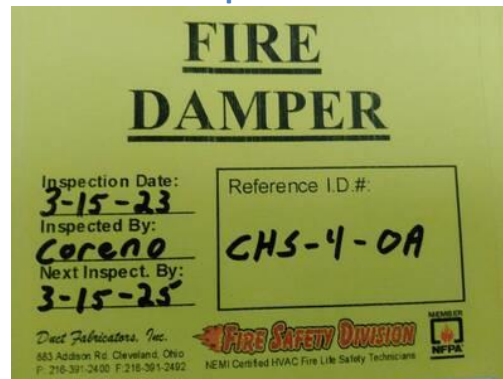

VISUAL CUYAHOGA COUNTY DAMPER INSPECTION REPORT

Date of Inspection

2023-03-15

Facility Location

Courthouse Square

Damper Location

4th men's room

Inspector Name

Dan Tulcewicz

Damper I.D. #

CHS-4-Toilet EX

Damper Type

Vertical Fire Damper

Damper Size

14"x10'

Damper Manufacturer

Prefco Products

Damper Model #

Unknown

Fusible Link Temperature

165 Degrees

Access Door Size

14"x14"

Pass / Fail / Abandoned

Pass

Comments / Corrections

None

Exterior Picture of Damper



Interior Picture of Damper



Picture of Damper I.D. Label



VISUAL CUYAHOGA COUNTY DAMPER INSPECTION REPORT

Date of Inspection

2023-03-16

Facility Location

Courthouse Square

Damper Location

5th floor

Inspector Name

Dan Tulcewicz

Damper I.D. #

CHS-5 OA

Damper Type

Vertical Fire Damper

Damper Size

24"x10"

Damper Manufacturer

Prefco Products

Damper Model #

Unknown

Fusible Link Temperature

165 Degrees

Access Door Size

12"x12"

Pass / Fail / Abandoned

Pass

Comments / Corrections

None

Exterior Picture of Damper



Interior Picture of Damper



Picture of Damper I.D. Label



Duct Fabricators, Inc.

883 Addison Rd. Cleveland, Ohio
P: 216-391-2400 F: 216-391-2492

FIRE SAFETY DIVISION

NEMI Certified HVAC Fire Life Safety Technicians



VISUAL CUYAHOGA COUNTY DAMPER INSPECTION REPORT

Date of Inspection

2023-03-16

Facility Location

Courthouse Square

Damper Location

5th floor

Inspector Name

Dan Tulcewicz

Damper I.D.

CHS-5-Gen Ex

Damper Type

Vertical Fire Damper

Damper Size

14"x10"

Damper Manufacturer

Prefco Products

Damper Model

Unknown

Fusible Link Temperature

165 Degrees

Access Door Size

8"x8"

Pass / Fail / Abandoned

Pass

Comments / Corrections

None


Exterior Picture of Damper



Interior Picture of Damper



Picture of Damper I.D. Label

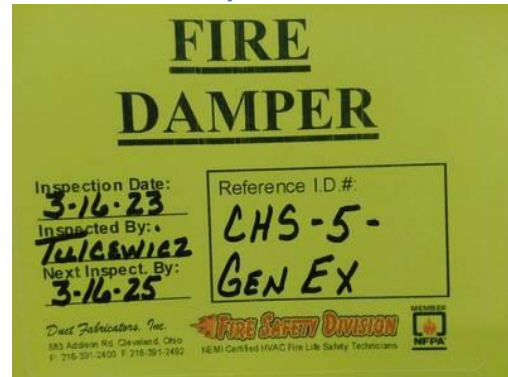

Duct Fabricators, Inc.

883 Addison Rd. Cleveland, Ohio
P: 216-391-2400 F: 216-391-2492

FIRE SAFETY DIVISION

NEMI Certified HVAC Fire Life Safety Technicians



VISUAL CUYAHOGA COUNTY DAMPER INSPECTION REPORT

Date of Inspection

2023-03-16

Facility Location

Courthouse Square

Damper Location

5Th Floor

Inspector Name

Dan Tulcewicz

Damper I.D. #

CHS-5-Toilet EX

Damper Type

Vertical Fire Damper

Damper Size

14"x10"

Damper Manufacturer

Prefco Products

Damper Model #

Unknown

Fusible Link Temperature

165 Degrees

Access Door Size

14"x14"

Pass / Fail / Abandoned

Pass

Comments / Corrections

None


Exterior Picture of Damper



Interior Picture of Damper



Picture of Damper I.D. Label

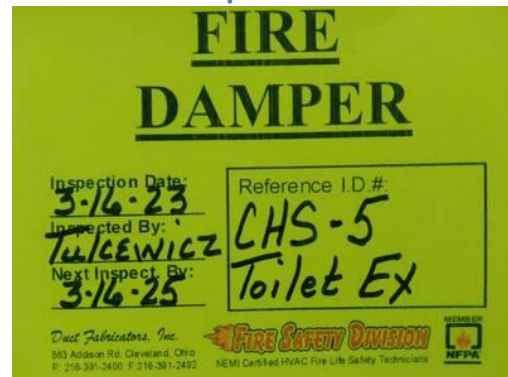

Duct Fabricators, Inc.

883 Addison Rd. Cleveland, Ohio
P: 216-391-2400 F: 216-391-2492

FIRE SAFETY DIVISION
NEMI Certified HVAC Fire Life Safety Technicians



VISUAL CUYAHOGA COUNTY DAMPER INSPECTION REPORT

Date of Inspection

2023-03-16

Facility Location

Courthouse Square

Damper Location

6th floor

Inspector Name

Dan Tulcewicz

Damper I.D. #

CHS-6 OA

Damper Type

Vertical Fire Damper

Damper Size

24"x10"

Damper Manufacturer

Prefco Products

Damper Model #

Unknown

Fusible Link Temperature

165 Degrees

Access Door Size

18"x18"

Pass / Fail / Abandoned

Pass

Comments / Corrections

None

Exterior Picture of Damper



Interior Picture of Damper



Picture of Damper I.D. Label



Duct Fabricators, Inc.

883 Addison Rd. Cleveland, Ohio
P: 216-391-2400 F: 216-391-2492

FIRE SAFETY DIVISION
NEMI Certified HVAC Fire Life Safety Technicians



VISUAL CUYAHOGA COUNTY DAMPER INSPECTION REPORT

Date of Inspection

2023-03-16

Facility Location

Courthouse Square

Damper Location

6th floor

Inspector Name

Dan Tulcewicz

Damper I.D.

CHS-6-Gen Ex

Damper Type

Vertical Fire Damper

Damper Size

14"x10"

Damper Manufacturer

Prefco Products

Damper Model

Unknown

Fusible Link Temperature

165 Degrees

Access Door Size

8"x8"

Pass / Fail / Abandoned

Pass

Comments / Corrections

None

Exterior Picture of Damper



Interior Picture of Damper



Picture of Damper I.D. Label



VISUAL CUYAHOGA COUNTY DAMPER INSPECTION REPORT

Date of Inspection

2023-03-16

Facility Location

Courthouse Square

Damper Location

6th floor

Inspector Name

Dan Tulcewicz

Damper I.D. #

CHS-6-Toilet Ex

Damper Type

Vertical Fire Damper

Damper Size

14"x10"

Damper Manufacturer

Prefco Products

Damper Model #

Unknown

Fusible Link Temperature

165 Degrees

Access Door Size

12"x12"

Pass / Fail / Abandoned

Pass

Comments / Corrections

None

Exterior Picture of Damper



Interior Picture of Damper



Picture of Damper I.D. Label



Duct Fabricators, Inc.

883 Addison Rd. Cleveland, Ohio
P: 216-391-2400 F: 216-391-2492



NEMI Certified HVAC Fire Life Safety Technicians



VISUAL CUYAHOGA COUNTY DAMPER INSPECTION REPORT

Date of Inspection

2023-03-16

Facility Location

Courthouse Square

Damper Location

7th Floor

Inspector Name

Dan Tulcewicz

Damper I.D.

CHS-7-Gen Ex

Damper Type

Vertical Fire Damper

Damper Size

14"x10"

Damper Manufacturer

Prefco Products

Damper Model

Unknown

Fusible Link Temperature

165 Degrees

Access Door Size

14"x14"

Pass / Fail / Abandoned

Pass


Comments / Corrections

None


Exterior Picture of Damper



Interior Picture of Damper

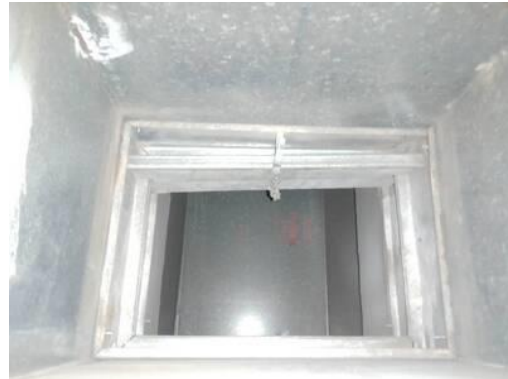

Picture of Damper I.D. Label

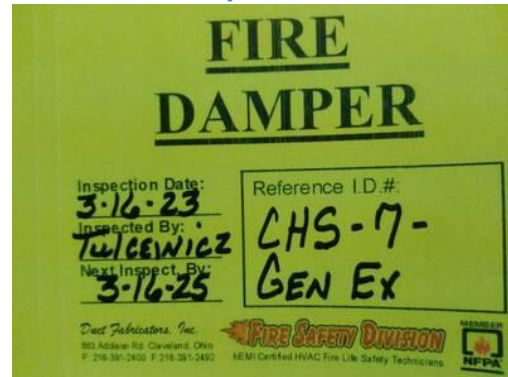

Duct Fabricators, Inc.

883 Addison Rd. Cleveland, Ohio
P: 216-391-2400 F: 216-391-2492

FIRE SAFETY DIVISION
NEMI Certified HVAC Fire Life Safety Technicians



VISUAL CUYAHOGA COUNTY DAMPER INSPECTION REPORT

Date of Inspection

2023-03-16

Facility Location

Courthouse Square

Damper Location

7th Floor

Inspector Name

Dan Tulcewicz

Damper I.D. #

CHS-7-OA

Damper Type

Vertical Fire Damper

Damper Size

24"x10"

Damper Manufacturer

Prefco Products

Damper Model #

Unknown

Fusible Link Temperature

165 Degrees

Access Door Size

10"x10"

Pass / Fail / Abandoned

Pass

Comments / Corrections

None

Exterior Picture of Damper



Interior Picture of Damper



Picture of Damper I.D. Label



VISUAL CUYAHOGA COUNTY DAMPER INSPECTION REPORT

Date of Inspection

2023-03-16

Facility Location

Courthouse Square

Damper Location

7th Floor men's restroom

Inspector Name

Julie Gue

Damper I.D. #

CHS-7-Toilet Ex

Damper Type

Vertical Fire Damper

Damper Size

14"x10"

Damper Manufacturer

Prefco Products

Damper Model #

Unknown

Fusible Link Temperature

165 Degrees

Access Door Size

14"x14"

Pass / Fail / Abandoned

Pass

Comments / Corrections

None


Exterior Picture of Damper



Interior Picture of Damper



Picture of Damper I.D. Label

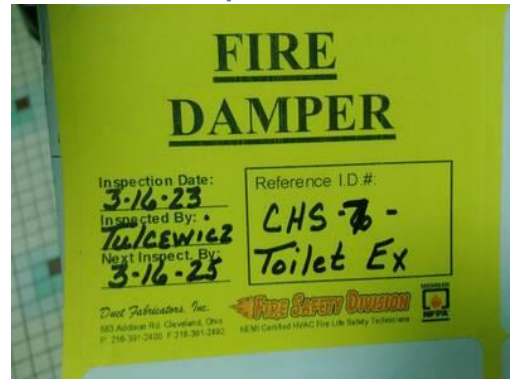

Duct Fabricators, Inc.

883 Addison Rd. Cleveland, Ohio
P: 216-391-2400 F: 216-391-2492

FIRE SAFETY DIVISION

NEMI Certified HVAC Fire Life Safety Technicians



VISUAL CUYAHOGA COUNTY DAMPER INSPECTION REPORT

Date of Inspection

2023-03-16

Facility Location

Courthouse Square

Damper Location

Penthouse

Inspector Name

Dan Tulcewicz

Damper I.D. #

CHS-PH Gen Ex

Damper Type

Horizontal Fire Damper

Damper Size

30"x20"

Damper Manufacturer

Prefco Products

Damper Model #

Unknown

Fusible Link Temperature

165 Degrees

Access Door Size

12"x12"

Pass / Fail / Abandoned

Pass

Comments / Corrections

None


Exterior Picture of Damper



Interior Picture of Damper



Picture of Damper I.D. Label

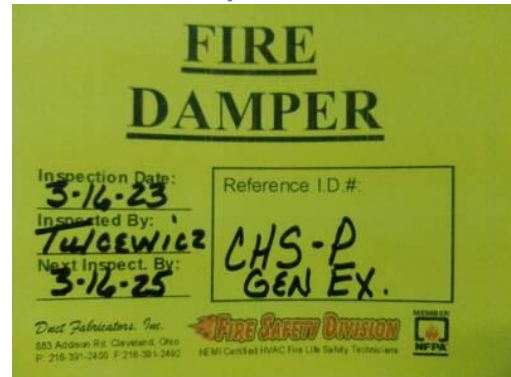

Duct Fabricators, Inc.

883 Addison Rd. Cleveland, Ohio
P: 216-391-2400 F: 216-391-2492

FIRE SAFETY DIVISION
NEMI Certified HVAC Fire Life Safety Technicians



VISUAL CUYAHOGA COUNTY DAMPER INSPECTION REPORT

Date of Inspection

2023-03-16

Facility Location

Courthouse Square

Damper Location

Penthouse

Inspector Name

Dan Tulcewicz

Damper I.D.

CHS-PH-OA

Damper Type

Horizontal Fire Damper

Damper Size

36"x30"

Damper Manufacturer

Prefco Products

Damper Model

Unknown

Fusible Link Temperature

165 Degrees

Access Door Size

14"x14"

Pass / Fail / Abandoned

Pass

Comments / Corrections

None

Exterior Picture of Damper



Interior Picture of Damper



Picture of Damper I.D. Label



Duct Fabricators, Inc.

883 Addison Rd. Cleveland, Ohio
P: 216-391-2400 F: 216-391-2492



VISUAL CUYAHOGA COUNTY DAMPER INSPECTION REPORT

Date of Inspection

2023-03-16

Facility Location

Courthouse Square

Damper Location

Penthouse

Inspector Name

Dan Tulcewicz

Damper I.D. #

CHS-PH-Toilet Ex

Damper Type

Horizontal Fire Damper

Damper Size

30"x20"

Damper Manufacturer

Prefco Products

Damper Model #

Unknown

Fusible Link Temperature

165 Degrees

Access Door Size

12"x12"

Pass / Fail / Abandoned

Pass

Comments / Corrections

None


Exterior Picture of Damper



Interior Picture of Damper



Picture of Damper I.D. Label

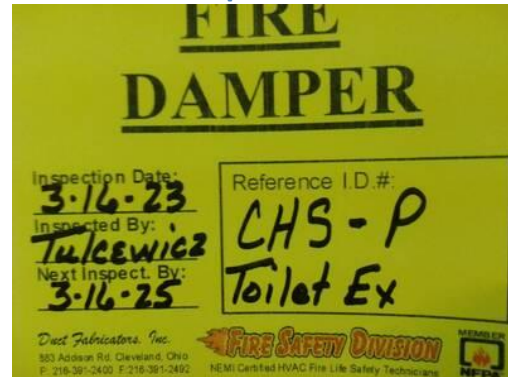

Duct Fabricators, Inc.
 883 Addison Rd. Cleveland, Ohio
 P: 216-391-2400 F: 216-391-2492



Fire / Smoke / Fire & Smoke Damper
Composite Inspection Report

<u>FD/SD/FSD</u>	<u>I.D.#</u>	<u>Size</u>	<u>Manufacturer</u>	<u>Model</u>	<u>Visual</u>	<u>Functional</u>	<u>Comments</u>
FD	CHS-Gen Ex-B	14x10	Prefco	Unknown	Pass	N/A	None
FD	CHS-OA-B	14X24	Prefco	Unknown	Pass	N/A	None
FD	CHS-Toilet Ex- B	14X10	Prefco	Unknown	Pass	N/A	None
FD	CHS-Gen-Ex-2	14X10	Prefco	Unknown	Pass	N/A	None
FD	CHS-OA-2	24X10	Prefco	Unknown	Pass	N/A	None
FD	CHS-Toilet Ex-2	14X10	Prefco	Unknown	Pass	N/A	None
FD	CHS-Gen-Ex-3	14X10	Prefco	Unknown	Pass	N/A	None
FD	CHS-OA-3	24X10	Prefco	Unknown	Pass	N/A	None
FD	CHS-Toilet Ex-3	14X10	Prefco	Unknown	Pass	N/A	None
FD	CHS-Gen Ex-4	14X10	Prefco	Unknown	Pass	N/A	None
FD	CHS-OA-4	24X10	Prefco	Unknown	Pass	N/A	None
FD	CHS-Toilet Ex-4	14X10	Prefco	Unknown	Pass	N/A	None
FD	CHS-Gen Ex-5	14X10	Prefco	Unknown	Pass	N/A	None
FD	CHS-OA-5	24X10	Prefco	Unknown	Pass	N/A	None
FD	CHS-Toilet Ex-5	14X10	Prefco	Unknown	Pass	N/A	None
FD	CHS-Gen Ex-6	14X10	Prefco	Unknown	Pass	N/A	None
FD	CHS-OA-6	24X10	Prefco	Unknown	Pass	N/A	None
FD	CHS-Toilet Ex-6	14X10	Prefco	Unknown	Pass	N/A	None
FD	CHS Gen Ex-7	14X10	Prefco	Unknown	Pass	N/A	None
FD	CHS -OA-7	24X10	Prefco	Unknown	Pass	N/A	None

Inspector: Dan Tulcewicz Larry Coreno
Inspection Dates: 3/15/23 and 3/16/23
Facility: Courthouse Square

SA = Supply Air FD = Fire Damper
 RA = Return Air SD = Smoke Damper
 EA = Exhaust Air FSD = Fire Smoke Damper

