

CUYAHOGA COUNTY DAMPER INSPECTION REPORT

Date of Inspection

2023-09-26

Facility Location

Metzenbaum Center

Damper Location

Mechanical room

Inspector Name

Julie Gue

Damper I.D. #

AHU1-R1

Damper Type

Horizontal Fire Damper

Damper Size

24" x 10"

Damper Manufacturer

Unknown

Damper Model #

Unknown

Fusible Link Temperature

165 Degrees

Access Door Size

Screen

Pass / Fail / Abandoned

Pass

Comments / Corrections

None

Picture of Damper in Open Position



Picture of Damper in Closed Position



Picture of Damper I.D. Label



CUYAHOGA COUNTY DAMPER INSPECTION REPORT

Date of Inspection

2023-09-25

Facility Location

Metzenbaum Center

Damper Location

Mechanical room

Inspector Name

Julie Gue

Damper I.D. #

AHU1-R2

Damper Type

Horizontal Fire Damper

Damper Size

12" x 10"

Damper Manufacturer

Unknown

Damper Model #

Unknown

Fusible Link Temperature

165 Degrees

Access Door Size

Open

Pass / Fail / Abandoned

Pass

Comments / Corrections

None

Picture of Damper in Open Position



Picture of Damper in Closed Position



Picture of Damper I.D. Label



CUYAHOGA COUNTY DAMPER INSPECTION REPORT

Date of Inspection
2023-10-02

Facility Location
Metzenbaum Center

Damper Location
Mechanical room

Inspector Name
Larry Coreno

Damper I.D. #
AHU1-R3

Damper Type
Horizontal Fire Damper

Damper Size
10" x 10"

Damper Manufacturer
Unknown

Damper Model #
Unknown

Fusible Link Temperature
165 Degrees

Access Door Size
Open

Pass / Fail / Abandoned
Pass

Comments / Corrections
None

Picture of Damper in Open Position



Picture of Damper in Closed Position



Picture of Damper I.D. Label



CUYAHOGA COUNTY DAMPER INSPECTION REPORT

Date of Inspection
2023-10-02

Picture of Damper in Open Position

Facility Location
Metzenbaum Center



Damper Location
Mechanical room

Inspector Name
Larry Coreno

Damper I.D. #
AHU1-R4

Picture of Damper in Closed Position

Damper Type
Horizontal Fire Damper



Damper Size
32" x 12"

Damper Manufacturer
Unknown

Damper Model #
Unknown

Fusible Link Temperature
165 Degrees

Picture of Damper I.D. Label

Access Door Size
Open

Pass / Fail / Abandoned
Pass

Comments / Corrections
None



Duct Fabricators, Inc.

883 Addison Rd. Cleveland, Ohio
P: 216-391-2400 F: 216-391-2492

FIRE SAFETY DIVISION
NEMI Certified HVAC Fire Life Safety Technicians



CUYAHOGA COUNTY DAMPER INSPECTION REPORT

Date of Inspection

2023-10-02

Picture of Damper in Open Position



Facility Location

Metzenbaum Center

Damper Location

Mechanical room

Inspector Name

Larry Coreno

Damper I.D. #

AHU1-R5

Picture of Damper in Closed Position



Damper Type

Horizontal Fire Damper

Damper Size

10" x 10"

Damper Manufacturer

Unknown


Damper Model #

Unknown

Fusible Link Temperature

165 Degrees

Picture of Damper I.D. Label

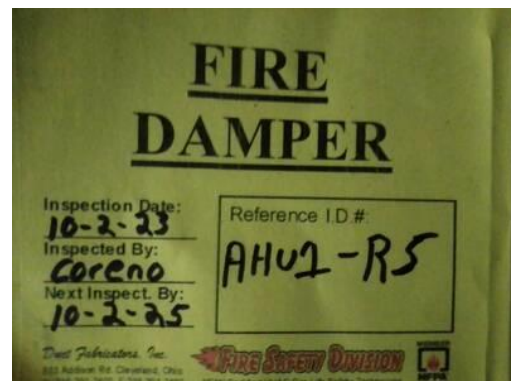

Access Door Size

Open

Pass / Fail / Abandoned

Pass

Comments / Corrections

None

CUYAHOGA COUNTY DAMPER INSPECTION REPORT

Date of Inspection

2023-09-25

Facility Location

Metzenbaum Center

Damper Location

Mechanical room

Inspector Name

Julie Gue

Damper I.D. #

AHU1-R6

Damper Type

Vertical Fire Damper

Damper Size

36" x 36"

Damper Manufacturer

Unknown

Damper Model #

Unknown

Fusible Link Temperature

165 Degrees

Access Door Size

Open

Pass / Fail / Abandoned

Pass

Comments / Corrections

None

Picture of Damper in Open Position



Picture of Damper in Closed Position



Picture of Damper I.D. Label



CUYAHOGA COUNTY DAMPER INSPECTION REPORT

Date of Inspection

2023-10-02

Facility Location

Metzenbaum Center

Damper Location

Mechanical room

Inspector Name

Larry Coreno

Damper I.D. #

AHU1-R7

Damper Type

Vertical Fire Damper

Damper Size

36" x 36"

Damper Manufacturer

Unknown

Damper Model #

Unknown

Fusible Link Temperature

165 Degrees

Access Door Size

Open

Pass / Fail / Abandoned

Pass

Comments / Corrections

None

Picture of Damper in Open Position



Picture of Damper in Closed Position



Picture of Damper I.D. Label



CUYAHOGA COUNTY DAMPER INSPECTION REPORT

Date of Inspection

2023-10-02

Facility Location

Metzenbaum Center

Damper Location

Mechanical room

Inspector Name

Julie Gue

Damper I.D. #

AHU1-R8

Damper Type

Vertical Fire Damper

Damper Size

36" x 36"

Damper Manufacturer

Unknown

Damper Model #

Unknown

Fusible Link Temperature

165 Degrees

Access Door Size

Open

Pass / Fail / Abandoned

Pass

Comments / Corrections

None


Picture of Damper in Open Position



Picture of Damper in Closed Position



Picture of Damper I.D. Label

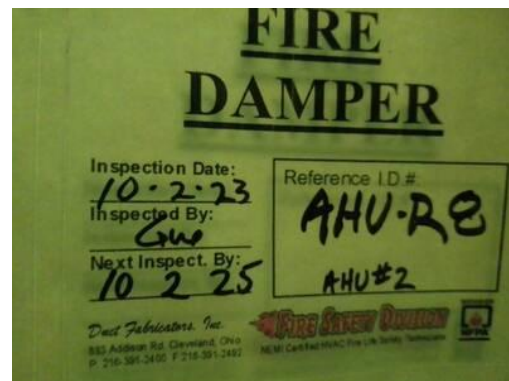

CUYAHOGA COUNTY DAMPER INSPECTION REPORT

Date of Inspection

2023-09-26

Facility Location

Metzenbaum Center

Damper Location

Mechanical room

Inspector Name

Julie Gue

Damper I.D. #

AHU2-R1

Damper Type

Horizontal Fire Damper

Damper Size

24" x 12"

Damper Manufacturer

Unknown

Damper Model #

Unknown

Fusible Link Temperature

165 Degrees

Access Door Size

Screen

Pass / Fail / Abandoned

Fail

Comments / Corrections

Wire holding open.
Will replace with proper fastener

Picture of Damper in Open Position



Picture of Damper in Closed Position



Picture of Damper I.D. Label



CUYAHOGA COUNTY DAMPER INSPECTION REPORT

Date of Inspection

2023-09-26

Facility Location

Metzenbaum Center

Damper Location

Mechanical room

Inspector Name

Julie Gue

Damper I.D. #

AHU1-R1

Damper Type

Horizontal Fire Damper

Damper Size

24" x 10"

Damper Manufacturer

Unknown

Damper Model #

Unknown

Fusible Link Temperature

165 Degrees

Access Door Size

Screen

Pass / Fail / Abandoned

Pass

Comments / Corrections

None

Picture of Damper in Open Position



Picture of Damper in Closed Position



Picture of Damper I.D. Label



CUYAHOGA COUNTY DAMPER INSPECTION REPORT

Date of Inspection

2023-09-26

Facility Location

Metzenbaum Center

Damper Location

Mechanical room

Inspector Name

Julie Gue

Damper I.D. #

AHU2-R2

Damper Type

Horizontal Fire Damper

Damper Size

24" x 10"

Damper Manufacturer

Unknown

Damper Model #

Unknown

Fusible Link Temperature

165 Degrees

Access Door Size

Screen

Pass / Fail / Abandoned

Fail

Comments / Corrections

Wired open

Picture of Damper in Open Position



Picture of Damper in Closed Position



Picture of Damper I.D. Label



CUYAHOGA COUNTY DAMPER INSPECTION REPORT

Date of Inspection
2023-09-26

Facility Location
Metzenbaum Center

Damper Location
Mechanical room

Inspector Name
Julie Gue

Damper I.D. #
AHU2-R3

Damper Type
Horizontal Fire Damper

Damper Size
36" x 12"

Damper Manufacturer
Unknown

Damper Model #
Unknown

Fusible Link Temperature
165 Degrees

Access Door Size
Screen

Pass / Fail / Abandoned
Pass

Comments / Corrections
None

Picture of Damper in Open Position



Picture of Damper in Closed Position



Picture of Damper I.D. Label



CUYAHOGA COUNTY DAMPER INSPECTION REPORT

Date of Inspection

2023-10-02

Facility Location

Metzenbaum Center

Damper Location

Mechanical room

Inspector Name

Larry Coreno

Damper I.D. #

AHU2-R4 a

Damper Type

Horizontal Fire Damper

Damper Size

24" x 10"

Damper Manufacturer

Unknown

Damper Model #

Unknown

Fusible Link Temperature

165 Degrees

Access Door Size

Open

Pass / Fail / Abandoned

Pass

Comments / Corrections

Fixed damper link

Picture of Damper in Open Position



Picture of Damper in Closed Position



Picture of Damper I.D. Label



CUYAHOGA COUNTY DAMPER INSPECTION REPORT

Date of Inspection

2023-10-02

Facility Location

Metzenbaum Center

Damper Location

Mechanical room

Inspector Name

Larry Coreno

Damper I.D. #

AHU2-R4

Damper Type

Horizontal Fire Damper

Damper Size

24" x 10"

Damper Manufacturer

Unknown

Damper Model #

Unknown

Fusible Link Temperature

165 Degrees

Access Door Size

Open

Pass / Fail / Abandoned

Fail

Comments / Corrections

Need new bolt nut

Picture of Damper in Open Position



Picture of Damper in Closed Position



Picture of Damper I.D. Label



Duct Fabricators, Inc.

883 Addison Rd. Cleveland, Ohio
P: 216-391-2400 F: 216-391-2492

FIRE SAFETY DIVISION
NEMI Certified HVAC Fire Life Safety Technicians



CUYAHOGA COUNTY DAMPER INSPECTION REPORT

Date of Inspection

2023-10-02

Facility Location

Metzenbaum Center

Damper Location

Mechanical room

Inspector Name

Larry Coreno

Damper I.D. #

AHU2-R5 A

Damper Type

Horizontal Fire Damper

Damper Size

24" x 10"

Damper Manufacturer

Unknown

Damper Model #

Unknown

Fusible Link Temperature

165 Degrees

Access Door Size

Open

Pass / Fail / Abandoned

Fail


Comments / Corrections

Need new bolt & nut

Picture of Damper in Open Position



Picture of Damper in Closed Position

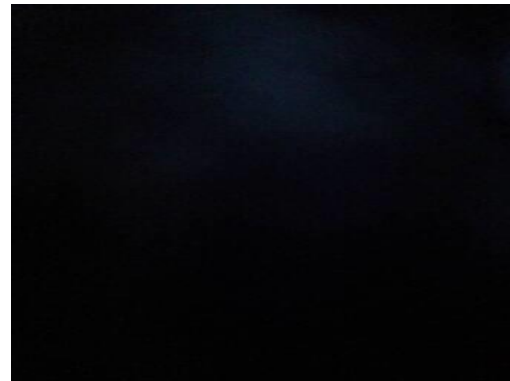

Picture of Damper I.D. Label



CUYAHOGA COUNTY DAMPER INSPECTION REPORT

Date of Inspection

2023-09-26

Facility Location

Metzenbaum Center

Damper Location

Mechanical room

Inspector Name

Julie Gue

Damper I.D. #

AHU2-R6

Damper Type

Vertical Fire Damper

Damper Size

36" x 36"

Damper Manufacturer

Unknown

Damper Model #

Unknown

Fusible Link Temperature

165 Degrees

Access Door Size

Open

Pass / Fail / Abandoned

Pass

Comments / Corrections

None


Picture of Damper in Open Position



Picture of Damper in Closed Position



Picture of Damper I.D. Label

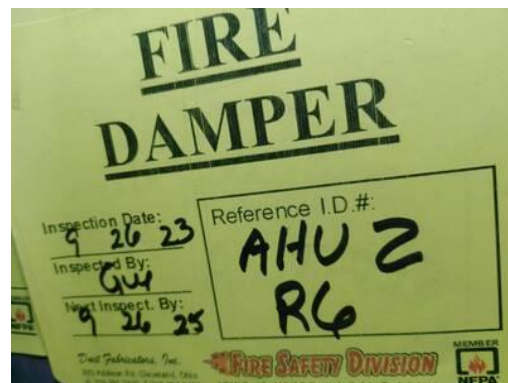

VISUAL CUYAHOGA COUNTY DAMPER INSPECTION REPORT

Date of Inspection

2022-09-13

Facility Location

Metzenbaum Center

Damper Location

Mechanical room

Inspector Name

Julie Gue

Damper I.D. #

AHU2-R1

Damper Type

Horizontal Fire Damper

Damper Size

24x10

Damper Manufacturer

Unknown

Damper Model #

Unknown

Fusible Link Temperature

165 Degrees

Access Door Size

Screen access

Pass / Fail / Abandoned

Pass

Comments / Corrections

None

Exterior Picture of Damper



Interior Picture of Damper



Picture of Damper I.D. Label



Duct Fabricators, Inc.

883 Addison Rd. Cleveland, Ohio
P: 216-391-2400 F: 216-391-2492

FIRE SAFETY DIVISION
NEMI Certified HVAC Fire Life Safety Technicians



VISUAL CUYAHOGA COUNTY DAMPER INSPECTION REPORT

Date of Inspection

2022-09-13

Facility Location

Metzenbaum Center

Damper Location

Mechanical room

Inspector Name

Julie Gue

Damper I.D. #

AHU1-R2

Damper Type

Horizontal Fire Damper

Damper Size

24x10

Damper Manufacturer

Unknown

Damper Model #

Unknown

Fusible Link Temperature

165 Degrees

Access Door Size

Screen access

Pass / Fail / Abandoned

Pass

Comments / Corrections

None


Exterior Picture of Damper



Interior Picture of Damper



Picture of Damper I.D. Label

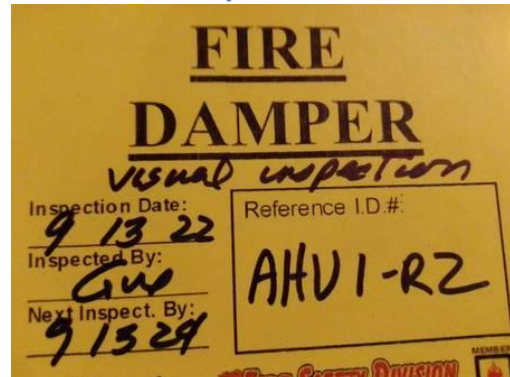

VISUAL CUYAHOGA COUNTY DAMPER INSPECTION REPORT

Date of Inspection

2022-09-13

Facility Location

Metzenbaum Center

Damper Location

Mechanical room

Inspector Name

Julie Gue

Damper I.D. #

AHU1-R3

Damper Type

Vertical Fire Damper

Damper Size

10x10

Damper Manufacturer

Unknown

Damper Model #

Unknown

Fusible Link Temperature

165 Degrees

Access Door Size

Screen access

Pass / Fail / Abandoned

Pass

Comments / Corrections

None


Exterior Picture of Damper



Interior Picture of Damper



Picture of Damper I.D. Label

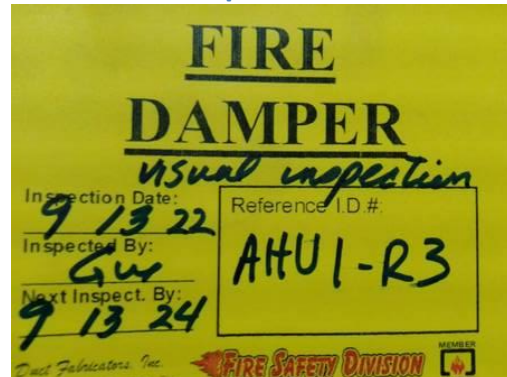

Duct Fabricators, Inc.

883 Addison Rd. Cleveland, Ohio
P: 216-391-2400 F: 216-391-2492

FIRE SAFETY DIVISION

NEMI Certified HVAC Fire Life Safety Technicians



VISUAL CUYAHOGA COUNTY DAMPER INSPECTION REPORT

Date of Inspection

2022-09-13

Facility Location

Metzenbaum Center

Damper Location

Mechanical room

Inspector Name

Julie Gue

Damper I.D. #

AHU1-R4

Damper Type

Horizontal Fire Damper

Damper Size

32x12

Damper Manufacturer

Unknown

Damper Model #

Unknown

Fusible Link Temperature

165 Degrees

Access Door Size

Screen access

Pass / Fail / Abandoned

Pass

Comments / Corrections

None


Exterior Picture of Damper



Interior Picture of Damper



Picture of Damper I.D. Label

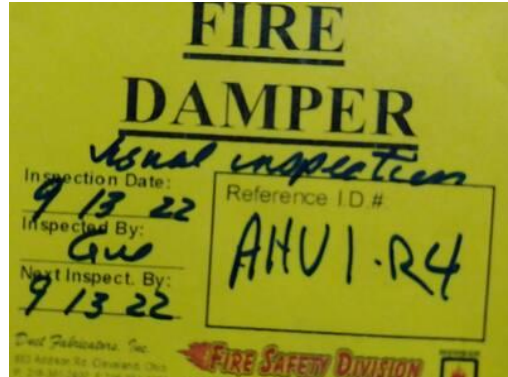

VISUAL CUYAHOGA COUNTY DAMPER INSPECTION REPORT

Date of Inspection

2022-09-14

Facility Location

Metzenbaum Center

Damper Location

Mechanical room

Inspector Name

Julie Gue

Damper I.D. #

AHU1-R5

Damper Type

Horizontal Fire Damper

Damper Size

10x10

Damper Manufacturer

Unknown

Damper Model #

Unknown

Fusible Link Temperature

165 Degrees

Access Door Size

Screen

Pass / Fail / Abandoned

Pass

Comments / Corrections

None

Exterior Picture of Damper



Interior Picture of Damper



Picture of Damper I.D. Label



Duct Fabricators, Inc.

883 Addison Rd. Cleveland, Ohio
P: 216-391-2400 F: 216-391-2492

FIRE SAFETY DIVISION

NEMI Certified HVAC Fire Life Safety Technicians



VISUAL CUYAHOGA COUNTY DAMPER INSPECTION REPORT

Date of Inspection

2022-09-13

Facility Location

Metzenbaum Center

Damper Location

Mechanical room

Inspector Name

Julie Gue

Damper I.D. #

AHU1-R6

Damper Type

Vertical Fire Damper

Damper Size

36x36

Damper Manufacturer

Unknown

Damper Model #

Unknown

Fusible Link Temperature

165 Degrees

Access Door Size

Open

Pass / Fail / Abandoned

Pass

Comments / Corrections

None


Exterior Picture of Damper



Interior Picture of Damper



Picture of Damper I.D. Label

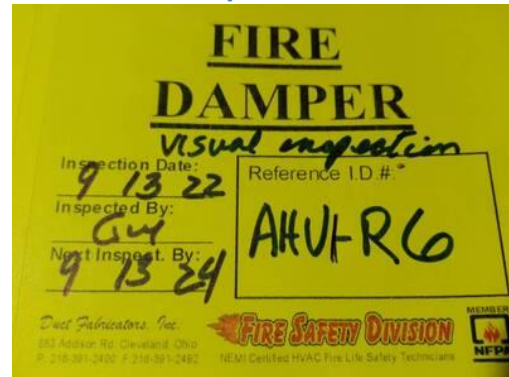

VISUAL CUYAHOGA COUNTY DAMPER INSPECTION REPORT

Date of Inspection

2022-09-13

Facility Location

Metzenbaum Center

Damper Location

Mechanical room

Inspector Name

Julie Gue

Damper I.D. #

AHU1-R7

Damper Type

Vertical Fire Damper

Damper Size

36x36

Damper Manufacturer

Unknown

Damper Model #

Unknown

Fusible Link Temperature

165 Degrees

Access Door Size

Open

Pass / Fail / Abandoned

Pass

Comments / Corrections

None


Exterior Picture of Damper



Interior Picture of Damper



Picture of Damper I.D. Label

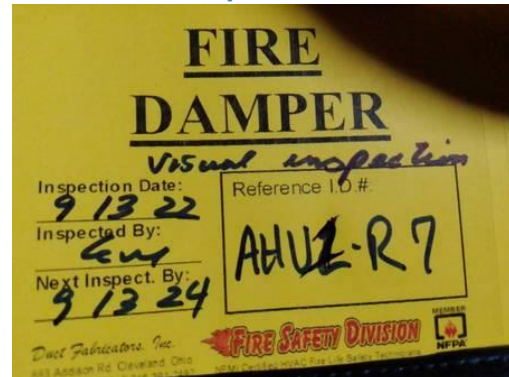

VISUAL CUYAHOGA COUNTY DAMPER INSPECTION REPORT

Date of Inspection

2022-09-13

Facility Location

Metzenbaum Center

Damper Location

Mechanical room

Inspector Name

Julie Gue

Damper I.D. #

AHU1-R1

Damper Type

Horizontal Fire Damper

Damper Size

36x12

Damper Manufacturer

Unknown

Damper Model #

Unknown

Fusible Link Temperature

165 Degrees

Access Door Size

Screen access

Pass / Fail / Abandoned

Pass

Comments / Corrections

None


Exterior Picture of Damper



Interior Picture of Damper



Picture of Damper I.D. Label

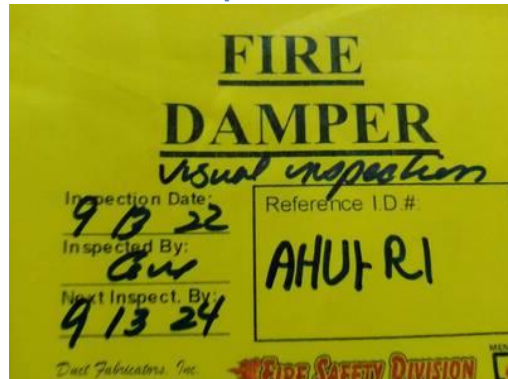

VISUAL CUYAHOGA COUNTY DAMPER INSPECTION REPORT

Date of Inspection

2022-09-13

Facility Location

Metzenbaum Center

Damper Location

Mechanical room

Inspector Name

Julie Gue

Damper I.D. #

AHU2-R2

Damper Type

Horizontal Fire Damper

Damper Size

24x10

Damper Manufacturer

Unknown

Damper Model #

Unknown

Fusible Link Temperature

165 Degrees

Access Door Size

Screen access

Pass / Fail / Abandoned

Pass

Comments / Corrections

None


Exterior Picture of Damper



Interior Picture of Damper



Picture of Damper I.D. Label

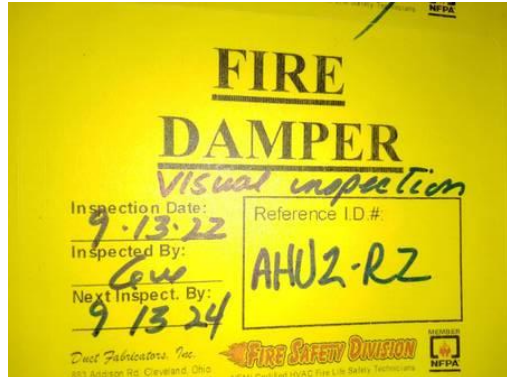

VISUAL CUYAHOGA COUNTY DAMPER INSPECTION REPORT

Date of Inspection

2022-09-13

Facility Location

Metzenbaum Center

Damper Location

Mechanical room

Inspector Name

Julie Gue

Damper I.D. #

AHU2-R3

Damper Type

Horizontal Fire Damper

Damper Size

36x12

Damper Manufacturer

Unknown

Damper Model #

Unknown

Fusible Link Temperature

165 Degrees

Access Door Size

Screen access

Pass / Fail / Abandoned

Pass

Comments / Corrections

None


Exterior Picture of Damper



Interior Picture of Damper



Picture of Damper I.D. Label

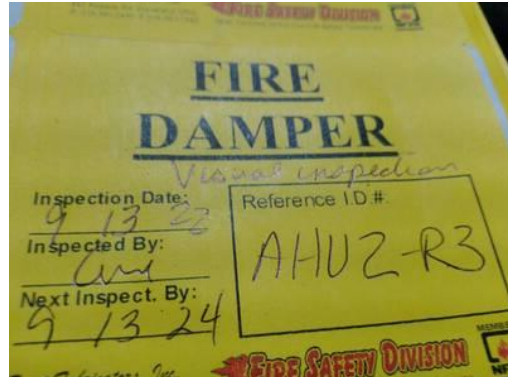

VISUAL CUYAHOGA COUNTY DAMPER INSPECTION REPORT

Date of Inspection

2022-09-13

Facility Location

Metzenbaum Center

Damper Location

Mechanical room

Inspector Name

Julie Gue

Damper I.D. #

AHU2-R4

Damper Type

Horizontal Fire Damper

Damper Size

24x10

Damper Manufacturer

Unknown

Damper Model #

Unknown

Fusible Link Temperature

165 Degrees

Access Door Size

Screen access

Pass / Fail / Abandoned

Pass

Comments / Corrections

None

Exterior Picture of Damper



Interior Picture of Damper



Picture of Damper I.D. Label



VISUAL CUYAHOGA COUNTY DAMPER INSPECTION REPORT

Date of Inspection

2022-09-13

Facility Location

Metzenbaum Center

Damper Location

Mechanical room

Inspector Name

Julie Gue

Damper I.D. #

AHU2-R5

Damper Type

Horizontal Fire Damper

Damper Size

24x10

Damper Manufacturer

Unknown

Damper Model #

Unknown

Fusible Link Temperature

165 Degrees

Access Door Size

Screen access

Pass / Fail / Abandoned

Pass

Comments / Corrections

None


Exterior Picture of Damper



Interior Picture of Damper



Picture of Damper I.D. Label

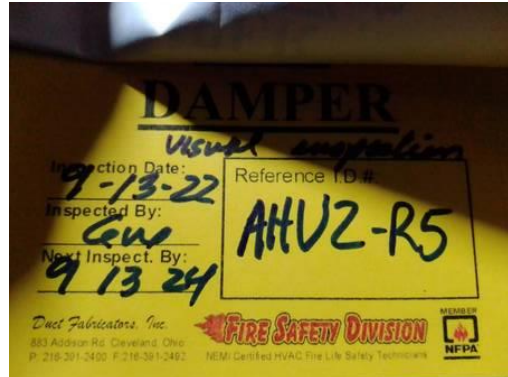

VISUAL CUYAHOGA COUNTY DAMPER INSPECTION REPORT

Date of Inspection

2022-09-14

Facility Location

Metzenbaum Center

Damper Location

Mechanical room

Inspector Name

Julie Gue

Damper I.D. #

AHU2-R6

Damper Type

Vertical Fire Damper

Damper Size

36x36

Damper Manufacturer

Unknown

Damper Model #

Unknown

Fusible Link Temperature

165 Degrees

Access Door Size

Open

Pass / Fail / Abandoned

Pass

Comments / Corrections

None


Exterior Picture of Damper



Interior Picture of Damper



Picture of Damper I.D. Label

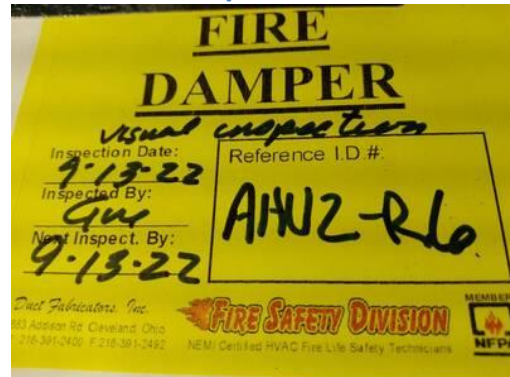

VISUAL CUYAHOGA COUNTY DAMPER INSPECTION REPORT

Date of Inspection

2022-09-14

Facility Location

Metzenbaum Center

Damper Location

Mechanical room

Inspector Name

Julie Gue

Damper I.D. #

AHU2-R7

Damper Type

Vertical Fire Damper

Damper Size

36x36

Damper Manufacturer

Unknown

Damper Model #

Unknown

Fusible Link Temperature

165 Degrees

Access Door Size

Open

Pass / Fail / Abandoned

Pass

Comments / Corrections

None


Exterior Picture of Damper



Interior Picture of Damper



Picture of Damper I.D. Label

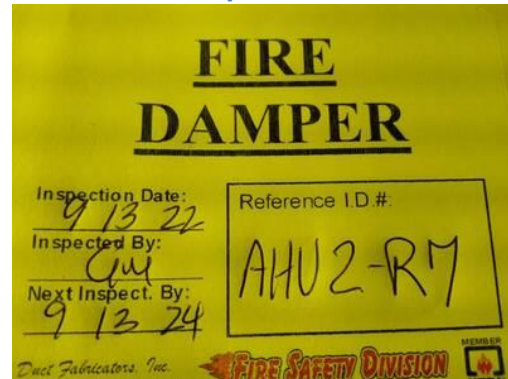

Duct Fabricators, Inc.

883 Addison Rd. Cleveland, Ohio
P: 216-391-2400 F: 216-391-2492

FIRE SAFETY DIVISION
NEMI Certified HVAC Fire Life Safety Technicians



VISUAL CUYAHOGA COUNTY DAMPER INSPECTION REPORT

Date of Inspection

2022-09-13

Facility Location

Metzenbaum Center

Damper Location

Mechanical room

Inspector Name

Julie Gue

Damper I.D. #

AHU2-R8

Damper Type

Vertical Fire Damper

Damper Size

36x36

Damper Manufacturer

Unknown

Damper Model #

Unknown

Fusible Link Temperature

165 Degrees

Access Door Size

Open

Pass / Fail / Abandoned

Pass

Comments / Corrections

None


Exterior Picture of Damper



Interior Picture of Damper



Picture of Damper I.D. Label

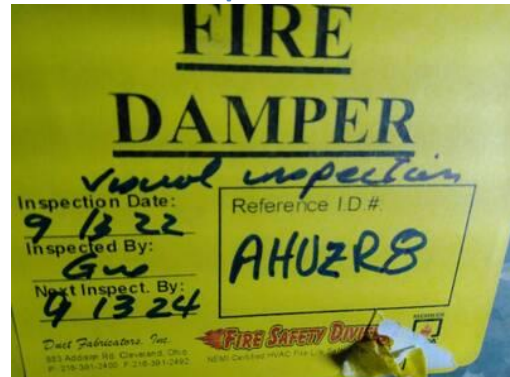

Duct Fabricators, Inc.

883 Addison Rd. Cleveland, Ohio
P: 216-391-2400 F: 216-391-2492



NEMI Certified HVAC Fire Life Safety Technicians



VISUAL CUYAHOGA COUNTY DAMPER INSPECTION REPORT

Date of Inspection

2022-09-14

Facility Location

Metzenbaum Center

Damper Location

Mechanical room

Inspector Name

Julie Gue

Damper I.D. #

AHU2-R9

Damper Type

Vertical Fire Damper

Damper Size

36X36

Damper Manufacturer

Unknown

Damper Model #

Unknown

Fusible Link Temperature

165 Degrees

Access Door Size

Open

Pass / Fail / Abandoned

Pass

Comments / Corrections

None


Exterior Picture of Damper



Interior Picture of Damper



Picture of Damper I.D. Label

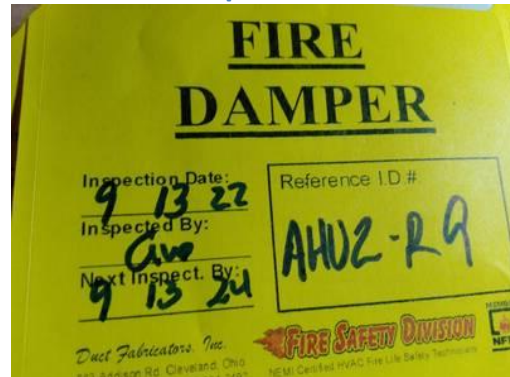

Duct Fabricators, Inc.
 883 Addison Rd. Cleveland, Ohio
 P: 216-391-2400 F: 216-391-2492



Fire / Smoke / Fire & Smoke Damper
Composite Inspection Report

	<u>FD/SD/FSD</u>	<u>I.D.#</u>	<u>Size</u>	<u>Manufacturer</u>	<u>Model</u>	<u>Visual</u>	<u>Functional</u>	<u>Comments</u>
1	FD	AHU1-R1	36x12	Unknown	Unknown	Pass	N/A	None
2	FD	AHU1-R2	24x10	Unknown	Unknown	Pass	N/A	None
3	FD	AHU1-R3	10x10	Unknown	Unknown	Pass	N/A	None
4	FD	AHU1-R4	32x12	Unknown	Unknown	Pass	N/A	None
5	FD	AHU1-R5	10x10	Unknown	Unknown	Pass	N/A	None
6	FD	AHU1-R6	36x36	Unknown	Unknown	Pass	N/A	None
7	FD	AHU1-R7	36x36	Unknown	Unknown	Pass	N/A	None
8	FD	AHU2-R1	24X10	Unknown	Unknown	Pass	N/A	None
9	FD	AHU2-R2	24X10	Unknown	Unknown	Pass	N/A	None
10	FD	AHU2-R3	36X12	Unknown	Unknown	Pass	N/A	None
11	FD	AHU2-R4	24X10	Unknown	Unknown	Pass	N/A	None
12	FD	AHU2-R5	24X10	Unknown	Unknown	Pass	N/A	None
13	FD	AHU2-R6	36X36	Unknown	Unknown	Pass	N/A	None
14	FD	AHU2-R7	36X36	Unknown	Unknown	Pass	N/A	None
15	FD	AHU2-R8	36X36	Unknown	Unknown	Pass	N/A	None
16	FD	AHU2-R9	36X36	Unknown	Unknown	Pass	N/A	None
17								
18								
19								
20								

Inspector: Julie Gue, Dan Tulcewicz
Inspection Dates: 9/13/2022
Facility: Metzenbaum Center

SA = Supply Air FD = Fire Damper
 RA = Return Air SD = Smoke Damper
 EA = Exhaust Air FSD = Fire Smoke Damper