

VISUAL CUYAHOGA COUNTY DAMPER INSPECTION REPORT

Date of Inspection

2022-09-15

Facility Location

Public Works

Damper Location

Electrical room

Inspector Name

Julie Gue

Damper I.D. #

PW AC1-S1

Damper Type

Vertical Fire Damper

Damper Size

12x10

Damper Manufacturer

Ruskin

Damper Model #

IBD2

Fusible Link Temperature

165 Degrees

Access Door Size

Open

Pass / Fail / Abandoned

Pass

Comments / Corrections

None


Exterior Picture of Damper



Interior Picture of Damper



Picture of Damper I.D. Label

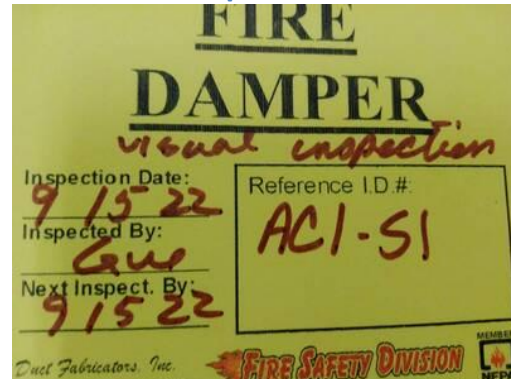

Duct Fabricators, Inc.
 883 Addison Rd. Cleveland, Ohio
 P: 216-391-2400 F:216-391-2492



Fire / Smoke / Fire & Smoke Damper
Composite Inspection Report

| | <u>FD/SD/FSD</u> | <u>I.D.#</u> | <u>Size</u> | <u>Manufacturer</u> | <u>Model</u> | <u>Visual</u> | <u>Functional</u> | <u>Comments</u> |
|----|------------------|--------------|-------------|---------------------|--------------|---------------|-------------------|-----------------|
| 1 | FD | PW AC1-S1 | 12x10 | Ruskin | IBD2 | Pass | N/A | None |
| 2 | FD | PW TA-1 | 18x12 | Ruskin | IBD2 | Pass | N/A | None |
| 3 | FD | PW TA-2 | 16x16 | Ruskin | IBD2 | Pass | N/A | None |
| 4 | | | | | | | | |
| 5 | | | | | | | | |
| 6 | | | | | | | | |
| 7 | | | | | | | | |
| 8 | | | | | | | | |
| 9 | | | | | | | | |
| 10 | | | | | | | | |
| 11 | | | | | | | | |
| 12 | | | | | | | | |
| 13 | | | | | | | | |
| 14 | | | | | | | | |
| 15 | | | | | | | | |
| 16 | | | | | | | | |
| 17 | | | | | | | | |
| 18 | | | | | | | | |
| 19 | | | | | | | | |
| 20 | | | | | | | | |

Inspector: Julie Gue/ Dan Tulcewicz
Inspection Dates: 15-Sep-23
Facility: Public Works

SA = Supply Air FD = Fire Damper
 RA = Return Air SD = Smoke Damper
 EA = Exhaust Air FSD = Fire Smoke Damper

Duct Fabricators, Inc.

883 Addison Rd. Cleveland, Ohio
P: 216-391-2400 F: 216-391-2492

 **FIRE SAFETY DIVISION**

NEMI Certified HVAC Fire Life Safety Technicians



Report Date: March 30, 2023

Project: Cuyahoga County
Public Works

Inspector(s):
Julianne Gue, Certified Technician
Dan Tulcewicz, Certified Technician

Inspection and Test Date(s):

September 15, 2022

Duct Fabricators, Inc. "Fire Safety Division" visually inspected Four Dampers for proper installation. The exterior and interior of each damper was photographed to confirm that the dampers were free of any obstructions or modifications.

Preventative maintenance was performed to enhance the longevity and reliability of the damper.

NOTES: NFPA 80 and NFPA 105 require newly installed dampers to be inspected and tested one year after initial installation. Thereafter, dampers located in patient care facilities are to be inspected and tested every six years.

Additionally, the information contained herein verified whether the dampers were functional at the time of testing. This verification process does not represent any form of a guarantee that the dampers will properly perform in the future.

Duct Fabricators, Inc.

883 Addison Rd. Cleveland, Ohio
P: 216-391-2400 F: 216-391-2492



NEMI Certified HVAC Fire Life Safety Technicians



VISUAL CUYAHOGA COUNTY DAMPER INSPECTION REPORT

Date of Inspection

2022-09-15

Facility Location

Public Works

Damper Location

Electrical room

Inspector Name

Julie Gue

Damper I.D.

PW TA 1

Damper Type

Vertical Fire Damper

Damper Size

18x12

Damper Manufacturer

Ruskin

Damper Model

IBD2

Fusible Link Temperature

165 Degrees

Access Door Size

Open

Pass / Fail / Abandoned

Pass

Comments / Corrections

None

Exterior Picture of Damper



Interior Picture of Damper



Picture of Damper I.D. Label



VISUAL CUYAHOGA COUNTY DAMPER INSPECTION REPORT

Date of Inspection

2022-09-15

Facility Location

Public Works

Damper Location

Office

Inspector Name

Julie Gue

Damper I.D. #

PW TA 2

Damper Type

Vertical Fire Damper

Damper Size

16x16

Damper Manufacturer

Ruskin

Damper Model #

IBD2

Fusible Link Temperature

165 Degrees

Access Door Size

Grille access

Pass / Fail / Abandoned

Pass

Comments / Corrections

None



Interior Picture of Damper



Picture of Damper I.D. Label



Exterior Picture of Damper

