

CUYAHOGA COUNTY DAMPER INSPECTION REPORT

Date of Inspection
2023-07-05

Facility Location
Virgil E Brown Center

Damper Location
Northeast

Inspector Name
Dan Tulcewicz

Damper I.D. #
AHUG.1-S9

Damper Type
Vertical Fire Damper

Damper Size
28x10

Damper Manufacturer
Ruskin

Damper Model #
IBD2

Fusible Link Temperature
212 Degrees

Access Door Size
16x16

Pass / Fail / Abandoned
Pass

Comments / Corrections
None


Picture of Damper in Open Position



Picture of Damper in Closed Position



Picture of Damper I.D. Label



CUYAHOGA COUNTY DAMPER INSPECTION REPORT

Date of Inspection
2023-06-28

Facility Location
Virgil E Brown Center

Damper Location
North

Inspector Name
Dan Tulcewicz

Damper I.D. #
AHU1.1-RA

Damper Type
Vertical Fire Damper

Damper Size
96"x60"

Damper Manufacturer
Ruskin

Damper Model #
IBD2

Fusible Link Temperature
165 Degrees

Access Door Size
Open

Pass / Fail / Abandoned
Pass

Comments / Corrections
None


Picture of Damper in Open Position



Picture of Damper in Closed Position



Picture of Damper I.D. Label

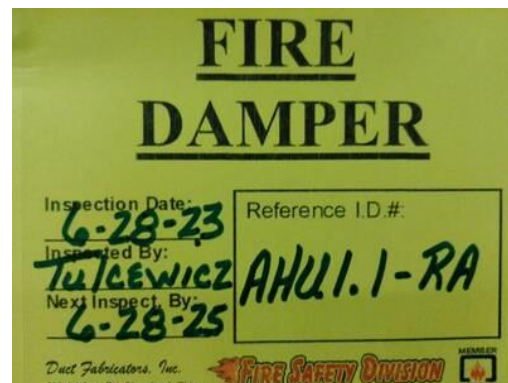

CUYAHOGA COUNTY DAMPER INSPECTION REPORT

Date of Inspection

2023-06-27

Facility Location

Virgil E Brown Center

Damper Location

North

Inspector Name

Dan Tulcewicz

Damper I.D. #

AHU1.1-S1

Damper Type

Vertical Fire Damper

Damper Size

56" x 16"

Damper Manufacturer

Ruskin

Damper Model #

IBD2

Fusible Link Temperature

212 Degrees

Access Door Size

18" x 18"

Pass / Fail / Abandoned

Pass

Comments / Corrections

None

Picture of Damper in Open Position



Picture of Damper in Closed Position



Picture of Damper I.D. Label

<u>FIRE</u>	
<u>DAMPER</u>	
Inspection Date: 6-27-23	Reference I.D. #:
Inspected By: Tulcewicz	AHU1.1-S1
Next Inspect. By: 6-27-25	
<small>Duct Fabricators, Inc. 883 Addison Rd. Cleveland, Ohio P. 216-391-2400 F. 216-391-2492</small>	
FIRE SAFETY DIVISION <small>NEMI Certified HVAC Fire Life Safety Technicians</small>	
<small>MEMBER</small> NFPA	

CUYAHOGA COUNTY DAMPER INSPECTION REPORT

Date of Inspection

2023-06-27

Facility Location

Virgil E Brown Center

Damper Location

North

Inspector Name

Dan Tulcewicz

Damper I.D. #

AHU1.1-S2

Damper Type

Vertical Fire Damper

Damper Size

56" x 16"

Damper Manufacturer

Ruskin

Damper Model #

IBD2

Fusible Link Temperature

212 Degrees

Access Door Size

18" x 18"

Pass / Fail / Abandoned

Pass

Comments / Corrections

None


Picture of Damper in Open Position



Picture of Damper in Closed Position



Picture of Damper I.D. Label



CUYAHOGA COUNTY DAMPER INSPECTION REPORT

Date of Inspection
2023-06-27

Facility Location
Virgil E Brown Center

Damper Location
1st floor North.

Inspector Name
Dan Tulcewicz

Damper I.D. #
AHU1.1-S3

Damper Type
Vertical Fire Damper

Damper Size
12"x9" Oval

Damper Manufacturer
Ruskin

Damper Model #
IBD2

Fusible Link Temperature
212 Degrees

Access Door Size
18"x18"

Pass / Fail / Abandoned
Pass

Comments / Corrections
Picture of wrong label.
Damper is S3

Picture of Damper in Open Position



Picture of Damper in Closed Position



Picture of Damper I.D. Label



CUYAHOGA COUNTY DAMPER INSPECTION REPORT

Date of Inspection

2023-06-27

Facility Location

Virgil E Brown Center

Damper Location

North

Inspector Name

Dan Tulcewicz

Damper I.D. #

AHU1.1-S5

Damper Type

Vertical Fire Damper

Damper Size

11" x 8" Oval

Damper Manufacturer

Ruskin

Damper Model #

IBD2

Fusible Link Temperature

212 Degrees

Access Door Size

18" x 18"


Pass / Fail / Abandoned

Pass

Comments / Corrections

None

Picture of Damper in Open Position



Picture of Damper in Closed Position



Picture of Damper I.D. Label

FIRE DAMPER

Inspection Date: **6-27-23** Reference I.D.#: **AHU1.1-S5**
Inspected By: **Tulcewicz**
Next Inspect. By: **6-27-25**

Duct Fabricators, Inc.
883 Addison Rd. Cleveland, Ohio
P: 216-391-2400 F: 216-391-2492

FIRE SAFETY DIVISION
NEMI Certified HVAC Fire Life Safety Technicians

MEMBER
NFPA

CUYAHOGA COUNTY DAMPER INSPECTION REPORT

Date of Inspection
2023-06-27

Facility Location
Virgil E Brown Center

Damper Location
North.

Inspector Name
Dan Tulcewicz

Damper I.D. #
AHU1.1-S6

Damper Type
Vertical Fire Damper

Damper Size
56" x 18"

Damper Manufacturer
Ruskin

Damper Model #
IBD2

Fusible Link Temperature
212 Degrees

Access Door Size
18" x 18"

Pass / Fail / Abandoned
Pass

Comments / Corrections
None

Picture of Damper in Open Position



Picture of Damper in Closed Position



Picture of Damper I.D. Label

FIRE DAMPER

Inspection Date: 6-27-23
Inspected By: Tulcewicz
Next Inspect. By: 6-27-25

Reference I.D.#: AHU1.1-S6

Duct Fabricators, Inc.
883 Addison Rd. Cleveland, Ohio
P: 216-391-2400 F: 216-391-2492

FIRE SAFETY DIVISION
NEMI Certified HVAC Fire Life Safety Technicians

MEMBER
NFPA

CUYAHOGA COUNTY DAMPER INSPECTION REPORT

Date of Inspection
2023-06-27

Facility Location
Virgil E Brown Center

Damper Location
North.

Inspector Name
Dan Tulcewicz

Damper I.D. #
AHU1.1-S8

Damper Type
Vertical Fire Damper

Damper Size
6" Round

Damper Manufacturer
Ruskin

Damper Model #
IBD2

Fusible Link Temperature
212 Degrees

Access Door Size
18"x18"

Pass / Fail / Abandoned
Pass

Comments / Corrections
None

Picture of Damper in Open Position



Picture of Damper in Closed Position



Picture of Damper I.D. Label



CUYAHOGA COUNTY DAMPER INSPECTION REPORT

Date of Inspection
2023-06-27

Facility Location
Virgil E Brown Center

Damper Location
North

Inspector Name
Dan Tulcewicz

Damper I.D. #
AHU1.1-S9

Damper Type
Vertical Fire Damper

Damper Size
56" x 16"

Damper Manufacturer
Ruskin

Damper Model #
IBD2

Fusible Link Temperature
212 Degrees

Access Door Size
18" x 18"

Pass / Fail / Abandoned
Pass

Comments / Corrections
None


Picture of Damper in Open Position



Picture of Damper in Closed Position



Picture of Damper I.D. Label



CUYAHOGA COUNTY DAMPER INSPECTION REPORT

Date of Inspection
2023-06-27

Picture of Damper in Open Position

Facility Location
Virgil E Brown Center



Damper Location
North

Inspector Name
Dan Tulcewicz

Damper I.D. #
AHU1.1-S10

Picture of Damper in Closed Position

Damper Type
Vertical Fire Damper



Damper Size
8" x 12"

Damper Manufacturer
Ruskin

Damper Model #
IBD2

Fusible Link Temperature
212 Degrees

Picture of Damper I.D. Label

Access Door Size
Open

Pass / Fail / Abandoned
Pass

Comments / Corrections
None



CUYAHOGA COUNTY DAMPER INSPECTION REPORT

Date of Inspection
2023-06-27

Facility Location
Virgil E Brown Center

Damper Location
North

Inspector Name
Dan Tulcewicz

Damper I.D. #
AHU1.1-S11

Damper Type
Vertical Fire Damper

Damper Size
56" x 16"

Damper Manufacturer
Ruskin

Damper Model #
IBD2

Fusible Link Temperature
212 Degrees

Access Door Size
18" x 18"

Pass / Fail / Abandoned
Pass

Comments / Corrections
None

Picture of Damper in Open Position



Picture of Damper in Closed Position



Picture of Damper I.D. Label

FIRE DAMPER

Inspection Date: 6-27-23
Inspected By: Tulcewicz
Next Inspect. By: 6-27-25

Reference I.D.#: AHU1.1-S11

Duct Fabricators, Inc.
883 Addison Rd. Cleveland, Ohio
P: 216-391-2400 F: 216-391-2492

FIRE SAFETY DIVISION
NEMI Certified HVAC Fire Life Safety Technicians

MEMBER
NFPA

CUYAHOGA COUNTY DAMPER INSPECTION REPORT

Date of Inspection
2023-06-28

Facility Location
Virgil E Brown Center

Damper Location
South

Inspector Name
Dan Tulcewicz

Damper I.D. #
AHU1.2-OA

Damper Type
Vertical Fire Damper

Damper Size
96"x24"

Damper Manufacturer
Ruskin

Damper Model #
IBD2

Fusible Link Temperature
212 Degrees

Access Door Size
16"x16"

Pass / Fail / Abandoned
Pass

Comments / Corrections
None


Picture of Damper in Open Position



Picture of Damper in Closed Position



Picture of Damper I.D. Label



CUYAHOGA COUNTY DAMPER INSPECTION REPORT

Date of Inspection
2023-06-28

Facility Location
Virgil E Brown Center

Damper Location
South

Inspector Name
Dan Tulcewicz

Damper I.D. #
AHU1.2-RA

Damper Type
Vertical Fire Damper

Damper Size
96"x60"

Damper Manufacturer
Ruskin

Damper Model #
IBD2

Fusible Link Temperature
165 Degrees

Access Door Size
Open

Pass / Fail / Abandoned
Pass

Comments / Corrections
None


Picture of Damper in Open Position



Picture of Damper in Closed Position



Picture of Damper I.D. Label



CUYAHOGA COUNTY DAMPER INSPECTION REPORT

Date of Inspection
2023-06-28

Facility Location
Virgil E Brown Center

Damper Location
South

Inspector Name
Dan Tulcewicz

Damper I.D. #
AHU1.2-S1

Damper Type
Vertical Fire Damper

Damper Size
36"x8"

Damper Manufacturer
Ruskin

Damper Model #
IBD2

Fusible Link Temperature
212 Degrees

Access Door Size
12"x12"

Pass / Fail / Abandoned
Pass

Comments / Corrections
None

Picture of Damper in Open Position



Picture of Damper in Closed Position



Picture of Damper I.D. Label



CUYAHOGA COUNTY DAMPER INSPECTION REPORT

Date of Inspection

2023-06-28

Facility Location

Virgil E Brown Center

Damper Location

South

Inspector Name

Dan Tulcewicz

Damper I.D. #

AHU1.2-S2

Damper Type

Vertical Fire Damper

Damper Size

36"x8"

Damper Manufacturer

Ruskin

Damper Model #

IBD2

Fusible Link Temperature

212 Degrees

Access Door Size

12"x12"

Pass / Fail / Abandoned

Pass

Comments / Corrections

None

Picture of Damper in Open Position



Picture of Damper in Closed Position



Picture of Damper I.D. Label



CUYAHOGA COUNTY DAMPER INSPECTION REPORT

Date of Inspection
2023-06-26

Facility Location
Virgil E Brown Center

Damper Location
South.

Inspector Name
Dan Tulcewicz

Damper I.D. #
AHU1.2-S3

Damper Type
Vertical Fire Damper

Damper Size
56"x16"

Damper Manufacturer
Ruskin

Damper Model #
IBD2

Fusible Link Temperature
212 Degrees

Access Door Size
18"x18"

Pass / Fail / Abandoned
Pass

Comments / Corrections
None


Picture of Damper in Open Position



Picture of Damper in Closed Position



Picture of Damper I.D. Label



CUYAHOGA COUNTY DAMPER INSPECTION REPORT

Date of Inspection
2023-06-26

Facility Location
Virgil E Brown Center

Damper Location
South.

Inspector Name
Dan Tulcewicz

Damper I.D. #
AHU1.2-S4

Damper Type
Vertical Fire Damper

Damper Size
56"x16"

Damper Manufacturer
Ruskin

Damper Model #
IBD2

Fusible Link Temperature
212 Degrees

Access Door Size
18"x18"

Pass / Fail / Abandoned
Pass

Comments / Corrections
None


Picture of Damper in Open Position



Picture of Damper in Closed Position



Picture of Damper I.D. Label



Duct Fabricators, Inc.

883 Addison Rd. Cleveland, Ohio
P: 216-391-2400 F: 216-391-2492

FIRE SAFETY DIVISION

NEMI Certified HVAC Fire Life Safety Technicians



CUYAHOGA COUNTY DAMPER INSPECTION REPORT

Date of Inspection

2023-06-27

Facility Location

Virgil E Brown Center

Damper Location

1st floor South.

Inspector Name

Dan Tulcewicz

Damper I.D.

AHU1.2-S5

Damper Type

Vertical Fire Damper

Damper Size

8"x12"

Damper Manufacturer

Ruskin

Damper Model

IBD2

Fusible Link Temperature

212 Degrees

Access Door Size

Open

Pass / Fail / Abandoned

Pass

Comments / Corrections

None

Picture of Damper in Open Position



Picture of Damper in Closed Position



Picture of Damper I.D. Label



CUYAHOGA COUNTY DAMPER INSPECTION REPORT

Date of Inspection
2023-06-26

Facility Location
Virgil E Brown Center

Damper Location
South .

Inspector Name
Dan Tulcewicz

Damper I.D. #
AHU1.2-S6

Damper Type
Vertical Fire Damper

Damper Size
17"x8"

Damper Manufacturer
Ruskin

Damper Model #
IBD2

Fusible Link Temperature
212 Degrees

Access Door Size
18"x18"

Pass / Fail / Abandoned
Pass

Comments / Corrections
None


Picture of Damper in Open Position



Picture of Damper in Closed Position



Picture of Damper I.D. Label



CUYAHOGA COUNTY DAMPER INSPECTION REPORT

Date of Inspection
2023-06-26

Facility Location
Virgil E Brown Center

Damper Location
South

Inspector Name
Dan Tulcewicz

Damper I.D. #
AHU1.2-S7

Damper Type
Vertical Fire Damper

Damper Size
17"x8"

Damper Manufacturer
Ruskin

Damper Model #
IBD2

Fusible Link Temperature
212 Degrees

Access Door Size
18"x18"

Pass / Fail / Abandoned
Pass

Comments / Corrections
None

Picture of Damper in Open Position



Picture of Damper in Closed Position



Picture of Damper I.D. Label



CUYAHOGA COUNTY DAMPER INSPECTION REPORT

Date of Inspection
2023-06-26

Facility Location
Virgil E Brown Center

Damper Location
South.

Inspector Name
Dan Tulcewicz

Damper I.D. #
AHU1.2-S8

Damper Type
Vertical Fire Damper

Damper Size
14"x8" oval

Damper Manufacturer
Ruskin

Damper Model #
IBD2

Fusible Link Temperature
212 Degrees

Access Door Size
18"x18"


Pass / Fail / Abandoned
Pass

Comments / Corrections
None

Picture of Damper in Open Position



Picture of Damper in Closed Position



Picture of Damper I.D. Label

<u>FIRE</u>	
<u>DAMPER</u>	
Inspection Date: 6-26-23	Reference I.D.#:
Inspected By: TULCEWICZ	AHU1.2-S8
Next Inspect. By: 6-26-25	

Duct Fabricators, Inc.
883 Addison Rd. Cleveland, Ohio
P: 216-391-2400 F: 216-391-2492

FIRE SAFETY DIVISION
NEMI Certified HVAC Fire Life Safety Technicians

MEMBER
NFPA

CUYAHOGA COUNTY DAMPER INSPECTION REPORT

Date of Inspection
2023-06-26

Facility Location
Virgil E Brown Center

Damper Location
South

Inspector Name
Dan Tulcewicz

Damper I.D. #
AHU1.2-S9

Damper Type
Vertical Fire Damper

Damper Size
17"x8"

Damper Manufacturer
Ruskin

Damper Model #
IBD2

Fusible Link Temperature
212 Degrees

Access Door Size
18"x18"


Pass / Fail / Abandoned
Pass

Comments / Corrections
None


Picture of Damper in Open Position



Picture of Damper in Closed Position



Picture of Damper I.D. Label



Duct Fabricators, Inc.

883 Addison Rd. Cleveland, Ohio
P: 216-391-2400 F:216-391-2492

FIRE SAFETY DIVISION

NEMI Certified HVAC Fire Life Safety Technicians



CUYAHOGA COUNTY DAMPER INSPECTION REPORT

Date of Inspection

2023-06-26

Facility Location

Virgil E Brown Center

Damper Location

South.

Inspector Name

Dan Tulcewicz

Damper I.D. #

AHU1.2-S10

Damper Type

Vertical Fire Damper

Damper Size

16"x10"

Damper Manufacturer

Ruskin

Damper Model #

IBD2

Fusible Link Temperature

212 Degrees

Access Door Size

18"x18"

Pass / Fail / Abandoned

Pass

Comments / Corrections

None


Picture of Damper in Open Position



Picture of Damper in Closed Position



Picture of Damper I.D. Label



CUYAHOGA COUNTY DAMPER INSPECTION REPORT

Date of Inspection

2023-06-26

Facility Location

Virgil E Brown Center

Damper Location

South.

Inspector Name

Dan Tulcewicz

Damper I.D. #

AHU1.2-S11

Damper Type

Vertical Fire Damper

Damper Size

36"x16"

Damper Manufacturer

Ruskin

Damper Model #

IBD2

Fusible Link Temperature

212 Degrees

Access Door Size

18"x18"

Pass / Fail / Abandoned

Pass

Comments / Corrections

None

Picture of Damper in Open Position



Picture of Damper in Closed Position



Picture of Damper I.D. Label

FIRE DAMPER

Inspection Date: 6-26-23	Reference I.D.#:
Inspected By: Tulcewicz	AHU1.2-S11
Next Inspect. By: 6-26-25	

Duct Fabricators, Inc.
883 Addison Rd. Cleveland, Ohio
P: 216-391-2400 F:216-391-2492

FIRE SAFETY DIVISION
NEMI Certified HVAC Fire Life Safety Technicians

MEMBER
NFPA

CUYAHOGA COUNTY DAMPER INSPECTION REPORT

Date of Inspection
2023-06-26

Facility Location
Virgil E Brown Center

Damper Location
South.

Inspector Name
Dan Tulcewicz

Damper I.D. #
AHU1.2-S12

Damper Type
Vertical Fire Damper

Damper Size
42"x16"

Damper Manufacturer
Ruskin

Damper Model #
IBD2

Fusible Link Temperature
212 Degrees

Access Door Size
Open

Pass / Fail / Abandoned
Pass

Comments / Corrections
None

Picture of Damper in Open Position



Picture of Damper in Closed Position



Picture of Damper I.D. Label

FIRE DAMPER	
Inspection Date: 6-26-23	Reference I.D. #:
Inspected By: Tulcewicz	AHU1.2-S12
Next Inspect. By: 6-26-25	

Duct Fabricators, Inc. 883 Addison Rd. Cleveland, Ohio P: 216-391-2400 F: 216-391-2492

FIRE SAFETY DIVISION
NEMI Certified HVAC Fire Life Safety Technicians

MEMBER
NFPA

CUYAHOGA COUNTY DAMPER INSPECTION REPORT

Date of Inspection
2023-06-27

Facility Location
Virgil E Brown Center

Damper Location
South.

Inspector Name
Dan Tulcewicz

Damper I.D. #
AHU1.2-S13

Damper Type
Vertical Fire Damper

Damper Size
42"x16"

Damper Manufacturer
Ruskin

Damper Model #
IBD2

Fusible Link Temperature
212 Degrees

Access Door Size
Open

Pass / Fail / Abandoned
Pass

Comments / Corrections
None

Picture of Damper in Open Position



Picture of Damper in Closed Position



Picture of Damper I.D. Label

FIRE DAMPER

Inspection Date: 6-27-23
Inspected By: TULCEWICZ
Next Inspect. By: 6-27-25

Reference I.D. #: AHU1.2-S13

Duct Fabricators, Inc.
883 Addison Rd. Cleveland, Ohio
P: 216-391-2400 F: 216-391-2492

FIRE SAFETY DIVISION
NEMI Certified HVAC Fire Life Safety Technicians

MEMBER
NFPA

CUYAHOGA COUNTY DAMPER INSPECTION REPORT

Date of Inspection
2023-06-27

Facility Location
Virgil E Brown Center

Damper Location
South.

Inspector Name
Dan Tulcewicz

Damper I.D. #
AHU1.2-S14

Damper Type
Vertical Fire Damper

Damper Size
36"x16"

Damper Manufacturer
Ruskin

Damper Model #
IBD2

Fusible Link Temperature
212 Degrees

Access Door Size
16"x16"

Pass / Fail / Abandoned
Pass

Comments / Corrections
None

Picture of Damper in Open Position



Picture of Damper in Closed Position



Picture of Damper I.D. Label

FIRE DAMPER	
Inspection Date: 6-27-23	Reference I.D.#: AHU1.2-S14
Inspected By: TULCEWICZ	
Next Inspect. By: 6-27-25	

Duct Fabricators, Inc. 883 Addison Rd. Cleveland, Ohio P: 216-391-2400 F: 216-391-2492

FIRE SAFETY DIVISION NEMI Certified HVAC Fire Life Safety Technicians

MEMBER **NFPA**

CUYAHOGA COUNTY DAMPER INSPECTION REPORT

Date of Inspection
2023-06-27

Facility Location
Virgil E Brown Center

Damper Location
South Protective Services.

Inspector Name
Dan Tulcewicz

Damper I.D. #
AHU1.2-S15

Damper Type
Vertical Fire Damper

Damper Size
28"x10"

Damper Manufacturer
Ruskin

Damper Model #
IBD2

Fusible Link Temperature
212 Degrees

Access Door Size
20"x20"

Pass / Fail / Abandoned
Pass

Comments / Corrections
None

Picture of Damper in Open Position



Picture of Damper in Closed Position



Picture of Damper I.D. Label

FIRE DAMPER

Inspection Date: 6-27-23
Inspected By: Tulcewicz
Next Inspect. By: 6-27-25

Reference I.D. #: AHU1.2-S15

Duct Fabricators, Inc.
883 Addison Rd. Cleveland, Ohio
P: 216-391-2400 F: 216-391-2492

FIRE SAFETY DIVISION
NEMI Certified HVAC Fire Life Safety Technicians

MEMBER
NFPA

CUYAHOGA COUNTY DAMPER INSPECTION REPORT

Date of Inspection

2023-06-27

Facility Location

Virgil E Brown Center

Damper Location

Protective Services.

Inspector Name

Dan Tulcewicz

Damper I.D. #

AHU1.2-S16

Damper Type

Vertical Fire Damper

Damper Size

28"x10"

Damper Manufacturer

Ruskin

Damper Model #

IBD2

Fusible Link Temperature

212 Degrees

Access Door Size

12"x12"

Pass / Fail / Abandoned

Pass

Comments / Corrections

None


Picture of Damper in Open Position



Picture of Damper in Closed Position



Picture of Damper I.D. Label



CUYAHOGA COUNTY DAMPER INSPECTION REPORT

Date of Inspection
2023-06-27

Facility Location
Virgil E Brown Center

Damper Location
Protective Services.

Inspector Name
Dan Tulcewicz

Damper I.D. #
AHU1.2-S17

Damper Type
Vertical Fire Damper

Damper Size
18"x10"

Damper Manufacturer
Ruskin

Damper Model #
IBD2

Fusible Link Temperature
212 Degrees

Access Door Size
8"x8"

Pass / Fail / Abandoned
Pass

Comments / Corrections
None

Picture of Damper in Open Position



Picture of Damper in Closed Position



Picture of Damper I.D. Label

FIRE DAMPER

Inspection Date: 6-27-23
Inspected By: Tulcewicz
Next Inspect. By: 6-27-25

Reference I.D.#: AHU1.2-S17

Duct Fabricators, Inc.
883 Addison Rd. Cleveland, Ohio
P: 216-391-2400 F: 216-391-2492

FIRE SAFETY DIVISION
NEMI Certified HVAC Fire Life Safety Technicians

MEMBER
NFPA

CUYAHOGA COUNTY DAMPER INSPECTION REPORT

Date of Inspection

2023-06-26

Facility Location

Virgil E Brown Center

Damper Location

South.

Inspector Name

Dan Tulcewicz

Damper I.D. #

AHU-1.2-S18

Damper Type

Vertical Fire Damper

Damper Size

56"x16"

Damper Manufacturer

Ruskin

Damper Model #

IBD2

Fusible Link Temperature

212 Degrees

Access Door Size

18"x18"

Pass / Fail / Abandoned

Pass

Comments / Corrections

None

Picture of Damper in Open Position



Picture of Damper in Closed Position



Picture of Damper I.D. Label



CUYAHOGA COUNTY DAMPER INSPECTION REPORT

Date of Inspection
2023-06-27

Facility Location
Virgil E Brown Center

Damper Location
South

Inspector Name
Dan Tulcewicz

Damper I.D. #
AHU1.2-S19

Damper Type
Vertical Fire Damper

Damper Size
8"x12"

Damper Manufacturer
Ruskin

Damper Model #
IBD2

Fusible Link Temperature
212 Degrees

Access Door Size
Open

Pass / Fail / Abandoned
Pass

Comments / Corrections
None

Picture of Damper in Open Position



Picture of Damper in Closed Position



Picture of Damper I.D. Label

<u>FIRE</u> <u>DAMPER</u>	
Inspection Date: 6-27-23	Reference I.D.#: AHU1.2-S19
Inspected By: TULCEWICZ	
Next Inspect. By: 6-27-25	
<small>Duct Fabricators, Inc. 883 Addison Rd. Cleveland, Ohio P: 216-391-2400 F: 216-391-2492</small>	
FIRE SAFETY DIVISION MEMBER	

CUYAHOGA COUNTY DAMPER INSPECTION REPORT

Date of Inspection
2023-06-26

Facility Location
Virgil E Brown Center

Damper Location
South.

Inspector Name
Dan Tulcewicz

Damper I.D. #
AHU1.2-S20

Damper Type
Vertical Fire Damper

Damper Size
56"x16"

Damper Manufacturer
Ruskin

Damper Model #
IBD2

Fusible Link Temperature
212 Degrees

Access Door Size
18"x18"

Pass / Fail / Abandoned
Pass

Comments / Corrections
None

Picture of Damper in Open Position



Picture of Damper in Closed Position



Picture of Damper I.D. Label



CUYAHOGA COUNTY DAMPER INSPECTION REPORT

Date of Inspection
2023-06-28

Facility Location
Virgil E Brown Center

Damper Location
South

Inspector Name
Dan Tulcewicz

Damper I.D. #
AHU-1.2-S21

Damper Type
Vertical Fire Damper

Damper Size
8" Round

Damper Manufacturer
Ruskin

Damper Model #
IBD2

Fusible Link Temperature
212 Degrees

Access Door Size
8"x6"


Pass / Fail / Abandoned
Pass

Comments / Corrections
None

Picture of Damper in Open Position



Picture of Damper in Closed Position



Picture of Damper I.D. Label

FIRE DAMPER	
Inspection Date: 6-28-23	Reference I.D.#: AHU1.2-S21
Inspected By: TULCEWICZ	
Next Inspect. By: 6-28-25	
<small>Duct Fabricators, Inc. 883 Addison Rd. Cleveland, Ohio P: 216-391-2400 F: 216-391-2492</small>	
FIRE SAFETY DIVISION <small>NEMI Certified HVAC Fire Life Safety Technicians</small>	
<small>MEMBER</small> NFPA	

CUYAHOGA COUNTY DAMPER INSPECTION REPORT

Date of Inspection

2023-06-23

Facility Location

Virgil E Brown Center

Damper Location

North mechanical room

Inspector Name

Dan Tulcewicz

Damper I.D. #

AHU2.1-OA

Damper Type

Vertical Fire Damper

Damper Size

96"x24"

Damper Manufacturer

Ruskin

Damper Model #

IBD2

Fusible Link Temperature

165 Degrees

Access Door Size

16"x16"

Pass / Fail / Abandoned

Pass

Comments / Corrections

None


Picture of Damper in Open Position



Picture of Damper in Closed Position



Picture of Damper I.D. Label



Duct Fabricators, Inc.

883 Addison Rd. Cleveland, Ohio
P: 216-391-2400 F: 216-391-2492



NEMI Certified HVAC Fire Life Safety Technicians



CUYAHOGA COUNTY DAMPER INSPECTION REPORT

Date of Inspection

2023-06-23

Facility Location

Virgil E Brown Center

Damper Location

North mechanical room

Inspector Name

Dan Tulcewicz

Damper I.D.

AHU2.1-RA

Damper Type

Vertical Fire Damper

Damper Size

96"x60"

Damper Manufacturer

Ruskin

Damper Model

IBD2

Fusible Link Temperature

165 Degrees

Access Door Size

Open

Pass / Fail / Abandoned

Pass

Comments / Corrections

None


Picture of Damper in Open Position



Picture of Damper in Closed Position



Picture of Damper I.D. Label



CUYAHOGA COUNTY DAMPER INSPECTION REPORT

Date of Inspection
2023-06-22

Facility Location
Virgil E Brown Center

Damper Location
NE corridor

Inspector Name
Julie Gue

Damper I.D. #
AHU2.1-S1

Damper Type
Vertical Fire Damper

Damper Size
56" x 16"

Damper Manufacturer
Ruskin

Damper Model #
IBD2

Fusible Link Temperature
212 Degrees

Access Door Size
18" x 18"

Pass / Fail / Abandoned
Pass

Comments / Corrections
None

Picture of Damper in Open Position



Picture of Damper in Closed Position



Picture of Damper I.D. Label

FIRE DAMPER	
Inspection Date: 6 23 23	Reference I.D.#: AHU 2.1
Inspected By: GW	S1
Next Inspect. By: 6 22 25	

Duct Fabricators, Inc. 883 Addison Rd. Cleveland, Ohio P: 216-391-2400 F: 216-391-2492

FIRE SAFETY DIVISION
NEMI Certified HVAC Fire Life Safety Technicians

MEMBER
NFPA

CUYAHOGA COUNTY DAMPER INSPECTION REPORT

Date of Inspection
2023-06-23

Facility Location
Virgil E Brown Center

Damper Location
North

Inspector Name
Dan Tulcewicz

Damper I.D. #
AHU2.1-S2

Damper Type
Vertical Fire Damper

Damper Size
14" x 8" Oval

Damper Manufacturer
Ruskin

Damper Model #
IBD2

Fusible Link Temperature
212 Degrees

Access Door Size
Remove the flex.


Pass / Fail / Abandoned
Pass

Comments / Corrections
None

Picture of Damper in Open Position



Picture of Damper in Closed Position



Picture of Damper I.D. Label

FIRE DAMPER

Inspection Date: 6-23-23
Inspected By: Tulcewicz
Next Inspect. By: 6-23-25

Reference I.D.#: AHU 2.1-S2

Duct Fabricators, Inc.
883 Addison Rd. Cleveland, Ohio
P. 216-391-2400 F.216-391-2492

FIRE SAFETY DIVISION
NEMI Certified HVAC Fire Life Safety Technicians

MEMBER
NFPA

CUYAHOGA COUNTY DAMPER INSPECTION REPORT

Date of Inspection

2023-06-22

Facility Location

Virgil E Brown Center

Damper Location

NE Corridor

Inspector Name

Julie Gue

Damper I.D. #

AHU2.1-S3

Damper Type

Vertical Fire Damper

Damper Size

56" x 16"

Damper Manufacturer

Ruskin

Damper Model #

IBD2

Fusible Link Temperature

212 Degrees

Access Door Size

18" x 18"

Pass / Fail / Abandoned

Pass

Comments / Corrections

None

Picture of Damper in Open Position



Picture of Damper in Closed Position



Picture of Damper I.D. Label



CUYAHOGA COUNTY DAMPER INSPECTION REPORT

Date of Inspection
2023-06-23

Facility Location
Virgil E Brown Center

Damper Location
North Com Room

Inspector Name
Dan Tulcewicz

Damper I.D. #
AHU2.1-S4

Damper Type
Vertical Fire Damper

Damper Size
8" x 12"

Damper Manufacturer
Ruskin

Damper Model #
IBD2

Fusible Link Temperature
212 Degrees

Access Door Size
Open

Pass / Fail / Abandoned
Pass

Comments / Corrections
None

Picture of Damper in Open Position



Picture of Damper in Closed Position



Picture of Damper I.D. Label



CUYAHOGA COUNTY DAMPER INSPECTION REPORT

Date of Inspection
2023-06-22

Facility Location
Virgil E Brown Center

Damper Location
NE Corridor

Inspector Name
Julie Gue

Damper I.D. #
AHU2.1-S5

Damper Type
Vertical Fire Damper

Damper Size
6" Round

Damper Manufacturer
Ruskin

Damper Model #
IBD2

Fusible Link Temperature
212 Degrees

Access Door Size
24" x 24"


Pass / Fail / Abandoned
Pass

Comments / Corrections
None

Picture of Damper in Open Position



Picture of Damper in Closed Position

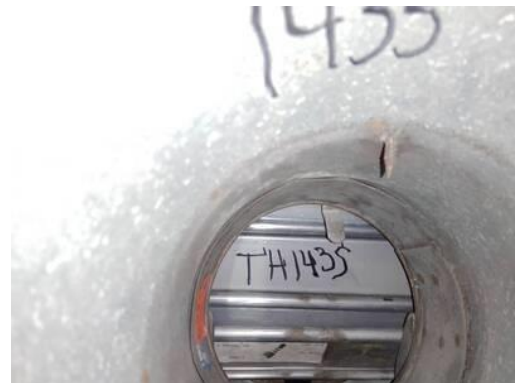

Picture of Damper I.D. Label

FIRE DAMPER	
Inspection Date: 6-22-23	Reference I.D. #: AHU2.1-S5
Inspected By: T. IGWIEZ	
Next Inspect. By: 6-22-25	

Duct Fabricators, Inc. **FIRE SAFETY DIVISION** MEMBER
883 Addison Rd. Cleveland, Ohio NEMI Certified HVAC Fire Life Safety Technicians **NFPA**

CUYAHOGA COUNTY DAMPER INSPECTION REPORT

Date of Inspection
2023-06-22

Facility Location
Virgil E Brown Center

Damper Location
NE Corridor

Inspector Name
Julie Gue

Damper I.D. #
AHU2.1-S6

Damper Type
Vertical Fire Damper

Damper Size
20" x 8" Oval

Damper Manufacturer
Ruskin

Damper Model #
IBD2

Fusible Link Temperature
212 Degrees

Access Door Size
18" x 18"

Pass / Fail / Abandoned
Pass

Comments / Corrections
None

Picture of Damper in Open Position



Picture of Damper in Closed Position



Picture of Damper I.D. Label



CUYAHOGA COUNTY DAMPER INSPECTION REPORT

Date of Inspection
2023-06-22

Facility Location
Virgil E Brown Center

Damper Location
NE Corridor

Inspector Name
Julie Gue

Damper I.D. #
AHU2.1-S7

Damper Type
Vertical Fire Damper

Damper Size
28" x 10'

Damper Manufacturer
Ruskin

Damper Model #
IBD2

Fusible Link Temperature
212 Degrees

Access Door Size
18" x 18"

Pass / Fail / Abandoned
Pass

Comments / Corrections
None


Picture of Damper in Open Position



Picture of Damper in Closed Position



Picture of Damper I.D. Label



CUYAHOGA COUNTY DAMPER INSPECTION REPORT

Date of Inspection
2023-06-22

Facility Location
Virgil E Brown Center

Damper Location
North Corridor

Inspector Name
Julie Gue

Damper I.D. #
AHU2.1-S9

Damper Type
Vertical Fire Damper

Damper Size
10" Round

Damper Manufacturer
Ruskin

Damper Model #
IBD2

Fusible Link Temperature
212 Degrees

Access Door Size
16" x 16"

Pass / Fail / Abandoned
Pass

Comments / Corrections
None

Picture of Damper in Open Position



Picture of Damper in Closed Position



Picture of Damper I.D. Label



CUYAHOGA COUNTY DAMPER INSPECTION REPORT

Date of Inspection
2023-06-22

Facility Location
Virgil E Brown Center

Damper Location
North Corridor

Inspector Name
Julie Gue

Damper I.D. #
AHU2.1-S10

Damper Type
Vertical Fire Damper

Damper Size
8" Round

Damper Manufacturer
Ruskin

Damper Model #
IBD2

Fusible Link Temperature
212 Degrees

Access Door Size
18" x 18"

Pass / Fail / Abandoned
Pass

Comments / Corrections
None

Picture of Damper in Open Position



Picture of Damper in Closed Position



Picture of Damper I.D. Label



CUYAHOGA COUNTY DAMPER INSPECTION REPORT

Date of Inspection
2023-06-23

Facility Location
Virgil E Brown Center

Damper Location
North

Inspector Name
Dan Tulcewicz

Damper I.D. #
AHU2.1-S11

Damper Type
Vertical Fire Damper

Damper Size
34" x 10"

Damper Manufacturer
Ruskin

Damper Model #
IBD2

Fusible Link Temperature
212 Degrees

Access Door Size
18" x 18"

Pass / Fail / Abandoned
Pass

Comments / Corrections
None

Picture of Damper in Open Position



Picture of Damper in Closed Position



Picture of Damper I.D. Label



CUYAHOGA COUNTY DAMPER INSPECTION REPORT

Date of Inspection

2023-06-22

Facility Location

Virgil E Brown Center

Damper Location

NW corridor

Inspector Name

Dan Tulcewicz

Damper I.D. #

AHU2.1-S12

Damper Type

Vertical Fire Damper

Damper Size

20" x 8" Oval

Damper Manufacturer

Ruskin

Damper Model #

IBD2

Fusible Link Temperature

212 Degrees

Access Door Size

18" x 18"

Pass / Fail / Abandoned

Pass

Comments / Corrections

None

Picture of Damper in Open Position



Picture of Damper in Closed Position



Picture of Damper I.D. Label



CUYAHOGA COUNTY DAMPER INSPECTION REPORT

Date of Inspection

2023-06-22

Facility Location

Virgil E Brown Center

Damper Location

NW corridor

Inspector Name

Julie Gue

Damper I.D. #

AHU2.1-S13

Damper Type

Vertical Fire Damper

Damper Size

6" Round

Damper Manufacturer

Ruskin

Damper Model #

Unknown

Fusible Link Temperature

212 Degrees

Access Door Size

18" x 18"

Pass / Fail / Abandoned

Pass

Comments / Corrections

None

Picture of Damper in Open Position



Picture of Damper in Closed Position



Picture of Damper I.D. Label



CUYAHOGA COUNTY DAMPER INSPECTION REPORT

Date of Inspection

2023-06-22

Facility Location

Virgil E Brown Center

Damper Location

NW Corridor

Inspector Name

Julie Gue

Damper I.D. #

AHU2.1-S14

Damper Type

Vertical Fire Damper

Damper Size

56" x 16"

Damper Manufacturer

Ruskin

Damper Model #

IBD2

Fusible Link Temperature

212 Degrees

Access Door Size

18" x 18"

Pass / Fail / Abandoned

Pass

Comments / Corrections

None


Picture of Damper in Open Position



Picture of Damper in Closed Position



Picture of Damper I.D. Label

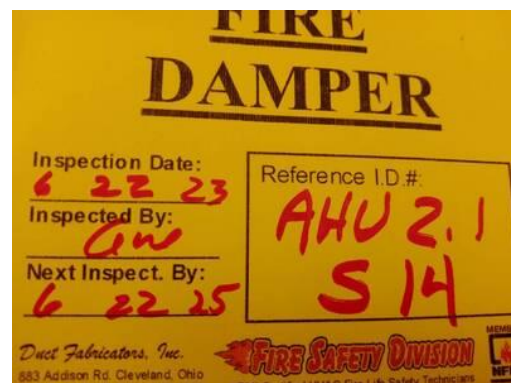

Duct Fabricators, Inc.

883 Addison Rd. Cleveland, Ohio
P: 216-391-2400 F: 216-391-2492

FIRE SAFETY DIVISION

NEMI Certified HVAC Fire Life Safety Technicians



CUYAHOGA COUNTY DAMPER INSPECTION REPORT

Date of Inspection

2023-06-23

Facility Location

Virgil E Brown Center

Damper Location

North Com Room.

Inspector Name

Dan Tulcewicz

Damper I.D. #

AHU2.1-S15

Damper Type

Vertical Fire Damper

Damper Size

8" x 12"

Damper Manufacturer

Ruskin

Damper Model #

IBD2

Fusible Link Temperature

212 Degrees

Access Door Size

Open

Pass / Fail / Abandoned

Pass

Comments / Corrections

None

Picture of Damper in Open Position



Picture of Damper in Closed Position



Picture of Damper I.D. Label



CUYAHOGA COUNTY DAMPER INSPECTION REPORT

Date of Inspection
2023-06-22

Facility Location
Virgil E Brown Center

Damper Location
NW Corridor

Inspector Name
Julie Gue

Damper I.D. #
AHU2.1-S16

Damper Type
Vertical Fire Damper

Damper Size
56" x 16"

Damper Manufacturer
Ruskin

Damper Model #
IBD2

Fusible Link Temperature
212 Degrees

Access Door Size
18" x 18"

Pass / Fail / Abandoned
Pass

Comments / Corrections
None


Picture of Damper in Open Position



Picture of Damper in Closed Position



Picture of Damper I.D. Label



CUYAHOGA COUNTY DAMPER INSPECTION REPORT

Date of Inspection
2023-06-23

Facility Location
Virgil E Brown Center

Damper Location
RM270

Inspector Name
Julie Gue

Damper I.D. #
AHU2.2-S1

Damper Type
Vertical Fire Damper

Damper Size
36" x 8"

Damper Manufacturer
Ruskin

Damper Model #
IBD2 ow

Fusible Link Temperature
212 Degrees

Access Door Size
12" x 12"


Pass / Fail / Abandoned
Pass

Comments / Corrections
None


Picture of Damper in Open Position



Picture of Damper in Closed Position



Picture of Damper I.D. Label



CUYAHOGA COUNTY DAMPER INSPECTION REPORT

Date of Inspection
2023-06-23

Facility Location
Virgil E Brown Center

Damper Location
Office 270

Inspector Name
Julie Gue

Damper I.D. #
AHU2.2-S2

Damper Type
Vertical Fire Damper

Damper Size
36" x 8"

Damper Manufacturer
Ruskin

Damper Model #
IBD2 ow

Fusible Link Temperature
212 Degrees

Access Door Size
12" x 12"

Pass / Fail / Abandoned
Pass

Comments / Corrections
None


Picture of Damper in Open Position



Picture of Damper in Closed Position



Picture of Damper I.D. Label



CUYAHOGA COUNTY DAMPER INSPECTION REPORT

Date of Inspection
2023-06-23

Facility Location
Virgil E Brown Center

Damper Location
SW corridor

Inspector Name
Julie Gue

Damper I.D. #
AHU2.2-S3

Damper Type
Vertical Fire Damper

Damper Size
56" x 16"

Damper Manufacturer
Ruskin

Damper Model #
IBD2

Fusible Link Temperature
212 Degrees

Access Door Size
18" x 18"

Pass / Fail / Abandoned
Pass

Comments / Corrections
None

Picture of Damper in Open Position



Picture of Damper in Closed Position



Picture of Damper I.D. Label

FIRE DAMPER

Inspection Date: 6 23 23	Reference I.D.#: AHU2.2
Inspected By: Gue	53
Next Inspect. By: 6 23 23	

Duct Fabricators, Inc.
883 Addison Rd. Cleveland, Ohio
P: 216-391-2400 F: 216-391-2492

FIRE SAFETY DIVISION
NEMI Certified HVAC Fire Life Safety Technicians

MEMBER
NFPA

CUYAHOGA COUNTY DAMPER INSPECTION REPORT

Date of Inspection
2023-06-23

Facility Location
Virgil E Brown Center

Damper Location
SW corridor

Inspector Name
Julie Gue

Damper I.D. #
AHU2.2-S4

Damper Type
Vertical Fire Damper

Damper Size
56" x 16"

Damper Manufacturer
Ruskin

Damper Model #
IBD2

Fusible Link Temperature
212 Degrees

Access Door Size
18" x 18"

Pass / Fail / Abandoned
Pass

Comments / Corrections
None


Picture of Damper in Open Position



Picture of Damper in Closed Position



Picture of Damper I.D. Label

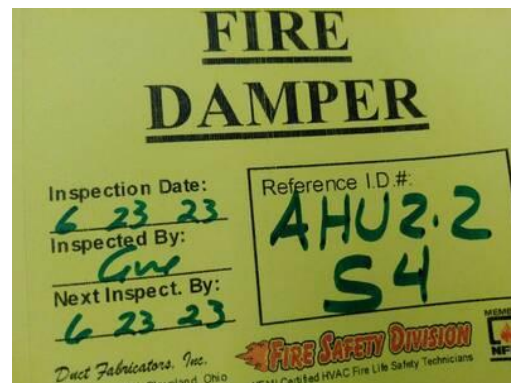

CUYAHOGA COUNTY DAMPER INSPECTION REPORT

Date of Inspection

2023-06-23

Facility Location

Virgil E Brown Center

Damper Location

SWcomm room

Inspector Name

Dan Tulcewicz

Damper I.D. #

AHU2.2-S5

Damper Type

Vertical Fire Damper

Damper Size

8"x12"

Damper Manufacturer

Ruskin

Damper Model #

IBD2

Fusible Link Temperature

212 Degrees

Access Door Size

Open

Pass / Fail / Abandoned

Pass

Comments / Corrections

None

Picture of Damper in Open Position



Picture of Damper in Closed Position



Picture of Damper I.D. Label



CUYAHOGA COUNTY DAMPER INSPECTION REPORT

Date of Inspection
2023-06-23

Facility Location
Virgil E Brown Center

Damper Location
SW Corridor

Inspector Name
Julie Gue

Damper I.D. #
AHU2.2-S6

Damper Type
Vertical Fire Damper

Damper Size
6" Round

Damper Manufacturer
Ruskin

Damper Model #
IBD2

Fusible Link Temperature
212 Degrees

Access Door Size
18" x 18"

Pass / Fail / Abandoned
Pass

Comments / Corrections
None

Picture of Damper in Open Position



Picture of Damper in Closed Position



Picture of Damper I.D. Label

<u>FIRE</u>	
<u>DAMPER</u>	
Inspection Date: 6/23/23	Reference I.D.#: AHU2.2
Inspected By: Gue	56
Next Inspect. By: 6/23/25	

Duct Fabricators, Inc. **FIRE SAFETY DIVISION** MEMBER

IM142-
FSD4

Duct Fabricators, Inc.

883 Addison Rd. Cleveland, Ohio
P: 216-391-2400 F: 216-391-2492

FIRE SAFETY DIVISION

NEMI Certified HVAC Fire Life Safety Technicians



CUYAHOGA COUNTY DAMPER INSPECTION REPORT

Date of Inspection

2023-06-23

Facility Location

Virgil E Brown Center

Damper Location

SW Corridor

Inspector Name

Julie Gue

Damper I.D.

AHU2.2-S7

Damper Type

Vertical Fire Damper

Damper Size

16" Oval

Damper Manufacturer

Ruskin

Damper Model

IBD2

Fusible Link Temperature

212 Degrees

Access Door Size

18" x 18"

Pass / Fail / Abandoned

Pass


Comments / Corrections

None

Picture of Damper in Open Position



Picture of Damper in Closed Position



Picture of Damper I.D. Label



CUYAHOGA COUNTY DAMPER INSPECTION REPORT

Date of Inspection
2023-06-23

Facility Location
Virgil E Brown Center

Damper Location
Room 260

Inspector Name
Julie Gue

Damper I.D. #
AHU2.2-S8

Damper Type
Vertical Fire Damper

Damper Size
6" R

Damper Manufacturer
Ruskin

Damper Model #
IBD2

Fusible Link Temperature
212 Degrees

Access Door Size
18" x 18"

Pass / Fail / Abandoned
Pass

Comments / Corrections
None

Picture of Damper in Open Position



Picture of Damper in Closed Position



Picture of Damper I.D. Label

FIRE DAMPER	
Inspection Date: 6/23/23	Reference I.D.#: AHU2.2 S8
Inspected By: Gue	
Next Inspect. By: 6/23/25	
Duct Fabricators, Inc. 883 Addison Rd. Cleveland, Ohio P: 216-391-2400 F: 216-391-2492	
FIRE SAFETY DIVISION NEMI Certified HVAC Fire Life Safety Technicians	
MEMBER NFPA	

CUYAHOGA COUNTY DAMPER INSPECTION REPORT

Date of Inspection
2023-06-23

Facility Location
Virgil E Brown Center

Damper Location
Room 260

Inspector Name
Julie Gue

Damper I.D. #
AHU2.2-S9

Damper Type
Vertical Fire Damper

Damper Size
32" x 10"

Damper Manufacturer
Ruskin

Damper Model #
IBD2

Fusible Link Temperature
212 Degrees

Access Door Size
18" x 18"

Pass / Fail / Abandoned
Pass

Comments / Corrections
None


Picture of Damper in Open Position



Picture of Damper in Closed Position



Picture of Damper I.D. Label



CUYAHOGA COUNTY DAMPER INSPECTION REPORT

Date of Inspection
2023-06-23

Facility Location
Virgil E Brown Center

Damper Location
South corridor

Inspector Name
Julie Gue

Damper I.D. #
AHU2.2-S10

Damper Type
Vertical Fire Damper

Damper Size
12" Round

Damper Manufacturer
Ruskin

Damper Model #
IBD2

Fusible Link Temperature
212 Degrees

Access Door Size
18" x 18"

Pass / Fail / Abandoned
Pass

Comments / Corrections
None

Picture of Damper in Open Position



Picture of Damper in Closed Position



Picture of Damper I.D. Label

FIRE DAMPER	
Inspection Date: <u>6-23-23</u>	Reference I.D. # AHU-2.2
Inspected By: <u>GUE</u>	S-10
Next Inspect. By: <u>6-23-25</u>	
Duct Fabricators, Inc. 883 Addison Rd. Cleveland, Ohio P: 216-391-2400 F: 216-391-2492	
FIRE SAFETY DIVISION NEMI Certified HVAC Fire Life Safety Technicians	
MEMBER NFPA	

CUYAHOGA COUNTY DAMPER INSPECTION REPORT

Date of Inspection
2023-06-23

Facility Location
Virgil E Brown Center

Damper Location
Conference Room 2b

Inspector Name
Julie Gue

Damper I.D. #
AHU2.2-S11

Damper Type
Vertical Fire Damper

Damper Size
12" Oval

Damper Manufacturer
Ruskin

Damper Model #
IBD2

Fusible Link Temperature
212 Degrees

Access Door Size
18" x 18"


Pass / Fail / Abandoned
Pass

Comments / Corrections
None

Picture of Damper in Open Position



Picture of Damper in Closed Position



Picture of Damper I.D. Label



CUYAHOGA COUNTY DAMPER INSPECTION REPORT

Date of Inspection
2023-06-23

Facility Location
Virgil E Brown Center

Damper Location
SE Office

Inspector Name
Julie Gue

Damper I.D. #
AHU2.2-S12

Damper Type
Vertical Fire Damper

Damper Size
34" x 10"

Damper Manufacturer
Ruskin

Damper Model #
IBD2

Fusible Link Temperature
212 Degrees

Access Door Size
20" x 20"


Pass / Fail / Abandoned
Pass

Comments / Corrections
None


Picture of Damper in Open Position



Picture of Damper in Closed Position



Picture of Damper I.D. Label



CUYAHOGA COUNTY DAMPER INSPECTION REPORT

Date of Inspection

2023-06-23

Facility Location

Virgil E Brown Center

Damper Location

SE Office

Inspector Name

Julie Gue

Damper I.D. #

AHU2.2-S13

Damper Type

Vertical Fire Damper

Damper Size

6" Round

Damper Manufacturer

Ruskin

Damper Model #

IBD2

Fusible Link Temperature

212 Degrees

Access Door Size

18" x 18"

Pass / Fail / Abandoned

Pass

Comments / Corrections

None


Picture of Damper in Open Position



Picture of Damper in Closed Position



Picture of Damper I.D. Label



CUYAHOGA COUNTY DAMPER INSPECTION REPORT

Date of Inspection
2023-06-23

Facility Location
Virgil E Brown Center

Damper Location
SE Corridor

Inspector Name
Julie Gue

Damper I.D. #
AHU2.2-S14

Damper Type
Vertical Fire Damper

Damper Size
6" Round

Damper Manufacturer
Ruskin

Damper Model #
IBD2

Fusible Link Temperature
212 Degrees

Access Door Size
18" x 18"

Pass / Fail / Abandoned
Pass

Comments / Corrections
None

Picture of Damper in Open Position



Picture of Damper in Closed Position



Picture of Damper I.D. Label

FIRE DAMPER	
Inspection Date: 6 23 23	Reference I.D.#: AHU2.2
Inspected By: GW	S14
Next Inspect. By: 6 23 25	

Duct Fabricators, Inc.
883 Addison Rd. Cleveland, Ohio

FIRE SAFETY DIVISION
NEMI Certified HVAC Fire Life Safety Technicians

MEMBER
NFPA

CUYAHOGA COUNTY DAMPER INSPECTION REPORT

Date of Inspection
2023-06-23

Facility Location
Virgil E Brown Center

Damper Location
SE Corridor

Inspector Name
Julie Gue

Damper I.D. #
AHU2.2-S15

Damper Type
Vertical Fire Damper

Damper Size
56" x 16"

Damper Manufacturer
Ruskin

Damper Model #
IBD2

Fusible Link Temperature
212 Degrees

Access Door Size
18" x 18"

Pass / Fail / Abandoned
Pass

Comments / Corrections
None

Picture of Damper in Open Position



Picture of Damper in Closed Position



Picture of Damper I.D. Label

FIRE DAMPER

Inspection Date: 6.23.23
Inspected By: GW
Next Inspect. By: 6.23.25

Reference I.D. #
AHU 2.2
S15

Duct Fabricators, Inc.
883 Addison Rd. Cleveland, Ohio
P: 216-391-2400 F: 216-391-2492

FIRE SAFETY DIVISION
NEMI Certified HVAC Fire Life Safety Technicians

MEMBER
NFPA

Duct Fabricators, Inc.

883 Addison Rd. Cleveland, Ohio
P: 216-391-2400 F: 216-391-2492



NEMI Certified HVAC Fire Life Safety Technicians



CUYAHOGA COUNTY DAMPER INSPECTION REPORT

Date of Inspection

2023-06-23

Facility Location

Virgil E Brown Center

Damper Location

South Com Room.

Inspector Name

Dan Tulcewicz

Damper I.D.

AHU2.2-S16

Damper Type

Vertical Fire Damper

Damper Size

8" x 12"

Damper Manufacturer

Ruskin

Damper Model

IBD2

Fusible Link Temperature

212 Degrees

Access Door Size

Open

Pass / Fail / Abandoned

Pass

Comments / Corrections

None

Picture of Damper in Open Position



Picture of Damper in Closed Position



Picture of Damper I.D. Label

FIRE DAMPER	
Inspection Date: 6-23-23	Reference I.D. #: AHU2.2-S16
Inspected By: TULCEWICZ	
Next Inspect. By: 6-23-25	

Duct Fabricators, Inc.
883 Addison Rd. Cleveland, Ohio
P: 216-391-2400 F: 216-391-2492

FIRE SAFETY DIVISION
NEMI Certified HVAC Fire Life Safety Technicians

MEMBER
NFPA

CUYAHOGA COUNTY DAMPER INSPECTION REPORT

Date of Inspection
2023-06-23

Facility Location
Virgil E Brown Center

Damper Location
SE Corridor

Inspector Name
Julie Gue

Damper I.D. #
AHU2.2-S17

Damper Type
Vertical Fire Damper

Damper Size
56" x 16"

Damper Manufacturer
Ruskin

Damper Model #
IBD2

Fusible Link Temperature
212 Degrees

Access Door Size
18" x 18"

Pass / Fail / Abandoned
Pass

Comments / Corrections
None

Picture of Damper in Open Position



Picture of Damper in Closed Position



Picture of Damper I.D. Label



CUYAHOGA COUNTY DAMPER INSPECTION REPORT

Date of Inspection
2023-06-23

Facility Location
Virgil E Brown Center

Damper Location
Room 240

Inspector Name
Julie Gue

Damper I.D. #
AHU2.2-S18

Damper Type
Vertical Fire Damper

Damper Size
18" x 10"

Damper Manufacturer
Ruskin

Damper Model #
IBD2

Fusible Link Temperature
212 Degrees

Access Door Size
12" x 12"

Pass / Fail / Abandoned
Pass

Comments / Corrections
None

Picture of Damper in Open Position



Picture of Damper in Closed Position



Picture of Damper I.D. Label



CUYAHOGA COUNTY DAMPER INSPECTION REPORT

Date of Inspection
2023-06-21

Facility Location
Virgil E Brown Center

Damper Location
North Mechanical Room

Inspector Name
Julie Gue

Damper I.D. #
AHU3.1-OA

Damper Type
Vertical Fire Damper

Damper Size
96" x 24'

Damper Manufacturer
Ruskin

Damper Model #
IBD2


Fusible Link Temperature
165 Degrees

Access Door Size
16' x 16"

Pass / Fail / Abandoned
Pass

Comments / Corrections
None

Picture of Damper in Open Position



Picture of Damper in Closed Position



Picture of Damper I.D. Label



CUYAHOGA COUNTY DAMPER INSPECTION REPORT

Date of Inspection

2023-06-21

Facility Location

Virgil E Brown Center

Damper Location

North mechanical room

Inspector Name

Julie Gue

Damper I.D. #

AHU3.1-RA

Damper Type

Vertical Fire Damper

Damper Size

96" x 60"

Damper Manufacturer

Ruskin

Damper Model #

IBD2

Fusible Link Temperature

212 Degrees

Access Door Size

Behind MOD

Pass / Fail / Abandoned

Pass

Comments / Corrections

None


Picture of Damper in Open Position



Picture of Damper in Closed Position



Picture of Damper I.D. Label



CUYAHOGA COUNTY DAMPER INSPECTION REPORT

Date of Inspection
2023-06-21

Facility Location
Virgil E Brown Center

Damper Location
NE Corridor

Inspector Name
Julie Gue

Damper I.D. #
AHU3.1-S1

Damper Type
Vertical Fire Damper

Damper Size
56" x 16"

Damper Manufacturer
Ruskin

Damper Model #
IBD2

Fusible Link Temperature
212 Degrees

Access Door Size
18" x 18"

Pass / Fail / Abandoned
Pass

Comments / Corrections
None


Picture of Damper in Open Position



Picture of Damper in Closed Position



Picture of Damper I.D. Label

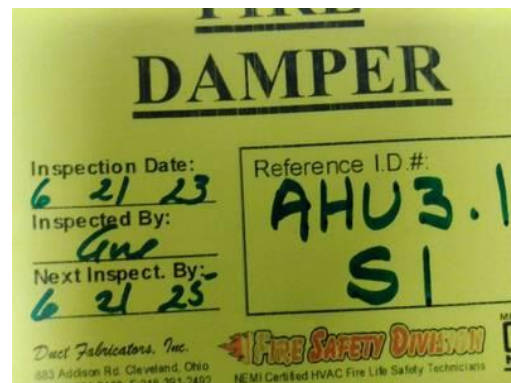

CUYAHOGA COUNTY DAMPER INSPECTION REPORT

Date of Inspection
2023-06-21

Facility Location
Virgil E Brown Center

Damper Location
NE Corridor

Inspector Name
Julie Gue

Damper I.D. #
AHU3.1-S2

Damper Type
Vertical Fire Damper

Damper Size
56" x 16"

Damper Manufacturer
Ruskin

Damper Model #
IBD2

Fusible Link Temperature
212 Degrees

Access Door Size
18" x 18"

Pass / Fail / Abandoned
Pass

Comments / Corrections
None

Picture of Damper in Open Position



Picture of Damper in Closed Position



Picture of Damper I.D. Label



CUYAHOGA COUNTY DAMPER INSPECTION REPORT

Date of Inspection
2023-06-20

Picture of Damper in Open Position

Facility Location
Virgil E Brown Center



Damper Location
NE Com Room

Inspector Name
Julie Gue

Damper I.D. #
AHU3.1-S3

Picture of Damper in Closed Position

Damper Type
Vertical Fire Damper



Damper Size
8" x 10"

Damper Manufacturer
Ruskin

Damper Model #
IBD2

Fusible Link Temperature
212 Degrees

Picture of Damper I.D. Label

Access Door Size
Open

Pass / Fail / Abandoned
Pass

Comments / Corrections
None



CUYAHOGA COUNTY DAMPER INSPECTION REPORT

Date of Inspection
2023-06-21

Facility Location
Virgil E Brown Center

Damper Location
NE Corridor

Inspector Name
Julie Gue

Damper I.D. #
c

Damper Type
Vertical Fire Damper

Damper Size
8" Round

Damper Manufacturer
Ruskin

Damper Model #
IBD2

Fusible Link Temperature
212 Degrees

Access Door Size
14' x 14"

Pass / Fail / Abandoned
Pass

Comments / Corrections
None

Picture of Damper in Open Position



Picture of Damper in Closed Position



Picture of Damper I.D. Label

FIRE DAMPER

Inspection Date: 6-21-23	Reference I.D.#: AHU 3.1
Inspected By: Gue	S4
Next Inspect. By: 6-21-25	

Duct Fabricators, Inc.
883 Addison Rd. Cleveland, Ohio
P: 216-391-2400 F: 216-391-2492

FIRE SAFETY DIVISION
NEMI Certified HVAC Fire Life Safety Technicians

MEMBER
NFPA

CUYAHOGA COUNTY DAMPER INSPECTION REPORT

Date of Inspection
2023-06-21

Facility Location
Virgil E Brown Center

Damper Location
NE Corridor

Inspector Name
Julie Gue

Damper I.D. #
AHU3.1-S5

Damper Type
Vertical Fire Damper

Damper Size
40" x 12"

Damper Manufacturer
Ruskin

Damper Model #
IBD2

Fusible Link Temperature
212 Degrees

Access Door Size
18" x 18"

Pass / Fail / Abandoned
Pass

Comments / Corrections
None


Picture of Damper in Open Position



Picture of Damper in Closed Position



Picture of Damper I.D. Label

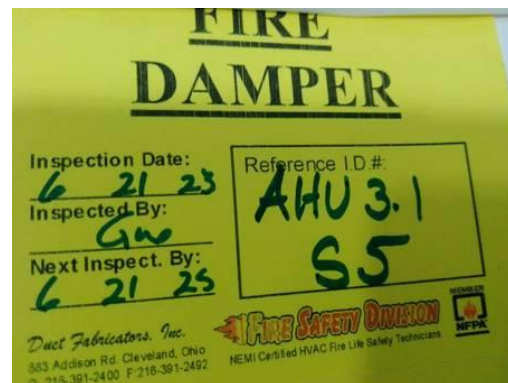

CUYAHOGA COUNTY DAMPER INSPECTION REPORT

Date of Inspection
2023-06-21

Facility Location
Virgil E Brown Center

Damper Location
North Corridor

Inspector Name
Julie Gue

Damper I.D. #
AHU3.1-S6

Damper Type
Vertical Fire Damper

Damper Size
56" x 12"

Damper Manufacturer
Ruskin

Damper Model #
IBD2

Fusible Link Temperature
212 Degrees

Access Door Size
18" x 18"

Pass / Fail / Abandoned
Pass

Comments / Corrections
None

Picture of Damper in Open Position



Picture of Damper in Closed Position



Picture of Damper I.D. Label

FIRE DAMPER

Inspection Date: 6/21/23	Reference I.D.#: AHU3.1
Inspected By: Gue	SC
Next Inspect. By: 6/21/25	

Duct Fabricators, Inc.
883 Addison Rd. Cleveland, Ohio
P: 216-391-2400 F: 216-391-2492

FIRE SAFETY DIVISION
NEMI Certified HVAC Fire Life Safety Technicians

MEMBER
NFPA

CUYAHOGA COUNTY DAMPER INSPECTION REPORT

Date of Inspection
2023-06-21

Facility Location
Virgil E Brown Center

Damper Location
NW Corridor

Inspector Name
Julie Gue

Damper I.D. #
AHU3.1-S7

Damper Type
Vertical Fire Damper

Damper Size
56" x 12"

Damper Manufacturer
Ruskin

Damper Model #
IBD2

Fusible Link Temperature
212 Degrees

Access Door Size
18" x 18"

Pass / Fail / Abandoned
Pass

Comments / Corrections
None

Picture of Damper in Open Position



Picture of Damper in Closed Position



Picture of Damper I.D. Label



CUYAHOGA COUNTY DAMPER INSPECTION REPORT

Date of Inspection
2023-06-21

Facility Location
Virgil E Brown Center

Damper Location
NW office

Inspector Name
Julie Gue

Damper I.D. #
AHU3.1-S8

Damper Type
Vertical Fire Damper

Damper Size
20" x 10"

Damper Manufacturer
Ruskin

Damper Model #
IBD2

Fusible Link Temperature
165 Degrees

Access Door Size
18" x 18"

Pass / Fail / Abandoned
Pass

Comments / Corrections
None


Picture of Damper in Open Position



Picture of Damper in Closed Position



Picture of Damper I.D. Label



CUYAHOGA COUNTY DAMPER INSPECTION REPORT

Date of Inspection
2023-06-21

Facility Location
Virgil E Brown Center

Damper Location
NW Corridor

Inspector Name
Julie Gue

Damper I.D. #
AHU3.1-S9

Damper Type
Vertical Fire Damper

Damper Size
16" oval

Damper Manufacturer
Ruskin

Damper Model #
IBD2

Fusible Link Temperature
212 Degrees

Access Door Size
18" x 18"

Pass / Fail / Abandoned
Pass

Comments / Corrections
None


Picture of Damper in Open Position



Picture of Damper in Closed Position



Picture of Damper I.D. Label

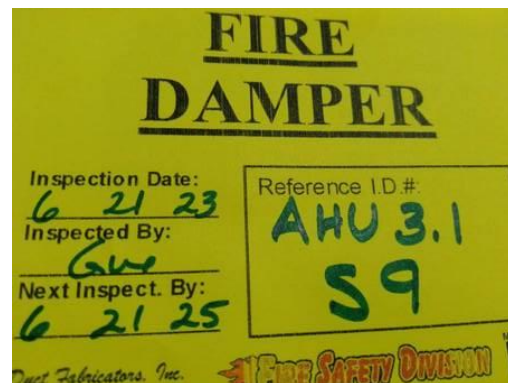

CUYAHOGA COUNTY DAMPER INSPECTION REPORT

Date of Inspection
2023-06-21

Facility Location
Virgil E Brown Center

Damper Location
NW Corridor

Inspector Name
Julie Gue

Damper I.D. #
AHU3.1-S10

Damper Type
Vertical Fire Damper

Damper Size
6" Round

Damper Manufacturer
Ruskin

Damper Model #
IBD2

Fusible Link Temperature
212 Degrees

Access Door Size
18" x 18"

Pass / Fail / Abandoned
Pass

Comments / Corrections
None

Picture of Damper in Open Position



Picture of Damper in Closed Position



Picture of Damper I.D. Label

FIRE DAMPER

Inspection Date: 6-21-23	Reference I.D.# AHU3.1
Inspected By: Gue	S10
Next Inspect. By: 6-21-25	

Duct Fabricators, Inc.
883 Addison Rd. Cleveland, Ohio
P: 216-391-2400 F: 216-391-2492

FIRE SAFETY DIVISION
NEMI Certified HVAC Fire Life Safety Technicians

MEMBER
NFPA

CUYAHOGA COUNTY DAMPER INSPECTION REPORT

Date of Inspection
2023-06-21

Facility Location
Virgil E Brown Center

Damper Location
NW Corridor

Inspector Name
Julie Gue

Damper I.D. #
AHU3.1-S11

Damper Type
Vertical Fire Damper

Damper Size
56" x 16"

Damper Manufacturer
Ruskin

Damper Model #
IBD2

Fusible Link Temperature
212 Degrees

Access Door Size
18" x 18"

Pass / Fail / Abandoned
Pass

Comments / Corrections
None


Picture of Damper in Open Position



Picture of Damper in Closed Position



Picture of Damper I.D. Label

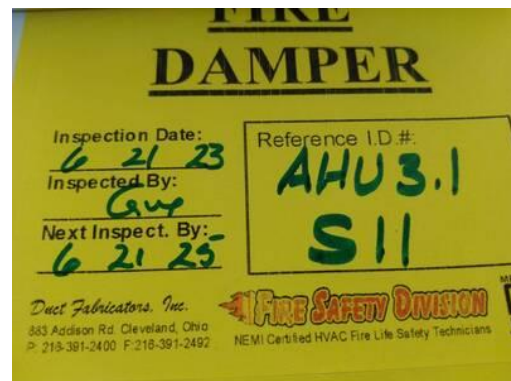

Duct Fabricators, Inc.

883 Addison Rd. Cleveland, Ohio
P: 216-391-2400 F: 216-391-2492



NEMI Certified HVAC Fire Life Safety Technicians



CUYAHOGA COUNTY DAMPER INSPECTION REPORT

Date of Inspection

2023-06-20

Facility Location

Virgil E Brown Center

Damper Location

NW Com Room

Inspector Name

Julie Gue

Damper I.D.

AHU3.1-S12

Damper Type

Vertical Fire Damper

Damper Size

8" x 12"

Damper Manufacturer

Ruskin

Damper Model

IBD2

Fusible Link Temperature

212 Degrees

Access Door Size

Open

Pass / Fail / Abandoned

Pass

Comments / Corrections

None

Picture of Damper in Open Position



Picture of Damper in Closed Position



Picture of Damper I.D. Label



CUYAHOGA COUNTY DAMPER INSPECTION REPORT

Date of Inspection
2023-06-21

Facility Location
Virgil E Brown Center

Damper Location
NW Corridor

Inspector Name
Julie Gue

Damper I.D. #
AHU3.1-S13

Damper Type
Vertical Fire Damper

Damper Size
56" x 16"

Damper Manufacturer
Ruskin

Damper Model #
IBD2

Fusible Link Temperature
212 Degrees

Access Door Size
18" x 18"

Pass / Fail / Abandoned
Pass

Comments / Corrections
None

Picture of Damper in Open Position



Picture of Damper in Closed Position



Picture of Damper I.D. Label



Duct Fabricators, Inc.

883 Addison Rd. Cleveland, Ohio
P: 216-391-2400 F: 216-391-2492



NEMI Certified HVAC Fire Life Safety Technicians



CUYAHOGA COUNTY DAMPER INSPECTION REPORT

Date of Inspection

2023-06-21

Facility Location

Virgil E Brown Center

Damper Location

RM 300

Inspector Name

Julie Gue

Damper I.D. #

AHU3.1-S14

Damper Type

Vertical Fire Damper

Damper Size

20" x 10"

Damper Manufacturer

Ruskin

Damper Model #

IBD2

Fusible Link Temperature

212 Degrees

Access Door Size

8' x 8"

Pass / Fail / Abandoned

Pass

Comments / Corrections

None


Picture of Damper in Open Position



Picture of Damper in Closed Position



Picture of Damper I.D. Label

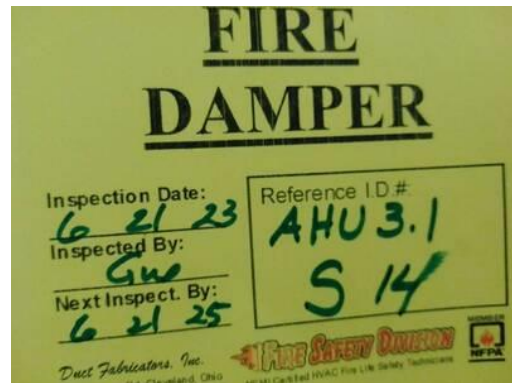

CUYAHOGA COUNTY DAMPER INSPECTION REPORT

Date of Inspection
2023-07-12

Facility Location
Virgil E Brown Center

Damper Location
Outside of room #350

Inspector Name
Dan Tulcewicz

Damper I.D. #
AHU3.1-S16

Damper Type
Vertical Fire Damper

Damper Size
18"x8" oval

Damper Manufacturer
Ruskin

Damper Model #
IBD2

Fusible Link Temperature
165 Degrees

Access Door Size
10"x10"

Pass / Fail / Abandoned
Pass

Comments / Corrections
None

Picture of Damper in Open Position



Picture of Damper in Closed Position



Picture of Damper I.D. Label

<u>FIRE</u> <u>DAMPER</u>	
Inspection Date: 7-12-23	Reference I.D. #: AHU3.1-S16
Inspected By: Tulcewicz	
Next Inspect. By: 7-12-25	
<small>Duct Fabricators, Inc. 883 Addison Rd. Cleveland, Ohio P: 216-391-2400 F: 216-391-2492</small>	
FIRE SAFETY DIVISION NEMI Certified HVAC Fire Life Safety Technicians	
<small>MEMBER NFPA</small>	

CUYAHOGA COUNTY DAMPER INSPECTION REPORT

Date of Inspection
2023-06-21

Facility Location
Virgil E Brown Center

Damper Location
South Mechanical Rm

Inspector Name
Julie Gue

Damper I.D. #
AHU3.2-OA

Damper Type
Vertical Fire Damper

Damper Size
96" x 24"

Damper Manufacturer
Ruskin

Damper Model #
IBD2

Fusible Link Temperature
212 Degrees

Access Door Size
16" x 16'

Pass / Fail / Abandoned
Pass

Comments / Corrections
None


Picture of Damper in Open Position



Picture of Damper in Closed Position



Picture of Damper I.D. Label



CUYAHOGA COUNTY DAMPER INSPECTION REPORT

Date of Inspection
2023-06-21

Picture of Damper in Open Position

Facility Location
Virgil E Brown Center



Damper Location
South mechanical room.

Inspector Name
Julie Gue

Damper I.D. #
AHU3.2-RA

Picture of Damper in Closed Position

Damper Type
Vertical Fire Damper



Damper Size
96" x 60"

Damper Manufacturer
Ruskin

Damper Model #
IBD2


Fusible Link Temperature
165 Degrees

Picture of Damper I.D. Label

Access Door Size
Open

Pass / Fail / Abandoned
Pass

Comments / Corrections
None



CUYAHOGA COUNTY DAMPER INSPECTION REPORT

Date of Inspection

2023-06-21

Facility Location

Virgil E Brown Center

Damper Location

Office

Inspector Name

Julie Gue

Damper I.D. #

AHU3.2-S2

Damper Type

Vertical Fire Damper

Damper Size

36" x 8"

Damper Manufacturer

Ruskin

Damper Model #

IBD2

Fusible Link Temperature

212 Degrees

Access Door Size

12" x 12"

Pass / Fail / Abandoned

Pass

Comments / Corrections

None

Picture of Damper in Open Position



Picture of Damper in Closed Position



Picture of Damper I.D. Label

<u>FIRE</u>	
<u>DAMPER</u>	
Inspection Date: 6-21-23	Reference I.D.#: AHU 3.2
Inspected By: GW	S2
Next Inspect. By: 6-21-25	
Duct Fabricators, Inc. 883 Addison Rd. Cleveland, Ohio	
FIRE SAFETY DIVISION	
MEMBER NFPA	

CUYAHOGA COUNTY DAMPER INSPECTION REPORT

Date of Inspection

2023-06-21

Facility Location

Virgil E Brown Center

Damper Location

SW Corridor

Inspector Name

Julie Gue

Damper I.D. #

AHU3.2-S3

Damper Type

Vertical Fire Damper

Damper Size

56" x 16'

Damper Manufacturer

Ruskin

Damper Model #

IBD2

Fusible Link Temperature

212 Degrees

Access Door Size

18" x 18"

Pass / Fail / Abandoned

Pass

Comments / Corrections

None


Picture of Damper in Open Position



Picture of Damper in Closed Position



Picture of Damper I.D. Label

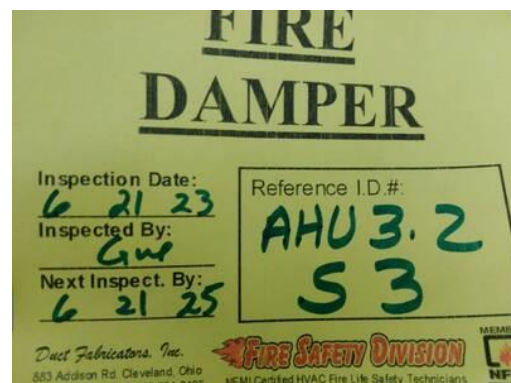

CUYAHOGA COUNTY DAMPER INSPECTION REPORT

Date of Inspection
2023-06-21

Facility Location
Virgil E Brown Center

Damper Location
SW Corridor

Inspector Name
Julie Gue

Damper I.D. #
AHU3.2-S4

Damper Type
Vertical Fire Damper

Damper Size
56" x 16"

Damper Manufacturer
Ruskin

Damper Model #
IBD2

Fusible Link Temperature
212 Degrees

Access Door Size
18" x 18"

Pass / Fail / Abandoned
Pass

Comments / Corrections
None

Picture of Damper in Open Position



Picture of Damper in Closed Position



Picture of Damper I.D. Label



CUYAHOGA COUNTY DAMPER INSPECTION REPORT

Date of Inspection
2023-06-20

Facility Location
Virgil E Brown Center

Damper Location
SW Corridor

Inspector Name
Julie Gue

Damper I.D. #
AHU3.2-S5

Damper Type
Vertical Fire Damper

Damper Size
8" x 12"

Damper Manufacturer
Ruskin

Damper Model #
IBD2

Fusible Link Temperature
212 Degrees

Access Door Size
Open

Pass / Fail / Abandoned
Pass

Comments / Corrections
None


Picture of Damper in Open Position



Picture of Damper in Closed Position



Picture of Damper I.D. Label

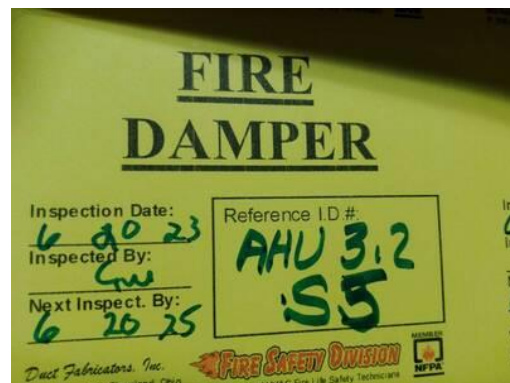

CUYAHOGA COUNTY DAMPER INSPECTION REPORT

Date of Inspection
2023-06-21

Facility Location
Virgil E Brown Center

Damper Location
SW Corridor

Inspector Name
Julie Gue

Damper I.D. #
AHU3.2-S6

Damper Type
Vertical Fire Damper

Damper Size
14" x 8" Oval

Damper Manufacturer
Ruskin

Damper Model #
IBD2

Fusible Link Temperature
212 Degrees

Access Door Size
18" x 18"

Pass / Fail / Abandoned
Pass

Comments / Corrections
None

Picture of Damper in Open Position



Picture of Damper in Closed Position



Picture of Damper I.D. Label

FIRE DAMPER

Inspection Date: 6/21/23	Reference I.D.#: AHU 3.2
Inspected By: Gue	S6
Next Inspect. By: 6/21/25	

Duct Fabricators, Inc.
883 Addison Rd. Cleveland, Ohio
P: 216-391-2400 F: 216-391-2492

FIRE SAFETY DIVISION
NEMI Certified HVAC Fire Life Safety Technicians

MEMBER
NFPA

CUYAHOGA COUNTY DAMPER INSPECTION REPORT

Date of Inspection
2023-06-21

Facility Location
Virgil E Brown Center

Damper Location
SW Corridor

Inspector Name
Julie Gue

Damper I.D. #
AHU3.2-S8

Damper Type
Vertical Fire Damper

Damper Size
56" x 16"

Damper Manufacturer
Ruskin

Damper Model #
IBD2

Fusible Link Temperature
212 Degrees

Access Door Size
18" x 18"

Pass / Fail / Abandoned
Pass

Comments / Corrections
None


Picture of Damper in Open Position



Picture of Damper in Closed Position



Picture of Damper I.D. Label



CUYAHOGA COUNTY DAMPER INSPECTION REPORT

Date of Inspection

2023-06-21

Facility Location

Virgil E Brown Center

Damper Location

SE Corridor

Inspector Name

Julie Gue

Damper I.D. #

AHU3.2-S9

Damper Type

Vertical Fire Damper

Damper Size

56" x 16"

Damper Manufacturer

Ruskin

Damper Model #

IBD2

Fusible Link Temperature

212 Degrees

Access Door Size

18 x 18"

Pass / Fail / Abandoned

Pass


Comments / Corrections

None


Picture of Damper in Open Position



Picture of Damper in Closed Position



Picture of Damper I.D. Label



CUYAHOGA COUNTY DAMPER INSPECTION REPORT

Date of Inspection
2023-06-21

Facility Location
Virgil E Brown Center

Damper Location
SW Corridor

Inspector Name
Julie Gue

Damper I.D. #
AHU3.2-S10

Damper Type
Vertical Fire Damper

Damper Size
20" x 8" oval

Damper Manufacturer
Ruskin

Damper Model #
IBD2

Fusible Link Temperature
212 Degrees

Access Door Size
18x18

Pass / Fail / Abandoned
Pass

Comments / Corrections
None

Picture of Damper in Open Position



Picture of Damper in Closed Position



Picture of Damper I.D. Label



CUYAHOGA COUNTY DAMPER INSPECTION REPORT

Date of Inspection
2023-06-21

Picture of Damper in Open Position

Facility Location
Virgil E Brown Center

Damper Location
SE Corridor

Inspector Name
Julie Gue

Damper I.D. #
AHU3.2-S11

Damper Type
Vertical Fire Damper

Damper Size
6" Round

Damper Manufacturer
Ruskin

Damper Model #
IBD2

Fusible Link Temperature
212 Degrees

Access Door Size
18" x 18"

Pass / Fail / Abandoned
Pass

Comments / Corrections
None



Picture of Damper in Closed Position



Picture of Damper I.D. Label

FIRE DAMPER	
Inspection Date: 6 21 23	Reference I.D.#: AHU 3.2
Inspected By: GW	S11
Next Inspect. By: 6 21 25	

Duct Fabricators, Inc.
883 Addison Rd. Cleveland, Ohio
P: 216-391-2400 F: 216-391-2492

FIRE SAFETY DIVISION
NEMI Certified HVAC Fire Life Safety Technicians

MEMBER
NFPA

CUYAHOGA COUNTY DAMPER INSPECTION REPORT

Date of Inspection
2023-06-21

Facility Location
Virgil E Brown Center

Damper Location
SE Corridor

Inspector Name
Julie Gue

Damper I.D. #
AHU3.2-S12

Damper Type
Vertical Fire Damper

Damper Size
56" x 16"

Damper Manufacturer
Ruskin

Damper Model #
IBD2

Fusible Link Temperature
212 Degrees

Access Door Size
18" x 18"

Pass / Fail / Abandoned
Pass

Comments / Corrections
None


Picture of Damper in Open Position



Picture of Damper in Closed Position



Picture of Damper I.D. Label



CUYAHOGA COUNTY DAMPER INSPECTION REPORT

Date of Inspection
2023-06-20

Facility Location
Virgil E Brown Center

Damper Location
SE Com Room

Inspector Name
Julie Gue

Damper I.D. #
AHU3.2-S13

Damper Type
Vertical Fire Damper

Damper Size
8" x 12"

Damper Manufacturer
Ruskin

Damper Model #
IBD2

Fusible Link Temperature
212 Degrees

Access Door Size
Open

Pass / Fail / Abandoned
Pass

Comments / Corrections
None

Picture of Damper in Open Position



Picture of Damper in Closed Position



Picture of Damper I.D. Label

<u>FIRE</u>	
<u>DAMPER</u>	
Inspection Date: 6 20 23	Reference I.D.# AHU 3.2
Inspected By: Gue	
Next Inspect. By: 6 20 25	S13
Duct Fabricators, Inc. 883 Addison Rd. Cleveland, Ohio P: 216-391-2400 F: 216-391-2492	
FIRE SAFETY DIVISION NEMI Certified HVAC Fire Life Safety Technicians	
MEMBER NFPA	

CUYAHOGA COUNTY DAMPER INSPECTION REPORT

Date of Inspection
2023-06-21

Facility Location
Virgil E Brown Center

Damper Location
SE Corridor

Inspector Name
Julie Gue

Damper I.D. #
AHU3.2-S14

Damper Type
Vertical Fire Damper

Damper Size
56" x 16"

Damper Manufacturer
Ruskin

Damper Model #
IBD2

Fusible Link Temperature
212 Degrees

Access Door Size
18" x 18"

Pass / Fail / Abandoned
Pass

Comments / Corrections
None


Picture of Damper in Open Position



Picture of Damper in Closed Position



Picture of Damper I.D. Label

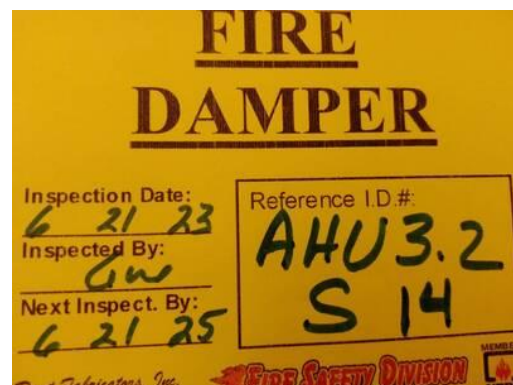

CUYAHOGA COUNTY DAMPER INSPECTION REPORT

Date of Inspection
2023-06-21

Facility Location
Virgil E Brown Center

Damper Location
SE Corridor

Inspector Name
Julie Gue

Damper I.D. #
AHU3.2-S15

Damper Type
Vertical Fire Damper

Damper Size
14" Oval

Damper Manufacturer
Ruskin

Damper Model #
IBD2

Fusible Link Temperature
212 Degrees

Access Door Size
16" x 16"

Pass / Fail / Abandoned
Pass

Comments / Corrections
None

Picture of Damper in Open Position



Picture of Damper in Closed Position



Picture of Damper I.D. Label



CUYAHOGA COUNTY DAMPER INSPECTION REPORT

Date of Inspection

2023-07-12

Facility Location

Virgil E Brown Center

Damper Location

Outside of room #350

Inspector Name

Dan Tulcewicz

Damper I.D. #

AHU3.2-S16

Damper Type

Vertical Fire Damper

Damper Size

14"Oval

Damper Manufacturer

Ruskin

Damper Model #

IBD2

Fusible Link Temperature

165 Degrees

Access Door Size

10"x10"

Pass / Fail / Abandoned

Pass

Comments / Corrections

None


Picture of Damper in Open Position



Picture of Damper in Closed Position



Picture of Damper I.D. Label



CUYAHOGA COUNTY DAMPER INSPECTION REPORT

Date of Inspection
2023-06-20

Facility Location
Virgil E Brown Center

Damper Location
North Mechanical room

Inspector Name
Julie Gue

Damper I.D. #
AHU4.1-OA

Damper Type
Vertical Fire Damper

Damper Size
96" x 24"

Damper Manufacturer
Ruskin

Damper Model #
IBD2

Fusible Link Temperature
212 Degrees

Access Door Size
16" x 16"

Pass / Fail / Abandoned
Pass

Comments / Corrections
None

Picture of Damper in Open Position



Picture of Damper in Closed Position



Picture of Damper I.D. Label



CUYAHOGA COUNTY DAMPER INSPECTION REPORT

Date of Inspection
2023-06-20

Facility Location
Virgil E Brown Center

Damper Location
North Mechanical room

Inspector Name
Julie Gue

Damper I.D. #
AHU4.1-RA

Damper Type
Vertical Fire Damper

Damper Size
96" x 60"

Damper Manufacturer
Ruskin

Damper Model #
IBD2

Fusible Link Temperature
212 Degrees

Access Door Size
Behind MOD

Pass / Fail / Abandoned
Pass

Comments / Corrections
None

Picture of Damper in Open Position



Picture of Damper in Closed Position



Picture of Damper I.D. Label

FIRE DAMPER	
Inspection Date: <u>6 20 23</u>	Reference I.D. #: <u>AHU 4.1</u>
Inspected By: <u>Gue</u>	<u>RA</u>
Next Inspect. By: <u>6 20 25</u>	

Duct Fabricators, Inc. **FIRE SAFETY DIVISION** MEMBER **NFPA**

CUYAHOGA COUNTY DAMPER INSPECTION REPORT

Date of Inspection
2023-06-20

Facility Location
Virgil E Brown Center

Damper Location
NE Corridor

Inspector Name
Julie Gue

Damper I.D. #
AHU4.1-S1

Damper Type
Vertical Fire Damper

Damper Size
56" x 16"

Damper Manufacturer
Ruskin

Damper Model #
IBD2

Fusible Link Temperature
212 Degrees

Access Door Size
18" x 18"

Pass / Fail / Abandoned
Pass

Comments / Corrections
None

Picture of Damper in Open Position



Picture of Damper in Closed Position



Picture of Damper I.D. Label



CUYAHOGA COUNTY DAMPER INSPECTION REPORT

Date of Inspection
2023-06-20

Facility Location
Virgil E Brown Center

Damper Location
NE corridor

Inspector Name
Julie Gue

Damper I.D. #
AHU4.1-S2

Damper Type
Vertical Fire Damper

Damper Size
56" x 16"

Damper Manufacturer
Ruskin

Damper Model #
IBD2

Fusible Link Temperature
212 Degrees

Access Door Size
18" x 18"

Pass / Fail / Abandoned
Pass

Comments / Corrections
None

Picture of Damper in Open Position



Picture of Damper in Closed Position



Picture of Damper I.D. Label

DAMPER	
Inspection Date: 6-20-23	Reference I.D.#: AHU4.1
Inspected By: Gue	S2
Next Inspect. By: 6-20-25	

Duct Fabricators, Inc. **FIRE SAFETY DIVISION**
883 Addison Rd. Cleveland, Ohio
216-391-2400 F: 216-391-2492 NEMI Certified HVAC Fire Life Safety Technicians

CUYAHOGA COUNTY DAMPER INSPECTION REPORT

Date of Inspection
2023-06-20

Facility Location
Virgil E Brown Center

Damper Location
NE Com Room

Inspector Name
Julie Gue

Damper I.D. #
AHU4.1-S3

Damper Type
Vertical Fire Damper

Damper Size
8" x 12"

Damper Manufacturer
Ruskin

Damper Model #
IBD2

Fusible Link Temperature
165 Degrees

Access Door Size
Open

Pass / Fail / Abandoned
Pass

Comments / Corrections
None

Picture of Damper in Open Position



Picture of Damper in Closed Position



Picture of Damper I.D. Label

FIRE DAMPER

Inspection Date: 6-20-23
Inspected By: Gue
Next Inspect. By: 6-20-25

Reference I.D.#:
AHU 4.1
S3

Duct Fabricators, Inc. 883 Addison Rd. Cleveland, Ohio P: 216-391-2400 F: 216-391-2492

FIRE SAFETY DIVISION
NEMI Certified HVAC Fire Life Safety Technicians

MEMBER
NFPA

CUYAHOGA COUNTY DAMPER INSPECTION REPORT

Date of Inspection
2023-06-20

Facility Location
Virgil E Brown Center

Damper Location
NE corridor

Inspector Name
Julie Gue

Damper I.D. #
AHU4.1-S4

Damper Type
Vertical Fire Damper

Damper Size
5" Round

Damper Manufacturer
Ruskin

Damper Model #
IBD2

Fusible Link Temperature
212 Degrees

Access Door Size
18" x 18"

Pass / Fail / Abandoned
Pass

Comments / Corrections
None

Picture of Damper in Open Position



Picture of Damper in Closed Position



Picture of Damper I.D. Label

FIRE DAMPER

Inspection Date: 6 20 23	Reference I.D.# AHU4.1
Inspected By: Gue	S4
Next Inspect. By: 6 20 25	

Duct Fabricators, Inc.
883 Addison Rd. Cleveland, Ohio
P: 216-391-2400 F: 216-391-2492

FIRE SAFETY DIVISION
NEMI Certified HVAC Fire Life Safety Technicians

MEMBER
NFPA

CUYAHOGA COUNTY DAMPER INSPECTION REPORT

Date of Inspection
2023-06-20

Facility Location
Virgil E Brown Center

Damper Location
NE corridor

Inspector Name
Julie Gue

Damper I.D. #
AHU4.1-S5

Damper Type
Vertical Fire Damper

Damper Size
16" oval

Damper Manufacturer
Ruskin

Damper Model #
IBD2

Fusible Link Temperature
212 Degrees

Access Door Size
18" x 18"

Pass / Fail / Abandoned
Pass

Comments / Corrections
None


Picture of Damper in Open Position



Picture of Damper in Closed Position



Picture of Damper I.D. Label

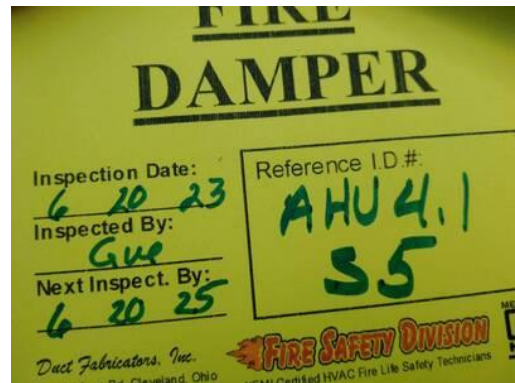

CUYAHOGA COUNTY DAMPER INSPECTION REPORT

Date of Inspection
2023-06-20

Facility Location
Virgil E Brown Center

Damper Location
NE corridor

Inspector Name
Julie Gue

Damper I.D. #
AHU4.1-S6

Damper Type
Vertical Fire Damper

Damper Size
56x16

Damper Manufacturer
Ruskin

Damper Model #
IBD2

Fusible Link Temperature
212 Degrees

Access Door Size
18x18

Pass / Fail / Abandoned
Pass

Comments / Corrections
None

Picture of Damper in Open Position



Picture of Damper in Closed Position



Picture of Damper I.D. Label

FIRE DAMPER	
Inspection Date: 6/20/23	Reference I.D.#: AHU4.1
Inspected By: Gue	
Next Inspect. By: 6/20/25	36

Duct Fabricators, Inc.
883 Addison Rd. Cleveland, Ohio
P: 216-391-2400 F: 216-391-2492

FIRE SAFETY DIVISION
NEMI Certified HVAC Fire Life Safety Technicians

Duct Fabricators, Inc.

883 Addison Rd. Cleveland, Ohio
P: 216-391-2400 F: 216-391-2492

FIRE SAFETY DIVISION

NEMI Certified HVAC Fire Life Safety Technicians



CUYAHOGA COUNTY DAMPER INSPECTION REPORT

Date of Inspection

2023-06-20

Facility Location

Virgil E Brown Center

Damper Location

NW corridor

Inspector Name

Julie Gue

Damper I.D.

AHU4.1-S7

Damper Type

Vertical Fire Damper

Damper Size

56x16

Damper Manufacturer

Ruskin

Damper Model

IBD2

Fusible Link Temperature

212 Degrees

Access Door Size

18x18

Pass / Fail / Abandoned

Pass

Comments / Corrections

None

Picture of Damper in Open Position



Picture of Damper in Closed Position



Picture of Damper I.D. Label



CUYAHOGA COUNTY DAMPER INSPECTION REPORT

Date of Inspection
2023-06-20

Facility Location
Virgil E Brown Center

Damper Location
NW corridor

Inspector Name
Julie Gue

Damper I.D. #
AHU4.1-S8

Damper Type
Vertical Fire Damper

Damper Size
8" Round

Damper Manufacturer
Ruskin

Damper Model #
IBD2


Fusible Link Temperature
212 Degrees

Access Door Size
18x18

Pass / Fail / Abandoned
Pass

Comments / Corrections
None

Picture of Damper in Open Position



Picture of Damper in Closed Position



Picture of Damper I.D. Label

FIRE DAMPER

Inspection Date: 6/20/23	Reference I.D. #: AHU 4.1 S8
Inspected By: Gue	
Next Inspect. By: 6/20/25	

Duct Fabricators, Inc.
883 Addison Rd. Cleveland, Ohio
P: 216-391-2400 F: 216-391-2492

FIRE SAFETY DIVISION
NEMI Certified HVAC Fire Life Safety Technicians

MEMBER
NFPA

CUYAHOGA COUNTY DAMPER INSPECTION REPORT

Date of Inspection
2023-06-20

Facility Location
Virgil E Brown Center

Damper Location
NW corridor

Inspector Name
Julie Gue

Damper I.D. #
AHU4.1-S9

Damper Type
Vertical Fire Damper

Damper Size
16" Oval

Damper Manufacturer
Ruskin

Damper Model #
IBD2

Fusible Link Temperature
212 Degrees

Access Door Size
18x18

Pass / Fail / Abandoned
Pass

Comments / Corrections
None

Picture of Damper in Open Position



Picture of Damper in Closed Position



Picture of Damper I.D. Label

FIRE DAMPER

Inspection Date: 6/20/23	Reference I.D.#: AHU 4.1
Inspected By: GJW	
Next Inspect. By: 6/20/25	S9

Duct Fabricators, Inc.
883 Addison Rd. Cleveland, Ohio
P: 216-391-2400 F: 216-391-2492

FIRE SAFETY DIVISION
NEMI Certified HVAC Fire Life Safety Technicians

MEMBER
NFPA

CUYAHOGA COUNTY DAMPER INSPECTION REPORT

Date of Inspection
2023-06-20

Facility Location
Virgil E Brown Center

Damper Location
NW corridor

Inspector Name
Julie Gue

Damper I.D. #
AHU4.1-S10

Damper Type
Vertical Fire Damper

Damper Size
56" x 16"

Damper Manufacturer
Ruskin

Damper Model #
IBD2

Fusible Link Temperature
212 Degrees

Access Door Size
18' x 18"

Pass / Fail / Abandoned
Pass

Comments / Corrections
None

Picture of Damper in Open Position



Picture of Damper in Closed Position



Picture of Damper I.D. Label



CUYAHOGA COUNTY DAMPER INSPECTION REPORT

Date of Inspection
2023-06-20

Facility Location
Virgil E Brown Center

Damper Location
NW Com Room

Inspector Name
Julie Gue

Damper I.D. #
AHU4.1-S11

Damper Type
Vertical Fire Damper

Damper Size
8" x 12"

Damper Manufacturer
Ruskin

Damper Model #
IBD2

Fusible Link Temperature
212 Degrees

Access Door Size
Open

Pass / Fail / Abandoned
Pass

Comments / Corrections
None

Picture of Damper in Open Position



Picture of Damper in Closed Position



Picture of Damper I.D. Label

FIRE DAMPER	
Inspection Date: 6/20/23	Reference I.D. #: AHU4.1 S11
Inspected By: JG	
Next Inspect. By: 6/20/25	

Duct Fabricators, Inc.
883 Addison Rd. Cleveland, Ohio
P: 216-391-2400 F: 216-391-2492

FIRE SAFETY DIVISION
NEMI Certified HVAC Fire Life Safety Technicians

MEMBER
NFPA

CUYAHOGA COUNTY DAMPER INSPECTION REPORT

Date of Inspection
2023-06-20

Facility Location
Virgil E Brown Center

Damper Location
NW Corridor

Inspector Name
Julie Gue

Damper I.D. #
AHU4.1-S12

Damper Type
Vertical Fire Damper

Damper Size
56" x 16"

Damper Manufacturer
Ruskin

Damper Model #
IBD2

Fusible Link Temperature
212 Degrees

Access Door Size
18" x 18"

Pass / Fail / Abandoned
Pass

Comments / Corrections
None

Picture of Damper in Open Position



Picture of Damper in Closed Position



Picture of Damper I.D. Label



CUYAHOGA COUNTY DAMPER INSPECTION REPORT

Date of Inspection
2023-06-16

Picture of Damper in Open Position

Facility Location
Virgil E Brown Center



Damper Location
Equipment room

Inspector Name
Julie Gue

Damper I.D. #
AHU4.2 OA

Picture of Damper in Closed Position

Damper Type
Vertical Fire Damper



Damper Size
96' x 24"

Damper Manufacturer
Ruskin

Damper Model #
IBD2


Fusible Link Temperature
212 Degrees

Picture of Damper I.D. Label

Access Door Size
16" x 16"

Pass / Fail / Abandoned
Pass

Comments / Corrections
None



CUYAHOGA COUNTY DAMPER INSPECTION REPORT

Date of Inspection
2023-06-20

Facility Location
Virgil E Brown Center

Damper Location
South Equipment room

Inspector Name
Julie Gue

Damper I.D. #
AHU4.2-RA

Damper Type
Vertical Fire Damper

Damper Size
96" x 60"

Damper Manufacturer
Ruskin

Damper Model #
IBD2

Fusible Link Temperature
212 Degrees

Access Door Size
Behind MOD

Pass / Fail / Abandoned
Pass

Comments / Corrections
None

Picture of Damper in Open Position



Picture of Damper in Closed Position



Picture of Damper I.D. Label



CUYAHOGA COUNTY DAMPER INSPECTION REPORT

Date of Inspection
2023-06-20

Facility Location
Virgil E Brown Center

Damper Location
SW Corridor

Inspector Name
Julie Gue

Damper I.D. #
AHU4.2-S1

Damper Type
Vertical Fire Damper

Damper Size
56" x 16"

Damper Manufacturer
Ruskin

Damper Model #
IBD2

Fusible Link Temperature
212 Degrees

Access Door Size
18" x 18"

Pass / Fail / Abandoned
Pass

Comments / Corrections
None

Picture of Damper in Open Position



Picture of Damper in Closed Position



Picture of Damper I.D. Label

FIRE DAMPER	
Inspection Date: 6 30 23	Reference I.D.#: AHU4.2
Inspected By: GW	S1
Next Inspect. By: 6 20 25	

Duct Fabricators, Inc.
883 Addison Rd. Cleveland, Ohio
P: 216-391-2400 F: 216-391-2492

FIRE SAFETY DIVISION
NEMI Certified HVAC Fire Life Safety Technicians

MEMBER
NFPA

AHU3.2-
S5

Duct Fabricators, Inc.

883 Addison Rd. Cleveland, Ohio
P: 216-391-2400 F: 216-391-2492

FIRE SAFETY DIVISION
NEMI Certified HVAC Fire Life Safety Technicians



CUYAHOGA COUNTY DAMPER INSPECTION REPORT

Date of Inspection

2023-06-20

Picture of Damper in Open Position

Facility Location

Virgil E Brown Center



Damper Location

SW Com Room

Inspector Name

Julie Gue

Damper I.D.

AHU4.2-S3

Picture of Damper in Closed Position

Damper Type

Vertical Fire Damper



Damper Size

8" x 12"

Damper Manufacturer

Ruskin

Damper Model

IBD2

Fusible Link Temperature

212 Degrees

Picture of Damper I.D. Label

Access Door Size

Open

Pass / Fail / Abandoned

Pass

Comments / Corrections

None

DAMPER

Inspection Date:
6-20-23
Inspected By:
GW
Next Inspect. By:
6-20-25

Reference I.D.#
AHV4.2
53

Duct Fabricators, Inc.
883 Addison Rd. Cleveland, Ohio
P. 216-391-2400 F. 216-391-2492



FIRE

CUYAHOGA COUNTY DAMPER INSPECTION REPORT

Date of Inspection

2023-06-16

Facility Location

Virgil E Brown Center

Damper Location

SW Corridor

Inspector Name

Julie Gue

Damper I.D. #

AHU4.2-S4

Damper Type

Vertical Fire Damper

Damper Size

56" x 16"

Damper Manufacturer

Ruskin

Damper Model #

IBD2

Fusible Link Temperature

212 Degrees

Access Door Size

18" x 18"

Pass / Fail / Abandoned

Pass

Comments / Corrections

None

Picture of Damper in Open Position



Picture of Damper in Closed Position



Picture of Damper I.D. Label



Duct Fabricators, Inc.

883 Addison Rd. Cleveland, Ohio
P: 216-391-2400 F: 216-391-2492

FIRE SAFETY DIVISION
NEMI Certified HVAC Fire Life Safety Technicians



CUYAHOGA COUNTY DAMPER INSPECTION REPORT

Date of Inspection

2023-06-16

Facility Location

Virgil E Brown Center

Damper Location

SE corridor

Inspector Name

Julie Gue

Damper I.D.

AHU4.2-S5

Damper Type

Vertical Fire Damper

Damper Size

56x16

Damper Manufacturer

Ruskin

Damper Model

IBD2

Fusible Link Temperature

212 Degrees

Access Door Size

16x16

Pass / Fail / Abandoned

Pass

Comments / Corrections

None


Picture of Damper in Open Position



Picture of Damper in Closed Position



Picture of Damper I.D. Label



CUYAHOGA COUNTY DAMPER INSPECTION REPORT

Date of Inspection
2023-06-20

Facility Location
Virgil E Brown Center

Damper Location
SE Corridor

Inspector Name
Julie Gue

Damper I.D. #
AHU4.2-S6

Damper Type
Vertical Fire Damper

Damper Size
6" Round

Damper Manufacturer
Ruskin

Damper Model #
IBD2

Fusible Link Temperature
212 Degrees

Access Door Size
18" x 18"


Pass / Fail / Abandoned
Pass

Comments / Corrections
None

Picture of Damper in Open Position



Picture of Damper in Closed Position



Picture of Damper I.D. Label

<u>FIRE</u>	
<u>DAMPER</u>	
Inspection Date: 6 20 23	Reference I.D.# AHU 4.2
Inspected By: Gue	S-6
Next Inspect. By: 6 20 25	

CUYAHOGA COUNTY DAMPER INSPECTION REPORT

Date of Inspection
2023-06-16

Facility Location
Virgil E Brown Center

Damper Location
SE Corridor

Inspector Name
Julie Gue

Damper I.D. #
AHU4.2-S7

Damper Type
Vertical Fire Damper

Damper Size
56" x 16"

Damper Manufacturer
Ruskin

Damper Model #
IBD2

Fusible Link Temperature
212 Degrees

Access Door Size
18" x 18"

Pass / Fail / Abandoned
Pass

Comments / Corrections
None

Picture of Damper in Open Position



Picture of Damper in Closed Position



Picture of Damper I.D. Label



CUYAHOGA COUNTY DAMPER INSPECTION REPORT

Date of Inspection
2023-06-20

Facility Location
Virgil E Brown Center

Damper Location
SE Com room

Inspector Name
Julie Gue

Damper I.D. #
AHU4.2-S8

Damper Type
Vertical Fire Damper

Damper Size
8" x 12"

Damper Manufacturer
Ruskin

Damper Model #
Unknown

Fusible Link Temperature
212 Degrees

Access Door Size
Open

Pass / Fail / Abandoned
Pass

Comments / Corrections
None


Picture of Damper in Open Position



Picture of Damper in Closed Position



Picture of Damper I.D. Label



CUYAHOGA COUNTY DAMPER INSPECTION REPORT

Date of Inspection

2023-07-11

Facility Location

Virgil E Brown Center

Damper Location

4th floor South.

Inspector Name

Dan Tulcewicz

Damper I.D. #

AHU4.2-S9

Damper Type

Vertical Fire Damper

Damper Size

20"x8" oval

Damper Manufacturer

Ruskin

Damper Model #

IBD2

Fusible Link Temperature

165 Degrees

Access Door Size

18"x18"

Pass / Fail / Abandoned

Pass

Comments / Corrections

None


Picture of Damper in Open Position



Picture of Damper in Closed Position



Picture of Damper I.D. Label



CUYAHOGA COUNTY DAMPER INSPECTION REPORT

Date of Inspection
2023-06-16

Facility Location
Virgil E Brown Center

Damper Location
SE Corridor

Inspector Name
Julie Gue

Damper I.D. #
AHU4.2-S10

Damper Type
Vertical Fire Damper

Damper Size
56" x 16"

Damper Manufacturer
Ruskin

Damper Model #
IBD2

Fusible Link Temperature
212 Degrees

Access Door Size
18" x 18"

Pass / Fail / Abandoned
Pass

Comments / Corrections
None

Picture of Damper in Open Position



Picture of Damper in Closed Position



Picture of Damper I.D. Label

FIRE DAMPER	
Inspection Date: <i>6 16 23</i>	Reference I.D.#: AHU 4.2
Inspected By: <i>GUE</i>	S10
Next Inspect. By: <i>6 16 25</i>	

Duct Fabricators, Inc.
883 Addison Rd. Cleveland, Ohio
P: 216-391-2400 F: 216-391-2492

FIRE SAFETY DIVISION
NEMI Certified HVAC Fire Life Safety Technicians

CUYAHOGA COUNTY DAMPER INSPECTION REPORT

Date of Inspection
2023-07-11

Facility Location
Virgil E Brown Center

Damper Location
Room #450

Inspector Name
Dan Tulcewicz

Damper I.D. #
AHU4.2-S11

Damper Type
Vertical Fire Damper

Damper Size
36"x8"

Damper Manufacturer
Ruskin

Damper Model #
IBD2

Fusible Link Temperature
165 Degrees

Access Door Size
12"x12"

Pass / Fail / Abandoned
Pass

Comments / Corrections
None

Picture of Damper in Open Position



Picture of Damper in Closed Position



Picture of Damper I.D. Label



Duct Fabricators, Inc.

883 Addison Rd. Cleveland, Ohio
P: 216-391-2400 F:216-391-2492



NEMI Certified HVAC Fire Life Safety Technicians



CUYAHOGA COUNTY DAMPER INSPECTION REPORT

Date of Inspection

2023-07-11

Facility Location

Virgil E Brown Center

Damper Location

Room #450

Inspector Name

Dan Tulcewicz

Damper I.D. #

AHU4.2-S12

Damper Type

Vertical Fire Damper

Damper Size

36"x8"

Damper Manufacturer

Ruskin

Damper Model #

IBD2

Fusible Link Temperature

165 Degrees

Access Door Size

12"x12"

Pass / Fail / Abandoned

Pass

Comments / Corrections

None


Picture of Damper in Open Position



Picture of Damper in Closed Position



Picture of Damper I.D. Label



CUYAHOGA COUNTY DAMPER INSPECTION REPORT

Date of Inspection

2023-07-11

Facility Location

Virgil E Brown Center

Damper Location

5th floor North mechanical room.

Inspector Name

Dan Tulcewicz

Damper I.D. #

AHU5.1-OA

Damper Type

Vertical Fire Damper

Damper Size

96"x36"

Damper Manufacturer

Ruskin

Damper Model #

IBD2

Fusible Link Temperature

212 Degrees

Access Door Size

16"x16"

Pass / Fail / Abandoned

Pass

Comments / Corrections

None


Picture of Damper in Open Position



Picture of Damper in Closed Position



Picture of Damper I.D. Label



Duct Fabricators, Inc.

883 Addison Rd. Cleveland, Ohio
P: 216-391-2400 F: 216-391-2492

FIRE SAFETY DIVISION

NEMI Certified HVAC Fire Life Safety Technicians



CUYAHOGA COUNTY DAMPER INSPECTION REPORT

Date of Inspection

2023-07-11

Facility Location

Virgil E Brown Center

Damper Location

5th floor North mechanical room.

Inspector Name

Dan Tulcewicz

Damper I.D.

AHU5.1-RA

Damper Type

Vertical Fire Damper

Damper Size

96"x84"

Damper Manufacturer

Ruskin

Damper Model

IBD2

Fusible Link Temperature

212 Degrees

Access Door Size

Open

Pass / Fail / Abandoned

Pass

Comments / Corrections

None


Picture of Damper in Open Position



Picture of Damper in Closed Position



Picture of Damper I.D. Label



CUYAHOGA COUNTY DAMPER INSPECTION REPORT

Date of Inspection
2023-06-15

Facility Location
Virgil E Brown Center

Damper Location
North

Inspector Name
Dan Tulcewicz

Damper I.D. #
AHU5.1-S1

Damper Type
Vertical Fire Damper

Damper Size
56"x18"

Damper Manufacturer
Ruskin

Damper Model #
IBD2

Fusible Link Temperature
212 Degrees

Access Door Size
18"x18"


Pass / Fail / Abandoned
Pass

Comments / Corrections
None


Picture of Damper in Open Position



Picture of Damper in Closed Position



Picture of Damper I.D. Label



CUYAHOGA COUNTY DAMPER INSPECTION REPORT

Date of Inspection
2023-06-15

Facility Location
Virgil E Brown Center

Damper Location
North

Inspector Name
Dan Tulcewicz

Damper I.D. #
AHU5.1-S2

Damper Type
Vertical Fire Damper

Damper Size
56"x18"

Damper Manufacturer
Ruskin

Damper Model #
IBD2

Fusible Link Temperature
212 Degrees

Access Door Size
18"x18"

Pass / Fail / Abandoned
Pass

Comments / Corrections
None

Picture of Damper in Open Position



Picture of Damper in Closed Position



Picture of Damper I.D. Label

FIRE DAMPER

Inspection Date: 6-15-23
Inspected By: Tulcewicz
Next Inspect. By: 6-15-25

Reference I.D.#: AHU5.1-S2

Duct Fabricators, Inc.
883 Addison Rd. Cleveland, Ohio
P: 216-391-2400 F: 216-391-2492

FIRE SAFETY DIVISION
NEMI Certified HVAC Fire Life Safety Technicians

MEMBER
NFPA

CUYAHOGA COUNTY DAMPER INSPECTION REPORT

Date of Inspection

2023-06-15

Facility Location

Virgil E Brown Center

Damper Location

North

Inspector Name

Dan Tulcewicz

Damper I.D. #

AHU5.1-S3

Damper Type

Vertical Fire Damper

Damper Size

36"x18"

Damper Manufacturer

Ruskin

Damper Model #

IBD2

Fusible Link Temperature

212 Degrees

Access Door Size

18"x18"

Pass / Fail / Abandoned

Pass

Comments / Corrections

None


Picture of Damper in Open Position



Picture of Damper in Closed Position



Picture of Damper I.D. Label



CUYAHOGA COUNTY DAMPER INSPECTION REPORT

Date of Inspection
2023-06-15

Facility Location
Virgil E Brown Center

Damper Location
North

Inspector Name
Dan Tulcewicz

Damper I.D. #
AHU5.1-S4

Damper Type
Vertical Fire Damper

Damper Size
36"x18"

Damper Manufacturer
Ruskin

Damper Model #
IBD2

Fusible Link Temperature
212 Degrees

Access Door Size
18"x18"

Pass / Fail / Abandoned
Pass

Comments / Corrections
None


Picture of Damper in Open Position



Picture of Damper in Closed Position



Picture of Damper I.D. Label

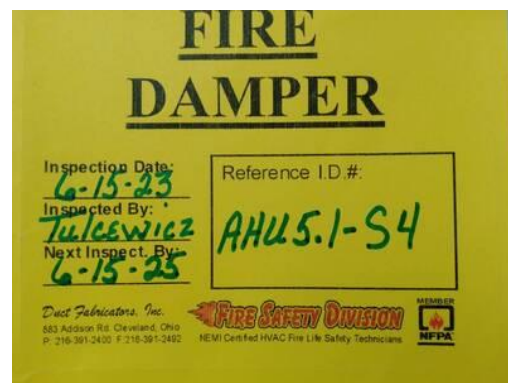

CUYAHOGA COUNTY DAMPER INSPECTION REPORT

Date of Inspection
2023-06-15

Facility Location
Virgil E Brown Center

Damper Location
North

Inspector Name
Dan Tulcewicz

Damper I.D. #
AHU5.1-S5

Damper Type
Vertical Fire Damper

Damper Size
56" x 18"

Damper Manufacturer
Ruskin

Damper Model #
IBD2

Fusible Link Temperature
212 Degrees

Access Door Size
18" x 18"


Pass / Fail / Abandoned
Pass

Comments / Corrections
None


Picture of Damper in Open Position



Picture of Damper in Closed Position



Picture of Damper I.D. Label



CUYAHOGA COUNTY DAMPER INSPECTION REPORT

Date of Inspection
2023-06-15

Facility Location
Virgil E Brown Center

Damper Location
North

Inspector Name
Dan Tulcewicz

Damper I.D. #
AHU5.1-S6

Damper Type
Vertical Fire Damper

Damper Size
56" x 18"

Damper Manufacturer
Ruskin

Damper Model #
IBD2

Fusible Link Temperature
212 Degrees

Access Door Size
18" x 18"


Pass / Fail / Abandoned
Pass

Comments / Corrections
None

Picture of Damper in Open Position



Picture of Damper in Closed Position



Picture of Damper I.D. Label

FIRE DAMPER

Inspection Date: 6-15-23
Inspected By: Tulcewicz
Next Inspect. By: 6-15-27

Reference I.D.#: AHU5.1-S6

Duct Fabricators, Inc.
883 Addison Rd. Cleveland, Ohio
P: 216-391-2400 F: 216-391-2492

FIRE SAFETY DIVISION
NEMI Certified HVAC Fire Life Safety Technicians

MEMBER
NFPA

CUYAHOGA COUNTY DAMPER INSPECTION REPORT

Date of Inspection
2023-06-23

Picture of Damper in Open Position

Facility Location
Virgil E Brown Center



Damper Location
North Com Room

Inspector Name
Dan Tulcewicz

Damper I.D. #
AHU5.1-S7

Picture of Damper in Closed Position

Damper Type
Vertical Fire Damper



Damper Size
8" x 12"

Damper Manufacturer
Ruskin

Damper Model #
IBD2


Fusible Link Temperature
212 Degrees

Picture of Damper I.D. Label

Access Door Size
Open

Pass / Fail / Abandoned
Pass

Comments / Corrections
None

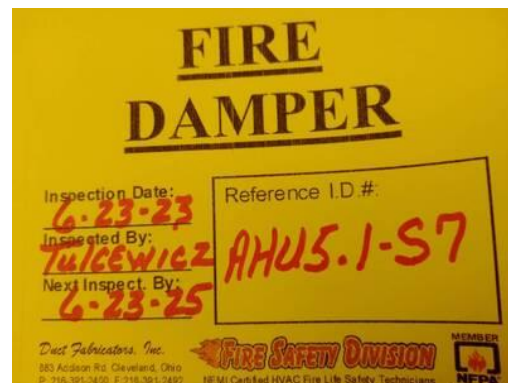

CUYAHOGA COUNTY DAMPER INSPECTION REPORT

Date of Inspection
2023-06-23

Facility Location
Virgil E Brown Center

Damper Location
North Com Room

Inspector Name
Dan Tulcewicz

Damper I.D. #
AHU5.1-S8

Damper Type
Vertical Fire Damper

Damper Size
8" x 12"

Damper Manufacturer
Ruskin

Damper Model #
IBD2

Fusible Link Temperature
212 Degrees

Access Door Size
Open

Pass / Fail / Abandoned
Pass

Comments / Corrections
None


Picture of Damper in Open Position



Picture of Damper in Closed Position



Picture of Damper I.D. Label



CUYAHOGA COUNTY DAMPER INSPECTION REPORT

Date of Inspection
2023-06-15

Facility Location
Virgil E Brown Center

Damper Location
North Corridor

Inspector Name
Dan Tulcewicz

Damper I.D. #
AHU5.1-S9

Damper Type
Vertical Fire Damper

Damper Size
10" Oval

Damper Manufacturer
Ruskin

Damper Model #
IBD2

Fusible Link Temperature
212 Degrees

Access Door Size
18" x 18"

Pass / Fail / Abandoned
Pass

Comments / Corrections
None

Picture of Damper in Open Position



Picture of Damper in Closed Position



Picture of Damper I.D. Label

<u>FIRE</u> <u>DAMPER</u>	
Inspection Date: 6-15-23	Reference I.D.#: AHU5.1-S9
Inspected By: TULCEWICZ	
Next Inspect. By: 6-15-25	
<small>Duct Fabricators, Inc. 883 Addison Rd. Cleveland, Ohio P: 216-391-2400 F: 216-391-2492</small>	
FIRE SAFETY DIVISION NEMI Certified HVAC Fire Life Safety Technicians	
<small>MEMBER</small> NFPA	

CUYAHOGA COUNTY DAMPER INSPECTION REPORT

Date of Inspection

2023-06-15

Facility Location

Virgil E Brown Center

Damper Location

North

Inspector Name

Dan Tulcewicz

Damper I.D. #

AHU5.1-S10

Damper Type

Vertical Fire Damper

Damper Size

40" x 10"

Damper Manufacturer

Ruskin

Damper Model #

IBD2

Fusible Link Temperature

212 Degrees

Access Door Size

16" x 16"

Pass / Fail / Abandoned

Pass

Comments / Corrections

None


Picture of Damper in Open Position



Picture of Damper in Closed Position



Picture of Damper I.D. Label



CUYAHOGA COUNTY DAMPER INSPECTION REPORT

Date of Inspection
2023-06-15

Facility Location
Virgil E Brown Center

Damper Location
North

Inspector Name
Dan Tulcewicz

Damper I.D. #
AHU5.1-S12

Damper Type
Vertical Fire Damper

Damper Size
10" oval

Damper Manufacturer
Ruskin

Damper Model #
IBD2

Fusible Link Temperature
212 Degrees

Access Door Size
18"x18"

Pass / Fail / Abandoned
Pass

Comments / Corrections
None

Picture of Damper in Open Position



Picture of Damper in Closed Position



Picture of Damper I.D. Label

FIRE
DAMPER

Inspection Date: 6-15-23
Inspected By: TULCEWICZ
Next Inspect. By: 6-15-25

Reference I.D.#: AHU5.1-S12

Duct Fabricators, Inc.
883 Addison Rd. Cleveland, Ohio
P: 216-391-2400 F:216-391-2492

FIRE SAFETY DIVISION
NEMI Certified HVAC Fire Life Safety Technicians

MEMBER
NFPA

CUYAHOGA COUNTY DAMPER INSPECTION REPORT

Date of Inspection

2023-06-20

Facility Location

Virgil E Brown Center

Damper Location

North

Inspector Name

Larry Coreno

Damper I.D. #

AUH5.1-S13

Damper Type

Vertical Fire Damper

Damper Size

24" x 10"

Damper Manufacturer

Ruskin

Damper Model #

IBD2

Fusible Link Temperature

212 Degrees

Access Door Size

16" x 16"

Pass / Fail / Abandoned

Pass

Comments / Corrections

None

Picture of Damper in Open Position



Picture of Damper in Closed Position



Picture of Damper I.D. Label



CUYAHOGA COUNTY DAMPER INSPECTION REPORT

Date of Inspection
2023-06-20

Facility Location
Virgil E Brown Center

Damper Location
South Mechanical Rm

Inspector Name
Larry Coreno

Damper I.D. #
AHU5.2-OA

Damper Type
Vertical Fire Damper

Damper Size
96" x 36"

Damper Manufacturer
Ruskin

Damper Model #
IBD2

Fusible Link Temperature
212 Degrees

Access Door Size
16" x 16"

Pass / Fail / Abandoned
Pass

Comments / Corrections
None

Picture of Damper in Open Position



Picture of Damper in Closed Position



Picture of Damper I.D. Label



CUYAHOGA COUNTY DAMPER INSPECTION REPORT

Date of Inspection
2023-06-20

Facility Location
Virgil E Brown Center

Damper Location
South

Inspector Name
Larry Coreno

Damper I.D. #
AHU5.2-R1

Damper Type
Vertical Fire Damper

Damper Size
24" x 18'

Damper Manufacturer
Ruskin

Damper Model #
IBD2

Fusible Link Temperature
212 Degrees

Access Door Size
18" x 18"

Pass / Fail / Abandoned
Pass

Comments / Corrections
None


Picture of Damper in Open Position



Picture of Damper in Closed Position



Picture of Damper I.D. Label



CUYAHOGA COUNTY DAMPER INSPECTION REPORT

Date of Inspection
2023-06-20

Facility Location
Virgil E Brown Center

Damper Location
South Mechanical Room

Inspector Name
Larry Coreno

Damper I.D. #
AHU5.2-RA

Damper Type
Vertical Fire Damper

Damper Size
96" x 84"

Damper Manufacturer
Ruskin

Damper Model #
IBD2

Fusible Link Temperature
212 Degrees

Access Door Size
Open

Pass / Fail / Abandoned
Pass

Comments / Corrections
None


Picture of Damper in Open Position



Picture of Damper in Closed Position



Picture of Damper I.D. Label



Duct Fabricators, Inc.

883 Addison Rd. Cleveland, Ohio
P: 216-391-2400 F: 216-391-2492



NEMI Certified HVAC Fire Life Safety Technicians



CUYAHOGA COUNTY DAMPER INSPECTION REPORT

Date of Inspection

2023-06-15

Facility Location

Old Courthouse

Damper Location

South

Inspector Name

Dan Tulcewicz

Damper I.D.

AHU5.2-S1

Damper Type

Vertical Fire Damper

Damper Size

56"x18"

Damper Manufacturer

Ruskin

Damper Model

IBD2

Fusible Link Temperature

212 Degrees

Access Door Size

18"x18"

Pass / Fail / Abandoned

Pass

Comments / Corrections

None

Picture of Damper in Open Position



Picture of Damper in Closed Position



Picture of Damper I.D. Label

FIRE DAMPER	
Inspection Date: 6-15-23	Reference I.D.#
Inspected By: TULCEWICZ	AHU5.2-S1
Next Inspect. By: 6-15-25	

Duct Fabricators, Inc.
883 Addison Rd. Cleveland, Ohio
P: 216-391-2400 F: 216-391-2492

FIRE SAFETY DIVISION
NEMI Certified HVAC Fire Life Safety Technicians

MEMBER
NFPA

CUYAHOGA COUNTY DAMPER INSPECTION REPORT

Date of Inspection

2023-06-15

Facility Location

Virgil E Brown Center

Damper Location

South

Inspector Name

Dan Tulcewicz

Damper I.D. #

AHU5.2-S2

Damper Type

Vertical Fire Damper

Damper Size

56"x18"

Damper Manufacturer

Ruskin

Damper Model #

IBD2

Fusible Link Temperature

212 Degrees

Access Door Size

18"x18"

Pass / Fail / Abandoned

Pass

Comments / Corrections

None


Picture of Damper in Open Position



Picture of Damper in Closed Position



Picture of Damper I.D. Label



CUYAHOGA COUNTY DAMPER INSPECTION REPORT

Date of Inspection

2023-06-15

Facility Location

Virgil E Brown Center

Damper Location

South

Inspector Name

Dan Tulcewicz

Damper I.D. #

AHU5.2-S3

Damper Type

Vertical Fire Damper

Damper Size

36"x18"

Damper Manufacturer

Ruskin

Damper Model #

IBD2

Fusible Link Temperature

212 Degrees

Access Door Size

18"x18"

Pass / Fail / Abandoned

Pass

Comments / Corrections

None


Picture of Damper in Open Position



Picture of Damper in Closed Position



Picture of Damper I.D. Label



CUYAHOGA COUNTY DAMPER INSPECTION REPORT

Date of Inspection

2023-06-15

Facility Location

Virgil E Brown Center

Damper Location

South

Inspector Name

Dan Tulcewicz

Damper I.D. #

AHU5.2-S4

Damper Type

Vertical Fire Damper

Damper Size

36"x18"

Damper Manufacturer

Ruskin

Damper Model #

IBD2

Fusible Link Temperature

212 Degrees

Access Door Size

18"x18"

Pass / Fail / Abandoned

Pass

Comments / Corrections

None


Picture of Damper in Open Position



Picture of Damper in Closed Position



Picture of Damper I.D. Label



CUYAHOGA COUNTY DAMPER INSPECTION REPORT

Date of Inspection

2023-06-15

Facility Location

Virgil E Brown Center

Damper Location

South

Inspector Name

Dan Tulcewicz

Damper I.D. #

AHU5.2-S5

Damper Type

Vertical Fire Damper

Damper Size

56"x18"

Damper Manufacturer

Ruskin

Damper Model #

IBD2

Fusible Link Temperature

212 Degrees

Access Door Size

16"x16"

Pass / Fail / Abandoned

Pass

Comments / Corrections

None


Picture of Damper in Open Position



Picture of Damper in Closed Position



Picture of Damper I.D. Label



CUYAHOGA COUNTY DAMPER INSPECTION REPORT

Date of Inspection
2023-06-15

Facility Location
Virgil E Brown Center

Damper Location
5th floor South

Inspector Name
Dan Tulcewicz

Damper I.D. #
AHU5.2-S6

Damper Type
Vertical Fire Damper

Damper Size
56"x18"

Damper Manufacturer
Ruskin

Damper Model #
IBD2

Fusible Link Temperature
212 Degrees

Access Door Size
18"x18"

Pass / Fail / Abandoned
Pass

Comments / Corrections
None


Picture of Damper in Open Position



Picture of Damper in Closed Position



Picture of Damper I.D. Label



CUYAHOGA COUNTY DAMPER INSPECTION REPORT

Date of Inspection
2023-06-20

Facility Location
Virgil E Brown Center

Damper Location
South

Inspector Name
Larry Coreno

Damper I.D. #
AHU5.2-S7

Damper Type
Vertical Fire Damper

Damper Size
8" x 10"

Damper Manufacturer
Ruskin

Damper Model #
IBD2

Fusible Link Temperature
212 Degrees

Access Door Size
Open

Pass / Fail / Abandoned
Pass

Comments / Corrections
None

Picture of Damper in Open Position



Picture of Damper in Closed Position



Picture of Damper I.D. Label



CUYAHOGA COUNTY DAMPER INSPECTION REPORT

Date of Inspection
2023-06-20

Picture of Damper in Open Position

Facility Location
Virgil E Brown Center



Damper Location
South

Inspector Name
Larry Coreno

Damper I.D. #
AHU5.2-S8

Picture of Damper in Closed Position

Damper Type
Vertical Fire Damper



Damper Size
8" x 10"

Damper Manufacturer
Ruskin

Damper Model #
IBD2


Fusible Link Temperature
212 Degrees

Picture of Damper I.D. Label

Access Door Size
Open face

Pass / Fail / Abandoned
Pass

Comments / Corrections
None

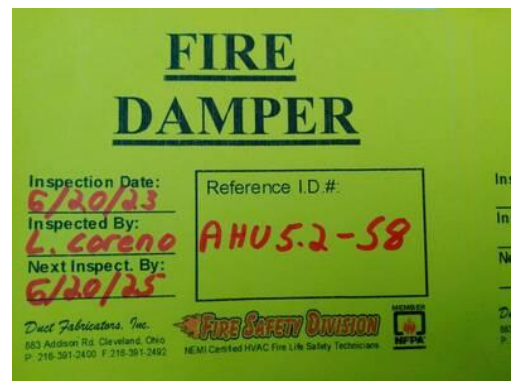

CUYAHOGA COUNTY DAMPER INSPECTION REPORT

Date of Inspection
2023-06-20

Facility Location
Virgil E Brown Center

Damper Location
South

Inspector Name
Larry Coreno

Damper I.D. #
AHU5.2-S9

Damper Type
Vertical Fire Damper

Damper Size
16" Oval

Damper Manufacturer
Ruskin

Damper Model #
IBD2

Fusible Link Temperature
212 Degrees

Access Door Size
18" x 18"


Pass / Fail / Abandoned
Pass

Comments / Corrections
None


Picture of Damper in Open Position



Picture of Damper in Closed Position

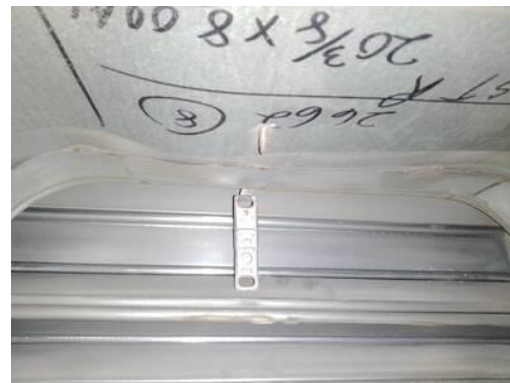

Picture of Damper I.D. Label



CUYAHOGA COUNTY DAMPER INSPECTION REPORT

Date of Inspection
2023-06-20

Facility Location
Virgil E Brown Center

Damper Location
South

Inspector Name
Larry Coreno

Damper I.D. #
AHU5.2-S10

Damper Type
Vertical Fire Damper

Damper Size
16" Oval

Damper Manufacturer
Ruskin

Damper Model #
IBD2

Fusible Link Temperature
212 Degrees

Access Door Size
18" x 18"

Pass / Fail / Abandoned
Pass

Comments / Corrections
None

Picture of Damper in Open Position



Picture of Damper in Closed Position



Picture of Damper I.D. Label



CUYAHOGA COUNTY DAMPER INSPECTION REPORT

Date of Inspection
2023-06-20

Facility Location
Virgil E Brown Center

Damper Location
South

Inspector Name
Larry Coreno

Damper I.D. #
AHU5.2-S11

Damper Type
Vertical Fire Damper

Damper Size
8" Round

Damper Manufacturer
Ruskin

Damper Model #
IBD2

Fusible Link Temperature
212 Degrees

Access Door Size
Flex

Pass / Fail / Abandoned
Pass

Comments / Corrections
None

Picture of Damper in Open Position



Picture of Damper in Closed Position



Picture of Damper I.D. Label

FIRE DAMPER

Inspection Date: 6/20/23	Reference I.D.#:
Inspected By: L. Coreno	AHU5.2-S11
Next Inspect. By: 6/20/25	

Duct Fabricators, Inc.
883 Addison Rd. Cleveland, Ohio
P: 216-391-2400 F: 216-391-2492

FIRE SAFETY DIVISION
NEMI Certified HVAC Fire Life Safety Technicians

MEMBER
NFPA

CUYAHOGA COUNTY DAMPER INSPECTION REPORT

Date of Inspection
2023-06-20

Facility Location
Virgil E Brown Center

Damper Location
South

Inspector Name
Larry Coreno

Damper I.D. #
AHU 5.2 -S12

Damper Type
Vertical Fire Damper

Damper Size
44" x 12"

Damper Manufacturer
Ruskin

Damper Model #
IBD2

Fusible Link Temperature
212 Degrees

Access Door Size
16" x 16"

Pass / Fail / Abandoned
Pass

Comments / Corrections
None

Picture of Damper in Open Position



Picture of Damper in Closed Position



Picture of Damper I.D. Label

FIRE DAMPER

Inspection Date: 6/20/23	Reference I.D. #: AHUS-2-S12
Inspected By: L. Coreno	
Next Inspect. By: 6/20/25	

Duct Fabricators, Inc.
883 Addison Rd. Cleveland, Ohio
P: 216-391-2400 F: 216-391-2492

FIRE SAFETY DIVISION
NEMI Certified HVAC Fire Life Safety Technicians

MEMBER
NFPA

CUYAHOGA COUNTY DAMPER INSPECTION REPORT

Date of Inspection
2023-06-20

Facility Location
Virgil E Brown Center

Damper Location
South

Inspector Name
Larry Coreno

Damper I.D. #
AHU5.2- S13

Damper Type
Vertical Fire Damper

Damper Size
46" x 10"

Damper Manufacturer
Ruskin

Damper Model #
IBD2

Fusible Link Temperature
212 Degrees

Access Door Size
16" x 16'

Pass / Fail / Abandoned
Pass

Comments / Corrections
None


Picture of Damper in Open Position



Picture of Damper in Closed Position



Picture of Damper I.D. Label

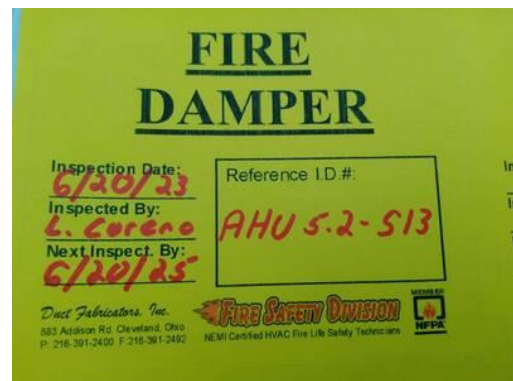

CUYAHOGA COUNTY DAMPER INSPECTION REPORT

Date of Inspection
2023-06-15

Facility Location
Virgil E Brown Center

Damper Location
South Corridor.

Inspector Name
Dan Tulcewicz

Damper I.D. #
AHU5.2-S14

Damper Type
Vertical Fire Damper

Damper Size
8" Round

Damper Manufacturer
Ruskin

Damper Model #
IBD2

Fusible Link Temperature
212 Degrees

Access Door Size
20" x 20"

Pass / Fail / Abandoned
Pass

Comments / Corrections
None

Picture of Damper in Open Position



Picture of Damper in Closed Position



Picture of Damper I.D. Label

<u>FIRE</u> <u>DAMPER</u>	
Inspection Date: 6-15-23	Reference I.D. #: AHU5.2-S14
Inspected By: TULCEWICZ	
Next Inspect. By: 6-15-25	
<small>Duct Fabricators, Inc. 883 Addison Rd. Cleveland, Ohio P: 216-391-2400 F: 216-391-2492</small>	
FIRE SAFETY DIVISION <small>NEMI Certified HVAC Fire Life Safety Technicians</small>	
<small>MEMBER NFPA</small>	

CUYAHOGA COUNTY DAMPER INSPECTION REPORT

Date of Inspection
2023-06-15

Facility Location
Virgil E Brown Center

Damper Location
South

Inspector Name
Dan Tulcewicz

Damper I.D. #
AHU5.2-S15

Damper Type
Vertical Fire Damper

Damper Size
16"Oval

Damper Manufacturer
Ruskin

Damper Model #
IBD2

Fusible Link Temperature
212 Degrees

Access Door Size
18"x18"


Pass / Fail / Abandoned
Pass

Comments / Corrections
None

Picture of Damper in Open Position



Picture of Damper in Closed Position



Picture of Damper I.D. Label

FIRE
DAMPER

Inspection Date: 6-15-23	Reference I.D. #: AHU5.2-S15
Inspected By: TULCEWICZ	
Next Inspect. By: 6-15-25	

Duct Fabricators, Inc.
883 Addison Rd. Cleveland, Ohio
P: 216-391-2400 F:216-391-2492

FIRE SAFETY DIVISION
NEMI Certified HVAC Fire Life Safety Technicians

MEMBER
NFPA

CUYAHOGA COUNTY DAMPER INSPECTION REPORT

Date of Inspection
2023-06-15

Facility Location
Virgil E Brown Center

Damper Location
South

Inspector Name
Dan Tulcewicz

Damper I.D. #
AHU5.2-S16

Damper Type
Vertical Fire Damper

Damper Size
6" Round

Damper Manufacturer
Ruskin

Damper Model #
IBD2

Fusible Link Temperature
212 Degrees

Access Door Size
18"x18"

Pass / Fail / Abandoned
Pass

Comments / Corrections
None


Picture of Damper in Open Position



Picture of Damper in Closed Position



Picture of Damper I.D. Label



CUYAHOGA COUNTY DAMPER INSPECTION REPORT

Date of Inspection
2023-06-15

Facility Location
Virgil E Brown Center

Damper Location
South

Inspector Name
Dan Tulcewicz

Damper I.D. #
AHU5.2-S17

Damper Type
Vertical Fire Damper

Damper Size
20"x10"

Damper Manufacturer
Ruskin

Damper Model #
IBD2

Fusible Link Temperature
212 Degrees

Access Door Size
14"x14"

Pass / Fail / Abandoned
Pass

Comments / Corrections
None


Picture of Damper in Open Position



Picture of Damper in Closed Position



Picture of Damper I.D. Label



CUYAHOGA COUNTY DAMPER INSPECTION REPORT

Date of Inspection
2023-06-20

Facility Location
Virgil E Brown Center

Damper Location
South

Inspector Name
Larry Coreno

Damper I.D. #
AHU5.2-S18

Damper Type
Vertical Fire Damper

Damper Size
144" x 6"

Damper Manufacturer
Ruskin

Damper Model #
IBD2

Fusible Link Temperature
212 Degrees

Access Door Size
Grille

Pass / Fail / Abandoned
Pass

Comments / Corrections
None


Picture of Damper in Open Position



Picture of Damper in Closed Position



Picture of Damper I.D. Label



CUYAHOGA COUNTY DAMPER INSPECTION REPORT

Date of Inspection

2023-07-06

Facility Location

Virgil E Brown Center

Damper Location

North Mechanical room

Inspector Name

Julie Gue

Damper I.D. #

AHUG.1-OA

Damper Type

Vertical Fire Damper

Damper Size

96x24

Damper Manufacturer

Ruskin

Damper Model #

IBD2

Fusible Link Temperature

212 Degrees

Access Door Size

16x16

Pass / Fail / Abandoned

Pass

Comments / Corrections

None

Picture of Damper in Open Position



Picture of Damper in Closed Position



Picture of Damper I.D. Label

FIRE DAMPER

Inspection Date:
7/6/25
Inspected By:
Gue
Next Inspect By:
7/6/25

Reference ID #
AHUG-1
OA

Chief, Philadelphia Fire Department
15th Street, Philadelphia, PA 19102
Phone: (215) 686-3100
www.phila.gov



CUYAHOGA COUNTY DAMPER INSPECTION REPORT

Date of Inspection
2023-07-06

Facility Location
Virgil E Brown Center

Damper Location
North Mechanical room

Inspector Name
Julie Gue

Damper I.D. #
AHUG.1-RA

Damper Type
Vertical Fire Damper

Damper Size
98x48

Damper Manufacturer
Ruskin

Damper Model #
IBD2

Fusible Link Temperature
212 Degrees

Access Door Size
Open

Pass / Fail / Abandoned
Pass

Comments / Corrections
None

Picture of Damper in Open Position



Picture of Damper in Closed Position



Picture of Damper I.D. Label



Duct Fabricators, Inc.

883 Addison Rd. Cleveland, Ohio
P: 216-391-2400 F: 216-391-2492



NEMI Certified HVAC Fire Life Safety Technicians



CUYAHOGA COUNTY DAMPER INSPECTION REPORT

Date of Inspection

2023-07-05

Facility Location

Virgil E Brown Center

Damper Location

North Corridor

Inspector Name

Dan Tulcewicz

Damper I.D.

AHUG.1-S2

Damper Type

Vertical Fire Damper

Damper Size

46"x16"

Damper Manufacturer

Ruskin

Damper Model

IBD2

Fusible Link Temperature

212 Degrees

Access Door Size

18"x18"

Pass / Fail / Abandoned

Pass

Comments / Corrections

None


Picture of Damper in Open Position



Picture of Damper in Closed Position



Picture of Damper I.D. Label

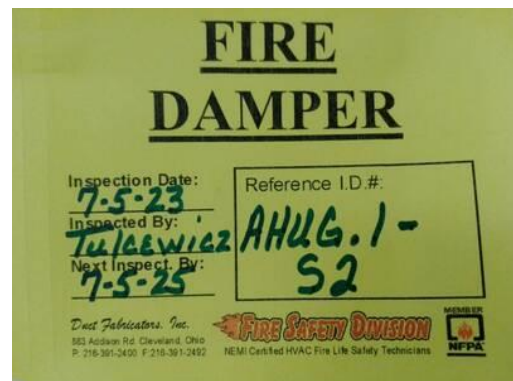

Duct Fabricators, Inc.

883 Addison Rd. Cleveland, Ohio
P: 216-391-2400 F: 216-391-2492



NEMI Certified HVAC Fire Life Safety Technicians



CUYAHOGA COUNTY DAMPER INSPECTION REPORT

Date of Inspection

2023-07-05

Facility Location

Virgil E Brown Center

Damper Location

Ground North

Inspector Name

Dan Tulcewicz

Damper I.D.

AHUG.1-S3

Damper Type

Vertical Fire Damper

Damper Size

46"x16"

Damper Manufacturer

Ruskin

Damper Model

IBD2

Fusible Link Temperature

212 Degrees

Access Door Size

18"x18"

Pass / Fail / Abandoned

Pass

Comments / Corrections

None


Picture of Damper in Open Position



Picture of Damper in Closed Position



Picture of Damper I.D. Label

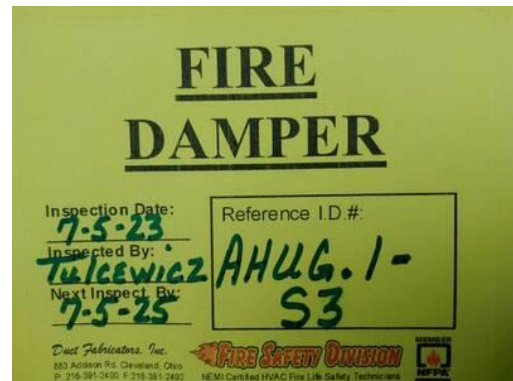

Duct Fabricators, Inc.

883 Addison Rd. Cleveland, Ohio
P: 216-391-2400 F: 216-391-2492

FIRE SAFETY DIVISION

NEMI Certified HVAC Fire Life Safety Technicians



CUYAHOGA COUNTY DAMPER INSPECTION REPORT

Date of Inspection

2023-07-05

Facility Location

Virgil E Brown Center

Damper Location

NE com room.

Inspector Name

Dan Tulcewicz

Damper I.D.

AHUG.1-S4

Damper Type

Vertical Fire Damper

Damper Size

8"x12"

Damper Manufacturer

Ruskin

Damper Model

IBD2

Fusible Link Temperature

212 Degrees

Access Door Size

Open

Pass / Fail / Abandoned

Pass

Comments / Corrections

None

Picture of Damper in Open Position



Picture of Damper in Closed Position



Picture of Damper I.D. Label

FIRE DAMPER	
Inspection Date: 7-5-23	Reference I.D. #: AHUG.1-S-4
Inspected By: TULCEWICZ	
Next Inspect. By: 7-5-25	
<small>Duct Fabricators, Inc. 883 Addison Rd. Cleveland, Ohio P: 216-391-2400 F: 216-391-2492</small>	
FIRE SAFETY DIVISION NEMI Certified HVAC Fire Life Safety Technicians	
<small>MEMBER NFPA</small>	

CUYAHOGA COUNTY DAMPER INSPECTION REPORT

Date of Inspection
2023-07-05

Facility Location
Virgil E Brown Center

Damper Location
Ground North

Inspector Name
Dan Tulcewicz

Damper I.D. #
AHUG.1-S5

Damper Type
Vertical Fire Damper

Damper Size
6"Round

Damper Manufacturer
Ruskin

Damper Model #
IBD2

Fusible Link Temperature
212 Degrees

Access Door Size
Remove the flex.

Pass / Fail / Abandoned
Pass

Comments / Corrections
None

Picture of Damper in Open Position



Picture of Damper in Closed Position



Picture of Damper I.D. Label



CUYAHOGA COUNTY DAMPER INSPECTION REPORT

Date of Inspection
2023-07-05

Facility Location
Virgil E Brown Center

Damper Location
North Corridor

Inspector Name
Dan Tulcewicz

Damper I.D. #
AHUG.1-S6

Damper Type
Vertical Fire Damper

Damper Size
6" Round

Damper Manufacturer
Ruskin

Damper Model #
IBD2

Fusible Link Temperature
212 Degrees

Access Door Size
16"x16"

Pass / Fail / Abandoned
Pass

Comments / Corrections
None

Picture of Damper in Open Position



Picture of Damper in Closed Position



Picture of Damper I.D. Label

FIRE DAMPER	
Inspection Date: 7-5-23	Reference I.D.#: AHUG.1-S6
Inspected By: Tulcewicz	
Next Inspect. By: 7-5-25	
Duct Fabricators, Inc. FIRE SAFETY DIVISION MEMBER 883 Addison Rd. Cleveland, Ohio NEMI Certified HVAC Fire Life Safety Technicians NFPA	

CUYAHOGA COUNTY DAMPER INSPECTION REPORT

Date of Inspection
2023-07-05

Facility Location
Virgil E Brown Center

Damper Location
North East

Inspector Name
Dan Tulcewicz

Damper I.D. #
AHUG.1-S7

Damper Type
Vertical Fire Damper

Damper Size
14" Oval

Damper Manufacturer
Ruskin

Damper Model #
IBD2

Fusible Link Temperature
212 Degrees

Access Door Size
16x16

Pass / Fail / Abandoned
Pass

Comments / Corrections
None

Picture of Damper in Open Position



Picture of Damper in Closed Position



Picture of Damper I.D. Label



CUYAHOGA COUNTY DAMPER INSPECTION REPORT

Date of Inspection
2023-07-05

Facility Location
Virgil E Brown Center

Damper Location
Northeast Corridor

Inspector Name
Dan Tulcewicz

Damper I.D. #
AHUG.1-S8

Damper Type
Vertical Fire Damper

Damper Size
6" Round

Damper Manufacturer
Ruskin

Damper Model #
IBD2

Fusible Link Temperature
212 Degrees

Access Door Size
16" x 16"

Pass / Fail / Abandoned
Pass

Comments / Corrections
None


Picture of Damper in Open Position



Picture of Damper in Closed Position



Picture of Damper I.D. Label

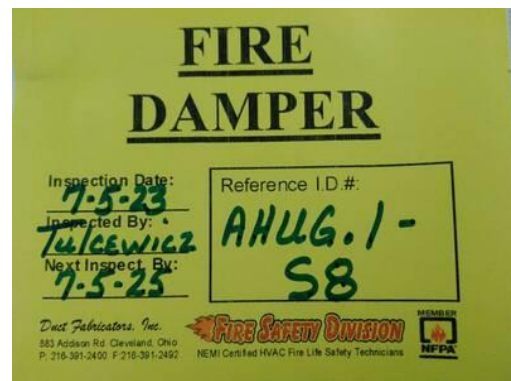

CUYAHOGA COUNTY DAMPER INSPECTION REPORT

Date of Inspection
2023-07-05

Facility Location
Virgil E Brown Center

Damper Location
Northeast

Inspector Name
Dan Tulcewicz

Damper I.D. #
AHUG.1-S9

Damper Type
Vertical Fire Damper

Damper Size
28x10

Damper Manufacturer
Ruskin

Damper Model #
IBD2

Fusible Link Temperature
212 Degrees

Access Door Size
16x16

Pass / Fail / Abandoned
Pass

Comments / Corrections
None

Picture of Damper in Open Position



Picture of Damper in Closed Position



Picture of Damper I.D. Label

FIRE DAMPER

Inspection Date: 7-5-23
Inspected By: Tulcewicz
Next Inspect By: 7-5-25

Reference I.D. #: AHUG.1-S9

Duct Fabricators, Inc.
883 Addison Rd. Cleveland, Ohio
P: 216-391-2400 F: 216-391-2492

FIRE SAFETY DIVISION
NEMI Certified HVAC Fire Life Safety Technicians

MEMBER
NFPA

CUYAHOGA COUNTY DAMPER INSPECTION REPORT

Date of Inspection
2023-07-05

Facility Location
Virgil E Brown Center

Damper Location
Northwest

Inspector Name
Dan Tulcewicz

Damper I.D. #
AHUG.1-S10

Damper Type
Vertical Fire Damper

Damper Size
10" oval

Damper Manufacturer
Ruskin

Damper Model #
IBD2

Fusible Link Temperature
212 Degrees

Access Door Size
16x16

Pass / Fail / Abandoned
Pass

Comments / Corrections
None


Picture of Damper in Open Position



Picture of Damper in Closed Position



Picture of Damper I.D. Label



CUYAHOGA COUNTY DAMPER INSPECTION REPORT

Date of Inspection
2023-07-05

Picture of Damper in Open Position

Facility Location
Virgil E Brown Center



Damper Location
Northwest

Inspector Name
Dan Tulcewicz

Damper I.D. #
AHUG.1-S11

Picture of Damper in Closed Position

Damper Type
Vertical Fire Damper



Damper Size
5"Round

Damper Manufacturer
Ruskin

Damper Model #
IBD2

Fusible Link Temperature
212 Degrees

Picture of Damper I.D. Label

Access Door Size
16x16

Pass / Fail / Abandoned
Pass

Comments / Corrections
None

<u>FIRE</u> <u>DAMPER</u>	
Inspection Date: 7-5-23	Reference I.D. #: AHUG.1-S11
Inspected By: TULCEWICZ	
Next Inspect. By: 7-5-25	
Duct Fabricators, Inc. 883 Addison Rd. Cleveland, Ohio P: 216-391-2400 F:216-391-2492	
FIRE SAFETY DIVISION NEMI Certified HVAC Fire Life Safety Technicians	
NFPA	

CUYAHOGA COUNTY DAMPER INSPECTION REPORT

Date of Inspection
2023-07-05

Facility Location
Virgil E Brown Center

Damper Location
North.

Inspector Name
Dan Tulcewicz

Damper I.D. #
AHUG.1-S12

Damper Type
Vertical Fire Damper

Damper Size
6" Round

Damper Manufacturer
Ruskin

Damper Model #
IBD2

Fusible Link Temperature
212 Degrees

Access Door Size
Remove the flex

Pass / Fail / Abandoned
Pass

Comments / Corrections
None


Picture of Damper in Open Position



Picture of Damper in Closed Position



Picture of Damper I.D. Label



Duct Fabricators, Inc.

883 Addison Rd. Cleveland, Ohio
P: 216-391-2400 F: 216-391-2492

FIRE SAFETY DIVISION
NEMI Certified HVAC Fire Life Safety Technicians



CUYAHOGA COUNTY DAMPER INSPECTION REPORT

Date of Inspection

2023-07-05

Facility Location

Virgil E Brown Center

Damper Location

NW Corridor

Inspector Name

Dan Tulcewicz

Damper I.D.

AHUG.1-S13

Damper Type

Vertical Fire Damper

Damper Size

46"x16"

Damper Manufacturer

Ruskin

Damper Model

IBD2

Fusible Link Temperature

212 Degrees

Access Door Size

16"x16"

Pass / Fail / Abandoned

Pass

Comments / Corrections

None

Picture of Damper in Open Position



Picture of Damper in Closed Position



Picture of Damper I.D. Label

<u>FIRE</u>	
<u>DAMPER</u>	
Inspection Date: 7-5-23	Reference I.D.#: AHUG.1 - S13
Inspected By: Tulcewicz	
Next Inspect. By: 7-5-25	

Duct Fabricators, Inc.
883 Addison Rd. Cleveland, Ohio
P: 216-391-2400 F: 216-391-2492

FIRE SAFETY DIVISION
NEMI Certified HVAC Fire Life Safety Technicians

MEMBER
NFPA

Duct Fabricators, Inc.

883 Addison Rd. Cleveland, Ohio
P: 216-391-2400 F: 216-391-2492

FIRE SAFETY DIVISION

NEMI Certified HVAC Fire Life Safety Technicians



CUYAHOGA COUNTY DAMPER INSPECTION REPORT

Date of Inspection

2023-07-05

Facility Location

Virgil E Brown Center

Damper Location

North.

Inspector Name

Dan Tulcewicz

Damper I.D.

AHUG.1-S14

Damper Type

Vertical Fire Damper

Damper Size

8"x12"

Damper Manufacturer

Ruskin

Damper Model

IBD2

Fusible Link Temperature

212 Degrees

Access Door Size

Open

Pass / Fail / Abandoned

Pass

Comments / Corrections

None

Picture of Damper in Open Position



Picture of Damper in Closed Position



Picture of Damper I.D. Label

FIRE DAMPER	
Inspection Date: 7-5-23	Reference I.D. #: AHUG.1-S14
Inspected By: TULCEWICZ	
Next Inspect. By: 7-5-25	

Duct Fabricators, Inc.
883 Addison Rd. Cleveland, Ohio
P: 216-391-2400 F: 216-391-2492

FIRE SAFETY DIVISION
NEMI Certified HVAC Fire Life Safety Technicians

Duct Fabricators, Inc.

883 Addison Rd. Cleveland, Ohio
P: 216-391-2400 F: 216-391-2492



NEMI Certified HVAC Fire Life Safety Technicians



CUYAHOGA COUNTY DAMPER INSPECTION REPORT

Date of Inspection

2023-07-05

Facility Location

Virgil E Brown Center

Damper Location

North.

Inspector Name

Dan Tulcewicz

Damper I.D.

AHUG.1-S15

Damper Type

Vertical Fire Damper

Damper Size

46"x16"

Damper Manufacturer

Ruskin

Damper Model

IBD2

Fusible Link Temperature

212 Degrees

Access Door Size

18"x18"

Pass / Fail / Abandoned

Pass

Comments / Corrections

None

Picture of Damper in Open Position



Picture of Damper in Closed Position



Picture of Damper I.D. Label

<u>FIRE</u>	
<u>DAMPER</u>	
Inspection Date: 7-5-23	Reference I.D.#: AHUG.1-S15
Inspected By: TULCEWICZ	
Next Inspect. By: 7-5-25	

Duct Fabricators, Inc.
883 Addison Rd. Cleveland, Ohio
P: 216-391-2400 F: 216-391-2492

FIRE SAFETY DIVISION
NEMI Certified HVAC Fire Life Safety Technicians

CUYAHOGA COUNTY DAMPER INSPECTION REPORT

Date of Inspection
2023-07-05

Picture of Damper in Open Position

Facility Location
Virgil E Brown Center



Damper Location
North.

Inspector Name
Dan Tulcewicz

Damper I.D. #
AHUG.1-S16

Picture of Damper in Closed Position

Damper Type
Vertical Fire Damper



Damper Size
6"Round

Damper Manufacturer
Ruskin

Damper Model #
IBD2

Fusible Link Temperature
212 Degrees

Picture of Damper I.D. Label

Access Door Size
Remove the flex

Pass / Fail / Abandoned
Pass

Comments / Corrections
None



CUYAHOGA COUNTY DAMPER INSPECTION REPORT

Date of Inspection
2023-07-05

Facility Location
Virgil E Brown Center

Damper Location
North.

Inspector Name
Dan Tulcewicz

Damper I.D. #
AHUG.1-S17

Damper Type
Vertical Fire Damper

Damper Size
16"x10"

Damper Manufacturer
Ruskin

Damper Model #
IBD2

Fusible Link Temperature
212 Degrees

Access Door Size
12"x12"

Pass / Fail / Abandoned
Pass

Comments / Corrections
None


Picture of Damper in Open Position



Picture of Damper in Closed Position



Picture of Damper I.D. Label



CUYAHOGA COUNTY DAMPER INSPECTION REPORT

Date of Inspection
2023-07-06

Picture of Damper in Open Position

Facility Location
Virgil E Brown Center



Damper Location
South Mechanical Room

Inspector Name
Julie Gue

Damper I.D. #
AHUG.2-OA

Picture of Damper in Closed Position

Damper Type
Vertical Fire Damper



Damper Size
96" x 20"

Damper Manufacturer
Ruskin

Damper Model #
IBD2


Fusible Link Temperature
212 Degrees

Picture of Damper I.D. Label

Access Door Size
16" x 16"

Pass / Fail / Abandoned
Pass

Comments / Corrections
None



CUYAHOGA COUNTY DAMPER INSPECTION REPORT

Date of Inspection
2023-07-06

Facility Location
Virgil E Brown Center

Damper Location
South Mechanical room

Inspector Name
Julie Gue

Damper I.D. #
AHUG.2-RA

Damper Type
Vertical Fire Damper

Damper Size
96" x 48"

Damper Manufacturer
Ruskin

Damper Model #
IBD2

Fusible Link Temperature
212 Degrees

Access Door Size
Open

Pass / Fail / Abandoned
Pass

Comments / Corrections
None

Picture of Damper in Open Position



Picture of Damper in Closed Position



Picture of Damper I.D. Label



CUYAHOGA COUNTY DAMPER INSPECTION REPORT

Date of Inspection

2023-07-06

Facility Location

Virgil E Brown Center

Damper Location

SW corridor

Inspector Name

Julie Gue

Damper I.D. #

AHUG.2-S2

Damper Type

Vertical Fire Damper

Damper Size

46" x 16"

Damper Manufacturer

Ruskin

Damper Model #

IBD2

Fusible Link Temperature

212 Degrees

Access Door Size

18" x 18"

Pass / Fail / Abandoned

Pass

Comments / Corrections

None


Picture of Damper in Open Position



Picture of Damper in Closed Position



Picture of Damper I.D. Label

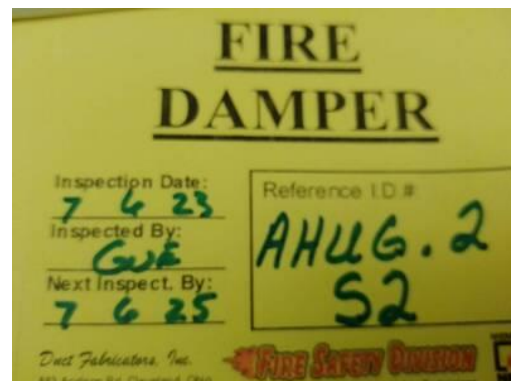

CUYAHOGA COUNTY DAMPER INSPECTION REPORT

Date of Inspection

2023-07-06

Facility Location

Virgil E Brown Center

Damper Location

SW Corridor

Inspector Name

Julie Gue

Damper I.D. #

AHUG.2-S3

Damper Type

Vertical Fire Damper

Damper Size

46" x 16"

Damper Manufacturer

Ruskin

Damper Model #

IBD2

Fusible Link Temperature

350 Degrees

Access Door Size

18" x 18"

Pass / Fail / Abandoned

Pass

Comments / Corrections

None

Picture of Damper in Open Position



Picture of Damper in Closed Position



Picture of Damper I.D. Label



CUYAHOGA COUNTY DAMPER INSPECTION REPORT

Date of Inspection
2023-07-07

Facility Location
Virgil E Brown Center

Damper Location
SW Com room

Inspector Name
Julie Gue

Damper I.D. #
AHUG.2-S4

Damper Type
Vertical Fire Damper

Damper Size
8x12

Damper Manufacturer
Ruskin

Damper Model #
IBD2

Fusible Link Temperature
212 Degrees

Access Door Size
Open


Pass / Fail / Abandoned
Pass

Comments / Corrections
None


Picture of Damper in Open Position



Picture of Damper in Closed Position



Picture of Damper I.D. Label



CUYAHOGA COUNTY DAMPER INSPECTION REPORT

Date of Inspection

2023-07-06

Facility Location

Virgil E Brown Center

Damper Location

SW corridor

Inspector Name

Julie Gue

Damper I.D. #

AHUG.2-S5

Damper Type

Vertical Fire Damper

Damper Size

36x12

Damper Manufacturer

Ruskin

Damper Model #

Unknown

Fusible Link Temperature

212 Degrees

Access Door Size

16x16

Pass / Fail / Abandoned

Pass

Comments / Corrections

None


Picture of Damper in Open Position



Picture of Damper in Closed Position



Picture of Damper I.D. Label

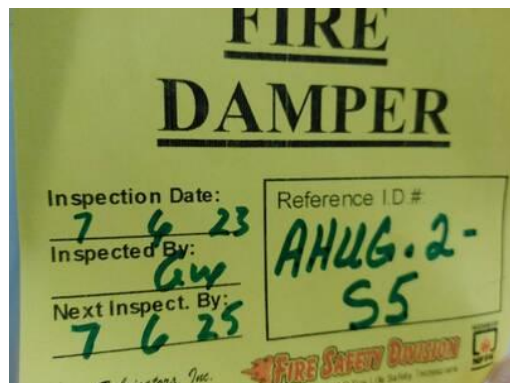

CUYAHOGA COUNTY DAMPER INSPECTION REPORT

Date of Inspection
2023-07-06

Facility Location
Virgil E Brown Center

Damper Location
South

Inspector Name
Julie Gue

Damper I.D. #
AHUG.2-S6

Damper Type
Vertical Fire Damper

Damper Size
14" Oval

Damper Manufacturer
Ruskin

Damper Model #
IBD2

Fusible Link Temperature
212 Degrees

Access Door Size
18x18

Pass / Fail / Abandoned
Pass

Comments / Corrections
None

Picture of Damper in Open Position



Picture of Damper in Closed Position



Picture of Damper I.D. Label



CUYAHOGA COUNTY DAMPER INSPECTION REPORT

Date of Inspection

2023-07-06

Facility Location

Virgil E Brown Center

Damper Location

SE Corner office

Inspector Name

Julie Gue

Damper I.D. #

AHUG.2-S7

Damper Type

Vertical Fire Damper

Damper Size

12" x 12"

Damper Manufacturer

Ruskin

Damper Model #

IBD2

Fusible Link Temperature

212 Degrees

Access Door Size

8" x 8"

Pass / Fail / Abandoned

Pass

Comments / Corrections

None


Picture of Damper in Open Position



Picture of Damper in Closed Position



Picture of Damper I.D. Label



CUYAHOGA COUNTY DAMPER INSPECTION REPORT

Date of Inspection

2023-07-06

Facility Location

Virgil E Brown Center

Damper Location

SW corridor

Inspector Name

Julie Gue

Damper I.D. #

AHUG.2-S8

Damper Type

Vertical Fire Damper

Damper Size

46" x 16"

Damper Manufacturer

Ruskin

Damper Model #

IBD2

Fusible Link Temperature

350 Degrees

Access Door Size

18" x 18"

Pass / Fail / Abandoned

Pass

Comments / Corrections

None

Picture of Damper in Open Position



Picture of Damper in Closed Position



Picture of Damper I.D. Label



CUYAHOGA COUNTY DAMPER INSPECTION REPORT

Date of Inspection
2023-07-07

Facility Location
Virgil E Brown Center

Damper Location
SE Com room

Inspector Name
Julie Gue

Damper I.D. #
AHUG.2-S9

Damper Type
Vertical Fire Damper

Damper Size
8x12

Damper Manufacturer
Ruskin

Damper Model #
IBD2

Fusible Link Temperature
212 Degrees

Access Door Size
Open

Pass / Fail / Abandoned
Pass

Comments / Corrections
None

Picture of Damper in Open Position



Picture of Damper in Closed Position



Picture of Damper I.D. Label

FIRE DAMPER	
Inspection Date: 7 7 23	Reference I.D. #: AHUG.2-S9
Inspected By: Gue	
Next Inspect. By: 7 7 25	

Duct Fabricators, Inc.
883 Addison Rd. Cleveland, Ohio
P: 216-391-2400 F: 216-391-2492

FIRE SAFETY DIVISION
NEMI Certified HVAC Fire Life Safety Technicians

MEMBER
NFPA

CUYAHOGA COUNTY DAMPER INSPECTION REPORT

Date of Inspection
2023-07-07

Facility Location
Virgil E Brown Center

Damper Location
SE corridor

Inspector Name
Julie Gue

Damper I.D. #
AHUG.2-S11

Damper Type
Vertical Fire Damper

Damper Size
16" Oval

Damper Manufacturer
Ruskin

Damper Model #
IBD2

Fusible Link Temperature
212 Degrees

Access Door Size
18x18

Pass / Fail / Abandoned
Pass

Comments / Corrections
None

Picture of Damper in Open Position



Picture of Damper in Closed Position



Picture of Damper I.D. Label



CUYAHOGA COUNTY DAMPER INSPECTION REPORT

Date of Inspection
2023-07-07

Facility Location
Virgil E Brown Center

Damper Location
SE corridor

Inspector Name
Julie Gue

Damper I.D. #
AHUG.2-S12

Damper Type
Vertical Fire Damper

Damper Size
6" Round

Damper Manufacturer
Ruskin

Damper Model #
IBD2

Fusible Link Temperature
212 Degrees

Access Door Size
18x18

Pass / Fail / Abandoned
Pass

Comments / Corrections
None

Picture of Damper in Open Position



Picture of Damper in Closed Position



Picture of Damper I.D. Label

FIRE DAMPER	
Inspection Date: 7 7 23	Reference I.D. #: AHUG.2-S12
Inspected By: Gue	
Next Inspect. By: 7 7 25	

Duct Fabricators, Inc. FIRE SAFETY DIVISION MEMBER NFPA
883 Addison Rd. Cleveland, Ohio NEMI Certified HVAC Fire Life Safety Technicians

CUYAHOGA COUNTY DAMPER INSPECTION REPORT

Date of Inspection
2023-07-10

Facility Location
Virgil E Brown Center

Damper Location
Lobby

Inspector Name
Julie Gue

Damper I.D. #
AHUG.3-R1

Damper Type
Horizontal Fire Damper

Damper Size
54x18

Damper Manufacturer
Ruskin

Damper Model #
IBD2

Fusible Link Temperature
212 Degrees

Access Door Size
Screen

Pass / Fail / Abandoned
Pass

Comments / Corrections
None

Picture of Damper in Open Position



Picture of Damper in Closed Position



Picture of Damper I.D. Label



Duct Fabricators, Inc.

883 Addison Rd. Cleveland, Ohio
P: 216-391-2400 F: 216-391-2492

FIRE SAFETY DIVISION
NEMI Certified HVAC Fire Life Safety Technicians



CUYAHOGA COUNTY DAMPER INSPECTION REPORT

Date of Inspection

2023-07-10

Facility Location

Virgil E Brown Center

Damper Location

South

Inspector Name

Julie Gue

Damper I.D. #

AHUG.3-R2

Damper Type

Horizontal Fire Damper

Damper Size

18x16

Damper Manufacturer

Ruskin

Damper Model #

IBD2

Fusible Link Temperature

212 Degrees

Access Door Size

10x10

Pass / Fail / Abandoned

Pass

Comments / Corrections

None

Picture of Damper in Open Position



Picture of Damper in Closed Position



Picture of Damper I.D. Label

FIRE DAMPER

Inspection Date:

7 9 23

Inspected By:

GWK

Next Inspect. By:

7 9 25

Reference ID #:

AH46.3-
R2

Quest Fabricators, Inc.
4601 Anderson Rd. Cleveland, Ohio

Fire Safety Division
NATIONAL FIRE PROTECTION ASSOCIATION
Fire Life Safety Technicians



CUYAHOGA COUNTY DAMPER INSPECTION REPORT

Date of Inspection
2023-07-10

Facility Location
Virgil E Brown Center

Damper Location
South

Inspector Name
Julie Gue

Damper I.D. #
AHUG.3-S1

Damper Type
Vertical Fire Damper

Damper Size
16x12

Damper Manufacturer
Ruskin

Damper Model #
IBD2

Fusible Link Temperature
212 Degrees

Access Door Size
12x12

Pass / Fail / Abandoned
Pass

Comments / Corrections
None


Picture of Damper in Open Position



Picture of Damper in Closed Position



Picture of Damper I.D. Label



CUYAHOGA COUNTY DAMPER INSPECTION REPORT

Date of Inspection
2023-07-10

Facility Location
Virgil E Brown Center

Damper Location
South

Inspector Name
Julie Gue

Damper I.D. #
AHUG.3-S2

Damper Type
Vertical Fire Damper

Damper Size
16x12

Damper Manufacturer
Ruskin

Damper Model #
IBD2

Fusible Link Temperature
212 Degrees

Access Door Size
12x12

Pass / Fail / Abandoned
Pass

Comments / Corrections
None


Picture of Damper in Open Position



Picture of Damper in Closed Position



Picture of Damper I.D. Label



CUYAHOGA COUNTY DAMPER INSPECTION REPORT

Date of Inspection

2023-07-10

Facility Location

Virgil E Brown Center

Damper Location

South

Inspector Name

Julie Gue

Damper I.D. #

AHUG.3-S3

Damper Type

Vertical Fire Damper

Damper Size

26" x 8"

Damper Manufacturer

Ruskin

Damper Model #

IBD2

Fusible Link Temperature

212 Degrees

Access Door Size

14" x 14"

Pass / Fail / Abandoned

Pass

Comments / Corrections

None


Picture of Damper in Open Position



Picture of Damper in Closed Position



Picture of Damper I.D. Label



CUYAHOGA COUNTY DAMPER INSPECTION REPORT

Date of Inspection

2023-07-10

Facility Location

Virgil E Brown Center

Damper Location

South

Inspector Name

Julie Gue

Damper I.D. #

AHUG.3-S4

Damper Type

Vertical Fire Damper

Damper Size

14x10

Damper Manufacturer

Ruskin

Damper Model #

IBD2

Fusible Link Temperature

212 Degrees

Access Door Size

12x12

Pass / Fail / Abandoned

Pass

Comments / Corrections

None

Picture of Damper in Open Position



Picture of Damper in Closed Position



Picture of Damper I.D. Label

DAMPER

Inspection Date:

7/9/23

Inspected By:

GWB

Next Inspect. By:

7/9/25

Reference I.D.#

AHUG.3-54



Direct Fabricators, Inc.

903 Madison St. Cleveland, Ohio
P. 796-367-2600 F. 216-357-2462

CUYAHOGA COUNTY DAMPER INSPECTION REPORT

Date of Inspection

2023-06-29

Facility Location

Virgil E Brown Center

Damper Location

Mechanical Room South

Inspector Name

Dan Tulcewicz

Damper I.D. #

AHULL.1-OA

Damper Type

Vertical Fire Damper

Damper Size

96" x 18"

Damper Manufacturer

Ruskin

Damper Model #

IBD2

Fusible Link Temperature

165 Degrees

Access Door Size

16" x 16"

Pass / Fail / Abandoned

Pass

Comments / Corrections

None


Picture of Damper in Open Position



Picture of Damper in Closed Position



Picture of Damper I.D. Label



CUYAHOGA COUNTY DAMPER INSPECTION REPORT

Date of Inspection
2023-06-29

Facility Location
Virgil E Brown Center

Damper Location
North Mechanical Room

Inspector Name
Dan Tulcewicz

Damper I.D. #
AHULL.1-RA

Damper Type
Vertical Fire Damper

Damper Size
96 " x 32"

Damper Manufacturer
Ruskin

Damper Model #
IBD2

Fusible Link Temperature
165 Degrees

Access Door Size
Open


Pass / Fail / Abandoned
Pass

Comments / Corrections
None


Picture of Damper in Open Position



Picture of Damper in Closed Position



Picture of Damper I.D. Label



CUYAHOGA COUNTY DAMPER INSPECTION REPORT

Date of Inspection
2023-06-29

Facility Location
Virgil E Brown Center

Damper Location
North com room.

Inspector Name
Dan Tulcewicz

Damper I.D. #
AHULL.1-S1

Damper Type
Vertical Fire Damper

Damper Size
8"X12"

Damper Manufacturer
Ruskin

Damper Model #
IBD2

Fusible Link Temperature
212 Degrees

Access Door Size
Open

Pass / Fail / Abandoned
Pass

Comments / Corrections
None

Picture of Damper in Open Position



Picture of Damper in Closed Position



Picture of Damper I.D. Label



CUYAHOGA COUNTY DAMPER INSPECTION REPORT

Date of Inspection
2023-06-29

Facility Location
Virgil E Brown Center

Damper Location
South Com Room.

Inspector Name
Dan Tulcewicz

Damper I.D. #
AHULL.1-S2

Damper Type
Vertical Fire Damper

Damper Size
8" X 12"

Damper Manufacturer
Ruskin

Damper Model #
IBD2

Fusible Link Temperature
212 Degrees

Access Door Size
Open

Pass / Fail / Abandoned
Pass

Comments / Corrections
None


Picture of Damper in Open Position



Picture of Damper in Closed Position



Picture of Damper I.D. Label



CUYAHOGA COUNTY DAMPER INSPECTION REPORT

Date of Inspection
2023-06-29

Facility Location
Virgil E Brown Center

Damper Location
South Mechanical Room

Inspector Name
Dan Tulcewicz

Damper I.D. #
AHULL.2-RA

Damper Type
Vertical Fire Damper

Damper Size
96" x 32"

Damper Manufacturer
Ruskin

Damper Model #
IBD2

Fusible Link Temperature
165 Degrees

Access Door Size
Open

Pass / Fail / Abandoned
Pass

Comments / Corrections
None

Picture of Damper in Open Position



Picture of Damper in Closed Position



Picture of Damper I.D. Label

<u>FIRE</u>	
<u>DAMPER</u>	
Inspection Date: 6-29-23	Reference I.D.#:
Inspected By: TULCEWICZ	AHULL.2-RA
Next Inspect. By: 6-29-25	
Duct Fabricators, Inc. 883 Addison Rd. Cleveland, Ohio P: 216-391-2400 F: 216-391-2492	
FIRE SAFETY DIVISION NEMI Certified HVAC Fire Life Safety Technicians	
MEMBER NFPA	

CUYAHOGA COUNTY DAMPER INSPECTION REPORT

Date of Inspection
2023-06-29

Facility Location
Virgil E Brown Center

Damper Location
South Com Room

Inspector Name
Dan Tulcewicz

Damper I.D. #
AHULL.2-S1

Damper Type
Vertical Fire Damper

Damper Size
24" x 12"

Damper Manufacturer
Ruskin

Damper Model #
DIBD2

Fusible Link Temperature
212 Degrees

Access Door Size
Open

Pass / Fail / Abandoned
Pass

Comments / Corrections
None


Picture of Damper in Open Position



Picture of Damper in Closed Position



Picture of Damper I.D. Label

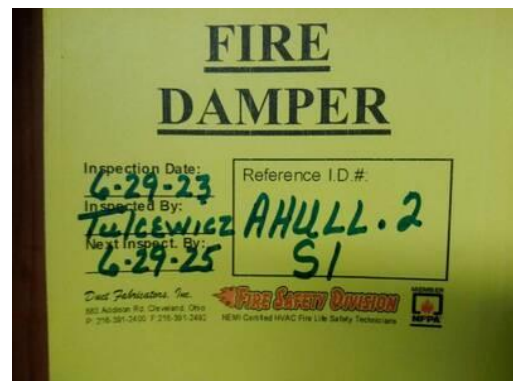

Duct Fabricators, Inc.

883 Addison Rd. Cleveland, Ohio
P: 216-391-2400 F: 216-391-2492

FIRE SAFETY DIVISION

NEMI Certified HVAC Fire Life Safety Technicians



CUYAHOGA COUNTY DAMPER INSPECTION REPORT

Date of Inspection

2023-06-29

Facility Location

Virgil E Brown Center

Damper Location

South

Inspector Name

Dan Tulcewicz

Damper I.D.

AHULL.2-S2

Damper Type

Vertical Fire Damper

Damper Size

18" x 12"

Damper Manufacturer

Ruskin

Damper Model

IBD2

Fusible Link Temperature

212 Degrees

Access Door Size

12" x 12"

Pass / Fail / Abandoned

Pass

Comments / Corrections

None

Picture of Damper in Open Position



Picture of Damper in Closed Position



Picture of Damper I.D. Label

FIRE DAMPER	
Inspection Date: 6-29-23	Reference I.D. #:
Inspected By: Tulcewicz	AHULL.2-S2
Next Inspect. By: 6-29-25	

Duct Fabricators, Inc.
883 Addison Rd. Cleveland, Ohio
P: 216-391-2400 F: 216-391-2492

FIRE SAFETY DIVISION
NEMI Certified HVAC Fire Life Safety Technicians

CUYAHOGA COUNTY DAMPER INSPECTION REPORT

Date of Inspection

2023-06-29

Facility Location

Virgil E Brown Center

Damper Location

South

Inspector Name

Dan Tulcewicz

Damper I.D. #

AHULL.2-S3

Damper Type

Vertical Fire Damper

Damper Size

22" x 10"

Damper Manufacturer

Ruskin

Damper Model #

IBD2

Fusible Link Temperature

212 Degrees

Access Door Size

18" x 18"

Pass / Fail / Abandoned

Pass

Comments / Corrections

None


Picture of Damper in Open Position



Picture of Damper in Closed Position



Picture of Damper I.D. Label



CUYAHOGA COUNTY DAMPER INSPECTION REPORT

Date of Inspection
2023-06-29

Picture of Damper in Open Position

Facility Location
Virgil E Brown Center




Damper Location
South.

Inspector Name
Dan Tulcewicz

Damper I.D. #
AHULL.2-S4

Picture of Damper in Closed Position

Damper Type
Vertical Fire Damper



Damper Size
10" Round

Damper Manufacturer
Ruskin

Damper Model #
IBD2


Fusible Link Temperature
212 Degrees

Picture of Damper I.D. Label

Access Door Size
8" x 6"

Pass / Fail / Abandoned
Pass

Comments / Corrections
None



CUYAHOGA COUNTY DAMPER INSPECTION REPORT

Date of Inspection

2023-06-29

Facility Location

Virgil E Brown Center

Damper Location

South

Inspector Name

Dan Tulcewicz

Damper I.D. #

AHULL.2-S5

Damper Type

Vertical Fire Damper

Damper Size

28" x 12"

Damper Manufacturer

Ruskin

Damper Model #

IBD2

Fusible Link Temperature

212 Degrees

Access Door Size

12" x 12"

Pass / Fail / Abandoned

Pass

Comments / Corrections

None

Picture of Damper in Open Position



Picture of Damper in Closed Position



Picture of Damper I.D. Label

FIRE DAMPER	
Inspection Date: 6-29-23	Reference I.D. #: AHULL.2-S5
Inspected By: Tulcewicz	
Next Inspect. By: 6-29-25	
Duct Fabricators, Inc. 883 Addison Rd. Cleveland, Ohio P: 216-391-2400 F: 216-391-2492	
FIRE SAFETY DIVISION NEMI Certified HVAC Fire Life Safety Technicians	
MEMBER NFPA	

CUYAHOGA COUNTY DAMPER INSPECTION REPORT

Date of Inspection
2023-06-29

Facility Location
Virgil E Brown Center

Damper Location
South Com Room

Inspector Name
Dan Tulcewicz

Damper I.D. #
AHULL.2-S6

Damper Type
Vertical Fire Damper

Damper Size
8" x 12"

Damper Manufacturer
Ruskin

Damper Model #
IBD2

Fusible Link Temperature
212 Degrees

Access Door Size
Open

Pass / Fail / Abandoned
Pass

Comments / Corrections
None


Picture of Damper in Open Position



Picture of Damper in Closed Position



Picture of Damper I.D. Label

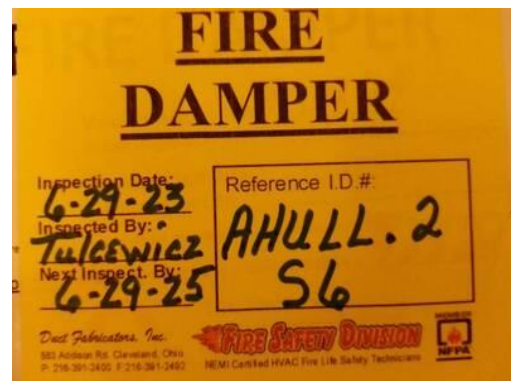

CUYAHOGA COUNTY DAMPER INSPECTION REPORT

Date of Inspection
2023-06-29

Facility Location
Virgil E Brown Center

Damper Location
South

Inspector Name
Dan Tulcewicz

Damper I.D. #
AHULL.2-S7

Damper Type
Vertical Fire Damper

Damper Size
8" x 8"

Damper Manufacturer
Ruskin

Damper Model #
IBD2

Fusible Link Temperature
212 Degrees

Access Door Size
6" x 6"

Pass / Fail / Abandoned
Pass

Comments / Corrections
None


Picture of Damper in Open Position



Picture of Damper in Closed Position



Picture of Damper I.D. Label



CUYAHOGA COUNTY DAMPER INSPECTION REPORT

Date of Inspection

2023-07-10

Facility Location

Virgil E Brown Center

Damper Location

Dock

Inspector Name

Julie Gue

Damper I.D. #

Dock-EA1

Damper Type

Horizontal Fire Damper

Damper Size

30x13

Damper Manufacturer

Ruskin

Damper Model #

IBD2

Fusible Link Temperature

165 Degrees

Access Door Size

24x24

Pass / Fail / Abandoned

Pass

Comments / Corrections

None


Picture of Damper in Open Position



Picture of Damper in Closed Position



Picture of Damper I.D. Label

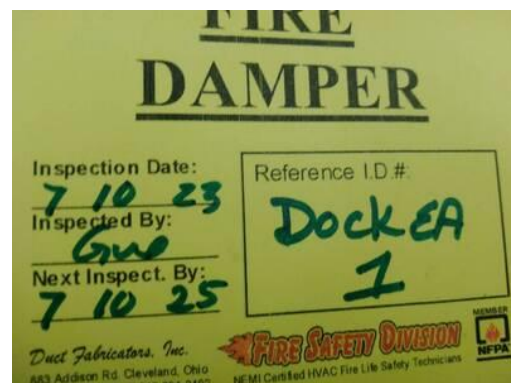

CUYAHOGA COUNTY DAMPER INSPECTION REPORT

Date of Inspection
2023-07-10

Facility Location
Virgil E Brown Center

Damper Location
Dock

Inspector Name
Julie Gue

Damper I.D. #
Dock-EA2

Damper Type
Horizontal Fire Damper

Damper Size
30X14

Damper Manufacturer
Ruskin

Damper Model #
IBD2

Fusible Link Temperature
212 Degrees

Access Door Size
24x24

Pass / Fail / Abandoned
Pass

Comments / Corrections
None

Picture of Damper in Open Position



Picture of Damper in Closed Position



Picture of Damper I.D. Label

FIRE DAMPER	
Inspection Date: 7 10 23	Reference I.D.#: Dock EA 2
Inspected By: Gw	
Next Inspect. By: 7 10 25	

Duct Fabricators, Inc. FIRE SAFETY DIVISION

CUYAHOGA COUNTY DAMPER INSPECTION REPORT

Date of Inspection

2023-07-12

Facility Location

Virgil E Brown Center

Damper Location

Dock Area

Inspector Name

Dan Tulcewicz

Damper I.D. #

Dock EA-3

Damper Type

Horizontal Fire Damper

Damper Size

48"x12"

Damper Manufacturer

Ruskin

Damper Model #

IBD2

Fusible Link Temperature

165 Degrees

Access Door Size

20"x20"

Pass / Fail / Abandoned

Fail

Comments / Corrections

Need to replace fire damper.
Blades are so rusted. Can not remove fire link to close damper.


Picture of Damper in Open Position



Picture of Damper in Closed Position



Picture of Damper I.D. Label



CUYAHOGA COUNTY DAMPER INSPECTION REPORT

Date of Inspection
2023-07-06

Facility Location
Virgil E Brown Center

Damper Location
South mechanical room

Inspector Name
Julie Gue

Damper I.D. #
EF-7 GRD

Damper Type
Horizontal Fire Damper

Damper Size
22x14

Damper Manufacturer
Ruskin

Damper Model #
IBD2

Fusible Link Temperature
212 Degrees

Access Door Size
16x16

Pass / Fail / Abandoned
Pass

Comments / Corrections
None

Picture of Damper in Open Position



Picture of Damper in Closed Position



Picture of Damper I.D. Label



CUYAHOGA COUNTY DAMPER INSPECTION REPORT

Date of Inspection
2023-06-28

Facility Location
Virgil E Brown Center

Damper Location
South

Inspector Name
Dan Tulcewicz

Damper I.D. #
EF7-1

Damper Type
Horizontal Fire Damper

Damper Size
22"x16"

Damper Manufacturer
Ruskin

Damper Model #
IBD2

Fusible Link Temperature
212 Degrees

Access Door Size
18"x18"

Pass / Fail / Abandoned
Pass

Comments / Corrections
None


Picture of Damper in Open Position



Picture of Damper in Closed Position



Picture of Damper I.D. Label



Duct Fabricators, Inc.

883 Addison Rd. Cleveland, Ohio
P: 216-391-2400 F: 216-391-2492

FIRE SAFETY DIVISION

NEMI Certified HVAC Fire Life Safety Technicians



CUYAHOGA COUNTY DAMPER INSPECTION REPORT

Date of Inspection

2023-06-21

Facility Location

Virgil E Brown Center

Damper Location

South Mechanical Rm

Inspector Name

Julie Gue

Damper I.D.

EF7-3

Damper Type

Horizontal Fire Damper

Damper Size

36" x 20.5"

Damper Manufacturer

Ruskin

Damper Model

IBD2

Fusible Link Temperature

212 Degrees

Access Door Size

24 x 24"

Pass / Fail / Abandoned

Pass

Comments / Corrections

None

Picture of Damper in Open Position



Picture of Damper in Closed Position



Picture of Damper I.D. Label



CUYAHOGA COUNTY DAMPER INSPECTION REPORT

Date of Inspection
2023-06-16

Facility Location
Virgil E Brown Center

Damper Location
North equipment room

Inspector Name
Julie Gue

Damper I.D. #
EF7-4

Damper Type
Horizontal Fire Damper

Damper Size
36" x 20"

Damper Manufacturer
Ruskin

Damper Model #
IBD2

Fusible Link Temperature
212 Degrees

Access Door Size
24" x 24"

Pass / Fail / Abandoned
Pass

Comments / Corrections
None

Picture of Damper in Open Position



Picture of Damper in Closed Position



Picture of Damper I.D. Label



CUYAHOGA COUNTY DAMPER INSPECTION REPORT

Date of Inspection

2023-07-10

Facility Location

Virgil E Brown Center

Damper Location

South PH

Inspector Name

Julie Gue

Damper I.D. #

EF7-PH

Damper Type

Horizontal Fire Damper

Damper Size

48x18

Damper Manufacturer

Ruskin

Damper Model #

IBD2

Fusible Link Temperature

212 Degrees

Access Door Size

24x24

Pass / Fail / Abandoned

Pass

Comments / Corrections

None


Picture of Damper in Open Position



Picture of Damper in Closed Position



Picture of Damper I.D. Label

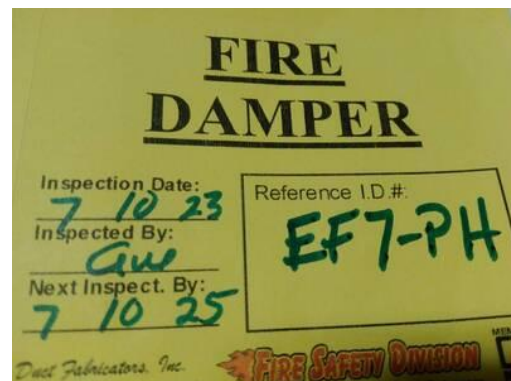

CUYAHOGA COUNTY DAMPER INSPECTION REPORT

Date of Inspection
2023-06-20

Facility Location
Virgil E Brown Center

Damper Location
South Mechanical Room

Inspector Name
Larry Coreno

Damper I.D. #
EF7-S5

Damper Type
Horizontal Fire Damper

Damper Size
40" x 20"

Damper Manufacturer
Ruskin

Damper Model #
IBD2

Fusible Link Temperature
212 Degrees

Access Door Size
24" x 24"

Pass / Fail / Abandoned
Pass

Comments / Corrections
None


Picture of Damper in Open Position



Picture of Damper in Closed Position



Picture of Damper I.D. Label



CUYAHOGA COUNTY DAMPER INSPECTION REPORT

Date of Inspection
2023-06-28

Facility Location
Virgil E Brown Center

Damper Location
North

Inspector Name
Dan Tulcewicz

Damper I.D. #
EF10-1

Damper Type
Horizontal Fire Damper

Damper Size
22"x16"

Damper Manufacturer
Ruskin

Damper Model #
IBD2

Fusible Link Temperature
165 Degrees

Access Door Size
18"x18"

Pass / Fail / Abandoned
Pass

Comments / Corrections
None

Picture of Damper in Open Position



Picture of Damper in Closed Position



Picture of Damper I.D. Label

<u>FIRE</u> <u>DAMPER</u>	
Inspection Date: 6-28-23	Reference I.D. #:
Inspected By: TULCEWICZ	EF10-1
Next Inspect. By: 6-28-25	
<small>Duct Fabricators, Inc. 883 Addison Rd. Cleveland, Ohio P: 216-391-2400 F: 216-391-2492</small>	
FIRE SAFETY DIVISION NEMI Certified HVAC Fire Life Safety Technicians	
<small>MEMBER NFPA</small>	

CUYAHOGA COUNTY DAMPER INSPECTION REPORT

Date of Inspection

2023-06-23

Facility Location

Virgil E Brown Center

Damper Location

North mechanical room

Inspector Name

Dan Tulcewicz

Damper I.D. #

EF10-2

Damper Type

Horizontal Fire Damper

Damper Size

26"x18"

Damper Manufacturer

Ruskin

Damper Model #

IBD2

Fusible Link Temperature

212 Degrees

Access Door Size

18"x18"

Pass / Fail / Abandoned

Pass

Comments / Corrections

None


Picture of Damper in Open Position



Picture of Damper in Closed Position



Picture of Damper I.D. Label



Duct Fabricators, Inc.

883 Addison Rd. Cleveland, Ohio
P: 216-391-2400 F: 216-391-2492



NEMI Certified HVAC Fire Life Safety Technicians



CUYAHOGA COUNTY DAMPER INSPECTION REPORT

Date of Inspection

2023-06-21

Facility Location

Virgil E Brown Center

Damper Location

North mechanical room

Inspector Name

Julie Gue

Damper I.D. #

EF10-3

Damper Type

Horizontal Fire Damper

Damper Size

36" x 21"

Damper Manufacturer

Ruskin

Damper Model #

IBD2

Fusible Link Temperature

212 Degrees

Access Door Size

24" x 24"

Pass / Fail / Abandoned

Pass

Comments / Corrections

None

Picture of Damper in Open Position



Picture of Damper in Closed Position



Picture of Damper I.D. Label



CUYAHOGA COUNTY DAMPER INSPECTION REPORT

Date of Inspection
2023-06-20

Picture of Damper in Open Position

Facility Location
Virgil E Brown Center



Damper Location
North mechanical room

Inspector Name
Julie Gue

Damper I.D. #
EF10-4

Picture of Damper in Closed Position

Damper Type
Horizontal Fire Damper



Damper Size
36" x 20"

Damper Manufacturer
Ruskin

Damper Model #
IBD2


Fusible Link Temperature
212 Degrees

Picture of Damper I.D. Label

Access Door Size
18" x 18"

Pass / Fail / Abandoned
Pass

Comments / Corrections
None



Duct Fabricators, Inc.

883 Addison Rd. Cleveland, Ohio
P: 216-391-2400 F: 216-391-2492

FIRE SAFETY DIVISION

NEMI Certified HVAC Fire Life Safety Technicians



CUYAHOGA COUNTY DAMPER INSPECTION REPORT

Date of Inspection

2023-07-11

Facility Location

Virgil E Brown Center

Damper Location

5th floor mechanical room north.

Inspector Name

Dan Tulcewicz

Damper I.D.

EF10-5

Damper Type

Horizontal Fire Damper

Damper Size

40"x20"

Damper Manufacturer

Ruskin

Damper Model

IBD2

Fusible Link Temperature

165 Degrees

Access Door Size

24"x24"

Pass / Fail / Abandoned

Pass

Comments / Corrections

None


Picture of Damper in Open Position



Picture of Damper in Closed Position



Picture of Damper I.D. Label



CUYAHOGA COUNTY DAMPER INSPECTION REPORT

Date of Inspection
2023-07-06

Facility Location
Virgil E Brown Center

Damper Location
North Mechanical room

Inspector Name
Julie Gue

Damper I.D. #
EF10-GRD

Damper Type
Vertical Fire Damper

Damper Size
14x20

Damper Manufacturer
Ruskin

Damper Model #
IBD2

Fusible Link Temperature
212 Degrees

Access Door Size
18x18

Pass / Fail / Abandoned
Pass

Comments / Corrections
None

Picture of Damper in Open Position



Picture of Damper in Closed Position



Picture of Damper I.D. Label



CUYAHOGA COUNTY DAMPER INSPECTION REPORT

Date of Inspection
2023-06-28

Facility Location
Virgil E Brown Center

Damper Location
North

Inspector Name
Dan Tulcewicz

Damper I.D. #
EF18-1

Damper Type
Vertical Fire Damper

Damper Size
12"x12"

Damper Manufacturer
Ruskin

Damper Model #
IBD2

Fusible Link Temperature
212 Degrees

Access Door Size
8"x8"

Pass / Fail / Abandoned
Pass

Comments / Corrections
None

Picture of Damper in Open Position



Picture of Damper in Closed Position



Picture of Damper I.D. Label

<u>FIRE</u>	
<u>DAMPER</u>	
Inspection Date: 6-28-23	Reference I.D. #: EF18-1
Inspected By: Tulcewicz	
Next Inspect. By: 6-28-25	
Duct Fabricators, Inc. 883 Addison Rd. Cleveland, Ohio P: 216-391-2400 F: 216-391-2492	
FIRE SAFETY DIVISION NEMI Certified HVAC Fire Life Safety Technicians	
MEMBER NFPA	

CUYAHOGA COUNTY DAMPER INSPECTION REPORT

Date of Inspection

2023-06-28

Facility Location

Virgil E Brown Center

Damper Location

North

Inspector Name

Dan Tulcewicz

Damper I.D. #

EF18-2

Damper Type

Vertical Fire Damper

Damper Size

12"x12"

Damper Manufacturer

Ruskin

Damper Model #

IBD2

Fusible Link Temperature

212 Degrees

Access Door Size

12"x12"

Pass / Fail / Abandoned

Pass

Comments / Corrections

None


Picture of Damper in Open Position



Picture of Damper in Closed Position



Picture of Damper I.D. Label



CUYAHOGA COUNTY DAMPER INSPECTION REPORT

Date of Inspection
2023-06-28

Facility Location
Virgil E Brown Center

Damper Location
North.

Inspector Name
Dan Tulcewicz

Damper I.D. #
EF18-3

Damper Type
Vertical Fire Damper

Damper Size
12"x14"

Damper Manufacturer
Ruskin

Damper Model #
IBD2

Fusible Link Temperature
212 Degrees

Access Door Size
Remove the grille.

Pass / Fail / Abandoned
Pass

Comments / Corrections
None

Picture of Damper in Open Position



Picture of Damper in Closed Position



Picture of Damper I.D. Label



CUYAHOGA COUNTY DAMPER INSPECTION REPORT

Date of Inspection
2023-06-28

Facility Location
Virgil E Brown Center

Damper Location
North.

Inspector Name
Dan Tulcewicz

Damper I.D. #
EF18-OA

Damper Type
Vertical Fire Damper

Damper Size
40"x24"

Damper Manufacturer
Ruskin

Damper Model #
IBD2

Fusible Link Temperature
165 Degrees

Access Door Size
18"x18"

Pass / Fail / Abandoned
Pass

Comments / Corrections
None

Picture of Damper in Open Position



Picture of Damper in Closed Position



Picture of Damper I.D. Label



CUYAHOGA COUNTY DAMPER INSPECTION REPORT

Date of Inspection
2023-06-28

Facility Location
Virgil E Brown Center

Damper Location
North Lower-Level

Inspector Name
Dan Tulcewicz

Damper I.D. #
EF25-1

Damper Type
Vertical Fire Damper

Damper Size
12" x 12"

Damper Manufacturer
Ruskin

Damper Model #
IBD2

Fusible Link Temperature
212 Degrees

Access Door Size
10" x 8"

Pass / Fail / Abandoned
Pass

Comments / Corrections
None

Picture of Damper in Open Position



Picture of Damper in Closed Position



Picture of Damper I.D. Label

FIRE DAMPER	
Inspection Date: 6-28-23	Reference I.D. #: EF25-1
Inspected By: TULCEWICZ	
Next Inspect. By: 6-28-25	

Duct Fabricators, Inc.
883 Addison Rd. Cleveland, Ohio
P: 216-391-2400 F: 216-391-2492

FIRE SAFETY DIVISION
NEMI Certified HVAC Fire Life Safety Technicians

MEMBER
NFPA

CUYAHOGA COUNTY DAMPER INSPECTION REPORT

Date of Inspection
2023-06-28

Facility Location
Virgil E Brown Center

Damper Location
North

Inspector Name
Dan Tulcewicz

Damper I.D. #
LL Relief -1

Damper Type
Vertical Fire Damper

Damper Size
24"x28"

Damper Manufacturer
Ruskin

Damper Model #
IBD2

Fusible Link Temperature
212 Degrees

Access Door Size
Remove the grille.

Pass / Fail / Abandoned
Pass

Comments / Corrections
None

Picture of Damper in Open Position



Picture of Damper in Closed Position



Picture of Damper I.D. Label



CUYAHOGA COUNTY DAMPER INSPECTION REPORT

Date of Inspection
2023-06-28

Picture of Damper in Open Position

Facility Location
Virgil E Brown Center



Damper Location
North.

Inspector Name
Dan Tulcewicz

Damper I.D. #
LL-RA2

Picture of Damper in Closed Position

Damper Type
Vertical Fire Damper



Damper Size
48"x66"

Damper Manufacturer
Ruskin

Damper Model #
IBD2

Fusible Link Temperature
212 Degrees

Picture of Damper I.D. Label

Access Door Size
Remove the grille.

Pass / Fail / Abandoned
Pass

Comments / Corrections
None



CUYAHOGA COUNTY DAMPER INSPECTION REPORT

Date of Inspection
2023-06-28

Facility Location
Virgil E Brown Center

Damper Location
North

Inspector Name
Dan Tulcewicz

Damper I.D. #
LL-RA3

Damper Type
Vertical Fire Damper

Damper Size
24"x28"

Damper Manufacturer
Ruskin

Damper Model #
IBD2

Fusible Link Temperature
165 Degrees

Access Door Size
Remove the grille.

Pass / Fail / Abandoned
Pass

Comments / Corrections
None


Picture of Damper in Open Position



Picture of Damper in Closed Position



Picture of Damper I.D. Label



CUYAHOGA COUNTY DAMPER INSPECTION REPORT

Date of Inspection
2023-06-28

Facility Location
Virgil E Brown Center

Damper Location
North.

Inspector Name
Dan Tulcewicz

Damper I.D. #
LL-RA4

Damper Type
Vertical Fire Damper

Damper Size
60"x84"

Damper Manufacturer
Ruskin

Damper Model #
IBD2

Fusible Link Temperature
212 Degrees

Access Door Size
Remove

Pass / Fail / Abandoned
Pass

Comments / Corrections
None

Picture of Damper in Open Position



Picture of Damper in Closed Position



Picture of Damper I.D. Label

<u>FIRE</u> <u>DAMPER</u>	
Inspection Date: 6-28-23	Reference I.D.#: LL-RA4
Inspected By: Tulcewicz	
Next Inspect. By: 6-28-25	
<small>Duct Fabricators, Inc. 883 Addison Rd. Cleveland, Ohio P: 216-391-2400 F: 216-391-2492</small>	
FIRE SAFETY DIVISION NEMI Certified HVAC Fire Life Safety Technicians	
<small>MEMBER</small> NFPA	

CUYAHOGA COUNTY DAMPER INSPECTION REPORT

Date of Inspection
2023-06-28

Facility Location
Virgil E Brown Center

Damper Location
North

Inspector Name
Dan Tulcewicz

Damper I.D. #
LL-TA-1

Damper Type
Vertical Fire Damper

Damper Size
48" x 18"

Damper Manufacturer
Ruskin

Damper Model #
IBD2

Fusible Link Temperature
212 Degrees

Access Door Size
Screen

Pass / Fail / Abandoned
Pass

Comments / Corrections
None

Picture of Damper in Open Position



Picture of Damper in Closed Position



Picture of Damper I.D. Label

FIRE DAMPER	
Inspection Date: 6-28-23	Reference I.D. #:
Inspected By: TULCEWICZ	LL-TA-1
Next Inspect By: 6-28-25	

Duct Fabricators, Inc.
883 Addison Rd. Cleveland, Ohio
P: 216-391-2400 F: 216-391-2492

FIRE SAFETY DIVISION
NEMI Certified HVAC Fire Life Safety Technicians

MEMBER
NFPA

Duct Fabricators, Inc.

883 Addison Rd. Cleveland, Ohio
P: 216-391-2400 F: 216-391-2492



NEMI Certified HVAC Fire Life Safety Technicians



CUYAHOGA COUNTY DAMPER INSPECTION REPORT

Date of Inspection

2023-06-28

Picture of Damper in Open Position



Facility Location

Virgil E Brown Center

Damper Location

North

Inspector Name

Dan Tulcewicz

Damper I.D. #

LL-TA-2

Picture of Damper in Closed Position



Damper Type

Vertical Fire Damper

Damper Size

12"x12"

Damper Manufacturer

Ruskin


Damper Model #

IBD2

Fusible Link Temperature

165 Degrees

Picture of Damper I.D. Label



Access Door Size

Remove the screen.

Pass / Fail / Abandoned

Pass

Comments / Corrections

None

Inspection Date:
6-28-23
Inspected By:
TULCEWICZ
Next Inspect. By:
6-28-23

Reference I.D. #:
LL-TA-2

Duct Fabricators, Inc.
883 Addison Rd. Cleveland, Ohio
P: 216-391-2400 F: 216-391-2492

FIRE SAFETY DIVISION
NEMI Certified HVAC Fire Life Safety Technicians



CUYAHOGA COUNTY DAMPER INSPECTION REPORT

Date of Inspection

2023-07-11

Facility Location

Virgil E Brown Center

Damper Location

Penthouse North.

Inspector Name

Dan Tulcewicz

Damper I.D. #

PH.1-OA

Damper Type

Vertical Fire Damper

Damper Size

120"x48"

Damper Manufacturer

Ruskin

Damper Model #

IBD2

Fusible Link Temperature

212 Degrees

Access Door Size

24"x24"

Pass / Fail / Abandoned

Pass

Comments / Corrections

None


Picture of Damper in Open Position



Picture of Damper in Closed Position



Picture of Damper I.D. Label



CUYAHOGA COUNTY DAMPER INSPECTION REPORT

Date of Inspection
2023-07-11

Facility Location
Virgil E Brown Center

Damper Location
Penthouse North.

Inspector Name
Dan Tulcewicz

Damper I.D. #
PH.1-RA

Damper Type
Vertical Fire Damper

Damper Size
108"x48"

Damper Manufacturer
Ruskin

Damper Model #
IBD2

Fusible Link Temperature
212 Degrees

Access Door Size
24"x24"

Pass / Fail / Abandoned
Pass

Comments / Corrections
Damper functions properly.

Picture of Damper in Open Position



Picture of Damper in Closed Position



Picture of Damper I.D. Label



CUYAHOGA COUNTY DAMPER INSPECTION REPORT

Date of Inspection
2023-07-10

Facility Location
Virgil E Brown Center

Damper Location
South PH

Inspector Name
Julie Gue

Damper I.D. #
PH.2-OA 3

Damper Type
Vertical Fire Damper

Damper Size
48x48

Damper Manufacturer
Ruskin

Damper Model #
IBD2

Fusible Link Temperature
212 Degrees

Access Door Size
Grille access

Pass / Fail / Abandoned
Pass

Comments / Corrections
None

Picture of Damper in Open Position



Picture of Damper in Closed Position



Picture of Damper I.D. Label

<u>FIRE</u>	
<u>DAMPER</u>	
Inspection Date: 7 10 23	Reference I.D. #: PH . 2
Inspected By: Gue	OA3
Next Inspect. By: 7 10 25	

Duct Fabricators, Inc. **FIRE SAFETY DIVISION** MEMBER **NFPA**

CUYAHOGA COUNTY DAMPER INSPECTION REPORT

Date of Inspection

2023-07-10

Facility Location

Virgil E Brown Center

Damper Location

South penthouse

Inspector Name

Julie Gue

Damper I.D. #

PH2-OA1

Damper Type

Vertical Fire Damper

Damper Size

114x48

Damper Manufacturer

Ruskin

Damper Model #

IBD2

Fusible Link Temperature

212 Degrees

Access Door Size

24x18

Pass / Fail / Abandoned

Pass

Comments / Corrections

None

Picture of Damper in Open Position



Picture of Damper in Closed Position



Picture of Damper I.D. Label



Duct Fabricators, Inc.

883 Addison Rd. Cleveland, Ohio
P: 216-391-2400 F: 216-391-2492



NEMI Certified HVAC Fire Life Safety Technicians



CUYAHOGA COUNTY DAMPER INSPECTION REPORT

Date of Inspection

2023-07-10

Facility Location

Virgil E Brown Center

Damper Location

South penthouse

Inspector Name

Julie Gue

Damper I.D.

PH2-OA2

Damper Type

Vertical Fire Damper

Damper Size

96x48

Damper Manufacturer

Ruskin

Damper Model

IBD2

Fusible Link Temperature

212 Degrees

Access Door Size

20x20

Pass / Fail / Abandoned

Pass

Comments / Corrections

None


Picture of Damper in Open Position



Picture of Damper in Closed Position



Picture of Damper I.D. Label

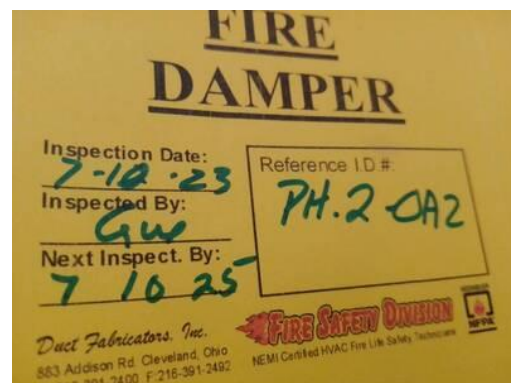

CUYAHOGA COUNTY DAMPER INSPECTION REPORT

Date of Inspection
2023-06-27

Picture of Damper in Open Position



Facility Location
Virgil E Brown Center

Damper Location
North.

Inspector Name
Dan Tulcewicz

Damper I.D. #
AHU1.1-S6

Picture of Damper in Closed Position



Damper Type
Vertical Fire Damper

Damper Size
56" x 18"

Damper Manufacturer
Ruskin

Damper Model #
IBD2

Fusible Link Temperature
212 Degrees

Picture of Damper I.D. Label



Access Door Size
18" x 18"

Pass / Fail / Abandoned
Pass

Comments / Corrections
None

CUYAHOGA COUNTY DAMPER INSPECTION REPORT

Date of Inspection
2023-06-27

Picture of Damper in Open Position

Facility Location
Virgil E Brown Center



Damper Location
North

Inspector Name
Dan Tulcewicz

Damper I.D. #
AHU1.1-S4

Picture of Damper in Closed Position

Damper Type
Vertical Fire Damper



Damper Size
8" x 12"

Damper Manufacturer
Ruskin

Damper Model #
IBD2

Picture of Damper I.D. Label

Fusible Link Temperature
212 Degrees

Access Door Size
Open

Pass / Fail / Abandoned
Pass

Comments / Corrections
None

FIRE
DAMPER

Inspection Date: 6-27-23	Reference I.D.#: AHU1.1-S4
Inspected By: TULCEWICZ	
Next Inspect. By: 6-27-25	

Duct Fabricators, Inc.
883 Addison Rd. Cleveland, Ohio
P: 216-391-2400 F: 216-391-2492

FIRE SAFETY DIVISION
NEMI Certified HVAC Fire Life Safety Technicians

MEMBER
NFPA

VISUAL CUYAHOGA COUNTY DAMPER INSPECTION REPORT

Date of Inspection

2022-08-10

Facility Location

Virgil E Brown Center

Damper Location

North mechanical room

Inspector Name

Julie Gue

Damper I.D. #

AHU1.1-OA

Damper Type

Vertical Fire Damper

Damper Size

96x24

Damper Manufacturer

Ruskin

Damper Model #

IBD2

Fusible Link Temperature

212 Degrees

Access Door Size

16x16

Pass / Fail / Abandoned

Pass

Comments / Corrections

None

Exterior Picture of Damper



Interior Picture of Damper



Picture of Damper I.D. Label



VISUAL CUYAHOGA COUNTY DAMPER INSPECTION REPORT

Date of Inspection

2022-08-10

Facility Location

Virgil E Brown Center

Damper Location

North mechanical room

Inspector Name

Julie Gue

Damper I.D. #

AHU1.1-RA

Damper Type

Vertical Fire Damper

Damper Size

96x60

Damper Manufacturer

Ruskin

Damper Model #

IBD2

Fusible Link Temperature

212 Degrees

Access Door Size

Open duct

Pass / Fail / Abandoned

Pass

Comments / Corrections

None


Exterior Picture of Damper



Interior Picture of Damper



Picture of Damper I.D. Label



VISUAL CUYAHOGA COUNTY DAMPER INSPECTION REPORT

Date of Inspection

2022-08-15

Facility Location

Virgil E Brown Center

Damper Location

Ground mechanical room

Inspector Name

Julie Gue

Damper I.D. #

AHU1.1-S1

Damper Type

Vertical Fire Damper

Damper Size

16x12

Damper Manufacturer

Ruskin

Damper Model #

IBD2

Fusible Link Temperature

212 Degrees

Access Door Size

14x14

Pass / Fail / Abandoned

Pass

Comments / Corrections

None


Exterior Picture of Damper



Interior Picture of Damper



Picture of Damper I.D. Label



Duct Fabricators, Inc.

883 Addison Rd. Cleveland, Ohio
P: 216-391-2400 F: 216-391-2492

FIRE SAFETY DIVISION
NEMI Certified HVAC Fire Life Safety Technicians



VISUAL CUYAHOGA COUNTY DAMPER INSPECTION REPORT

Date of Inspection

2022-08-15

Facility Location

Virgil E Brown Center

Damper Location

Northeast corridor

Inspector Name

Julie Gue

Damper I.D. #

AHU1.1-S2

Damper Type

Vertical Fire Damper

Damper Size

56x16

Damper Manufacturer

Ruskin

Damper Model #

IBD2

Fusible Link Temperature

212 Degrees

Access Door Size

18x18

Pass / Fail / Abandoned

Pass

Comments / Corrections

None


Exterior Picture of Damper



Interior Picture of Damper



Picture of Damper I.D. Label



VISUAL CUYAHOGA COUNTY DAMPER INSPECTION REPORT

Date of Inspection

2022-08-15

Facility Location

Virgil E Brown Center

Damper Location

Northeast corridor

Inspector Name

Julie Gue

Damper I.D. #

AHU1.1-S4

Damper Type

Vertical Fire Damper

Damper Size

12x9.5 oval

Damper Manufacturer

Ruskin

Damper Model #

IBD2

Fusible Link Temperature

212 Degrees

Access Door Size

18x18

Pass / Fail / Abandoned

Pass


Comments / Corrections

None

Exterior Picture of Damper



Interior Picture of Damper



Picture of Damper I.D. Label



VISUAL CUYAHOGA COUNTY DAMPER INSPECTION REPORT

Date of Inspection

2022-08-15

Facility Location

Virgil E Brown Center

Damper Location

Northeast mechanical room

Inspector Name

Julie Gue

Damper I.D. #

AHU1.1-S5

Damper Type

Vertical Fire Damper

Damper Size

10" oval

Damper Manufacturer

Ruskin

Damper Model #

IBD2

Fusible Link Temperature

212 Degrees

Access Door Size

18x18


Pass / Fail / Abandoned

Pass

Comments / Corrections

None

Exterior Picture of Damper



Interior Picture of Damper



Picture of Damper I.D. Label



VISUAL CUYAHOGA COUNTY DAMPER INSPECTION REPORT

Date of Inspection

2022-08-15

Facility Location

Virgil E Brown Center

Damper Location

Northeast corridor

Inspector Name

Julie Gue

Damper I.D. #

AHU1.1-S6

Damper Type

Vertical Fire Damper

Damper Size

56x16

Damper Manufacturer

Ruskin

Damper Model #

IBD2

Fusible Link Temperature

212 Degrees

Access Door Size

18x18

Pass / Fail / Abandoned

Pass

Comments / Corrections

None


Exterior Picture of Damper



Interior Picture of Damper



Picture of Damper I.D. Label



VISUAL CUYAHOGA COUNTY DAMPER INSPECTION REPORT

Date of Inspection

2022-08-15

Facility Location

Virgil E Brown Center

Damper Location

Northwest corridor

Inspector Name

Julie Gue

Damper I.D. #

AHU1.1-S7

Damper Type

Vertical Fire Damper

Damper Size

56x16

Damper Manufacturer

Ruskin

Damper Model #

IBD2

Fusible Link Temperature

212 Degrees

Access Door Size

18x18

Pass / Fail / Abandoned

Pass

Comments / Corrections

None

Exterior Picture of Damper



Interior Picture of Damper



Picture of Damper I.D. Label



VISUAL CUYAHOGA COUNTY DAMPER INSPECTION REPORT

Date of Inspection

2022-08-15

Facility Location

Virgil E Brown Center

Damper Location

Northwest corridor

Inspector Name

Julie Gue

Damper I.D. #

AHU1.1-S8

Damper Type

Vertical Fire Damper

Damper Size

6" Round

Damper Manufacturer

Ruskin

Damper Model #

IBD2

Fusible Link Temperature

212 Degrees

Access Door Size

18x18

Pass / Fail / Abandoned

Pass

Comments / Corrections

None

Exterior Picture of Damper



Interior Picture of Damper



Picture of Damper I.D. Label



VISUAL CUYAHOGA COUNTY DAMPER INSPECTION REPORT

Date of Inspection

2022-08-15

Facility Location

Virgil E Brown Center

Damper Location

Northwest corridor

Inspector Name

Julie Gue

Damper I.D. #

AHU1.1-S9

Damper Type

Vertical Fire Damper

Damper Size

56x16

Damper Manufacturer

Ruskin

Damper Model #

IBD2

Fusible Link Temperature

212 Degrees

Access Door Size

18x18

Pass / Fail / Abandoned

Pass

Comments / Corrections

None

Exterior Picture of Damper



Interior Picture of Damper



Picture of Damper I.D. Label



VISUAL CUYAHOGA COUNTY DAMPER INSPECTION REPORT

Date of Inspection

2022-08-10

Facility Location

Virgil E Brown Center

Damper Location

Northwest comm room

Inspector Name

Julie Gue

Damper I.D. #

AHU1.1-S10

Damper Type

Vertical Fire Damper

Damper Size

8x12

Damper Manufacturer

Ruskin

Damper Model #

IBD2

Fusible Link Temperature

212 Degrees

Access Door Size

Open duct

Pass / Fail / Abandoned

Pass

Comments / Corrections

None

Exterior Picture of Damper



Interior Picture of Damper



Picture of Damper I.D. Label



VISUAL CUYAHOGA COUNTY DAMPER INSPECTION REPORT

Date of Inspection

2022-08-15

Facility Location

Virgil E Brown Center

Damper Location

Northwest corridor

Inspector Name

Julie Gue

Damper I.D. #

AHU1.1-S11

Damper Type

Vertical Fire Damper

Damper Size

56x16

Damper Manufacturer

Ruskin

Damper Model #

IBD2

Fusible Link Temperature

212 Degrees

Access Door Size

16x16

Pass / Fail / Abandoned

Pass

Comments / Corrections

None


Exterior Picture of Damper



Interior Picture of Damper



Picture of Damper I.D. Label



Duct Fabricators, Inc.

883 Addison Rd. Cleveland, Ohio
P: 216-391-2400 F: 216-391-2492

FIRE SAFETY DIVISION

NEMI Certified HVAC Fire Life Safety Technicians



VISUAL CUYAHOGA COUNTY DAMPER INSPECTION REPORT

Date of Inspection

2022-08-16

Facility Location

Virgil E Brown Center

Damper Location

Front lobby

Inspector Name

Julie Gue

Damper I.D.

AHU1.1-S12

Damper Type

Vertical Fire Damper

Damper Size

46x16

Damper Manufacturer

Ruskin

Damper Model

IBD2

Fusible Link Temperature

212 Degrees

Access Door Size

Grille access

Pass / Fail / Abandoned

Pass

Comments / Corrections

None


Exterior Picture of Damper



Interior Picture of Damper



Picture of Damper I.D. Label



VISUAL CUYAHOGA COUNTY DAMPER INSPECTION REPORT

Date of Inspection

2022-08-10

Facility Location

Virgil E Brown Center

Damper Location

South mechanical room

Inspector Name

Julie Gue

Damper I.D. #

AHU1.2-OA

Damper Type

Vertical Fire Damper

Damper Size

96x24

Damper Manufacturer

Ruskin

Damper Model #

IBD2

Fusible Link Temperature

212 Degrees

Access Door Size

16x16

Pass / Fail / Abandoned

Pass

Comments / Corrections

None


Exterior Picture of Damper



Interior Picture of Damper



Picture of Damper I.D. Label



VISUAL CUYAHOGA COUNTY DAMPER INSPECTION REPORT

Date of Inspection

2022-08-10

Facility Location

Virgil E Brown Center

Damper Location

South mechanical room

Inspector Name

Julie Gue

Damper I.D. #

AHU1.2-RA

Damper Type

Vertical Fire Damper

Damper Size

96x60

Damper Manufacturer

Ruskin

Damper Model #

IBD2

Fusible Link Temperature

212 Degrees

Access Door Size

Open duct

Pass / Fail / Abandoned

Pass

Comments / Corrections

None

Exterior Picture of Damper



Interior Picture of Damper



Picture of Damper I.D. Label



VISUAL CUYAHOGA COUNTY DAMPER INSPECTION REPORT

Date of Inspection

2022-08-16

Facility Location

Virgil E Brown Center

Damper Location

RM180

Inspector Name

Julie Gue

Damper I.D. #

AHU1.2-S1

Damper Type

Vertical Fire Damper

Damper Size

36x8

Damper Manufacturer

Ruskin

Damper Model #

IBD2

Fusible Link Temperature

212 Degrees

Access Door Size

12x12

Pass / Fail / Abandoned

Pass

Comments / Corrections

None

Exterior Picture of Damper



Interior Picture of Damper



Picture of Damper I.D. Label



VISUAL CUYAHOGA COUNTY DAMPER INSPECTION REPORT

Date of Inspection

2022-08-16

Facility Location

Virgil E Brown Center

Damper Location

State Hearing Room

Inspector Name

Julie Gue

Damper I.D. #

AHU1.2-S2

Damper Type

Vertical Fire Damper

Damper Size

36x8

Damper Manufacturer

Ruskin

Damper Model #

IBD2

Fusible Link Temperature

212 Degrees

Access Door Size

12x12

Pass / Fail / Abandoned

Pass

Comments / Corrections

None

Exterior Picture of Damper



Interior Picture of Damper



Picture of Damper I.D. Label



VISUAL CUYAHOGA COUNTY DAMPER INSPECTION REPORT

Date of Inspection

2022-08-16

Facility Location

Virgil E Brown Center

Damper Location

Southwest corridor

Inspector Name

Julie Gue

Damper I.D. #

AHU1.2-S3

Damper Type

Vertical Fire Damper

Damper Size

56x16

Damper Manufacturer

Ruskin

Damper Model #

IBD2

Fusible Link Temperature

212 Degrees

Access Door Size

18x18

Pass / Fail / Abandoned

Pass

Comments / Corrections

None


Exterior Picture of Damper



Interior Picture of Damper



Picture of Damper I.D. Label



VISUAL CUYAHOGA COUNTY DAMPER INSPECTION REPORT

Date of Inspection

2022-08-10

Facility Location

Virgil E Brown Center

Damper Location

Southwest com room

Inspector Name

Julie Gue

Damper I.D. #

AHU1.2-S5

Damper Type

Vertical Fire Damper

Damper Size

8x12

Damper Manufacturer

Ruskin

Damper Model #

IBD2

Fusible Link Temperature

212 Degrees

Access Door Size

Open duct

Pass / Fail / Abandoned

Pass

Comments / Corrections

None


Exterior Picture of Damper



Interior Picture of Damper



Picture of Damper I.D. Label



VISUAL CUYAHOGA COUNTY DAMPER INSPECTION REPORT

Date of Inspection

2022-08-16

Facility Location

Virgil E Brown Center

Damper Location

Southwest corridor

Inspector Name

Julie Gue

Damper I.D. #

AHU1.2-S6

Damper Type

Vertical Fire Damper

Damper Size

17x8

Damper Manufacturer

Ruskin

Damper Model #

IBD2

Fusible Link Temperature

212 Degrees

Access Door Size

18x18

Pass / Fail / Abandoned

Pass

Comments / Corrections

None

Exterior Picture of Damper



Interior Picture of Damper



Picture of Damper I.D. Label



VISUAL CUYAHOGA COUNTY DAMPER INSPECTION REPORT

Date of Inspection

2022-08-16

Facility Location

Virgil E Brown Center

Damper Location

180 main lobby

Inspector Name

Julie Gue

Damper I.D. #

AHU1.2-S7

Damper Type

Vertical Fire Damper

Damper Size

17x8 oval

Damper Manufacturer

Ruskin

Damper Model #

IBD2

Fusible Link Temperature

212 Degrees

Access Door Size

18x18

Pass / Fail / Abandoned

Pass

Comments / Corrections

None

Exterior Picture of Damper



Interior Picture of Damper



Picture of Damper I.D. Label



VISUAL CUYAHOGA COUNTY DAMPER INSPECTION REPORT

Date of Inspection

2022-08-16

Facility Location

Virgil E Brown Center

Damper Location

Southwest of lobby

Inspector Name

Julie Gue

Damper I.D. #

AHU1.2-S8

Damper Type

Vertical Fire Damper

Damper Size

14x8 oval

Damper Manufacturer

Ruskin

Damper Model #

IBD2

Fusible Link Temperature

212 Degrees

Access Door Size

18x18

Pass / Fail / Abandoned

Pass

Comments / Corrections

None

Exterior Picture of Damper



Interior Picture of Damper



Picture of Damper I.D. Label



VISUAL CUYAHOGA COUNTY DAMPER INSPECTION REPORT

Date of Inspection

2022-08-16

Facility Location

Virgil E Brown Center

Damper Location

Southwest of lobby

Inspector Name

Julie Gue

Damper I.D. #

AHU1.2-S9

Damper Type

Vertical Fire Damper

Damper Size

17x8 oval

Damper Manufacturer

Ruskin

Damper Model #

IBD2

Fusible Link Temperature

212 Degrees

Access Door Size

18x18

Pass / Fail / Abandoned

Pass

Comments / Corrections

None

Exterior Picture of Damper



Interior Picture of Damper



Picture of Damper I.D. Label



Duct Fabricators, Inc.

883 Addison Rd. Cleveland, Ohio
P: 216-391-2400 F: 216-391-2492



NEMI Certified HVAC Fire Life Safety Technicians



VISUAL CUYAHOGA COUNTY DAMPER INSPECTION REPORT

Date of Inspection

2022-08-16

Facility Location

Virgil E Brown Center

Damper Location

Southwest of lobby

Inspector Name

Julie Gue

Damper I.D. #

AHU1.2-S10

Damper Type

Vertical Fire Damper

Damper Size

16x10

Damper Manufacturer

Ruskin

Damper Model #

IBD2

Fusible Link Temperature

212 Degrees

Access Door Size

18x18

Pass / Fail / Abandoned

Pass

Comments / Corrections

None


Exterior Picture of Damper



Interior Picture of Damper



Picture of Damper I.D. Label



VISUAL CUYAHOGA COUNTY DAMPER INSPECTION REPORT

Date of Inspection

2022-08-16

Facility Location

Virgil E Brown Center

Damper Location

Southwest of lobby

Inspector Name

Julie Gue

Damper I.D. #

AHU1.2-S11

Damper Type

Vertical Fire Damper

Damper Size

36x16

Damper Manufacturer

Ruskin

Damper Model #

IBD2

Fusible Link Temperature

212 Degrees

Access Door Size

18x18

Pass / Fail / Abandoned

Pass

Comments / Corrections

None


Exterior Picture of Damper



Interior Picture of Damper



Picture of Damper I.D. Label



Duct Fabricators, Inc.

883 Addison Rd. Cleveland, Ohio
P: 216-391-2400 F: 216-391-2492

FIRE SAFETY DIVISION
NEMI Certified HVAC Fire Life Safety Technicians



VISUAL CUYAHOGA COUNTY DAMPER INSPECTION REPORT

Date of Inspection

2022-08-16

Facility Location

Virgil E Brown Center

Damper Location

Front lobby

Inspector Name

Julie Gue

Damper I.D. #

AHU1.2-S13

Damper Type

Vertical Fire Damper

Damper Size

42x16

Damper Manufacturer

Ruskin

Damper Model #

IBD2

Fusible Link Temperature

212 Degrees

Access Door Size

Grille access

Pass / Fail / Abandoned

Pass

Comments / Corrections

None


Exterior Picture of Damper



Interior Picture of Damper



Picture of Damper I.D. Label



VISUAL CUYAHOGA COUNTY DAMPER INSPECTION REPORT

Date of Inspection

2022-08-16

Facility Location

Virgil E Brown Center

Damper Location

Southeast

Inspector Name

Julie Gue

Damper I.D. #

AHU1.2-S14

Damper Type

Vertical Fire Damper

Damper Size

56x16

Damper Manufacturer

Ruskin

Damper Model #

IBD2

Fusible Link Temperature

212 Degrees

Access Door Size

16x16

Pass / Fail / Abandoned

Pass

Comments / Corrections

None

Exterior Picture of Damper



Interior Picture of Damper



Picture of Damper I.D. Label



Duct Fabricators, Inc.

883 Addison Rd. Cleveland, Ohio
P: 216-391-2400 F: 216-391-2492



NEMI Certified HVAC Fire Life Safety Technicians



VISUAL CUYAHOGA COUNTY DAMPER INSPECTION REPORT

Date of Inspection

2022-08-16

Facility Location

Virgil E Brown Center

Damper Location

RM170

Inspector Name

Julie Gue

Damper I.D.

AHU1.2-S15

Damper Type

Vertical Fire Damper

Damper Size

28x10

Damper Manufacturer

Ruskin

Damper Model

IBD2

Fusible Link Temperature

212 Degrees

Access Door Size

20x20

Pass / Fail / Abandoned

Pass

Comments / Corrections

None


Exterior Picture of Damper



Interior Picture of Damper



Picture of Damper I.D. Label



VISUAL CUYAHOGA COUNTY DAMPER INSPECTION REPORT

Date of Inspection

2022-08-16

Facility Location

Virgil E Brown Center

Damper Location

Protective services

Inspector Name

Julie Gue

Damper I.D. #

AHU1.2-S16

Damper Type

Vertical Fire Damper

Damper Size

8" Round

Damper Manufacturer

Ruskin

Damper Model #

IBD2

Fusible Link Temperature

212 Degrees

Access Door Size

18x18

Pass / Fail / Abandoned

Pass

Comments / Corrections

None


Exterior Picture of Damper



Interior Picture of Damper



Picture of Damper I.D. Label



VISUAL CUYAHOGA COUNTY DAMPER INSPECTION REPORT

Date of Inspection

2022-08-16

Facility Location

Virgil E Brown Center

Damper Location

Protective services

Inspector Name

Julie Gue

Damper I.D. #

AHU1.2-S17

Damper Type

Vertical Fire Damper

Damper Size

18x10

Damper Manufacturer

Ruskin

Damper Model #

IBD2

Fusible Link Temperature

212 Degrees

Access Door Size

8x8

Pass / Fail / Abandoned

Pass

Comments / Corrections

None


Exterior Picture of Damper



Interior Picture of Damper



Picture of Damper I.D. Label



VISUAL CUYAHOGA COUNTY DAMPER INSPECTION REPORT

Date of Inspection

2022-08-16

Facility Location

Virgil E Brown Center

Damper Location

Southeast corridor

Inspector Name

Julie Gue

Damper I.D. #

AHU1.2-S18

Damper Type

Vertical Fire Damper

Damper Size

56x16

Damper Manufacturer

Ruskin

Damper Model #

IBD2

Fusible Link Temperature

212 Degrees

Access Door Size

18x18

Pass / Fail / Abandoned

Pass

Comments / Corrections

None

Exterior Picture of Damper



Interior Picture of Damper



Picture of Damper I.D. Label



VISUAL CUYAHOGA COUNTY DAMPER INSPECTION REPORT

Date of Inspection

2022-08-10

Facility Location

Virgil E Brown Center

Damper Location

Southeast com room

Inspector Name

Julie Gue

Damper I.D. #

AHU1.2-S19

Damper Type

Vertical Fire Damper

Damper Size

8x12

Damper Manufacturer

Ruskin

Damper Model #

IBD2

Fusible Link Temperature

212 Degrees

Access Door Size

Open duct

Pass / Fail / Abandoned

Pass

Comments / Corrections

None

Exterior Picture of Damper



Interior Picture of Damper



Picture of Damper I.D. Label



VISUAL CUYAHOGA COUNTY DAMPER INSPECTION REPORT

Date of Inspection

2022-08-16

Facility Location

Virgil E Brown Center

Damper Location

Southeast corridor

Inspector Name

Julie Gue

Damper I.D. #

AHU1.2-S20

Damper Type

Vertical Fire Damper

Damper Size

56x16

Damper Manufacturer

Ruskin

Damper Model #

IBD2

Fusible Link Temperature

212 Degrees

Access Door Size

18x18

Pass / Fail / Abandoned

Pass

Comments / Corrections

None


Exterior Picture of Damper



Interior Picture of Damper



Picture of Damper I.D. Label



VISUAL CUYAHOGA COUNTY DAMPER INSPECTION REPORT

Date of Inspection

2022-08-16

Facility Location

Virgil E Brown Center

Damper Location

RM150

Inspector Name

Julie Gue

Damper I.D. #

AHU1.2-S21

Damper Type

Vertical Fire Damper

Damper Size

8" Round

Damper Manufacturer

Ruskin

Damper Model #

IBD2

Fusible Link Temperature

212 Degrees

Access Door Size

8" oval

Pass / Fail / Abandoned

Pass

Comments / Corrections

None


Exterior Picture of Damper



Interior Picture of Damper



Picture of Damper I.D. Label



VISUAL CUYAHOGA COUNTY DAMPER INSPECTION REPORT

Date of Inspection

2022-08-10

Facility Location

Virgil E Brown Center

Damper Location

Mechanical room

Inspector Name

Julie Gue

Damper I.D. #

AHU2.1-OA

Damper Type

Vertical Fire Damper

Damper Size

96x24

Damper Manufacturer

Ruskin

Damper Model #

IBD2

Fusible Link Temperature

212 Degrees

Access Door Size

16x16

Pass / Fail / Abandoned

Pass

Comments / Corrections

None


Exterior Picture of Damper



Interior Picture of Damper



Picture of Damper I.D. Label



VISUAL CUYAHOGA COUNTY DAMPER INSPECTION REPORT

Date of Inspection

2022-08-10

Facility Location

Virgil E Brown Center

Damper Location

Mechanical room

Inspector Name

Julie Gue

Damper I.D. #

AHU2.1-RA

Damper Type

Vertical Fire Damper

Damper Size

96x60

Damper Manufacturer

Ruskin

Damper Model #

IBD2

Fusible Link Temperature

212 Degrees

Access Door Size

Open duct

Pass / Fail / Abandoned

Pass

Comments / Corrections

None

Exterior Picture of Damper



Interior Picture of Damper



Picture of Damper I.D. Label



VISUAL CUYAHOGA COUNTY DAMPER INSPECTION REPORT

Date of Inspection

2022-08-08

Facility Location

Virgil E Brown Center

Damper Location

Northeast corridor

Inspector Name

Julie Gue

Damper I.D. #

AHU2.1-S1

Damper Type

Vertical Fire Damper

Damper Size

56x16

Damper Manufacturer

Ruskin

Damper Model #

IBD2

Fusible Link Temperature

212 Degrees

Access Door Size

18x18

Pass / Fail / Abandoned

Pass

Comments / Corrections

None

Exterior Picture of Damper



Interior Picture of Damper



Picture of Damper I.D. Label



VISUAL CUYAHOGA COUNTY DAMPER INSPECTION REPORT

Date of Inspection

2022-08-08

Facility Location

Virgil E Brown Center

Damper Location

Northeast corridor

Inspector Name

Julie Gue

Damper I.D. #

AHU2.1-S3

Damper Type

Vertical Fire Damper

Damper Size

56x16

Damper Manufacturer

Ruskin

Damper Model #

IBD2

Fusible Link Temperature

212 Degrees

Access Door Size

18x18

Pass / Fail / Abandoned

Pass

Comments / Corrections

None


Exterior Picture of Damper



Interior Picture of Damper



Picture of Damper I.D. Label



VISUAL CUYAHOGA COUNTY DAMPER INSPECTION REPORT

Date of Inspection
2022-08-10

Facility Location
Virgil E Brown Center

Damper Location
Northeast comm room

Inspector Name
Julie Gue

Damper I.D. #
AHU2.1-S4

Damper Type
Vertical Fire Damper

Damper Size
8x12

Damper Manufacturer
Ruskin

Damper Model #
IBD2

Fusible Link Temperature
212 Degrees

Access Door Size
Open duct

Pass / Fail / Abandoned
Pass

Comments / Corrections
None

Exterior Picture of Damper



Interior Picture of Damper



Picture of Damper I.D. Label



VISUAL CUYAHOGA COUNTY DAMPER INSPECTION REPORT

Date of Inspection

2022-08-08

Facility Location

Virgil E Brown Center

Damper Location

Northeast corridor

Inspector Name

Julie Gue

Damper I.D. #

AHU2.1-S5

Damper Type

Vertical Fire Damper

Damper Size

6" Round

Damper Manufacturer

Ruskin

Damper Model #

IBD2

Fusible Link Temperature

212 Degrees

Access Door Size

24x24

Pass / Fail / Abandoned

Pass

Comments / Corrections

None


Exterior Picture of Damper



Interior Picture of Damper



Picture of Damper I.D. Label



VISUAL CUYAHOGA COUNTY DAMPER INSPECTION REPORT

Date of Inspection

2022-08-08

Facility Location

Justice Center Court Towers

Damper Location

Northeast corridor

Inspector Name

Julie Gue

Damper I.D. #

AHU2.1-S6

Damper Type

Vertical Fire Damper

Damper Size

20x8 Oval

Damper Manufacturer

Ruskin

Damper Model #

IBD2

Fusible Link Temperature

212 Degrees

Access Door Size

18x18

Pass / Fail / Abandoned

Pass

Comments / Corrections

None


Exterior Picture of Damper



Interior Picture of Damper



Picture of Damper I.D. Label



Duct Fabricators, Inc.

883 Addison Rd. Cleveland, Ohio
P: 216-391-2400 F: 216-391-2492

FIRE SAFETY DIVISION
NEMI Certified HVAC Fire Life Safety Technicians



VISUAL CUYAHOGA COUNTY DAMPER INSPECTION REPORT

Date of Inspection

2022-08-08

Facility Location

Virgil E Brown Center

Damper Location

Northeast corridor

Inspector Name

Julie Gue

Damper I.D.

AHU2.1-S7

Damper Type

Vertical Fire Damper

Damper Size

28x10

Damper Manufacturer

Ruskin

Damper Model

IBD2

Fusible Link Temperature

212 Degrees

Access Door Size

20x20

Pass / Fail / Abandoned

Pass

Comments / Corrections

None


Exterior Picture of Damper



Interior Picture of Damper



Picture of Damper I.D. Label



VISUAL CUYAHOGA COUNTY DAMPER INSPECTION REPORT

Date of Inspection

2022-08-08

Facility Location

Virgil E Brown Center

Damper Location

AB322

Inspector Name

Julie Gue

Damper I.D. #

AHU2.1-S8

Damper Type

Vertical Fire Damper

Damper Size

6" Round

Damper Manufacturer

Ruskin

Damper Model #

IBD2

Fusible Link Temperature

212 Degrees

Access Door Size

18x18

Pass / Fail / Abandoned

Pass

Comments / Corrections

None


Exterior Picture of Damper



Interior Picture of Damper



Picture of Damper I.D. Label



VISUAL CUYAHOGA COUNTY DAMPER INSPECTION REPORT

Date of Inspection

2022-08-08

Facility Location

Virgil E Brown Center

Damper Location

Conference room 2A

Inspector Name

Julie Gue

Damper I.D. #

AHU2.1-S9

Damper Type

Vertical Fire Damper

Damper Size

10" Round

Damper Manufacturer

Ruskin

Damper Model #

IBD2

Fusible Link Temperature

212 Degrees

Access Door Size

18x18

Pass / Fail / Abandoned

Pass

Comments / Corrections

None

Exterior Picture of Damper



Interior Picture of Damper



Picture of Damper I.D. Label



VISUAL CUYAHOGA COUNTY DAMPER INSPECTION REPORT

Date of Inspection

2022-08-08

Facility Location

Virgil E Brown Center

Damper Location

RM 209

Inspector Name

Julie Gue

Damper I.D. #

AHU2.1-S10

Damper Type

Vertical Fire Damper

Damper Size

8" Round

Damper Manufacturer

Ruskin

Damper Model #

IBD2

Fusible Link Temperature

212 Degrees

Access Door Size

18x18

Pass / Fail / Abandoned

Pass

Comments / Corrections

None

Exterior Picture of Damper



Interior Picture of Damper



Picture of Damper I.D. Label



VISUAL CUYAHOGA COUNTY DAMPER INSPECTION REPORT

Date of Inspection

2022-08-08

Facility Location

Virgil E Brown Center

Damper Location

Northwest corridor

Inspector Name

Julie Gue

Damper I.D. #

AHU2.1-S11

Damper Type

Vertical Fire Damper

Damper Size

34x10

Damper Manufacturer

Ruskin

Damper Model #

IBD2

Fusible Link Temperature

212 Degrees

Access Door Size

18x18

Pass / Fail / Abandoned

Pass

Comments / Corrections

None

Exterior Picture of Damper



Interior Picture of Damper



Picture of Damper I.D. Label



VISUAL CUYAHOGA COUNTY DAMPER INSPECTION REPORT

Date of Inspection

2022-08-08

Facility Location

Virgil E Brown Center

Damper Location

Northwest corridor

Inspector Name

Julie Gue

Damper I.D. #

AHU2.1-S12

Damper Type

Vertical Fire Damper

Damper Size

20x8

Damper Manufacturer

Ruskin

Damper Model #

IBD2

Fusible Link Temperature

165 Degrees

Access Door Size

18x18

Pass / Fail / Abandoned

Pass

Comments / Corrections

None


Exterior Picture of Damper



Interior Picture of Damper



Picture of Damper I.D. Label



VISUAL CUYAHOGA COUNTY DAMPER INSPECTION REPORT

Date of Inspection

2022-08-08

Facility Location

Virgil E Brown Center

Damper Location

Northwest corridor

Inspector Name

Julie Gue

Damper I.D. #

AHU2.1-S13

Damper Type

Vertical Fire Damper

Damper Size

6" Round

Damper Manufacturer

Ruskin

Damper Model #

IBD2

Fusible Link Temperature

212 Degrees

Access Door Size

18x18

Pass / Fail / Abandoned

Pass

Comments / Corrections

None


Exterior Picture of Damper



Interior Picture of Damper



Picture of Damper I.D. Label



Duct Fabricators, Inc.

883 Addison Rd. Cleveland, Ohio
P: 216-391-2400 F: 216-391-2492

FIRE SAFETY DIVISION

NEMI Certified HVAC Fire Life Safety Technicians



VISUAL CUYAHOGA COUNTY DAMPER INSPECTION REPORT

Date of Inspection

2022-08-08

Facility Location

Virgil E Brown Center

Damper Location

Northwest corridor

Inspector Name

Julie Gue

Damper I.D. #

AHU2.1-S14

Damper Type

Vertical Fire Damper

Damper Size

56x16

Damper Manufacturer

Ruskin

Damper Model #

IBD2

Fusible Link Temperature

212 Degrees

Access Door Size

18x18

Pass / Fail / Abandoned

Pass

Comments / Corrections

None


Exterior Picture of Damper



Interior Picture of Damper



Picture of Damper I.D. Label



VISUAL CUYAHOGA COUNTY DAMPER INSPECTION REPORT

Date of Inspection

2022-08-10

Facility Location

Virgil E Brown Center

Damper Location

Northwest comm room

Inspector Name

Julie Gue

Damper I.D. #

AHU2.1-S15

Damper Type

Vertical Fire Damper

Damper Size

8x12

Damper Manufacturer

Ruskin

Damper Model #

IBD2

Fusible Link Temperature

212 Degrees

Access Door Size

Open

Pass / Fail / Abandoned

Pass

Comments / Corrections

None


Exterior Picture of Damper



Interior Picture of Damper



Picture of Damper I.D. Label



VISUAL CUYAHOGA COUNTY DAMPER INSPECTION REPORT

Date of Inspection

2022-08-08

Facility Location

Virgil E Brown Center

Damper Location

Northwest corridor

Inspector Name

Julie Gue

Damper I.D. #

AHU2.1-S16

Damper Type

Vertical Fire Damper

Damper Size

56x16

Damper Manufacturer

Ruskin

Damper Model #

IBD2

Fusible Link Temperature

212 Degrees

Access Door Size

18x18

Pass / Fail / Abandoned

Pass

Comments / Corrections

None

Exterior Picture of Damper



Interior Picture of Damper



Picture of Damper I.D. Label



Duct Fabricators, Inc.

883 Addison Rd. Cleveland, Ohio
P: 216-391-2400 F: 216-391-2492

FIRE SAFETY DIVISION

NEMI Certified HVAC Fire Life Safety Technicians



VISUAL CUYAHOGA COUNTY DAMPER INSPECTION REPORT

Date of Inspection

2022-08-10

Facility Location

Virgil E Brown Center

Damper Location

Mechanical South

Inspector Name

Julie Gue

Damper I.D. #

AHU2.2-OA

Damper Type

Vertical Fire Damper

Damper Size

96x24

Damper Manufacturer

Ruskin

Damper Model #

IBD2

Fusible Link Temperature

212 Degrees

Access Door Size

16x16

Pass / Fail / Abandoned

Pass

Comments / Corrections

None


Exterior Picture of Damper



Interior Picture of Damper



Picture of Damper I.D. Label



Duct Fabricators, Inc.

883 Addison Rd. Cleveland, Ohio
P: 216-391-2400 F: 216-391-2492

FIRE SAFETY DIVISION
NEMI Certified HVAC Fire Life Safety Technicians



VISUAL CUYAHOGA COUNTY DAMPER INSPECTION REPORT

Date of Inspection

2022-08-10

Facility Location

Virgil E Brown Center

Damper Location

Mechanical South

Inspector Name

Julie Gue

Damper I.D.

AHU2.2-RA

Damper Type

Vertical Fire Damper

Damper Size

96x60

Damper Manufacturer

Ruskin

Damper Model

IBD2

Fusible Link Temperature

212 Degrees

Access Door Size

Open duct

Pass / Fail / Abandoned

Pass

Comments / Corrections

None


Exterior Picture of Damper



Interior Picture of Damper



Picture of Damper I.D. Label



VISUAL CUYAHOGA COUNTY DAMPER INSPECTION REPORT

Date of Inspection

2022-08-08

Facility Location

Virgil E Brown Center

Damper Location

By break room

Inspector Name

Julie Gue

Damper I.D. #

AHU2.2-S1

Damper Type

Vertical Fire Damper

Damper Size

38x8

Damper Manufacturer

Ruskin

Damper Model #

IBD2 OW

Fusible Link Temperature

165 Degrees

Access Door Size

12x12


Pass / Fail / Abandoned

Pass

Comments / Corrections

None


Exterior Picture of Damper



Interior Picture of Damper



Picture of Damper I.D. Label



VISUAL CUYAHOGA COUNTY DAMPER INSPECTION REPORT

Date of Inspection

2022-08-08

Facility Location

Virgil E Brown Center

Damper Location

Break room

Inspector Name

Julie Gue

Damper I.D. #

AHU2.2-S2

Damper Type

Vertical Fire Damper

Damper Size

38x8

Damper Manufacturer

Ruskin

Damper Model #

IBD2 OW

Fusible Link Temperature

165 Degrees

Access Door Size

12x12

Pass / Fail / Abandoned

Pass

Comments / Corrections

None


Exterior Picture of Damper



Interior Picture of Damper



Picture of Damper I.D. Label



VISUAL CUYAHOGA COUNTY DAMPER INSPECTION REPORT

Date of Inspection

2022-08-08

Facility Location

Virgil E Brown Center

Damper Location

Southwest corridor

Inspector Name

Julie Gue

Damper I.D. #

AHU2.2-S3

Damper Type

Vertical Fire Damper

Damper Size

56x16

Damper Manufacturer

Ruskin

Damper Model #

IBD2

Fusible Link Temperature

212 Degrees

Access Door Size

18x18

Pass / Fail / Abandoned

Pass

Comments / Corrections

None


Exterior Picture of Damper



Interior Picture of Damper



Picture of Damper I.D. Label



VISUAL CUYAHOGA COUNTY DAMPER INSPECTION REPORT

Date of Inspection

2022-08-08

Facility Location

Virgil E Brown Center

Damper Location

Southwest corridor

Inspector Name

Julie Gue

Damper I.D. #

AHU2.2-S4

Damper Type

Vertical Fire Damper

Damper Size

56x16

Damper Manufacturer

Ruskin

Damper Model #

IBD2

Fusible Link Temperature

165 Degrees

Access Door Size

18x18

Pass / Fail / Abandoned

Pass

Comments / Corrections

None


Exterior Picture of Damper



Interior Picture of Damper



Picture of Damper I.D. Label



VISUAL CUYAHOGA COUNTY DAMPER INSPECTION REPORT

Date of Inspection

2022-08-10

Facility Location

Virgil E Brown Center

Damper Location

Southwest comm room

Inspector Name

Julie Gue

Damper I.D. #

AHU2.2-S5

Damper Type

Vertical Fire Damper

Damper Size

8x12

Damper Manufacturer

Ruskin

Damper Model #

IBD2

Fusible Link Temperature

212 Degrees

Access Door Size

Open duct

Pass / Fail / Abandoned

Pass

Comments / Corrections

None


Exterior Picture of Damper



Interior Picture of Damper



Picture of Damper I.D. Label



VISUAL CUYAHOGA COUNTY DAMPER INSPECTION REPORT

Date of Inspection
2022-08-08

Facility Location
Virgil E Brown Center

Damper Location
Southwest corridor

Inspector Name
Julie Gue

Damper I.D. #
AHU2.2-S6

Damper Type
Vertical Fire Damper

Damper Size
6" Round

Damper Manufacturer
Ruskin

Damper Model #
IBD2

Fusible Link Temperature
212 Degrees

Access Door Size
18x18

Pass / Fail / Abandoned
Pass

Comments / Corrections
None

Exterior Picture of Damper



Interior Picture of Damper



Picture of Damper I.D. Label

FIRE DAMPER
Visual inspection

Inspection Date: 8/8/22	Reference I.D.# AHU22-S6
Inspected By: GUE	
Next Inspect. By: 8/8/24	

Duct Fabricators, Inc.
883 Addison Rd. Cleveland, Ohio
P: 216-391-2400 F: 216-391-2492

FIRE SAFETY DIVISION
NEMI Certified HVAC Fire Life Safety Technicians

MEMBER
NFPA

VISUAL CUYAHOGA COUNTY DAMPER INSPECTION REPORT

Date of Inspection

2022-08-08

Facility Location

Virgil E Brown Center

Damper Location

Southwest corridor

Inspector Name

Julie Gue

Damper I.D. #

AHU2.2-S7

Damper Type

Vertical Fire Damper

Damper Size

16" oval

Damper Manufacturer

Ruskin

Damper Model #

IBD2

Fusible Link Temperature

165 Degrees

Access Door Size

18x18

Pass / Fail / Abandoned

Pass

Comments / Corrections

None


Exterior Picture of Damper



Interior Picture of Damper



Picture of Damper I.D. Label



VISUAL CUYAHOGA COUNTY DAMPER INSPECTION REPORT

Date of Inspection

2022-08-08

Facility Location

Virgil E Brown Center

Damper Location

RM260

Inspector Name

Julie Gue

Damper I.D. #

AHU2.2-S8

Damper Type

Vertical Fire Damper

Damper Size

6" Round

Damper Manufacturer

Ruskin

Damper Model #

IBD2

Fusible Link Temperature

212 Degrees

Access Door Size

18x18

Pass / Fail / Abandoned

Pass

Comments / Corrections

None


Exterior Picture of Damper



Interior Picture of Damper



Picture of Damper I.D. Label



VISUAL CUYAHOGA COUNTY DAMPER INSPECTION REPORT

Date of Inspection

2022-08-08

Facility Location

Virgil E Brown Center

Damper Location

RM260A

Inspector Name

Julie Gue

Damper I.D. #

AHU2.2-S9

Damper Type

Vertical Fire Damper

Damper Size

32x10

Damper Manufacturer

Ruskin

Damper Model #

IBD2

Fusible Link Temperature

212 Degrees

Access Door Size

18x18

Pass / Fail / Abandoned

Pass

Comments / Corrections

None


Exterior Picture of Damper



Interior Picture of Damper



Picture of Damper I.D. Label



VISUAL CUYAHOGA COUNTY DAMPER INSPECTION REPORT

Date of Inspection

2022-08-08

Facility Location

Virgil E Brown Center

Damper Location

Conference room 2C

Inspector Name

Julie Gue

Damper I.D. #

AHU2.2-S10

Damper Type

Vertical Fire Damper

Damper Size

12" Round

Damper Manufacturer

Ruskin

Damper Model #

IBD2

Fusible Link Temperature

165 Degrees

Access Door Size

18x18

Pass / Fail / Abandoned

Pass

Comments / Corrections

None

Exterior Picture of Damper



Interior Picture of Damper



Picture of Damper I.D. Label



VISUAL CUYAHOGA COUNTY DAMPER INSPECTION REPORT

Date of Inspection

2022-08-08

Facility Location

Virgil E Brown Center

Damper Location

Conference room 2B

Inspector Name

Julie Gue

Damper I.D. #

AHU2.2-S11

Damper Type

Vertical Fire Damper

Damper Size

12" oval

Damper Manufacturer

Ruskin

Damper Model #

IBD2

Fusible Link Temperature

212 Degrees

Access Door Size

18x18

Pass / Fail / Abandoned

Pass

Comments / Corrections

None

Exterior Picture of Damper



Interior Picture of Damper



Picture of Damper I.D. Label



VISUAL CUYAHOGA COUNTY DAMPER INSPECTION REPORT

Date of Inspection

2022-08-09

Facility Location

Virgil E Brown Center

Damper Location

Lactation room

Inspector Name

Julie Gue

Damper I.D. #

AHU2.2-S12

Damper Type

Vertical Fire Damper

Damper Size

34x19

Damper Manufacturer

Ruskin

Damper Model #

IBD2

Fusible Link Temperature

165 Degrees

Access Door Size

18x18

Pass / Fail / Abandoned

Pass

Comments / Corrections

None


Exterior Picture of Damper



Interior Picture of Damper



Picture of Damper I.D. Label



VISUAL CUYAHOGA COUNTY DAMPER INSPECTION REPORT

Date of Inspection

2022-08-09

Facility Location

Virgil E Brown Center

Damper Location

Southeast

Inspector Name

Julie Gue

Damper I.D. #

AHU2.2-S13

Damper Type

Vertical Fire Damper

Damper Size

6" Round

Damper Manufacturer

Ruskin

Damper Model #

IBD2

Fusible Link Temperature

165 Degrees

Access Door Size

18x18

Pass / Fail / Abandoned

Pass

Comments / Corrections

None


Exterior Picture of Damper



Interior Picture of Damper



Picture of Damper I.D. Label



VISUAL CUYAHOGA COUNTY DAMPER INSPECTION REPORT

Date of Inspection

2022-08-09

Facility Location

Virgil E Brown Center

Damper Location

Southeast corridor

Inspector Name

Julie Gue

Damper I.D. #

AHU2.2-S14

Damper Type

Vertical Fire Damper

Damper Size

6" Round

Damper Manufacturer

Ruskin

Damper Model #

IBD2

Fusible Link Temperature

165 Degrees

Access Door Size

18x18

Pass / Fail / Abandoned

Pass

Comments / Corrections

None


Exterior Picture of Damper



Interior Picture of Damper



Picture of Damper I.D. Label



VISUAL CUYAHOGA COUNTY DAMPER INSPECTION REPORT

Date of Inspection

2022-08-09

Facility Location

Virgil E Brown Center

Damper Location

Southeast corridor

Inspector Name

Julie Gue

Damper I.D. #

AHU2.2-S15

Damper Type

Vertical Fire Damper

Damper Size

56x16

Damper Manufacturer

Ruskin

Damper Model #

IBD2

Fusible Link Temperature

212 Degrees

Access Door Size

18x18

Pass / Fail / Abandoned

Pass

Comments / Corrections

None


Exterior Picture of Damper



Interior Picture of Damper



Picture of Damper I.D. Label



VISUAL CUYAHOGA COUNTY DAMPER INSPECTION REPORT

Date of Inspection

2022-08-10

Facility Location

Virgil E Brown Center

Damper Location

Southeast com room

Inspector Name

Julie Gue

Damper I.D. #

AHU2.2-S16

Damper Type

Vertical Fire Damper

Damper Size

8x12

Damper Manufacturer

Ruskin

Damper Model #

IBD2

Fusible Link Temperature

212 Degrees

Access Door Size

Open access

Pass / Fail / Abandoned

Pass

Comments / Corrections

None


Exterior Picture of Damper



Interior Picture of Damper



Picture of Damper I.D. Label



VISUAL CUYAHOGA COUNTY DAMPER INSPECTION REPORT

Date of Inspection

2022-08-09

Facility Location

Virgil E Brown Center

Damper Location

Southeast corridor

Inspector Name

Julie Gue

Damper I.D. #

AHU2.2-S17

Damper Type

Vertical Fire Damper

Damper Size

56x16

Damper Manufacturer

Ruskin

Damper Model #

IBD2

Fusible Link Temperature

212 Degrees

Access Door Size

18x18

Pass / Fail / Abandoned

Pass

Comments / Corrections

None


Exterior Picture of Damper



Interior Picture of Damper



Picture of Damper I.D. Label



VISUAL CUYAHOGA COUNTY DAMPER INSPECTION REPORT

Date of Inspection

2022-08-09

Facility Location

Virgil E Brown Center

Damper Location

Lobby 240

Inspector Name

Julie Gue

Damper I.D. #

AHU2.2-S18

Damper Type

Vertical Fire Damper

Damper Size

18x10

Damper Manufacturer

Ruskin

Damper Model #

IBD2

Fusible Link Temperature

212 Degrees

Access Door Size

2x12

Pass / Fail / Abandoned

Pass

Comments / Corrections

None


Exterior Picture of Damper



Interior Picture of Damper



Picture of Damper I.D. Label



VISUAL CUYAHOGA COUNTY DAMPER INSPECTION REPORT

Date of Inspection

2022-08-04

Facility Location

Virgil E Brown Center

Damper Location

3rd floor mechanical room north

Inspector Name

Dan Tulcewicz

Damper I.D. #

AHU3.1- 0A

Damper Type

Vertical Fire Damper

Damper Size

96x24

Damper Manufacturer

Ruskin

Damper Model #

IBD2

Fusible Link Temperature

212 Degrees

Access Door Size

16x16

Pass / Fail / Abandoned

Pass

Comments / Corrections

None


Exterior Picture of Damper



Interior Picture of Damper



Picture of Damper I.D. Label



VISUAL CUYAHOGA COUNTY DAMPER INSPECTION REPORT

Date of Inspection

2022-08-05

Facility Location

Virgil E Brown Center

Damper Location

3rd floor north

Inspector Name

Dan Tulcewicz

Damper I.D. #

AHU3.1-S1

Damper Type

Vertical Fire Damper

Damper Size

56x16

Damper Manufacturer

Ruskin

Damper Model #

IBD2

Fusible Link Temperature

212 Degrees

Access Door Size

18x18

Pass / Fail / Abandoned

Pass

Comments / Corrections

None


Exterior Picture of Damper



Interior Picture of Damper



Picture of Damper I.D. Label



VISUAL CUYAHOGA COUNTY DAMPER INSPECTION REPORT

Date of Inspection

2022-08-05

Facility Location

Virgil E Brown Center

Damper Location

3rd floor north

Inspector Name

Dan Tulcewicz

Damper I.D. #

AHU3.1-S2

Damper Type

Vertical Fire Damper

Damper Size

56x16

Damper Manufacturer

Ruskin

Damper Model #

IBD2

Fusible Link Temperature

212 Degrees

Access Door Size

18x18

Pass / Fail / Abandoned

Pass

Comments / Corrections

None


Exterior Picture of Damper



Interior Picture of Damper



Picture of Damper I.D. Label



VISUAL CUYAHOGA COUNTY DAMPER INSPECTION REPORT

Date of Inspection

2022-08-03

Facility Location

Virgil E Brown Center

Damper Location

North telephone room

Inspector Name

Dan Tulcewicz

Damper I.D. #

AHU3.1-S3

Damper Type

Vertical Fire Damper

Damper Size

12x8

Damper Manufacturer

Ruskin

Damper Model #

IBD2

Fusible Link Temperature

212 Degrees

Access Door Size

Open

Pass / Fail / Abandoned

Pass

Comments / Corrections

None

Exterior Picture of Damper



Interior Picture of Damper



Picture of Damper I.D. Label



VISUAL CUYAHOGA COUNTY DAMPER INSPECTION REPORT

Date of Inspection
2022-08-09

Facility Location
Virgil E Brown Center

Damper Location
Northeast corridor

Inspector Name
Julie Gue

Damper I.D. #
AHU3.1-S4

Damper Type
Vertical Fire Damper

Damper Size
8" Round

Damper Manufacturer
Ruskin

Damper Model #
IBD2

Fusible Link Temperature
165 Degrees

Access Door Size
14x14

Pass / Fail / Abandoned
Pass

Comments / Corrections
None


Exterior Picture of Damper



Interior Picture of Damper



Picture of Damper I.D. Label



VISUAL CUYAHOGA COUNTY DAMPER INSPECTION REPORT

Date of Inspection

2022-08-05

Facility Location

Virgil E Brown Center

Damper Location

3rd floor north

Inspector Name

Dan Tulcewicz

Damper I.D. #

AHU3.1-S5

Damper Type

Vertical Fire Damper

Damper Size

40x12

Damper Manufacturer

Ruskin

Damper Model #

IBD2

Fusible Link Temperature

212 Degrees

Access Door Size

18x18

Pass / Fail / Abandoned

Pass

Comments / Corrections

None

Exterior Picture of Damper



Interior Picture of Damper



Picture of Damper I.D. Label



Duct Fabricators, Inc.

883 Addison Rd. Cleveland, Ohio
P: 216-391-2400 F: 216-391-2492

FIRE SAFETY DIVISION
NEMI Certified HVAC Fire Life Safety Technicians



VISUAL CUYAHOGA COUNTY DAMPER INSPECTION REPORT

Date of Inspection

2022-08-05

Facility Location

Virgil E Brown Center

Damper Location

3rd floor north

Inspector Name

Dan Tulcewicz

Damper I.D.

AHU3.1-S6

Damper Type

Vertical Fire Damper

Damper Size

56x16

Damper Manufacturer

Ruskin

Damper Model

IBD2

Fusible Link Temperature

212 Degrees

Access Door Size

18x18

Pass / Fail / Abandoned

Pass

Comments / Corrections

None

Exterior Picture of Damper



Interior Picture of Damper



Picture of Damper I.D. Label



Duct Fabricators, Inc.

883 Addison Rd. Cleveland, Ohio
P: 216-391-2400 F: 216-391-2492



VISUAL CUYAHOGA COUNTY DAMPER INSPECTION REPORT

Date of Inspection

2022-08-05

Facility Location

Virgil E Brown Center

Damper Location

3rd floor north

Inspector Name

Dan Tulcewicz

Damper I.D. #

AHU3.1-S7

Damper Type

Vertical Fire Damper

Damper Size

56x16

Damper Manufacturer

Ruskin

Damper Model #

IBD2

Fusible Link Temperature

212 Degrees

Access Door Size

18x18

Pass / Fail / Abandoned

Pass

Comments / Corrections

None


Exterior Picture of Damper



Interior Picture of Damper



Picture of Damper I.D. Label



VISUAL CUYAHOGA COUNTY DAMPER INSPECTION REPORT

Date of Inspection

2022-08-05

Facility Location

Virgil E Brown Center

Damper Location

3rd floor north

Inspector Name

Dan Tulcewicz

Damper I.D. #

AHU3.1-S8

Damper Type

Vertical Fire Damper

Damper Size

20x10

Damper Manufacturer

Ruskin

Damper Model #

IBD2

Fusible Link Temperature

212 Degrees

Access Door Size

18x18

Pass / Fail / Abandoned

Pass

Comments / Corrections

None

Exterior Picture of Damper



Interior Picture of Damper



Picture of Damper I.D. Label



VISUAL CUYAHOGA COUNTY DAMPER INSPECTION REPORT

Date of Inspection

2022-08-05

Facility Location

Virgil E Brown Center

Damper Location

3rd floor north

Inspector Name

Dan Tulcewicz

Damper I.D. #

AHU3.1-S9

Damper Type

Vertical Fire Damper

Damper Size

16"Oval

Damper Manufacturer

Ruskin

Damper Model #

IBD2

Fusible Link Temperature

212 Degrees

Access Door Size

18x18

Pass / Fail / Abandoned

Pass

Comments / Corrections

None

Exterior Picture of Damper



Interior Picture of Damper



Picture of Damper I.D. Label



VISUAL CUYAHOGA COUNTY DAMPER INSPECTION REPORT

Date of Inspection

2022-08-05

Facility Location

Virgil E Brown Center

Damper Location

3rd floor north

Inspector Name

Dan Tulcewicz

Damper I.D. #

AHU3.1-S10

Damper Type

Vertical Fire Damper

Damper Size

6" Round

Damper Manufacturer

Ruskin

Damper Model #

IBD2

Fusible Link Temperature

212 Degrees

Access Door Size

18x18

Pass / Fail / Abandoned

Pass

Comments / Corrections

None


Exterior Picture of Damper



Interior Picture of Damper



Picture of Damper I.D. Label



VISUAL CUYAHOGA COUNTY DAMPER INSPECTION REPORT

Date of Inspection

2022-08-05

Facility Location

Virgil E Brown Center

Damper Location

3rd floor north

Inspector Name

Dan Tulcewicz

Damper I.D. #

AHU3.1-S11

Damper Type

Vertical Fire Damper

Damper Size

56x16

Damper Manufacturer

Ruskin

Damper Model #

IBD2

Fusible Link Temperature

212 Degrees

Access Door Size

18x18

Pass / Fail / Abandoned

Pass

Comments / Corrections

None


Exterior Picture of Damper



Interior Picture of Damper



Picture of Damper I.D. Label



VISUAL CUYAHOGA COUNTY DAMPER INSPECTION REPORT

Date of Inspection

2022-08-03

Facility Location

Virgil E Brown Center

Damper Location

3rd floor north telephone room

Inspector Name

Dan Tulcewicz

Damper I.D. #

AHU3.1-S12

Damper Type

Vertical Fire Damper

Damper Size

8x12

Damper Manufacturer

Ruskin

Damper Model #

IBD2

Fusible Link Temperature

212 Degrees

Access Door Size

Open

Pass / Fail / Abandoned

Pass

Comments / Corrections

None

Exterior Picture of Damper



Interior Picture of Damper



Picture of Damper I.D. Label



VISUAL CUYAHOGA COUNTY DAMPER INSPECTION REPORT

Date of Inspection

2022-08-05

Facility Location

Virgil E Brown Center

Damper Location

3rd floor north

Inspector Name

Dan Tulcewicz

Damper I.D. #

AHU3.1-S13

Damper Type

Vertical Fire Damper

Damper Size

56x16

Damper Manufacturer

Ruskin

Damper Model #

IBD2

Fusible Link Temperature

212 Degrees

Access Door Size

18x18

Pass / Fail / Abandoned

Pass

Comments / Corrections

None


Exterior Picture of Damper



Interior Picture of Damper



Picture of Damper I.D. Label



VISUAL CUYAHOGA COUNTY DAMPER INSPECTION REPORT

Date of Inspection

2022-08-09

Facility Location

Virgil E Brown Center

Damper Location

Southeast corridor

Inspector Name

Julie Gue

Damper I.D. #

AHU3.1-S14

Damper Type

Vertical Fire Damper

Damper Size

14" oval

Damper Manufacturer

Ruskin

Damper Model #

IBD2

Fusible Link Temperature

165 Degrees

Access Door Size

8x8

Pass / Fail / Abandoned

Pass

Comments / Corrections

None

Exterior Picture of Damper



Interior Picture of Damper



Picture of Damper I.D. Label



VISUAL CUYAHOGA COUNTY DAMPER INSPECTION REPORT

Date of Inspection

2022-08-09

Facility Location

Virgil E Brown Center

Damper Location

AHU3.2 South

Inspector Name

Dan Tulcewicz

Damper I.D. #

AHU3.2-14

Damper Type

Vertical Fire Damper

Damper Size

56x16

Damper Manufacturer

Ruskin

Damper Model #

IBD2

Fusible Link Temperature

212 Degrees

Access Door Size

18x18

Pass / Fail / Abandoned

Pass

Comments / Corrections

None


Exterior Picture of Damper



Interior Picture of Damper



Picture of Damper I.D. Label



Duct Fabricators, Inc.

883 Addison Rd. Cleveland, Ohio
P: 216-391-2400 F: 216-391-2492



NEMI Certified HVAC Fire Life Safety Technicians



VISUAL CUYAHOGA COUNTY DAMPER INSPECTION REPORT

Date of Inspection

2022-08-04

Facility Location

Virgil E Brown Center

Damper Location

3rd floor mechanical room South

Inspector Name

Dan Tulcewicz

Damper I.D.

AHU3.2-OA

Damper Type

Vertical Fire Damper

Damper Size

96x24

Damper Manufacturer

Ruskin

Damper Model

IBD2

Fusible Link Temperature

212 Degrees

Access Door Size

16x16

Pass / Fail / Abandoned

Pass

Comments / Corrections

None

Exterior Picture of Damper



Interior Picture of Damper



Picture of Damper I.D. Label

Visual Insp

**FIRE
DAMPER**

Inspection Date: 8-4-2022 Reference I.D. #:
Inspected By: Tulcewicz AHU3.2-OA
Next Inspect. By: 8-4-2024

Duct Fabricators, Inc. 883 Addison Rd. Cleveland, Ohio P: 216-391-2400 F: 216-391-2492

FIRE SAFETY DIVISION NEMI Certified HVAC Fire Life Safety Technicians

MEMBER NFPA

Duct Fabricators, Inc.

883 Addison Rd. Cleveland, Ohio
P: 216-391-2400 F: 216-391-2492



NEMI Certified HVAC Fire Life Safety Technicians



VISUAL CUYAHOGA COUNTY DAMPER INSPECTION REPORT

Date of Inspection

2022-08-04

Facility Location

Virgil E Brown Center

Damper Location

3rd floor mechanical room north

Inspector Name

Dan Tulcewicz

Damper I.D.

AHU3.2-RA

Damper Type

Vertical Fire Damper

Damper Size

96x60

Damper Manufacturer

Ruskin

Damper Model

IBD2

Fusible Link Temperature

212 Degrees

Access Door Size

Open

Pass / Fail / Abandoned

Pass

Comments / Corrections

None

Exterior Picture of Damper



Interior Picture of Damper



Picture of Damper I.D. Label



VISUAL CUYAHOGA COUNTY DAMPER INSPECTION REPORT

Date of Inspection

2022-08-09

Facility Location

Virgil E Brown Center

Damper Location

RM 390

Inspector Name

Julie Gue

Damper I.D. #

AHU3.2-S1

Damper Type

Vertical Fire Damper

Damper Size

36x8

Damper Manufacturer

Ruskin

Damper Model #

IBD20W

Fusible Link Temperature

212 Degrees

Access Door Size

12x12

Pass / Fail / Abandoned

Pass

Comments / Corrections

None


Exterior Picture of Damper



Interior Picture of Damper



Picture of Damper I.D. Label



VISUAL CUYAHOGA COUNTY DAMPER INSPECTION REPORT

Date of Inspection

2022-08-09

Facility Location

Virgil E Brown Center

Damper Location

RM390

Inspector Name

Julie Gue

Damper I.D. #

AHU3.2-S2

Damper Type

Vertical Fire Damper

Damper Size

36x8

Damper Manufacturer

Ruskin

Damper Model #

IBD2 OW

Fusible Link Temperature

212 Degrees

Access Door Size

12x12

Pass / Fail / Abandoned

Pass

Comments / Corrections

None


Exterior Picture of Damper



Interior Picture of Damper



Picture of Damper I.D. Label



VISUAL CUYAHOGA COUNTY DAMPER INSPECTION REPORT

Date of Inspection

2022-08-05

Facility Location

Virgil E Brown Center

Damper Location

3rd floor South

Inspector Name

Dan Tulcewicz

Damper I.D. #

AHU3.2-S3

Damper Type

Vertical Fire Damper

Damper Size

56x16

Damper Manufacturer

Ruskin

Damper Model #

IBD2

Fusible Link Temperature

212 Degrees

Access Door Size

18x18

Pass / Fail / Abandoned

Pass

Comments / Corrections

None

Exterior Picture of Damper



Interior Picture of Damper



Picture of Damper I.D. Label



VISUAL CUYAHOGA COUNTY DAMPER INSPECTION REPORT

Date of Inspection

2022-08-05

Facility Location

Virgil E Brown Center

Damper Location

3rd floor South

Inspector Name

Dan Tulcewicz

Damper I.D. #

AHU3.2-S4

Damper Type

Vertical Fire Damper

Damper Size

56x16

Damper Manufacturer

Ruskin

Damper Model #

IBD2

Fusible Link Temperature

212 Degrees

Access Door Size

18x18

Pass / Fail / Abandoned

Pass

Comments / Corrections

None

Exterior Picture of Damper



Interior Picture of Damper



Picture of Damper I.D. Label



VISUAL CUYAHOGA COUNTY DAMPER INSPECTION REPORT

Date of Inspection

2022-08-03

Facility Location

Virgil E Brown Center

Damper Location

South Telephone Room

Inspector Name

Dan Tulcewicz

Damper I.D. #

AHU3.2-S5

Damper Type

Vertical Fire Damper

Damper Size

8x12

Damper Manufacturer

Ruskin

Damper Model #

IBD2

Fusible Link Temperature

212 Degrees

Access Door Size

Open

Pass / Fail / Abandoned

Pass

Comments / Corrections

None

Exterior Picture of Damper



Interior Picture of Damper



Picture of Damper I.D. Label



VISUAL CUYAHOGA COUNTY DAMPER INSPECTION REPORT

Date of Inspection

2022-08-05

Facility Location

Virgil E Brown Center

Damper Location

3rd floor South

Inspector Name

Dan Tulcewicz

Damper I.D. #

AHU3.2-S6

Damper Type

Vertical Fire Damper

Damper Size

14x8 Oval

Damper Manufacturer

Ruskin

Damper Model #

IBD2

Fusible Link Temperature

212 Degrees

Access Door Size

18x18

Pass / Fail / Abandoned

Pass


Comments / Corrections

None


Exterior Picture of Damper



Interior Picture of Damper



Picture of Damper I.D. Label



VISUAL CUYAHOGA COUNTY DAMPER INSPECTION REPORT

Date of Inspection

2022-08-05

Facility Location

Virgil E Brown Center

Damper Location

3rd floor South

Inspector Name

Dan Tulcewicz

Damper I.D. #

AHU3.2-S7

Damper Type

Vertical Fire Damper

Damper Size

6" Round

Damper Manufacturer

Ruskin

Damper Model #

IBD2

Fusible Link Temperature

212 Degrees

Access Door Size

18x18

Pass / Fail / Abandoned

Pass

Comments / Corrections

None


Exterior Picture of Damper



Interior Picture of Damper



Picture of Damper I.D. Label



VISUAL CUYAHOGA COUNTY DAMPER INSPECTION REPORT

Date of Inspection

2022-08-05

Facility Location

Virgil E Brown Center

Damper Location

3rd floor South

Inspector Name

Dan Tulcewicz

Damper I.D. #

AHU3.2-S8

Damper Type

Vertical Fire Damper

Damper Size

56x18

Damper Manufacturer

Ruskin

Damper Model #

IBD2

Fusible Link Temperature

212 Degrees

Access Door Size

18x18

Pass / Fail / Abandoned

Pass

Comments / Corrections

None


Exterior Picture of Damper



Interior Picture of Damper



Picture of Damper I.D. Label



VISUAL CUYAHOGA COUNTY DAMPER INSPECTION REPORT

Date of Inspection

2022-08-05

Facility Location

Virgil E Brown Center

Damper Location

3rd floor South

Inspector Name

Dan Tulcewicz

Damper I.D. #

AHU3.2-S9

Damper Type

Vertical Fire Damper

Damper Size

56x16

Damper Manufacturer

Ruskin

Damper Model #

IBD2

Fusible Link Temperature

212 Degrees

Access Door Size

18x18

Pass / Fail / Abandoned

Pass

Comments / Corrections

None

Exterior Picture of Damper



Interior Picture of Damper



Picture of Damper I.D. Label



VISUAL CUYAHOGA COUNTY DAMPER INSPECTION REPORT

Date of Inspection

2022-08-05

Facility Location

Virgil E Brown Center

Damper Location

3rd floor South

Inspector Name

Dan Tulcewicz

Damper I.D. #

AHU3.2-S10

Damper Type

Vertical Fire Damper

Damper Size

20x8 Oval

Damper Manufacturer

Ruskin

Damper Model #

IBD2

Fusible Link Temperature

212 Degrees

Access Door Size

18x18

Pass / Fail / Abandoned

Pass

Comments / Corrections

None


Exterior Picture of Damper



Interior Picture of Damper



Picture of Damper I.D. Label



VISUAL CUYAHOGA COUNTY DAMPER INSPECTION REPORT

Date of Inspection

2022-08-05

Facility Location

Virgil E Brown Center

Damper Location

3rd floor South

Inspector Name

Dan Tulcewicz

Damper I.D. #

AHU3.2-S11

Damper Type

Vertical Fire Damper

Damper Size

6" Round

Damper Manufacturer

Ruskin

Damper Model #

IBD2

Fusible Link Temperature

212 Degrees

Access Door Size

18x18

Pass / Fail / Abandoned

Pass

Comments / Corrections

None

Exterior Picture of Damper



Interior Picture of Damper



Picture of Damper I.D. Label

Visual Insp. **FIRE DAMPER**

Inspection Date: <u>8-5-2022</u>	Reference I.D.#:
Inspected By: <u>TULCEWICZ</u>	<u>AHU3.2-S11</u>
Next Inspect. By: <u>8-5-2024</u>	

Duct Fabricators, Inc.
883 Addison Rd. Cleveland, Ohio
P: 216-391-2400 F: 216-391-2492

FIRE SAFETY DIVISION
NEMI Certified HVAC Fire Life Safety Technicians

MEMBER
NFPA

VISUAL CUYAHOGA COUNTY DAMPER INSPECTION REPORT

Date of Inspection

2022-08-05

Facility Location

Virgil E Brown Center

Damper Location

3rd floor South

Inspector Name

Dan Tulcewicz

Damper I.D. #

AHU3.2-S12

Damper Type

Vertical Fire Damper

Damper Size

56x16

Damper Manufacturer

Ruskin

Damper Model #

IBD2

Fusible Link Temperature

212 Degrees

Access Door Size

18x18

Pass / Fail / Abandoned

Pass

Comments / Corrections

None

Exterior Picture of Damper



Interior Picture of Damper



Picture of Damper I.D. Label



VISUAL CUYAHOGA COUNTY DAMPER INSPECTION REPORT

Date of Inspection

2022-08-03

Facility Location

Virgil E Brown Center

Damper Location

3rd floor South Telephone Room

Inspector Name

Dan Tulcewicz

Damper I.D. #

AHU3.2-S13

Damper Type

Vertical Fire Damper

Damper Size

8x12

Damper Manufacturer

Ruskin

Damper Model #

IBD2

Fusible Link Temperature

212 Degrees

Access Door Size

Open

Pass / Fail / Abandoned

Pass

Comments / Corrections

None


Exterior Picture of Damper



Interior Picture of Damper



Picture of Damper I.D. Label



VISUAL CUYAHOGA COUNTY DAMPER INSPECTION REPORT

Date of Inspection

2022-08-09

Facility Location

Virgil E Brown Center

Damper Location

RM 350

Inspector Name

Dan Tulcewicz

Damper I.D. #

AHU3.2-S15

Damper Type

Vertical Fire Damper

Damper Size

14" oval

Damper Manufacturer

Ruskin

Damper Model #

IBD2

Fusible Link Temperature

212 Degrees

Access Door Size

Flex

Pass / Fail / Abandoned

Pass

Comments / Corrections

None

Exterior Picture of Damper



Interior Picture of Damper



Picture of Damper I.D. Label



VISUAL CUYAHOGA COUNTY DAMPER INSPECTION REPORT

Date of Inspection

2022-08-05

Facility Location

Virgil E Brown Center

Damper Location

3rd floor South

Inspector Name

Dan Tulcewicz

Damper I.D. #

AHU3.2-S16

Damper Type

Vertical Fire Damper

Damper Size

14" Oval

Damper Manufacturer

Ruskin

Damper Model #

IBD2

Fusible Link Temperature

212 Degrees

Access Door Size

10x10

Pass / Fail / Abandoned

Pass

Comments / Corrections

None

Exterior Picture of Damper



Interior Picture of Damper



Picture of Damper I.D. Label



Duct Fabricators, Inc.

883 Addison Rd. Cleveland, Ohio
P: 216-391-2400 F: 216-391-2492



VISUAL CUYAHOGA COUNTY DAMPER INSPECTION REPORT

Date of Inspection

2022-07-26

Facility Location

Virgil E Brown Center

Damper Location

4th floor mechanical room north

Inspector Name

Dan Tulcewicz

Damper I.D. #

AHU4.1-OA

Damper Type

Vertical Fire Damper

Damper Size

96x24

Damper Manufacturer

Ruskin

Damper Model #

IBD2

Fusible Link Temperature

212 Degrees

Access Door Size

16x16

Pass / Fail / Abandoned

Pass

Comments / Corrections

None


Exterior Picture of Damper



Interior Picture of Damper



Picture of Damper I.D. Label



Duct Fabricators, Inc.

883 Addison Rd. Cleveland, Ohio
P: 216-391-2400 F: 216-391-2492



VISUAL CUYAHOGA COUNTY DAMPER INSPECTION REPORT

Date of Inspection

2022-07-26

Facility Location

Virgil E Brown Center

Damper Location

4th floor mechanical room north

Inspector Name

Dan Tulcewicz

Damper I.D.

AHU4.1-RA

Damper Type

Vertical Fire Damper

Damper Size

96x60

Damper Manufacturer

Ruskin

Damper Model

IBD2

Fusible Link Temperature

212 Degrees

Access Door Size

Open

Pass / Fail / Abandoned

Pass

Comments / Corrections

None


Exterior Picture of Damper



Interior Picture of Damper



Picture of Damper I.D. Label



VISUAL CUYAHOGA COUNTY DAMPER INSPECTION REPORT

Date of Inspection

2022-08-03

Facility Location

Virgil E Brown Center

Damper Location

4th floor north

Inspector Name

Dan Tulcewicz

Damper I.D. #

AHU4.1-S1

Damper Type

Vertical Fire Damper

Damper Size

56x16

Damper Manufacturer

Ruskin

Damper Model #

IBC2

Fusible Link Temperature

212 Degrees

Access Door Size

18x18

Pass / Fail / Abandoned

Pass

Comments / Corrections

None


Exterior Picture of Damper



Interior Picture of Damper



Picture of Damper I.D. Label



VISUAL CUYAHOGA COUNTY DAMPER INSPECTION REPORT

Date of Inspection

2022-08-03

Facility Location

Virgil E Brown Center

Damper Location

4th floor north

Inspector Name

Dan Tulcewicz

Damper I.D. #

AHU4.1-S2

Damper Type

Vertical Fire Damper

Damper Size

56x16

Damper Manufacturer

Ruskin

Damper Model #

IBD2

Fusible Link Temperature

212 Degrees

Access Door Size

18x18

Pass / Fail / Abandoned

Pass

Comments / Corrections

None


Exterior Picture of Damper



Interior Picture of Damper



Picture of Damper I.D. Label



Duct Fabricators, Inc.

883 Addison Rd. Cleveland, Ohio
P: 216-391-2400 F: 216-391-2492

FIRE SAFETY DIVISION

NEMI Certified HVAC Fire Life Safety Technicians



VISUAL CUYAHOGA COUNTY DAMPER INSPECTION REPORT

Date of Inspection

2022-08-02

Facility Location

Virgil E Brown Center

Damper Location

4th floor north telephone room

Inspector Name

Dan Tulcewicz

Damper I.D.

AHU4.1-S3

Damper Type

Vertical Fire Damper

Damper Size

8x12

Damper Manufacturer

Ruskin

Damper Model

IBD2

Fusible Link Temperature

212 Degrees

Access Door Size

Open

Pass / Fail / Abandoned

Pass

Comments / Corrections

None


Exterior Picture of Damper



Interior Picture of Damper



Picture of Damper I.D. Label



VISUAL CUYAHOGA COUNTY DAMPER INSPECTION REPORT

Date of Inspection

2022-08-03

Facility Location

Virgil E Brown Center

Damper Location

4th floor north

Inspector Name

Dan Tulcewicz

Damper I.D. #

AHU4.1-S4

Damper Type

Vertical Fire Damper

Damper Size

5" Round

Damper Manufacturer

Ruskin

Damper Model #

IBD2

Fusible Link Temperature

212 Degrees

Access Door Size

18x18

Pass / Fail / Abandoned

Pass

Comments / Corrections

None

Exterior Picture of Damper



Interior Picture of Damper



Picture of Damper I.D. Label

Visual Insp. **FIRE DAMPER**

Inspection Date: 8-3-2022	Reference I.D.#: AHU4.1-S4
Inspected By: TULCEWICZ	
Next Inspect. By: 8-3-2024	

Duct Fabricators, Inc. 883 Addison Rd. Cleveland, Ohio P: 216-391-2400 F: 216-391-2492 **FIRE SAFETY DIVISION** NEMI Certified HVAC Fire Life Safety Technicians **NFPA**

VISUAL CUYAHOGA COUNTY DAMPER INSPECTION REPORT

Date of Inspection

2022-08-03

Facility Location

Virgil E Brown Center

Damper Location

4th floor north

Inspector Name

Dan Tulcewicz

Damper I.D. #

AHU4.1-S5

Damper Type

Vertical Fire Damper

Damper Size

16"Oval

Damper Manufacturer

Ruskin

Damper Model #

IBD2

Fusible Link Temperature

212 Degrees

Access Door Size

18x18

Pass / Fail / Abandoned

Pass

Comments / Corrections

None

Exterior Picture of Damper



Interior Picture of Damper



Picture of Damper I.D. Label



VISUAL CUYAHOGA COUNTY DAMPER INSPECTION REPORT

Date of Inspection

2022-08-03

Facility Location

Virgil E Brown Center

Damper Location

4th floor north

Inspector Name

Dan Tulcewicz

Damper I.D. #

AHU4.1-S6

Damper Type

Vertical Fire Damper

Damper Size

56x16

Damper Manufacturer

Ruskin

Damper Model #

IBD2

Fusible Link Temperature

212 Degrees

Access Door Size

18x18

Pass / Fail / Abandoned

Pass

Comments / Corrections

None

Exterior Picture of Damper



Interior Picture of Damper



Picture of Damper I.D. Label



VISUAL CUYAHOGA COUNTY DAMPER INSPECTION REPORT

Date of Inspection

2022-08-03

Facility Location

Virgil E Brown Center

Damper Location

4th floor north

Inspector Name

Dan Tulcewicz

Damper I.D. #

AHU4.1-S7

Damper Type

Vertical Fire Damper

Damper Size

56x16

Damper Manufacturer

Ruskin

Damper Model #

IBD2

Fusible Link Temperature

212 Degrees

Access Door Size

18x18

Pass / Fail / Abandoned

Pass

Comments / Corrections

None


Exterior Picture of Damper



Interior Picture of Damper



Picture of Damper I.D. Label



Duct Fabricators, Inc.

883 Addison Rd. Cleveland, Ohio
P: 216-391-2400 F: 216-391-2492

FIRE SAFETY DIVISION

NEMI Certified HVAC Fire Life Safety Technicians



VISUAL CUYAHOGA COUNTY DAMPER INSPECTION REPORT

Date of Inspection

2022-08-03

Facility Location

Virgil E Brown Center

Damper Location

4th floor north

Inspector Name

Dan Tulcewicz

Damper I.D. #

AHU4.1-S8

Damper Type

Vertical Fire Damper

Damper Size

11"x8"Oval

Damper Manufacturer

Ruskin

Damper Model #

IBD2

Fusible Link Temperature

212 Degrees

Access Door Size

18x18

Pass / Fail / Abandoned

Pass

Comments / Corrections

None

Exterior Picture of Damper



Interior Picture of Damper



Picture of Damper I.D. Label

VISUAL Insp. **FIRE DAMPER**

Inspection Date: 8-3-2022	Reference I.D. #:
Inspected By: Tulcewicz	AHU4.1-S8
Next Inspect. By: 8-3-2024	

Duct Fabricators, Inc.
883 Addison Rd. Cleveland, Ohio
P: 216-391-2400 F: 216-391-2492

FIRE SAFETY DIVISION
NEMI Certified HVAC Fire Life Safety Technicians

MEMBER
NFPA

VISUAL CUYAHOGA COUNTY DAMPER INSPECTION REPORT

Date of Inspection

2022-08-03

Facility Location

Virgil E Brown Center

Damper Location

4th floor north

Inspector Name

Dan Tulcewicz

Damper I.D. #

AHU4.1-S9

Damper Type

Vertical Fire Damper

Damper Size

16" Oval

Damper Manufacturer

Ruskin

Damper Model #

IBD2

Fusible Link Temperature

212 Degrees

Access Door Size

18x18

Pass / Fail / Abandoned

Pass

Comments / Corrections

None

Exterior Picture of Damper



Interior Picture of Damper



Picture of Damper I.D. Label

Visual Insp **FIRE DAMPER**

Inspection Date: 8-3-2022	Reference I.D.#:
Inspected By: Tulcewicz	AHU4.1-S9
Next Inspect. By: 8-3-2024	

Duct Fabricators, Inc.
883 Addison Rd. Cleveland, Ohio
P: 216-391-2400 F: 216-391-2492

FIRE SAFETY DIVISION
NEMI Certified HVAC Fire Life Safety Technicians

MEMBER
NFPA

VISUAL CUYAHOGA COUNTY DAMPER INSPECTION REPORT

Date of Inspection

2022-08-03

Facility Location

Virgil E Brown Center

Damper Location

4th floor north

Inspector Name

Dan Tulcewicz

Damper I.D. #

AHU4.1-S10

Damper Type

Vertical Fire Damper

Damper Size

56x16

Damper Manufacturer

Ruskin

Damper Model #

IBD2

Fusible Link Temperature

212 Degrees

Access Door Size

18x18

Pass / Fail / Abandoned

Pass

Comments / Corrections

None


Exterior Picture of Damper



Interior Picture of Damper



Picture of Damper I.D. Label



Duct Fabricators, Inc.

883 Addison Rd. Cleveland, Ohio
P: 216-391-2400 F: 216-391-2492

FIRE SAFETY DIVISION

NEMI Certified HVAC Fire Life Safety Technicians



VISUAL CUYAHOGA COUNTY DAMPER INSPECTION REPORT

Date of Inspection

2022-08-02

Facility Location

Virgil E Brown Center

Damper Location

4th floor north telephone room

Inspector Name

Dan Tulcewicz

Damper I.D. #

AHU4.1-S11

Damper Type

Vertical Fire Damper

Damper Size

8x12

Damper Manufacturer

Ruskin

Damper Model #

IBD2

Fusible Link Temperature

212 Degrees

Access Door Size

Open

Pass / Fail / Abandoned

Pass

Comments / Corrections

None


Exterior Picture of Damper



Interior Picture of Damper



Picture of Damper I.D. Label



VISUAL CUYAHOGA COUNTY DAMPER INSPECTION REPORT

Date of Inspection

2022-08-03

Facility Location

Virgil E Brown Center

Damper Location

4th floor north

Inspector Name

Dan Tulcewicz

Damper I.D. #

AHU4.1-S12

Damper Type

Vertical Fire Damper

Damper Size

56x16

Damper Manufacturer

Ruskin

Damper Model #

IBD2

Fusible Link Temperature

212 Degrees

Access Door Size

18x18

Pass / Fail / Abandoned

Pass

Comments / Corrections

None

Exterior Picture of Damper



Interior Picture of Damper



Picture of Damper I.D. Label



VISUAL CUYAHOGA COUNTY DAMPER INSPECTION REPORT

Date of Inspection

2022-07-26

Facility Location

Virgil E Brown Center

Damper Location

Mechanical room South

Inspector Name

Dan Tulcewicz

Damper I.D. #

AHU4.2-OA

Damper Type

Vertical Fire Damper

Damper Size

96x36

Damper Manufacturer

Ruskin

Damper Model #

IBD2

Fusible Link Temperature

212 Degrees

Access Door Size

16x16

Pass / Fail / Abandoned

Pass

Comments / Corrections

None


Exterior Picture of Damper



Interior Picture of Damper



Picture of Damper I.D. Label



Duct Fabricators, Inc.

883 Addison Rd. Cleveland, Ohio
P: 216-391-2400 F: 216-391-2492

FIRE SAFETY DIVISION
NEMI Certified HVAC Fire Life Safety Technicians



VISUAL CUYAHOGA COUNTY DAMPER INSPECTION REPORT

Date of Inspection

2022-07-26

Facility Location

Virgil E Brown Center

Damper Location

4t floor mechanical room South

Inspector Name

Dan Tulcewicz

Damper I.D. #

AHU4.2-RA

Damper Type

Vertical Fire Damper

Damper Size

96x60

Damper Manufacturer

Ruskin

Damper Model #

IBD2

Fusible Link Temperature

212 Degrees

Access Door Size

Open

Pass / Fail / Abandoned

Pass

Comments / Corrections

None

Exterior Picture of Damper



Interior Picture of Damper



Picture of Damper I.D. Label



Duct Fabricators, Inc.

883 Addison Rd. Cleveland, Ohio
P: 216-391-2400 F: 216-391-2492



VISUAL CUYAHOGA COUNTY DAMPER INSPECTION REPORT

Date of Inspection

2022-08-04

Facility Location

Virgil E Brown Center

Damper Location

4th floor South

Inspector Name

Dan Tulcewicz

Damper I.D.

AHU4.2-S1

Damper Type

Vertical Fire Damper

Damper Size

56x16

Damper Manufacturer

Ruskin

Damper Model

IBD2

Fusible Link Temperature

212 Degrees

Access Door Size

18x18

Pass / Fail / Abandoned

Pass

Comments / Corrections

None

Exterior Picture of Damper



Interior Picture of Damper



Picture of Damper I.D. Label



VISUAL CUYAHOGA COUNTY DAMPER INSPECTION REPORT

Date of Inspection

2022-08-04

Facility Location

Virgil E Brown Center

Damper Location

4th floor South

Inspector Name

Dan Tulcewicz

Damper I.D. #

AHU4.2-S2

Damper Type

Vertical Fire Damper

Damper Size

56x16

Damper Manufacturer

Ruskin

Damper Model #

IBD2

Fusible Link Temperature

212 Degrees

Access Door Size

23x17

Pass / Fail / Abandoned

Pass

Comments / Corrections

None

Exterior Picture of Damper



Interior Picture of Damper



Picture of Damper I.D. Label



VISUAL CUYAHOGA COUNTY DAMPER INSPECTION REPORT

Date of Inspection

2022-08-02

Facility Location

Virgil E Brown Center

Damper Location

4th floor South Telephone Room

Inspector Name

Dan Tulcewicz

Damper I.D. #

AHU4.2-S3

Damper Type

Vertical Fire Damper

Damper Size

8x12

Damper Manufacturer

Ruskin

Damper Model #

IBD2

Fusible Link Temperature

212 Degrees

Access Door Size

Open

Pass / Fail / Abandoned

Pass

Comments / Corrections

None

Exterior Picture of Damper



Interior Picture of Damper



Picture of Damper I.D. Label



VISUAL CUYAHOGA COUNTY DAMPER INSPECTION REPORT

Date of Inspection

2022-08-04

Facility Location

Virgil E Brown Center

Damper Location

4th floor South

Inspector Name

Dan Tulcewicz

Damper I.D. #

AHU4.2-S4

Damper Type

Vertical Fire Damper

Damper Size

56x16

Damper Manufacturer

Ruskin

Damper Model #

IBD2

Fusible Link Temperature

212 Degrees

Access Door Size

18x18

Pass / Fail / Abandoned

Pass

Comments / Corrections

None

Exterior Picture of Damper



Interior Picture of Damper



Picture of Damper I.D. Label



VISUAL CUYAHOGA COUNTY DAMPER INSPECTION REPORT

Date of Inspection

2022-08-04

Facility Location

Virgil E Brown Center

Damper Location

4th floor South

Inspector Name

Dan Tulcewicz

Damper I.D. #

AHU4.2-S5

Damper Type

Vertical Fire Damper

Damper Size

56x16

Damper Manufacturer

Ruskin

Damper Model #

IBD2

Fusible Link Temperature

212 Degrees

Access Door Size

18x18

Pass / Fail / Abandoned

Pass

Comments / Corrections

Drywall issues

Exterior Picture of Damper



Interior Picture of Damper



Picture of Damper I.D. Label



Duct Fabricators, Inc.

883 Addison Rd. Cleveland, Ohio
P: 216-391-2400 F: 216-391-2492



NEMI Certified HVAC Fire Life Safety Technicians



VISUAL CUYAHOGA COUNTY DAMPER INSPECTION REPORT

Date of Inspection

2022-08-04

Facility Location

Virgil E Brown Center

Damper Location

4th floor South

Inspector Name

Dan Tulcewicz

Damper I.D. #

AHU4.2-S6

Damper Type

Vertical Fire Damper

Damper Size

6"Round

Damper Manufacturer

Ruskin

Damper Model #

IBD2

Fusible Link Temperature

212 Degrees

Access Door Size

18x18

Pass / Fail / Abandoned

Pass

Comments / Corrections

None


Exterior Picture of Damper



Interior Picture of Damper



Picture of Damper I.D. Label



VISUAL CUYAHOGA COUNTY DAMPER INSPECTION REPORT

Date of Inspection

2022-08-04

Facility Location

Virgil E Brown Center

Damper Location

4th floor South

Inspector Name

Dan Tulcewicz

Damper I.D. #

AHU4.2-S7

Damper Type

Vertical Fire Damper

Damper Size

56x16

Damper Manufacturer

Ruskin

Damper Model #

IBD2

Fusible Link Temperature

212 Degrees

Access Door Size

18x18

Pass / Fail / Abandoned

Pass

Comments / Corrections

None

Exterior Picture of Damper



Interior Picture of Damper



Picture of Damper I.D. Label



VISUAL CUYAHOGA COUNTY DAMPER INSPECTION REPORT

Date of Inspection

2022-08-02

Facility Location

Virgil E Brown Center

Damper Location

South Telephone Room

Inspector Name

Dan Tulcewicz

Damper I.D. #

AHU4.2-S8

Damper Type

Vertical Fire Damper

Damper Size

8x12

Damper Manufacturer

Ruskin

Damper Model #

IBD2

Fusible Link Temperature

212 Degrees

Access Door Size

Open

Pass / Fail / Abandoned

Pass

Comments / Corrections

None

Exterior Picture of Damper



Interior Picture of Damper



Picture of Damper I.D. Label



VISUAL CUYAHOGA COUNTY DAMPER INSPECTION REPORT

Date of Inspection

2022-08-04

Facility Location

Virgil E Brown Center

Damper Location

4th floor South

Inspector Name

Dan Tulcewicz

Damper I.D. #

AHU4.2-S9

Damper Type

Vertical Fire Damper

Damper Size

20x8 Oval

Damper Manufacturer

Ruskin

Damper Model #

IBD2

Fusible Link Temperature

212 Degrees

Access Door Size

14x14

Pass / Fail / Abandoned

Pass

Comments / Corrections

None


Exterior Picture of Damper



Interior Picture of Damper



Picture of Damper I.D. Label



VISUAL CUYAHOGA COUNTY DAMPER INSPECTION REPORT

Date of Inspection

2022-08-04

Facility Location

Virgil E Brown Center

Damper Location

4th floor South

Inspector Name

Dan Tulcewicz

Damper I.D.

c

Damper Type

Vertical Fire Damper

Damper Size

56x16

Damper Manufacturer

Ruskin

Damper Model

IBD2

Fusible Link Temperature

212 Degrees

Access Door Size

18x18

Pass / Fail / Abandoned

Fail

Comments / Corrections

Drywall needs to be repaired
and needs retaining angle


Exterior Picture of Damper



Interior Picture of Damper



Picture of Damper I.D. Label



VISUAL CUYAHOGA COUNTY DAMPER INSPECTION REPORT

Date of Inspection

2022-08-04

Facility Location

Virgil E Brown Center

Damper Location

4th floor South

Inspector Name

Dan Tulcewicz

Damper I.D. #

AHU4.2-S11

Damper Type

Vertical Fire Damper

Damper Size

36x8

Damper Manufacturer

Ruskin

Damper Model #

IBD2

Fusible Link Temperature

165 Degrees

Access Door Size

12x12

Pass / Fail / Abandoned

Pass

Comments / Corrections

None


Exterior Picture of Damper



Interior Picture of Damper



Picture of Damper I.D. Label



VISUAL CUYAHOGA COUNTY DAMPER INSPECTION REPORT

Date of Inspection

2022-08-04

Facility Location

Virgil E Brown Center

Damper Location

4th floor South

Inspector Name

Dan Tulcewicz

Damper I.D. #

AHU4.2-S12

Damper Type

Vertical Fire Damper

Damper Size

36x8

Damper Manufacturer

Ruskin

Damper Model #

IBD2

Fusible Link Temperature

165 Degrees

Access Door Size

12x12

Pass / Fail / Abandoned

Pass

Comments / Corrections

None


Exterior Picture of Damper



Interior Picture of Damper



Picture of Damper I.D. Label



Duct Fabricators, Inc.
883 Addison Rd. Cleveland, Ohio
P: 216-391-2400 F: 216-391-2492

FIRE SAFETY DIVISION
NEMI Certified HVAC Fire Life Safety Technicians



VISUAL CUYAHOGA COUNTY DAMPER INSPECTION REPORT

Date of Inspection

2022-07-26

Facility Location

Virgil E Brown Center

Damper Location

5th floor north

Inspector Name

Dan Tulcewicz

Damper I.D.

AHU5.1 S-4

Damper Type

Vertical Fire Damper

Damper Size

36x18

Damper Manufacturer

Ruskin

Damper Model

IBD2

Fusible Link Temperature

212 Degrees

Access Door Size

18x18

Pass / Fail / Abandoned

Pass

Comments / Corrections

None

Exterior Picture of Damper



Interior Picture of Damper



Picture of Damper I.D. Label



Duct Fabricators, Inc.

883 Addison Rd. Cleveland, Ohio
P: 216-391-2400 F: 216-391-2492

FIRE SAFETY DIVISION

NEMI Certified HVAC Fire Life Safety Technicians



VISUAL CUYAHOGA COUNTY DAMPER INSPECTION REPORT

Date of Inspection

2022-08-02

Facility Location

Virgil E Brown Center

Damper Location

5th floor north

Inspector Name

Dan Tulcewicz

Damper I.D. #

AHU5.1 S-6

Damper Type

Vertical Fire Damper

Damper Size

56x18

Damper Manufacturer

Ruskin

Damper Model #

IBD2

Fusible Link Temperature

212 Degrees

Access Door Size

18x18

Pass / Fail / Abandoned

Pass

Comments / Corrections

None

Exterior Picture of Damper



Interior Picture of Damper



Picture of Damper I.D. Label

VISUAL Insp. **FIRE DAMPER**

Inspection Date:	Reference I.D. #:
Inspected By: <i>TULCEWICZ</i>	<i>AHU5.1-S6</i>
Next Inspect. By:	

Duct Fabricators, Inc.
883 Addison Rd. Cleveland, Ohio
P: 216-391-2400 F: 216-391-2492

FIRE SAFETY DIVISION
NEMI Certified HVAC Fire Life Safety Technicians

MEMBER
NFPA

VISUAL CUYAHOGA COUNTY DAMPER INSPECTION REPORT

Date of Inspection

2022-07-25

Facility Location

Virgil E Brown Center

Damper Location

5th Floor Mechanical North

Inspector Name

Dan Tulcewicz

Damper I.D. #

AHU5.1-OA

Damper Type

Vertical Fire Damper

Damper Size

96x36

Damper Manufacturer

Ruskin

Damper Model #

IBD2

Fusible Link Temperature

212 Degrees

Access Door Size

16x16

Pass / Fail / Abandoned

Pass

Comments / Corrections

None


Exterior Picture of Damper



Interior Picture of Damper



Picture of Damper I.D. Label



Duct Fabricators, Inc.

883 Addison Rd. Cleveland, Ohio
P: 216-391-2400 F: 216-391-2492



VISUAL CUYAHOGA COUNTY DAMPER INSPECTION REPORT

Date of Inspection

2022-07-25

Facility Location

Virgil E Brown Center

Damper Location

5th Floor Mechanical North

Inspector Name

Dan Tulcewicz

Damper I.D.

AHU5.1-RA

Damper Type

Vertical Fire Damper

Damper Size

96x84

Damper Manufacturer

Ruskin

Damper Model

IBD2

Fusible Link Temperature

212 Degrees

Access Door Size

Open

Pass / Fail / Abandoned

Pass

Comments / Corrections

None

Exterior Picture of Damper



Interior Picture of Damper



Picture of Damper I.D. Label



VISUAL CUYAHOGA COUNTY DAMPER INSPECTION REPORT

Date of Inspection

2022-07-25

Facility Location

Virgil E Brown Center

Damper Location

5th floor north

Inspector Name

Dan Tulcewicz

Damper I.D. #

AHU5.1-S1

Damper Type

Vertical Fire Damper

Damper Size

56x18

Damper Manufacturer

Ruskin

Damper Model #

IBD2

Fusible Link Temperature

212 Degrees

Access Door Size

18x18

Pass / Fail / Abandoned

Pass

Comments / Corrections

None

Exterior Picture of Damper



Interior Picture of Damper



Picture of Damper I.D. Label



VISUAL CUYAHOGA COUNTY DAMPER INSPECTION REPORT

Date of Inspection

2022-07-26

Facility Location

Virgil E Brown Center

Damper Location

5th Floor North

Inspector Name

Dan Tulcewicz

Damper I.D. #

AHU5.1-S2

Damper Type

Vertical Fire Damper

Damper Size

56x18

Damper Manufacturer

Ruskin

Damper Model #

IBD2

Fusible Link Temperature

212 Degrees

Access Door Size

18x18

Pass / Fail / Abandoned

Pass

Comments / Corrections

None

Exterior Picture of Damper



Interior Picture of Damper



Picture of Damper I.D. Label



VISUAL CUYAHOGA COUNTY DAMPER INSPECTION REPORT

Date of Inspection

2022-07-26

Facility Location

Virgil E Brown Center

Damper Location

5th Floor North

Inspector Name

Dan Tulcewicz

Damper I.D. #

AHU5.1-S3

Damper Type

Vertical Fire Damper

Damper Size

36x18

Damper Manufacturer

Ruskin

Damper Model #

IBD2

Fusible Link Temperature

212 Degrees

Access Door Size

18x18

Pass / Fail / Abandoned

Pass

Comments / Corrections

None


Exterior Picture of Damper



Interior Picture of Damper



Picture of Damper I.D. Label



VISUAL CUYAHOGA COUNTY DAMPER INSPECTION REPORT

Date of Inspection

2022-08-09

Facility Location

Virgil E Brown Center

Damper Location

Northwest corridor

Inspector Name

Dan Tulcewicz

Damper I.D. #

AHU5.1-S5

Damper Type

Vertical Fire Damper

Damper Size

56x18

Damper Manufacturer

Ruskin

Damper Model #

IBD2

Fusible Link Temperature

212 Degrees

Access Door Size

18x18

Pass / Fail / Abandoned

Pass

Comments / Corrections

None

Exterior Picture of Damper



Interior Picture of Damper



Picture of Damper I.D. Label



VISUAL CUYAHOGA COUNTY DAMPER INSPECTION REPORT

Date of Inspection

2022-08-02

Facility Location

Virgil E Brown Center

Damper Location

5th floor north

Inspector Name

Dan Tulcewicz

Damper I.D. #

AHU5.1-S6

Damper Type

Vertical Fire Damper

Damper Size

56x18

Damper Manufacturer

Ruskin

Damper Model #

IBD2

Fusible Link Temperature

212 Degrees

Access Door Size

18x18

Pass / Fail / Abandoned

Pass

Comments / Corrections

None

Exterior Picture of Damper



Interior Picture of Damper



Picture of Damper I.D. Label



VISUAL CUYAHOGA COUNTY DAMPER INSPECTION REPORT

Date of Inspection

2022-08-02

Facility Location

Virgil E Brown Center

Damper Location

North telephone room

Inspector Name

Dan Tulcewicz

Damper I.D. #

AHU5.1-S7

Damper Type

Vertical Fire Damper

Damper Size

8x12

Damper Manufacturer

Ruskin

Damper Model #

IBD2

Fusible Link Temperature

212 Degrees

Access Door Size

Open

Pass / Fail / Abandoned

Pass

Comments / Corrections

None


Exterior Picture of Damper



Interior Picture of Damper



Picture of Damper I.D. Label



Duct Fabricators, Inc.

883 Addison Rd. Cleveland, Ohio
P: 216-391-2400 F: 216-391-2492

FIRE SAFETY DIVISION
NEMI Certified HVAC Fire Life Safety Technicians



VISUAL CUYAHOGA COUNTY DAMPER INSPECTION REPORT

Date of Inspection

2022-08-02

Facility Location

Virgil E Brown Center

Damper Location

North telephone room

Inspector Name

Dan Tulcewicz

Damper I.D.

AHU5.1-S8

Damper Type

Vertical Fire Damper

Damper Size

8x12

Damper Manufacturer

Ruskin

Damper Model

IBD2

Fusible Link Temperature

212 Degrees

Access Door Size

Open

Pass / Fail / Abandoned

Pass

Comments / Corrections

None


Exterior Picture of Damper



Interior Picture of Damper



Picture of Damper I.D. Label



VISUAL CUYAHOGA COUNTY DAMPER INSPECTION REPORT

Date of Inspection

2022-08-09

Facility Location

Virgil E Brown Center

Damper Location

Room 510

Inspector Name

Julie Gue

Damper I.D. #

AHU5.1-S9

Damper Type

Vertical Fire Damper

Damper Size

10" oval

Damper Manufacturer

Ruskin

Damper Model #

IBD2

Fusible Link Temperature

212 Degrees

Access Door Size

18x18

Pass / Fail / Abandoned

Pass

Comments / Corrections

None


Exterior Picture of Damper



Interior Picture of Damper



Picture of Damper I.D. Label



VISUAL CUYAHOGA COUNTY DAMPER INSPECTION REPORT

Date of Inspection

2022-08-19

Facility Location

Virgil E Brown Center

Damper Location

RM510

Inspector Name

Julie Gue

Damper I.D. #

AHU5.1-S10

Damper Type

Vertical Fire Damper

Damper Size

38x10

Damper Manufacturer

Ruskin

Damper Model #

IBD2

Fusible Link Temperature

212 Degrees

Access Door Size

16x16


Pass / Fail / Abandoned

Pass

Comments / Corrections

None

Exterior Picture of Damper



Interior Picture of Damper



Picture of Damper I.D. Label



Duct Fabricators, Inc.
883 Addison Rd. Cleveland, Ohio
P: 216-391-2400 F: 216-391-2492

FIRE SAFETY DIVISION
NEMI Certified HVAC Fire Life Safety Technicians



VISUAL CUYAHOGA COUNTY DAMPER INSPECTION REPORT

Date of Inspection

2022-07-26

Facility Location

Virgil E Brown Center

Damper Location

5th Floor North

Inspector Name

Dan Tulcewicz

Damper I.D.

AHU5.1-S11

Damper Type

Vertical Fire Damper

Damper Size

18x10

Damper Manufacturer

Unknown

Damper Model

IBD2

Fusible Link Temperature

212 Degrees

Access Door Size

18x18

Pass / Fail / Abandoned

Pass

Comments / Corrections

None

Exterior Picture of Damper



Interior Picture of Damper



Picture of Damper I.D. Label



VISUAL CUYAHOGA COUNTY DAMPER INSPECTION REPORT

Date of Inspection

2022-07-26

Facility Location

Virgil E Brown Center

Damper Location

5th Floor North

Inspector Name

Dan Tulcewicz

Damper I.D. #

AHU5.1-S12

Damper Type

Vertical Fire Damper

Damper Size

12x8 Oval

Damper Manufacturer

Ruskin

Damper Model #

IBD2

Fusible Link Temperature

212 Degrees

Access Door Size

18x18

Pass / Fail / Abandoned

Pass

Comments / Corrections

None


Exterior Picture of Damper



Interior Picture of Damper



Picture of Damper I.D. Label



VISUAL CUYAHOGA COUNTY DAMPER INSPECTION REPORT

Date of Inspection

2022-07-26

Facility Location

Virgil E Brown Center

Damper Location

5th Floor North

Inspector Name

Dan Tulcewicz

Damper I.D. #

AHU5.1-S13

Damper Type

Vertical Fire Damper

Damper Size

34x10

Damper Manufacturer

Ruskin

Damper Model #

IBD2

Fusible Link Temperature

212 Degrees

Access Door Size

16x16

Pass / Fail / Abandoned

Pass

Comments / Corrections

None


Exterior Picture of Damper



Interior Picture of Damper



Picture of Damper I.D. Label



VISUAL CUYAHOGA COUNTY DAMPER INSPECTION REPORT

Date of Inspection

2022-07-25

Facility Location

Virgil E Brown Center

Damper Location

5th Floor Mechanical South

Inspector Name

Dan Tulcewicz

Damper I.D. #

AHU5.2-OA

Damper Type

Vertical Fire Damper

Damper Size

96x36

Damper Manufacturer

Ruskin

Damper Model #

IBD2

Fusible Link Temperature

212 Degrees

Access Door Size

16x16

Pass / Fail / Abandoned

Pass

Comments / Corrections

None


Exterior Picture of Damper



Interior Picture of Damper



Picture of Damper I.D. Label



VISUAL CUYAHOGA COUNTY DAMPER INSPECTION REPORT

Date of Inspection
2022-08-09

Facility Location
Virgil E Brown Center

Damper Location
Copy room

Inspector Name
Julie Gue

Damper I.D. #
AHU5.2-R1

Damper Type
Vertical Fire Damper

Damper Size
24x18

Damper Manufacturer
Ruskin

Damper Model #
IBD2

Fusible Link Temperature
212 Degrees

Access Door Size
18x18

Pass / Fail / Abandoned
Pass

Comments / Corrections
None

Exterior Picture of Damper



Interior Picture of Damper



Picture of Damper I.D. Label

FIRE DAMPER	
VISUAL INSPECTIONS	
Inspection Date: 8-9-22	Reference I.D.#
Inspected By: GUE	AHU 5.2-
Next Inspect. By: 8-9-24	R1

Duct Fabricators, Inc.
883 Addison Rd. Cleveland, Ohio
P: 216-391-2400 F: 216-391-2492

FIRE SAFETY DIVISION
NEMI Certified HVAC Fire Life Safety Technicians

MEMBER
NFPA

VISUAL CUYAHOGA COUNTY DAMPER INSPECTION REPORT

Date of Inspection

2022-07-25

Facility Location

Virgil E Brown Center

Damper Location

5th Floor Mechanical South

Inspector Name

Dan Tulcewicz

Damper I.D. #

AHU5.2-RA

Damper Type

Vertical Fire Damper

Damper Size

96x84

Damper Manufacturer

Ruskin

Damper Model #

IBD2

Fusible Link Temperature

212 Degrees

Access Door Size

Open

Pass / Fail / Abandoned

Pass

Comments / Corrections

None

Exterior Picture of Damper



Interior Picture of Damper



Picture of Damper I.D. Label



VISUAL CUYAHOGA COUNTY DAMPER INSPECTION REPORT

Date of Inspection

2022-08-02

Facility Location

Virgil E Brown Center

Damper Location

5th floor South

Inspector Name

Dan Tulcewicz

Damper I.D. #

AHU5.2-S1

Damper Type

Vertical Fire Damper

Damper Size

56x18

Damper Manufacturer

Ruskin

Damper Model #

IBD2

Fusible Link Temperature

212 Degrees

Access Door Size

18x18

Pass / Fail / Abandoned

Pass

Comments / Corrections

None


Exterior Picture of Damper



Interior Picture of Damper



Picture of Damper I.D. Label



VISUAL CUYAHOGA COUNTY DAMPER INSPECTION REPORT

Date of Inspection

2022-08-02

Facility Location

Virgil E Brown Center

Damper Location

5th floor South

Inspector Name

Dan Tulcewicz

Damper I.D. #

AHU5.2-S2

Damper Type

Vertical Fire Damper

Damper Size

56x18

Damper Manufacturer

Ruskin

Damper Model #

IBD2

Fusible Link Temperature

212 Degrees

Access Door Size

18x18

Pass / Fail / Abandoned

Pass

Comments / Corrections

None


Exterior Picture of Damper



Interior Picture of Damper



Picture of Damper I.D. Label



VISUAL CUYAHOGA COUNTY DAMPER INSPECTION REPORT

Date of Inspection

2022-08-02

Facility Location

Virgil E Brown Center

Damper Location

5th floor South

Inspector Name

Dan Tulcewicz

Damper I.D. #

AHU5.2-S3

Damper Type

Vertical Fire Damper

Damper Size

36x18

Damper Manufacturer

Ruskin

Damper Model #

IBD2

Fusible Link Temperature

212 Degrees

Access Door Size

18x18

Pass / Fail / Abandoned

Pass

Comments / Corrections

None


Exterior Picture of Damper



Interior Picture of Damper



Picture of Damper I.D. Label



Duct Fabricators, Inc.

883 Addison Rd. Cleveland, Ohio
P: 216-391-2400 F: 216-391-2492



NEMI Certified HVAC Fire Life Safety Technicians



VISUAL CUYAHOGA COUNTY DAMPER INSPECTION REPORT

Date of Inspection

2022-08-02

Facility Location

Virgil E Brown Center

Damper Location

5th floor South

Inspector Name

Dan Tulcewicz

Damper I.D.

AHU5.2-S4

Damper Type

Vertical Fire Damper

Damper Size

36x18

Damper Manufacturer

Ruskin

Damper Model

IBD2

Fusible Link Temperature

212 Degrees

Access Door Size

18x18

Pass / Fail / Abandoned

Pass

Comments / Corrections

None


Exterior Picture of Damper



Interior Picture of Damper



Picture of Damper I.D. Label

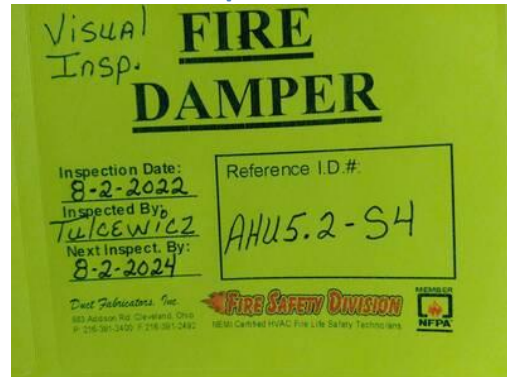

VISUAL CUYAHOGA COUNTY DAMPER INSPECTION REPORT

Date of Inspection

2022-08-02

Facility Location

Virgil E Brown Center

Damper Location

5th floor South

Inspector Name

Dan Tulcewicz

Damper I.D. #

AHU5.2-S5

Damper Type

Vertical Fire Damper

Damper Size

56x18

Damper Manufacturer

Ruskin

Damper Model #

IBD2

Fusible Link Temperature

212 Degrees

Access Door Size

16x16

Pass / Fail / Abandoned

Pass

Comments / Corrections

None


Exterior Picture of Damper



Interior Picture of Damper



Picture of Damper I.D. Label



VISUAL CUYAHOGA COUNTY DAMPER INSPECTION REPORT

Date of Inspection

2022-08-02

Facility Location

Virgil E Brown Center

Damper Location

5th floor South

Inspector Name

Dan Tulcewicz

Damper I.D. #

AHU5.2-S6

Damper Type

Vertical Fire Damper

Damper Size

56x18

Damper Manufacturer

Ruskin

Damper Model #

IBD2

Fusible Link Temperature

212 Degrees

Access Door Size

18x18

Pass / Fail / Abandoned

Pass

Comments / Corrections

None


Exterior Picture of Damper



Interior Picture of Damper



Picture of Damper I.D. Label



Duct Fabricators, Inc.

883 Addison Rd. Cleveland, Ohio
P: 216-391-2400 F: 216-391-2492



NEMI Certified HVAC Fire Life Safety Technicians



VISUAL CUYAHOGA COUNTY DAMPER INSPECTION REPORT

Date of Inspection

2022-08-02

Facility Location

Virgil E Brown Center

Damper Location

South Telephone Room

Inspector Name

Dan Tulcewicz

Damper I.D.

AHU5.2-S7

Damper Type

Vertical Fire Damper

Damper Size

8x12

Damper Manufacturer

Ruskin

Damper Model

IBD2

Fusible Link Temperature

212 Degrees

Access Door Size

Open

Pass / Fail / Abandoned

Pass

Comments / Corrections

None

Exterior Picture of Damper



Interior Picture of Damper



Picture of Damper I.D. Label

Visual Insp.		FIRE DAMPER	
Inspection Date:	8-2-2022	Reference I.D.#:	AHU5.2-S7
Inspected By:	Tulcewicz		
Next Inspect. By:	8-2-2024		
Duct Fabricators, Inc. 883 Addison Rd. Cleveland, Ohio P: 216-391-2400 F: 216-391-2492		MEMBER FIRE SAFETY DIVISION NEMI Certified HVAC Fire Life Safety Technicians NFPA	

VISUAL CUYAHOGA COUNTY DAMPER INSPECTION REPORT

Date of Inspection

2022-08-02

Facility Location

Virgil E Brown Center

Damper Location

5th floor South Telephone Room

Inspector Name

Dan Tulcewicz

Damper I.D. #

AHU5.2-S8

Damper Type

Vertical Fire Damper

Damper Size

12x8

Damper Manufacturer

Ruskin

Damper Model #

IBD2

Fusible Link Temperature

212 Degrees

Access Door Size

Open

Pass / Fail / Abandoned

Pass

Comments / Corrections

None


Exterior Picture of Damper



Interior Picture of Damper



Picture of Damper I.D. Label



VISUAL CUYAHOGA COUNTY DAMPER INSPECTION REPORT

Date of Inspection

2022-08-09

Facility Location

Virgil E Brown Center

Damper Location

Copy room

Inspector Name

Julie Gue

Damper I.D. #

AHU5.2-S9

Damper Type

Vertical Fire Damper

Damper Size

16" oval

Damper Manufacturer

Ruskin

Damper Model #

IBD2

Fusible Link Temperature

212 Degrees

Access Door Size

18x18

Pass / Fail / Abandoned

Pass

Comments / Corrections

None

Exterior Picture of Damper



Interior Picture of Damper



Picture of Damper I.D. Label



VISUAL CUYAHOGA COUNTY DAMPER INSPECTION REPORT

Date of Inspection
2022-08-09

Facility Location
Virgil E Brown Center

Damper Location
Copy room

Inspector Name
Julie Gue

Damper I.D. #
AHU5.2-S10

Damper Type
Vertical Fire Damper

Damper Size
16" oval

Damper Manufacturer
Ruskin

Damper Model #
IBD2

Fusible Link Temperature
165 Degrees

Access Door Size
18x18


Pass / Fail / Abandoned
Pass

Comments / Corrections
None

Exterior Picture of Damper



Interior Picture of Damper



Picture of Damper I.D. Label



VISUAL CUYAHOGA COUNTY DAMPER INSPECTION REPORT

Date of Inspection

2022-08-09

Facility Location

Virgil E Brown Center

Damper Location

Copy room

Inspector Name

Julie Gue

Damper I.D. #

AHU5.2-S11

Damper Type

Vertical Fire Damper

Damper Size

8" Round

Damper Manufacturer

Ruskin

Damper Model #

IBD2

Fusible Link Temperature

165 Degrees

Access Door Size

Flex access

Pass / Fail / Abandoned

Pass

Comments / Corrections

None


Exterior Picture of Damper



Interior Picture of Damper



Picture of Damper I.D. Label



VISUAL CUYAHOGA COUNTY DAMPER INSPECTION REPORT

Date of Inspection

2022-08-02

Facility Location

Virgil E Brown Center

Damper Location

5th floor South

Inspector Name

Dan Tulcewicz

Damper I.D. #

AHU5.2-S12

Damper Type

Vertical Fire Damper

Damper Size

44x12

Damper Manufacturer

Ruskin

Damper Model #

IBD2

Fusible Link Temperature

212 Degrees

Access Door Size

16x16

Pass / Fail / Abandoned

Pass

Comments / Corrections

None


Exterior Picture of Damper



Interior Picture of Damper



Picture of Damper I.D. Label



Duct Fabricators, Inc.

883 Addison Rd. Cleveland, Ohio
P: 216-391-2400 F: 216-391-2492

FIRE SAFETY DIVISION

NEMI Certified HVAC Fire Life Safety Technicians



VISUAL CUYAHOGA COUNTY DAMPER INSPECTION REPORT

Date of Inspection

2022-08-02

Facility Location

Virgil E Brown Center

Damper Location

5th floor South

Inspector Name

Dan Tulcewicz

Damper I.D.

AHU5.2-S13

Damper Type

Vertical Fire Damper

Damper Size

45x10

Damper Manufacturer

Ruskin

Damper Model

IBD2

Fusible Link Temperature

212 Degrees

Access Door Size

16x16

Pass / Fail / Abandoned

Pass

Comments / Corrections

None

Exterior Picture of Damper



Interior Picture of Damper



Picture of Damper I.D. Label

Visual Insp. **FIRE DAMPER**

Inspection Date: 8-2-2022	Reference I.D. #:
Inspected By: TULCEWICZ	AHU5.2-S13
Next Inspect. By: 8-2-2024	

Duct Fabricators, Inc.
883 Addison Rd. Cleveland, Ohio
P: 216-391-2400 F: 216-391-2492

FIRE SAFETY DIVISION
NEMI Certified HVAC Fire Life Safety Technicians

MEMBER
NFPA

VISUAL CUYAHOGA COUNTY DAMPER INSPECTION REPORT

Date of Inspection

2022-08-02

Facility Location

Virgil E Brown Center

Damper Location

5th floor South

Inspector Name

Dan Tulcewicz

Damper I.D.

AHU5.2-S14

Damper Type

Vertical Fire Damper

Damper Size

8" Round

Damper Manufacturer

Ruskin

Damper Model

IBD2

Fusible Link Temperature

212 Degrees

Access Door Size

20x20

Pass / Fail / Abandoned

Pass

Comments / Corrections

None


Exterior Picture of Damper



Interior Picture of Damper



Picture of Damper I.D. Label



VISUAL CUYAHOGA COUNTY DAMPER INSPECTION REPORT

Date of Inspection

2022-08-02

Facility Location

Virgil E Brown Center

Damper Location

5th floor South

Inspector Name

Dan Tulcewicz

Damper I.D. #

AHU5.2-S15

Damper Type

Vertical Fire Damper

Damper Size

16"Oval

Damper Manufacturer

Ruskin

Damper Model #

IBD2

Fusible Link Temperature

212 Degrees

Access Door Size

18x18

Pass / Fail / Abandoned

Pass

Comments / Corrections

None


Exterior Picture of Damper



Interior Picture of Damper



Picture of Damper I.D. Label



Duct Fabricators, Inc.

883 Addison Rd. Cleveland, Ohio
P: 216-391-2400 F: 216-391-2492

FIRE SAFETY DIVISION

NEMI Certified HVAC Fire Life Safety Technicians



VISUAL CUYAHOGA COUNTY DAMPER INSPECTION REPORT

Date of Inspection

2022-08-02

Facility Location

Virgil E Brown Center

Damper Location

5th floor South

Inspector Name

Dan Tulcewicz

Damper I.D.

AHU5.2-S16

Damper Type

Vertical Fire Damper

Damper Size

6" Round

Damper Manufacturer

Ruskin

Damper Model

IBD2

Fusible Link Temperature

212 Degrees

Access Door Size

18x18

Pass / Fail / Abandoned

Pass

Comments / Corrections

None


Exterior Picture of Damper



Interior Picture of Damper



Picture of Damper I.D. Label

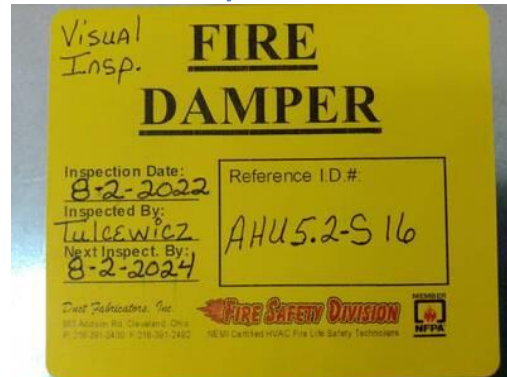

VISUAL CUYAHOGA COUNTY DAMPER INSPECTION REPORT

Date of Inspection

2022-08-02

Facility Location

Virgil E Brown Center

Damper Location

5th floor South

Inspector Name

Dan Tulcewicz

Damper I.D. #

AHU5.2-S17

Damper Type

Vertical Fire Damper

Damper Size

20x10

Damper Manufacturer

Ruskin

Damper Model #

IBD2

Fusible Link Temperature

212 Degrees

Access Door Size

14x14

Pass / Fail / Abandoned

Pass

Comments / Corrections

None


Exterior Picture of Damper



Interior Picture of Damper



Picture of Damper I.D. Label



VISUAL CUYAHOGA COUNTY DAMPER INSPECTION REPORT

Date of Inspection

2022-08-15

Facility Location

Virgil E Brown Center

Damper Location

Southeast corridor

Inspector Name

Julie Gue

Damper I.D. #

AHUG .2-S8

Damper Type

Vertical Fire Damper

Damper Size

46x16

Damper Manufacturer

Ruskin

Damper Model #

IBD2

Fusible Link Temperature

212 Degrees

Access Door Size

18x17

Pass / Fail / Abandoned

Pass

Comments / Corrections

None


Exterior Picture of Damper



Interior Picture of Damper



Picture of Damper I.D. Label



VISUAL CUYAHOGA COUNTY DAMPER INSPECTION REPORT

Date of Inspection

2022-08-10

Facility Location

Virgil E Brown Center

Damper Location

South mechanical room

Inspector Name

Julie Gue

Damper I.D. #

AHUG 2-RA

Damper Type

Vertical Fire Damper

Damper Size

96x48

Damper Manufacturer

Ruskin

Damper Model #

IBD2

Fusible Link Temperature

212 Degrees

Access Door Size

Open duct

Pass / Fail / Abandoned

Pass

Comments / Corrections

None


Exterior Picture of Damper



Interior Picture of Damper



Picture of Damper I.D. Label



VISUAL CUYAHOGA COUNTY DAMPER INSPECTION REPORT

Date of Inspection

2022-08-15

Facility Location

Virgil E Brown Center

Damper Location

Southwest corridor

Inspector Name

Julie Gue

Damper I.D. #

AHUG 2-S1

Damper Type

Vertical Fire Damper

Damper Size

14x8 oval

Damper Manufacturer

Ruskin

Damper Model #

IBD2

Fusible Link Temperature

212 Degrees

Access Door Size

16x16

Pass / Fail / Abandoned

Pass

Comments / Corrections

None


Exterior Picture of Damper



Interior Picture of Damper



Picture of Damper I.D. Label



VISUAL CUYAHOGA COUNTY DAMPER INSPECTION REPORT

Date of Inspection

2022-08-15

Facility Location

Virgil E Brown Center

Damper Location

Southwest corridor

Inspector Name

Julie Gue

Damper I.D. #

AHUG 2-S3

Damper Type

Vertical Fire Damper

Damper Size

46x16

Damper Manufacturer

Ruskin

Damper Model #

IBD2

Fusible Link Temperature

212 Degrees

Access Door Size

18x18

Pass / Fail / Abandoned

Pass

Comments / Corrections

None


Exterior Picture of Damper



Interior Picture of Damper



Picture of Damper I.D. Label



VISUAL CUYAHOGA COUNTY DAMPER INSPECTION REPORT

Date of Inspection

2022-08-15

Facility Location

Virgil E Brown Center

Damper Location

Southwest corridor

Inspector Name

Julie Gue

Damper I.D. #

AHUG 2-S5

Damper Type

Vertical Fire Damper

Damper Size

36x12

Damper Manufacturer

Ruskin

Damper Model #

IBD2

Fusible Link Temperature

212 Degrees

Access Door Size

18x18

Pass / Fail / Abandoned

Pass

Comments / Corrections

None


Exterior Picture of Damper



Interior Picture of Damper



Picture of Damper I.D. Label



VISUAL CUYAHOGA COUNTY DAMPER INSPECTION REPORT

Date of Inspection

2022-08-15

Facility Location

Virgil E Brown Center

Damper Location

South corridor

Inspector Name

Julie Gue

Damper I.D. #

AHUG 2-S6

Damper Type

Vertical Fire Damper

Damper Size

18x10 oval

Damper Manufacturer

Ruskin

Damper Model #

IBD2

Fusible Link Temperature

212 Degrees

Access Door Size

16x16

Pass / Fail / Abandoned

Pass

Comments / Corrections

None


Exterior Picture of Damper



Interior Picture of Damper



Picture of Damper I.D. Label



VISUAL CUYAHOGA COUNTY DAMPER INSPECTION REPORT

Date of Inspection

2022-08-10

Facility Location

Virgil E Brown Center

Damper Location

Southeast com room

Inspector Name

Julie Gue

Damper I.D. #

AHUG 2-S9

Damper Type

Vertical Fire Damper

Damper Size

8x12

Damper Manufacturer

Ruskin

Damper Model #

IBD2

Fusible Link Temperature

212 Degrees

Access Door Size

Open duct

Pass / Fail / Abandoned

Pass

Comments / Corrections

None


Exterior Picture of Damper



Interior Picture of Damper



Picture of Damper I.D. Label



VISUAL CUYAHOGA COUNTY DAMPER INSPECTION REPORT

Date of Inspection

2022-08-10

Facility Location

Virgil E Brown Center

Damper Location

North mechanical room

Inspector Name

Julie Gue

Damper I.D. #

AHUG.1 OA

Damper Type

Vertical Fire Damper

Damper Size

96x20

Damper Manufacturer

Ruskin

Damper Model #

IBD2

Fusible Link Temperature

212 Degrees

Access Door Size

18x18

Pass / Fail / Abandoned

Pass

Comments / Corrections

None


Exterior Picture of Damper



Interior Picture of Damper



Picture of Damper I.D. Label



VISUAL CUYAHOGA COUNTY DAMPER INSPECTION REPORT

Date of Inspection

2022-08-10

Facility Location

Virgil E Brown Center

Damper Location

North mechanical room

Inspector Name

Julie Gue

Damper I.D. #

AHUG.1 RA

Damper Type

Vertical Fire Damper

Damper Size

96x48

Damper Manufacturer

Ruskin

Damper Model #

IBD2

Fusible Link Temperature

212 Degrees

Access Door Size

Open duct

Pass / Fail / Abandoned

Pass

Comments / Corrections

None


Exterior Picture of Damper



Interior Picture of Damper



Picture of Damper I.D. Label



VISUAL CUYAHOGA COUNTY DAMPER INSPECTION REPORT

Date of Inspection

2022-08-15

Facility Location

Virgil E Brown Center

Damper Location

Northeast corridor

Inspector Name

Julie Gue

Damper I.D. #

AHUG.1-S1

Damper Type

Vertical Fire Damper

Damper Size

56x16

Damper Manufacturer

Ruskin

Damper Model #

IBD2

Fusible Link Temperature

212 Degrees

Access Door Size

30x18

Pass / Fail / Abandoned

Pass

Comments / Corrections

None

Exterior Picture of Damper



Interior Picture of Damper



Picture of Damper I.D. Label



Duct Fabricators, Inc.

883 Addison Rd. Cleveland, Ohio
P: 216-391-2400 F:216-391-2492



NEMI Certified HVAC Fire Life Safety Technicians



VISUAL CUYAHOGA COUNTY DAMPER INSPECTION REPORT

Date of Inspection

2022-08-15

Facility Location

Virgil E Brown Center

Damper Location

Southwest corridor

Inspector Name

Julie Gue

Damper I.D. #

AHUG.1-S2

Damper Type

Vertical Fire Damper

Damper Size

46x16

Damper Manufacturer

Ruskin

Damper Model #

IBD2

Fusible Link Temperature

212 Degrees

Access Door Size

16x16

Pass / Fail / Abandoned

Pass

Comments / Corrections

None


Exterior Picture of Damper



Interior Picture of Damper



Picture of Damper I.D. Label



VISUAL CUYAHOGA COUNTY DAMPER INSPECTION REPORT

Date of Inspection

2022-08-11

Facility Location

Virgil E Brown Center

Damper Location

Northeast corridor

Inspector Name

Julie Gue

Damper I.D. #

AHUG.1-S3

Damper Type

Vertical Fire Damper

Damper Size

46x16

Damper Manufacturer

Ruskin

Damper Model #

IBD2

Fusible Link Temperature

212 Degrees

Access Door Size

18x18

Pass / Fail / Abandoned

Pass

Comments / Corrections

None


Exterior Picture of Damper



Interior Picture of Damper



Picture of Damper I.D. Label

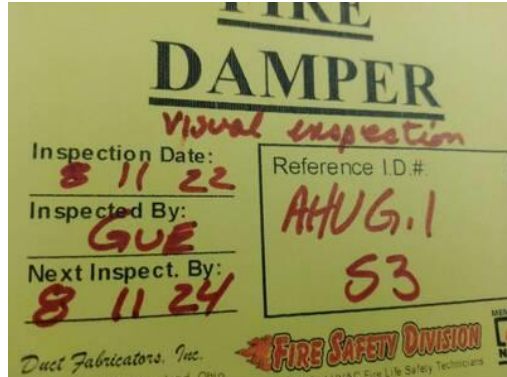

VISUAL CUYAHOGA COUNTY DAMPER INSPECTION REPORT

Date of Inspection

2022-08-10

Facility Location

Virgil E Brown Center

Damper Location

Northeast com room

Inspector Name

Julie Gue

Damper I.D. #

AHUG.1-S4

Damper Type

Vertical Fire Damper

Damper Size

8x12

Damper Manufacturer

Ruskin

Damper Model #

IBD2

Fusible Link Temperature

212 Degrees

Access Door Size

Open duct

Pass / Fail / Abandoned

Pass

Comments / Corrections

None

Exterior Picture of Damper



Interior Picture of Damper



Picture of Damper I.D. Label



VISUAL CUYAHOGA COUNTY DAMPER INSPECTION REPORT

Date of Inspection

2022-08-11

Facility Location

Virgil E Brown Center

Damper Location

RM 88

Inspector Name

Julie Gue

Damper I.D. #

AHUG.1-S5

Damper Type

Vertical Fire Damper

Damper Size

6" Round

Damper Manufacturer

Ruskin

Damper Model #

IBD2

Fusible Link Temperature

212 Degrees

Access Door Size

6x6

Pass / Fail / Abandoned

Pass

Comments / Corrections

None


Exterior Picture of Damper



Interior Picture of Damper



Picture of Damper I.D. Label



VISUAL CUYAHOGA COUNTY DAMPER INSPECTION REPORT

Date of Inspection

2022-08-11

Facility Location

Virgil E Brown Center

Damper Location

Front desk

Inspector Name

Julie Gue

Damper I.D. #

AHUG.1-S6

Damper Type

Vertical Fire Damper

Damper Size

6" Round

Damper Manufacturer

Ruskin

Damper Model #

IBD2

Fusible Link Temperature

212 Degrees

Access Door Size

18x18

Pass / Fail / Abandoned

Pass

Comments / Corrections

None


Exterior Picture of Damper



Interior Picture of Damper



Picture of Damper I.D. Label



VISUAL CUYAHOGA COUNTY DAMPER INSPECTION REPORT

Date of Inspection

2022-08-11

Facility Location

Virgil E Brown Center

Damper Location

Superior Lobby

Inspector Name

Julie Gue

Damper I.D. #

AHUG.1-S7

Damper Type

Vertical Fire Damper

Damper Size

14" oval

Damper Manufacturer

Ruskin

Damper Model #

IBD2

Fusible Link Temperature

212 Degrees

Access Door Size

16x16

Pass / Fail / Abandoned

Pass

Comments / Corrections

None


Exterior Picture of Damper



Interior Picture of Damper



Picture of Damper I.D. Label



VISUAL CUYAHOGA COUNTY DAMPER INSPECTION REPORT

Date of Inspection

2022-08-11

Facility Location

Virgil E Brown Center

Damper Location

Superior Lobby

Inspector Name

Julie Gue

Damper I.D. #

AHUG.1-S8

Damper Type

Vertical Fire Damper

Damper Size

6" Round

Damper Manufacturer

Ruskin

Damper Model #

IBD2

Fusible Link Temperature

212 Degrees

Access Door Size

16x16

Pass / Fail / Abandoned

Pass

Comments / Corrections

None


Exterior Picture of Damper



Interior Picture of Damper



Picture of Damper I.D. Label



VISUAL CUYAHOGA COUNTY DAMPER INSPECTION REPORT

Date of Inspection

2022-08-11

Facility Location

Virgil E Brown Center

Damper Location

X-ray machine

Inspector Name

Julie Gue

Damper I.D. #

AHUG.1-S9

Damper Type

Vertical Fire Damper

Damper Size

28x10

Damper Manufacturer

Ruskin

Damper Model #

IBD2

Fusible Link Temperature

212 Degrees

Access Door Size

16x16

Pass / Fail / Abandoned

Pass

Comments / Corrections

None

Exterior Picture of Damper



Interior Picture of Damper



Picture of Damper I.D. Label



VISUAL CUYAHOGA COUNTY DAMPER INSPECTION REPORT

Date of Inspection

2022-08-11

Facility Location

Virgil E Brown Center

Damper Location

Direct service

Inspector Name

Julie Gue

Damper I.D. #

AHUG.1-S10

Damper Type

Vertical Fire Damper

Damper Size

14x8 oval

Damper Manufacturer

Ruskin

Damper Model #

IBD2

Fusible Link Temperature

212 Degrees

Access Door Size

16x16

Pass / Fail / Abandoned

Pass

Comments / Corrections

None


Exterior Picture of Damper



Interior Picture of Damper



Picture of Damper I.D. Label



VISUAL CUYAHOGA COUNTY DAMPER INSPECTION REPORT

Date of Inspection

2022-08-11

Facility Location

Virgil E Brown Center

Damper Location

Direct service

Inspector Name

Julie Gue

Damper I.D. #

AHUG.1-S11

Damper Type

Vertical Fire Damper

Damper Size

6" Round

Damper Manufacturer

Ruskin

Damper Model #

IBD2

Fusible Link Temperature

212 Degrees

Access Door Size

16x16

Pass / Fail / Abandoned

Pass

Comments / Corrections

None


Exterior Picture of Damper



Interior Picture of Damper



Picture of Damper I.D. Label



VISUAL CUYAHOGA COUNTY DAMPER INSPECTION REPORT

Date of Inspection

2022-08-11

Facility Location

Virgil E Brown Center

Damper Location

Genetic testing

Inspector Name

Julie Gue

Damper I.D. #

AHUG.1-S12

Damper Type

Vertical Fire Damper

Damper Size

6" Round

Damper Manufacturer

Ruskin

Damper Model #

IBD2

Fusible Link Temperature

212 Degrees

Access Door Size

Flex

Pass / Fail / Abandoned

Pass

Comments / Corrections

None

Exterior Picture of Damper



Interior Picture of Damper



Picture of Damper I.D. Label



VISUAL CUYAHOGA COUNTY DAMPER INSPECTION REPORT

Date of Inspection

2022-08-11

Facility Location

Virgil E Brown Center

Damper Location

Northwest corridor

Inspector Name

Julie Gue

Damper I.D. #

AHUG.1-S13

Damper Type

Vertical Fire Damper

Damper Size

48x16

Damper Manufacturer

Ruskin

Damper Model #

IBD2

Fusible Link Temperature

212 Degrees

Access Door Size

16x16

Pass / Fail / Abandoned

Pass

Comments / Corrections

None


Exterior Picture of Damper



Interior Picture of Damper



Picture of Damper I.D. Label



VISUAL CUYAHOGA COUNTY DAMPER INSPECTION REPORT

Date of Inspection

2022-08-10

Facility Location

Virgil E Brown Center

Damper Location

Northwest com room

Inspector Name

Julie Gue

Damper I.D. #

AHUG.1-S14

Damper Type

Vertical Fire Damper

Damper Size

8x12

Damper Manufacturer

Ruskin

Damper Model #

IBD2

Fusible Link Temperature

212 Degrees

Access Door Size

Open duct

Pass / Fail / Abandoned

Pass

Comments / Corrections

None


Exterior Picture of Damper



Interior Picture of Damper



Picture of Damper I.D. Label



VISUAL CUYAHOGA COUNTY DAMPER INSPECTION REPORT

Date of Inspection

2022-08-15

Facility Location

Virgil E Brown Center

Damper Location

Northwest corridor

Inspector Name

Julie Gue

Damper I.D. #

AHUG.1-S15

Damper Type

Vertical Fire Damper

Damper Size

46x16

Damper Manufacturer

Ruskin

Damper Model #

IBD2

Fusible Link Temperature

212 Degrees

Access Door Size

16x16

Pass / Fail / Abandoned

Pass

Comments / Corrections

None

Exterior Picture of Damper



Interior Picture of Damper



Picture of Damper I.D. Label



VISUAL CUYAHOGA COUNTY DAMPER INSPECTION REPORT

Date of Inspection

2022-08-15

Facility Location

Virgil E Brown Center

Damper Location

Brazetin office

Inspector Name

Julie Gue

Damper I.D. #

AHUG.1-S16

Damper Type

Vertical Fire Damper

Damper Size

6" Round

Damper Manufacturer

Ruskin

Damper Model #

IBD2

Fusible Link Temperature

212 Degrees

Access Door Size

Flex

Pass / Fail / Abandoned

Pass

Comments / Corrections

None

Exterior Picture of Damper



Interior Picture of Damper



Picture of Damper I.D. Label



Duct Fabricators, Inc.

883 Addison Rd. Cleveland, Ohio
P: 216-391-2400 F: 216-391-2492



NEMI Certified HVAC Fire Life Safety Technicians



VISUAL CUYAHOGA COUNTY DAMPER INSPECTION REPORT

Date of Inspection

2022-08-10

Facility Location

Virgil E Brown Center

Damper Location

South mechanical room

Inspector Name

Julie Gue

Damper I.D. #

AHUG.2-OA

Damper Type

Vertical Fire Damper

Damper Size

96x20

Damper Manufacturer

Ruskin

Damper Model #

IBD2

Fusible Link Temperature

212 Degrees

Access Door Size

16x16

Pass / Fail / Abandoned

Pass

Comments / Corrections

None

Exterior Picture of Damper



Interior Picture of Damper



Picture of Damper I.D. Label



VISUAL CUYAHOGA COUNTY DAMPER INSPECTION REPORT

Date of Inspection

2022-08-15

Facility Location

Virgil E Brown Center

Damper Location

Ground mechanical room

Inspector Name

Julie Gue

Damper I.D. #

AHUG.2-S1

Damper Type

Vertical Fire Damper

Damper Size

16x12

Damper Manufacturer

Ruskin

Damper Model #

IBD2

Fusible Link Temperature

165 Degrees

Access Door Size

14x14

Pass / Fail / Abandoned

Pass

Comments / Corrections

None


Exterior Picture of Damper



Interior Picture of Damper



Picture of Damper I.D. Label

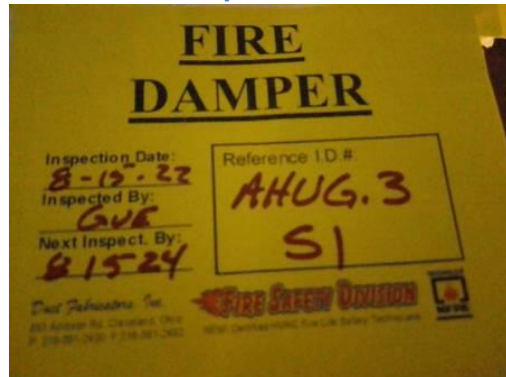

VISUAL CUYAHOGA COUNTY DAMPER INSPECTION REPORT

Date of Inspection

2022-08-15

Facility Location

Virgil E Brown Center

Damper Location

Southwest corridor

Inspector Name

Julie Gue

Damper I.D. #

AHUG.2-S3

Damper Type

Vertical Fire Damper

Damper Size

46x16

Damper Manufacturer

Ruskin

Damper Model #

IBD2

Fusible Link Temperature

212 Degrees

Access Door Size

18x18

Pass / Fail / Abandoned

Pass

Comments / Corrections

None


Exterior Picture of Damper



Interior Picture of Damper



Picture of Damper I.D. Label



VISUAL CUYAHOGA COUNTY DAMPER INSPECTION REPORT

Date of Inspection

2022-08-10

Facility Location

Virgil E Brown Center

Damper Location

Southwest com room

Inspector Name

Julie Gue

Damper I.D. #

AHUG.2-S4

Damper Type

Vertical Fire Damper

Damper Size

8x12

Damper Manufacturer

Ruskin

Damper Model #

IBD2

Fusible Link Temperature

212 Degrees

Access Door Size

Open duct

Pass / Fail / Abandoned

Pass

Comments / Corrections

None


Exterior Picture of Damper



Interior Picture of Damper



Picture of Damper I.D. Label



VISUAL CUYAHOGA COUNTY DAMPER INSPECTION REPORT

Date of Inspection

2022-08-15

Facility Location

Virgil E Brown Center

Damper Location

RM77

Inspector Name

Julie Gue

Damper I.D. #

AHUG.2-S7

Damper Type

Vertical Fire Damper

Damper Size

20x10

Damper Manufacturer

Ruskin

Damper Model #

IBD2

Fusible Link Temperature

212 Degrees

Access Door Size

8x8

Pass / Fail / Abandoned

Pass

Comments / Corrections

None

Exterior Picture of Damper



Interior Picture of Damper



Picture of Damper I.D. Label



VISUAL CUYAHOGA COUNTY DAMPER INSPECTION REPORT

Date of Inspection

2022-08-15

Facility Location

Virgil E Brown Center

Damper Location

Southeast corridor

Inspector Name

Julie Gue

Damper I.D. #

AHUG.2-S8

Damper Type

Vertical Fire Damper

Damper Size

46x16

Damper Manufacturer

Ruskin

Damper Model #

IBD2

Fusible Link Temperature

212 Degrees

Access Door Size

18x17

Pass / Fail / Abandoned

Pass

Comments / Corrections

None


Exterior Picture of Damper



Interior Picture of Damper



Picture of Damper I.D. Label



VISUAL CUYAHOGA COUNTY DAMPER INSPECTION REPORT

Date of Inspection

2022-08-15

Facility Location

Virgil E Brown Center

Damper Location

Southeast corridor

Inspector Name

Julie Gue

Damper I.D. #

AHUG.2-S10

Damper Type

Vertical Fire Damper

Damper Size

46x16

Damper Manufacturer

Ruskin

Damper Model #

IBD2

Fusible Link Temperature

212 Degrees

Access Door Size

18x18

Pass / Fail / Abandoned

Pass

Comments / Corrections

None


Exterior Picture of Damper



Interior Picture of Damper



Picture of Damper I.D. Label



VISUAL CUYAHOGA COUNTY DAMPER INSPECTION REPORT

Date of Inspection

2022-08-15

Facility Location

Virgil E Brown Center

Damper Location

Southeast corridor

Inspector Name

Julie Gue

Damper I.D. #

AHUG.2-S11

Damper Type

Vertical Fire Damper

Damper Size

16" oval

Damper Manufacturer

Ruskin

Damper Model #

IBD2

Fusible Link Temperature

212 Degrees

Access Door Size

18x18

Pass / Fail / Abandoned

Pass

Comments / Corrections

None

Exterior Picture of Damper



Interior Picture of Damper



Picture of Damper I.D. Label



VISUAL CUYAHOGA COUNTY DAMPER INSPECTION REPORT

Date of Inspection

2022-08-15

Facility Location

Virgil E Brown Center

Damper Location

Southeast corridor

Inspector Name

Julie Gue

Damper I.D. #

AHUG.2-S12

Damper Type

Vertical Fire Damper

Damper Size

6" Round

Damper Manufacturer

Ruskin

Damper Model #

IBD2

Fusible Link Temperature

212 Degrees

Access Door Size

18x18

Pass / Fail / Abandoned

Pass

Comments / Corrections

None


Exterior Picture of Damper



Interior Picture of Damper



Picture of Damper I.D. Label



VISUAL CUYAHOGA COUNTY DAMPER INSPECTION REPORT

Date of Inspection

2022-08-16

Facility Location

Virgil E Brown Center

Damper Location

Under lobby stairs

Inspector Name

Julie Gue

Damper I.D. #

AHUG.3-RA1

Damper Type

Horizontal Fire Damper

Damper Size

54x18

Damper Manufacturer

Ruskin

Damper Model #

IBD2

Fusible Link Temperature

212 Degrees

Access Door Size

Screen access

Pass / Fail / Abandoned

Pass

Comments / Corrections

None


Exterior Picture of Damper



Interior Picture of Damper



Picture of Damper I.D. Label

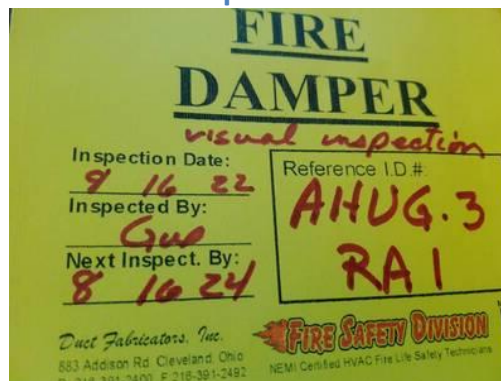

VISUAL CUYAHOGA COUNTY DAMPER INSPECTION REPORT

Date of Inspection

2022-08-15

Facility Location

Virgil E Brown Center

Damper Location

Ground mechanical room

Inspector Name

Julie Gue

Damper I.D. #

AHUG.3-RA2

Damper Type

Horizontal Fire Damper

Damper Size

18x16

Damper Manufacturer

Ruskin

Damper Model #

IBD2

Fusible Link Temperature

212 Degrees

Access Door Size

12x12

Pass / Fail / Abandoned

Pass

Comments / Corrections

None

Exterior Picture of Damper



Interior Picture of Damper



Picture of Damper I.D. Label



VISUAL CUYAHOGA COUNTY DAMPER INSPECTION REPORT

Date of Inspection

2022-08-15

Facility Location

Virgil E Brown Center

Damper Location

Ground mechanical room

Inspector Name

Julie Gue

Damper I.D. #

AHUG.3-S2

Damper Type

Vertical Fire Damper

Damper Size

16x12

Damper Manufacturer

Ruskin

Damper Model #

IBD2

Fusible Link Temperature

212 Degrees

Access Door Size

14x14

Pass / Fail / Abandoned

Pass

Comments / Corrections

None


Exterior Picture of Damper



Interior Picture of Damper



Picture of Damper I.D. Label



VISUAL CUYAHOGA COUNTY DAMPER INSPECTION REPORT

Date of Inspection

2022-08-15

Facility Location

Virgil E Brown Center

Damper Location

Lobby Mechanical Room

Inspector Name

Julie Gue

Damper I.D. #

AHUG.3-S3

Damper Type

Vertical Fire Damper

Damper Size

26x10

Damper Manufacturer

Ruskin

Damper Model #

IBD2

Fusible Link Temperature

165 Degrees

Access Door Size

14x14

Pass / Fail / Abandoned

Pass

Comments / Corrections

None

Exterior Picture of Damper



Interior Picture of Damper



Picture of Damper I.D. Label



Duct Fabricators, Inc.

883 Addison Rd. Cleveland, Ohio
P: 216-391-2400 F: 216-391-2492

FIRE SAFETY DIVISION
NEMI Certified HVAC Fire Life Safety Technicians



VISUAL CUYAHOGA COUNTY DAMPER INSPECTION REPORT

Date of Inspection

2022-08-15

Facility Location

Virgil E Brown Center

Damper Location

Ground mechanical room

Inspector Name

Julie Gue

Damper I.D. #

AHUG.3-S4

Damper Type

Vertical Fire Damper

Damper Size

14x10

Damper Manufacturer

Ruskin

Damper Model #

IBD2

Fusible Link Temperature

165 Degrees

Access Door Size

12x12

Pass / Fail / Abandoned

Pass

Comments / Corrections

None

Exterior Picture of Damper



Interior Picture of Damper



Picture of Damper I.D. Label



VISUAL CUYAHOGA COUNTY DAMPER INSPECTION REPORT

Date of Inspection

2022-08-10

Facility Location

Virgil E Brown Center

Damper Location

North mechanical room

Inspector Name

Julie Gue

Damper I.D. #

AHUL.1-RA

Damper Type

Vertical Fire Damper

Damper Size

96x32

Damper Manufacturer

Ruskin

Damper Model #

IBD2

Fusible Link Temperature

212 Degrees

Access Door Size

Open access

Pass / Fail / Abandoned

Pass

Comments / Corrections

None


Exterior Picture of Damper



Interior Picture of Damper



Picture of Damper I.D. Label



Duct Fabricators, Inc.

883 Addison Rd. Cleveland, Ohio
P: 216-391-2400 F: 216-391-2492

FIRE SAFETY DIVISION
NEMI Certified HVAC Fire Life Safety Technicians



VISUAL CUYAHOGA COUNTY DAMPER INSPECTION REPORT

Date of Inspection

2022-08-10

Facility Location

Virgil E Brown Center

Damper Location

South mechanical room

Inspector Name

Julie Gue

Damper I.D. #

AHULL 2- OA

Damper Type

Vertical Fire Damper

Damper Size

96x18

Damper Manufacturer

Ruskin

Damper Model #

IBD2

Fusible Link Temperature

212 Degrees

Access Door Size

16x16

Pass / Fail / Abandoned

Pass

Comments / Corrections

None

Exterior Picture of Damper



Interior Picture of Damper



Picture of Damper I.D. Label



VISUAL CUYAHOGA COUNTY DAMPER INSPECTION REPORT

Date of Inspection

2022-08-11

Facility Location

Virgil E Brown Center

Damper Location

Record room

Inspector Name

Julie Gue

Damper I.D. #

AHULL 2-S2

Damper Type

Vertical Fire Damper

Damper Size

18x12

Damper Manufacturer

Ruskin

Damper Model #

IBD2

Fusible Link Temperature

212 Degrees

Access Door Size

12x12

Pass / Fail / Abandoned

Pass

Comments / Corrections

None

Exterior Picture of Damper



Interior Picture of Damper



Picture of Damper I.D. Label



VISUAL CUYAHOGA COUNTY DAMPER INSPECTION REPORT

Date of Inspection

2022-08-11

Facility Location

Virgil E Brown Center

Damper Location

Break room

Inspector Name

Julie Gue

Damper I.D. #

AHULL 2-S3

Damper Type

Vertical Fire Damper

Damper Size

22x10

Damper Manufacturer

Ruskin

Damper Model #

IBD2

Fusible Link Temperature

212 Degrees

Access Door Size

18x18

Pass / Fail / Abandoned

Pass

Comments / Corrections

None


Exterior Picture of Damper



Interior Picture of Damper



Picture of Damper I.D. Label



Duct Fabricators, Inc.

883 Addison Rd. Cleveland, Ohio
P: 216-391-2400 F: 216-391-2492

FIRE SAFETY DIVISION
NEMI Certified HVAC Fire Life Safety Technicians



VISUAL CUYAHOGA COUNTY DAMPER INSPECTION REPORT

Date of Inspection

2022-08-10

Facility Location

Virgil E Brown Center

Damper Location

North mechanical room

Inspector Name

Julie Gue

Damper I.D.

AHULL.1-OA

Damper Type

Vertical Fire Damper

Damper Size

96x18

Damper Manufacturer

Ruskin

Damper Model

IBD2

Fusible Link Temperature

212 Degrees

Access Door Size

16x16

Pass / Fail / Abandoned

Pass

Comments / Corrections

None

Exterior Picture of Damper



Interior Picture of Damper



Picture of Damper I.D. Label



VISUAL CUYAHOGA COUNTY DAMPER INSPECTION REPORT

Date of Inspection

2022-08-11

Facility Location

Virgil E Brown Center

Damper Location

Northeast

Inspector Name

Julie Gue

Damper I.D. #

AHULL.1-S1

Damper Type

Vertical Fire Damper

Damper Size

8x12

Damper Manufacturer

Ruskin

Damper Model #

IBD2

Fusible Link Temperature

212 Degrees

Access Door Size

Open duct

Pass / Fail / Abandoned

Pass

Comments / Corrections

None

Exterior Picture of Damper



Interior Picture of Damper



Picture of Damper I.D. Label



Duct Fabricators, Inc.

883 Addison Rd. Cleveland, Ohio
P: 216-391-2400 F: 216-391-2492

FIRE SAFETY DIVISION

NEMI Certified HVAC Fire Life Safety Technicians



VISUAL CUYAHOGA COUNTY DAMPER INSPECTION REPORT

Date of Inspection

2022-08-11

Facility Location

Virgil E Brown Center

Damper Location

Northwest com room

Inspector Name

Julie Gue

Damper I.D.

AHULL.1-S2

Damper Type

Vertical Fire Damper

Damper Size

8x12

Damper Manufacturer

Ruskin

Damper Model

IBD2

Fusible Link Temperature

212 Degrees

Access Door Size

Open

Pass / Fail / Abandoned

Pass

Comments / Corrections

None


Exterior Picture of Damper



Interior Picture of Damper



Picture of Damper I.D. Label



VISUAL CUYAHOGA COUNTY DAMPER INSPECTION REPORT

Date of Inspection

2022-08-10

Facility Location

Virgil E Brown Center

Damper Location

South mechanical room

Inspector Name

Julie Gue

Damper I.D. #

AHULL.2-RA

Damper Type

Vertical Fire Damper

Damper Size

96x32

Damper Manufacturer

Ruskin

Damper Model #

IBD2

Fusible Link Temperature

212 Degrees

Access Door Size

Open duct

Pass / Fail / Abandoned

Pass

Comments / Corrections

None


Exterior Picture of Damper



Interior Picture of Damper



Picture of Damper I.D. Label



VISUAL CUYAHOGA COUNTY DAMPER INSPECTION REPORT

Date of Inspection
2022-08-11

Facility Location
Virgil E Brown Center

Damper Location
Southwest

Inspector Name
Julie Gue

Damper I.D. #
AHULL.2-S1

Damper Type
Vertical Fire Damper

Damper Size
24x12

Damper Manufacturer
Ruskin

Damper Model #
IBD2

Fusible Link Temperature
212 Degrees

Access Door Size
Open

Pass / Fail / Abandoned
Pass

Comments / Corrections
None

Exterior Picture of Damper



Interior Picture of Damper



Picture of Damper I.D. Label



VISUAL CUYAHOGA COUNTY DAMPER INSPECTION REPORT

Date of Inspection

2022-08-19

Facility Location

Virgil E Brown

Damper Location

File room

Inspector Name

Julie Gue

Damper I.D. #

AHULL.2-S4

Damper Type

Vertical Fire Damper

Damper Size

10" Round

Damper Manufacturer

Ruskin

Damper Model #

IBD2

Fusible Link Temperature

212 Degrees

Access Door Size

10" oval

Pass / Fail / Abandoned

Pass

Comments / Corrections

None


Exterior Picture of Damper



Interior Picture of Damper



Picture of Damper I.D. Label



VISUAL CUYAHOGA COUNTY DAMPER INSPECTION REPORT

Date of Inspection

2022-08-11

Facility Location

Virgil E Brown Center

Damper Location

Document room

Inspector Name

Julie Gue

Damper I.D. #

AHULL.2-S5

Damper Type

Vertical Fire Damper

Damper Size

28x12

Damper Manufacturer

Ruskin

Damper Model #

IBD2

Fusible Link Temperature

212 Degrees

Access Door Size

12x12

Pass / Fail / Abandoned

Pass

Comments / Corrections

None


Exterior Picture of Damper



Interior Picture of Damper



Picture of Damper I.D. Label



VISUAL CUYAHOGA COUNTY DAMPER INSPECTION REPORT

Date of Inspection

2022-08-11

Facility Location

Virgil E Brown Center

Damper Location

Southeast com room

Inspector Name

Julie Gue

Damper I.D. #

AHULL.2-S6

Damper Type

Vertical Fire Damper

Damper Size

8x12

Damper Manufacturer

Ruskin

Damper Model #

IBD2

Fusible Link Temperature

212 Degrees

Access Door Size

Open

Pass / Fail / Abandoned

Pass

Comments / Corrections

None


Exterior Picture of Damper



Interior Picture of Damper



Picture of Damper I.D. Label



VISUAL CUYAHOGA COUNTY DAMPER INSPECTION REPORT

Date of Inspection

2022-08-11

Facility Location

Virgil E Brown Center

Damper Location

Custodial office

Inspector Name

Julie Gue

Damper I.D. #

AHULL.2-S7

Damper Type

Vertical Fire Damper

Damper Size

8x8

Damper Manufacturer

Ruskin

Damper Model #

IBD2

Fusible Link Temperature

212 Degrees

Access Door Size

6x6

Pass / Fail / Abandoned

Pass

Comments / Corrections

None

Exterior Picture of Damper



Interior Picture of Damper



Picture of Damper I.D. Label



VISUAL CUYAHOGA COUNTY DAMPER INSPECTION REPORT

Date of Inspection

2022-08-04

Facility Location

Virgil E Brown Center

Damper Location

3rd floor mechanical room South

Inspector Name

Dan Tulcewicz

Damper I.D. #

EF 7-3

Damper Type

Horizontal Fire Damper

Damper Size

36x18

Damper Manufacturer

Ruskin

Damper Model #

IBD2

Fusible Link Temperature

212 Degrees

Access Door Size

24x24

Pass / Fail / Abandoned

Pass

Comments / Corrections

None


Exterior Picture of Damper



Interior Picture of Damper



Picture of Damper I.D. Label



VISUAL CUYAHOGA COUNTY DAMPER INSPECTION REPORT

Date of Inspection

2022-08-10

Facility Location

Virgil E Brown Center

Damper Location

South mechanical room

Inspector Name

Julie Gue

Damper I.D. #

EF7-1

Damper Type

Vertical Fire Damper

Damper Size

22x16

Damper Manufacturer

Ruskin

Damper Model #

IBD2

Fusible Link Temperature

212 Degrees

Access Door Size

18x18

Pass / Fail / Abandoned

Pass

Comments / Corrections

None

Exterior Picture of Damper



Interior Picture of Damper



Picture of Damper I.D. Label



VISUAL CUYAHOGA COUNTY DAMPER INSPECTION REPORT

Date of Inspection

2022-08-10

Facility Location

Virgil E Brown Center

Damper Location

South mechanical room

Inspector Name

Julie Gue

Damper I.D. #

EF7-2

Damper Type

Vertical Fire Damper

Damper Size

26x18

Damper Manufacturer

Ruskin

Damper Model #

IBD2

Fusible Link Temperature

212 Degrees

Access Door Size

20x20

Pass / Fail / Abandoned

Pass

Comments / Corrections

None


Exterior Picture of Damper



Interior Picture of Damper



Picture of Damper I.D. Label



Duct Fabricators, Inc.

883 Addison Rd. Cleveland, Ohio
P: 216-391-2400 F: 216-391-2492



NEMI Certified HVAC Fire Life Safety Technicians



VISUAL CUYAHOGA COUNTY DAMPER INSPECTION REPORT

Date of Inspection

2022-08-04

Facility Location

Virgil E Brown Center

Damper Location

3rd floor mechanical room South

Inspector Name

Dan Tulcewicz

Damper I.D.

EF7-3

Damper Type

Horizontal Fire Damper

Damper Size

36x18

Damper Manufacturer

Ruskin

Damper Model

IBD2

Fusible Link Temperature

212 Degrees

Access Door Size

24x24

Pass / Fail / Abandoned

Pass

Comments / Corrections

None


Exterior Picture of Damper



Interior Picture of Damper



Picture of Damper I.D. Label



Duct Fabricators, Inc.

883 Addison Rd. Cleveland, Ohio
P: 216-391-2400 F: 216-391-2492

FIRE SAFETY DIVISION
NEMI Certified HVAC Fire Life Safety Technicians



VISUAL CUYAHOGA COUNTY DAMPER INSPECTION REPORT

Date of Inspection

2022-07-26

Facility Location

Virgil E Brown Center

Damper Location

4th floor mechanical room South

Inspector Name

Dan Tulcewicz

Damper I.D. #

EF7-4

Damper Type

Horizontal Fire Damper

Damper Size

36x20

Damper Manufacturer

Ruskin

Damper Model #

IBD2

Fusible Link Temperature

212 Degrees

Access Door Size

24x24

Pass / Fail / Abandoned

Pass

Comments / Corrections

None


Exterior Picture of Damper



Interior Picture of Damper



Picture of Damper I.D. Label



VISUAL CUYAHOGA COUNTY DAMPER INSPECTION REPORT

Date of Inspection

2022-08-10

Facility Location

Virgil E Brown Center

Damper Location

South mechanical room

Inspector Name

Julie Gue

Damper I.D. #

EF7-GRD

Damper Type

Horizontal Fire Damper

Damper Size

20x14

Damper Manufacturer

Ruskin

Damper Model #

IBD2

Fusible Link Temperature

212 Degrees

Access Door Size

18x18

Pass / Fail / Abandoned

Pass

Comments / Corrections

None

Exterior Picture of Damper



Interior Picture of Damper



Picture of Damper I.D. Label



VISUAL CUYAHOGA COUNTY DAMPER INSPECTION REPORT

Date of Inspection

2022-07-25

Facility Location

Virgil E Brown Center

Damper Location

Penthouse South

Inspector Name

Dan Tulcewicz

Damper I.D. #

EF7-PH

Damper Type

Horizontal Fire Damper

Damper Size

48x18

Damper Manufacturer

Ruskin

Damper Model #

IBD2

Fusible Link Temperature

212 Degrees

Access Door Size

24x24

Pass / Fail / Abandoned

Pass

Comments / Corrections

None

Exterior Picture of Damper



Interior Picture of Damper



Picture of Damper I.D. Label



Duct Fabricators, Inc.

883 Addison Rd. Cleveland, Ohio
P: 216-391-2400 F: 216-391-2492



VISUAL CUYAHOGA COUNTY DAMPER INSPECTION REPORT

Date of Inspection

2022-07-25

Facility Location

Virgil E Brown Center

Damper Location

5th Floor Mechanical South

Inspector Name

Dan Tulcewicz

Damper I.D.

EF7-S5

Damper Type

Horizontal Fire Damper

Damper Size

40x20

Damper Manufacturer

Ruskin

Damper Model

IBD2

Fusible Link Temperature

212 Degrees

Access Door Size

24x24

Pass / Fail / Abandoned

Pass

Comments / Corrections

None

Exterior Picture of Damper



Interior Picture of Damper



Picture of Damper I.D. Label



VISUAL CUYAHOGA COUNTY DAMPER INSPECTION REPORT

Date of Inspection

2022-08-10

Facility Location

Virgil E Brown Center

Damper Location

North mechanical room

Inspector Name

Julie Gue

Damper I.D. #

EF10-1

Damper Type

Vertical Fire Damper

Damper Size

22x16

Damper Manufacturer

Ruskin

Damper Model #

IBD2

Fusible Link Temperature

212 Degrees

Access Door Size

18x18

Pass / Fail / Abandoned

Pass

Comments / Corrections

None


Exterior Picture of Damper



Interior Picture of Damper



Picture of Damper I.D. Label



VISUAL CUYAHOGA COUNTY DAMPER INSPECTION REPORT

Date of Inspection

2022-08-10

Facility Location

Virgil E Brown Center

Damper Location

Mechanical room

Inspector Name

Julie Gue

Damper I.D. #

EF10-2

Damper Type

Vertical Fire Damper

Damper Size

26x18

Damper Manufacturer

Ruskin

Damper Model #

IBD2

Fusible Link Temperature

212 Degrees

Access Door Size

20x20

Pass / Fail / Abandoned

Pass

Comments / Corrections

None


Exterior Picture of Damper



Interior Picture of Damper



Picture of Damper I.D. Label



Duct Fabricators, Inc.

883 Addison Rd. Cleveland, Ohio
P: 216-391-2400 F: 216-391-2492

FIRE SAFETY DIVISION

NEMI Certified HVAC Fire Life Safety Technicians



VISUAL CUYAHOGA COUNTY DAMPER INSPECTION REPORT

Date of Inspection

2022-08-04

Facility Location

Virgil E Brown Center

Damper Location

3rd floor mechanical room north

Inspector Name

Dan Tulcewicz

Damper I.D. #

EF10-3

Damper Type

Horizontal Fire Damper

Damper Size

36x18

Damper Manufacturer

Ruskin

Damper Model #

IBD2

Fusible Link Temperature

212 Degrees

Access Door Size

24x24

Pass / Fail / Abandoned

Pass

Comments / Corrections

None


Exterior Picture of Damper



Interior Picture of Damper



Picture of Damper I.D. Label



Duct Fabricators, Inc.

883 Addison Rd. Cleveland, Ohio
P: 216-391-2400 F: 216-391-2492



NEMI Certified HVAC Fire Life Safety Technicians

MEMBER



VISUAL CUYAHOGA COUNTY DAMPER INSPECTION REPORT

Date of Inspection

2022-07-26

Facility Location

Virgil E Brown Center

Damper Location

4th floor mechanical room north

Inspector Name

Dan Tulcewicz

Damper I.D.

EF10-4

Damper Type

Horizontal Fire Damper

Damper Size

36x20

Damper Manufacturer

Ruskin

Damper Model

IBD2

Fusible Link Temperature

212 Degrees

Access Door Size

18x18

Pass / Fail / Abandoned

Pass

Comments / Corrections

None


Exterior Picture of Damper



Interior Picture of Damper



Picture of Damper I.D. Label

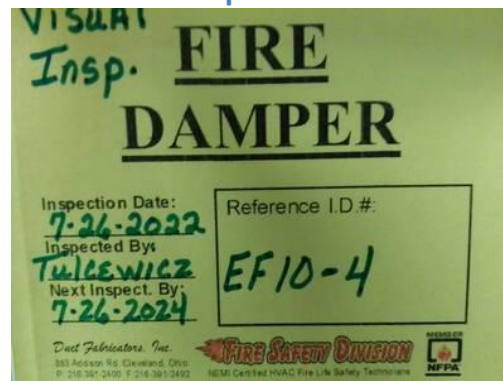

VISUAL CUYAHOGA COUNTY DAMPER INSPECTION REPORT

Date of Inspection

2022-07-25

Facility Location

Virgil E Brown Center

Damper Location

5th Floor Mechanical North

Inspector Name

Dan Tulcewicz

Damper I.D. #

EF10-5

Damper Type

Horizontal Fire Damper

Damper Size

40x20

Damper Manufacturer

Ruskin

Damper Model #

IBD2

Fusible Link Temperature

212 Degrees

Access Door Size

24x24

Pass / Fail / Abandoned

Pass

Comments / Corrections

None


Exterior Picture of Damper



Interior Picture of Damper



Picture of Damper I.D. Label



VISUAL CUYAHOGA COUNTY DAMPER INSPECTION REPORT

Date of Inspection

2022-08-10

Facility Location

Virgil E Brown Center

Damper Location

North mechanical room

Inspector Name

Julie Gue

Damper I.D. #

EF10-G

Damper Type

Horizontal Fire Damper

Damper Size

14x20

Damper Manufacturer

Ruskin

Damper Model #

IBD2

Fusible Link Temperature

212 Degrees

Access Door Size

18x18

Pass / Fail / Abandoned

Pass

Comments / Corrections

None


Exterior Picture of Damper



Interior Picture of Damper



Picture of Damper I.D. Label



VISUAL CUYAHOGA COUNTY DAMPER INSPECTION REPORT

Date of Inspection

2022-08-08

Facility Location

Virgil E Brown Center

Damper Location

Lower level mechanical room

Inspector Name

Julie Gue

Damper I.D. #

EF18-1

Damper Type

Vertical Fire Damper

Damper Size

12x12

Damper Manufacturer

Ruskin

Damper Model #

IBD2

Fusible Link Temperature

212 Degrees

Access Door Size

8x8

Pass / Fail / Abandoned

Pass

Comments / Corrections

None


Exterior Picture of Damper



Interior Picture of Damper



Picture of Damper I.D. Label



VISUAL CUYAHOGA COUNTY DAMPER INSPECTION REPORT

Date of Inspection

2022-08-08

Facility Location

Virgil E Brown Center

Damper Location

Lower level
Mechanical room

Inspector Name

Julie Gue

Damper I.D. #

EF18-OA

Damper Type

Vertical Fire Damper

Damper Size

40x24

Damper Manufacturer

Ruskin

Damper Model #

IBD2

Fusible Link Temperature

165 Degrees

Access Door Size

18x18

Pass / Fail / Abandoned

Pass

Comments / Corrections

None


Exterior Picture of Damper



Interior Picture of Damper



Picture of Damper I.D. Label

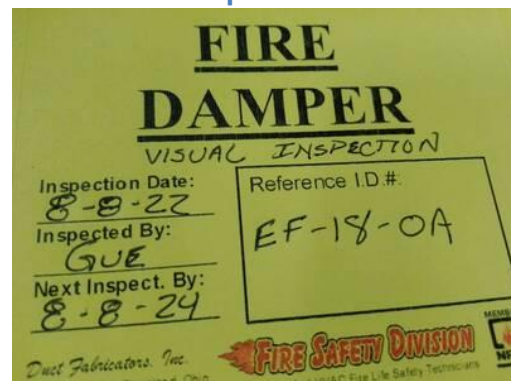

VISUAL CUYAHOGA COUNTY DAMPER INSPECTION REPORT

Date of Inspection

2022-08-08

Facility Location

Virgil E Brown Center

Damper Location

Lower level

Inspector Name

Julie Gue

Damper I.D. #

EF-25-1

Damper Type

Vertical Fire Damper

Damper Size

12x12

Damper Manufacturer

Ruskin

Damper Model #

IBD2

Fusible Link Temperature

212 Degrees

Access Door Size

10x8

Pass / Fail / Abandoned

Pass

Comments / Corrections

None


Exterior Picture of Damper



Interior Picture of Damper



Picture of Damper I.D. Label



Duct Fabricators, Inc.

883 Addison Rd. Cleveland, Ohio
P: 216-391-2400 F: 216-391-2492

FIRE SAFETY DIVISION

NEMI Certified HVAC Fire Life Safety Technicians



VISUAL CUYAHOGA COUNTY DAMPER INSPECTION REPORT

Date of Inspection

2022-08-11

Facility Location

Virgil E Brown Center

Damper Location

Mechanical room

Inspector Name

Julie Gue

Damper I.D. #

LL RA3

Damper Type

Vertical Fire Damper

Damper Size

24x24

Damper Manufacturer

Ruskin

Damper Model #

IBD2

Fusible Link Temperature

212 Degrees

Access Door Size

Grille

Pass / Fail / Abandoned

Pass

Comments / Corrections

None


Exterior Picture of Damper



Interior Picture of Damper



Picture of Damper I.D. Label



VISUAL CUYAHOGA COUNTY DAMPER INSPECTION REPORT

Date of Inspection

2022-08-08

Facility Location

Virgil E Brown Center

Damper Location

Mechanical room

Inspector Name

Julie Gue

Damper I.D. #

LL-RA 4

Damper Type

Vertical Fire Damper

Damper Size

60x84

Damper Manufacturer

Ruskin

Damper Model #

IBD2

Fusible Link Temperature

212 Degrees

Access Door Size

Grille access

Pass / Fail / Abandoned

Pass

Comments / Corrections

None


Exterior Picture of Damper



Interior Picture of Damper



Picture of Damper I.D. Label



Duct Fabricators, Inc.

883 Addison Rd. Cleveland, Ohio
P: 216-391-2400 F: 216-391-2492

FIRE SAFETY DIVISION
NEMI Certified HVAC Fire Life Safety Technicians



VISUAL CUYAHOGA COUNTY DAMPER INSPECTION REPORT

Date of Inspection

2022-08-08

Facility Location

Virgil E Brown Center

Damper Location

Lower level mechanical room

Inspector Name

Julie Gue

Damper I.D. #

LL-RA1

Damper Type

Vertical Fire Damper

Damper Size

24x28

Damper Manufacturer

Ruskin

Damper Model #

IBD2

Fusible Link Temperature

212 Degrees

Access Door Size

Grille access

Pass / Fail / Abandoned

Pass

Comments / Corrections

None


Exterior Picture of Damper



Interior Picture of Damper



Picture of Damper I.D. Label



VISUAL CUYAHOGA COUNTY DAMPER INSPECTION REPORT

Date of Inspection

2022-08-11

Facility Location

Virgil E Brown Center

Damper Location

Mechanical room

Inspector Name

Julie Gue

Damper I.D. #

LL-RA2

Damper Type

Vertical Fire Damper

Damper Size

48x60

Damper Manufacturer

Ruskin

Damper Model #

IBD2

Fusible Link Temperature

212 Degrees

Access Door Size

Grille access

Pass / Fail / Abandoned

Pass

Comments / Corrections

None

Exterior Picture of Damper



Interior Picture of Damper



Picture of Damper I.D. Label



Duct Fabricators, Inc.

883 Addison Rd. Cleveland, Ohio
P: 216-391-2400 F: 216-391-2492



NEMI Certified HVAC Fire Life Safety Technicians



VISUAL CUYAHOGA COUNTY DAMPER INSPECTION REPORT

Date of Inspection

2022-08-08

Facility Location

Virgil E Brown Center

Damper Location

Lower level mechanical room

Inspector Name

Julie Gue

Damper I.D.

LL-RA4

Damper Type

Vertical Fire Damper

Damper Size

60x84

Damper Manufacturer

Ruskin

Damper Model

IBD2

Fusible Link Temperature

165 Degrees

Access Door Size

Grille access

Pass / Fail / Abandoned

Pass

Comments / Corrections

None

Exterior Picture of Damper



Interior Picture of Damper



Picture of Damper I.D. Label

FIRE DAMPER	
VISUAL INSPECTION	
Inspection Date: 8-8-22	Reference I.D.#
Inspected By: GUE	LL-RA4
Next Inspect. By: 8-8-24	

Duct Fabricators, Inc.
883 Addison Rd. Cleveland, Ohio
P: 216-391-2400 F: 216-391-2492

FIRE SAFETY DIVISION
NEMI Certified HVAC Fire Life Safety Technicians

MEMBER
NFPA

Duct Fabricators, Inc.

883 Addison Rd. Cleveland, Ohio
P: 216-391-2400 F: 216-391-2492



NEMI Certified HVAC Fire Life Safety Technicians



VISUAL CUYAHOGA COUNTY DAMPER INSPECTION REPORT

Date of Inspection

2022-08-08

Facility Location

Virgil E Brown Center

Damper Location

Lower level mechanical room

Inspector Name

Julie Gue

Damper I.D. #

LL-TA-1

Damper Type

Vertical Fire Damper

Damper Size

48x18

Damper Manufacturer

Ruskin

Damper Model #

IBD2

Fusible Link Temperature

165 Degrees

Access Door Size

Screen access

Pass / Fail / Abandoned

Pass

Comments / Corrections

None


Exterior Picture of Damper



Interior Picture of Damper



Picture of Damper I.D. Label



Duct Fabricators, Inc.

883 Addison Rd. Cleveland, Ohio
P: 216-391-2400 F: 216-391-2492



NEMI Certified HVAC Fire Life Safety Technicians



VISUAL CUYAHOGA COUNTY DAMPER INSPECTION REPORT

Date of Inspection

2022-08-08

Facility Location

Virgil E Brown Center

Damper Location

Lower level mechanical room

Inspector Name

Julie Gue

Damper I.D.

LL-TA-2

Damper Type

Vertical Fire Damper

Damper Size

12x12

Damper Manufacturer

Ruskin

Damper Model

IBD2

Fusible Link Temperature

165 Degrees

Access Door Size

Screen access

Pass / Fail / Abandoned

Pass

Comments / Corrections

None


Exterior Picture of Damper



Interior Picture of Damper



Picture of Damper I.D. Label



VISUAL CUYAHOGA COUNTY DAMPER INSPECTION REPORT

Date of Inspection

2022-07-25

Facility Location

Virgil E Brown Center

Damper Location

Penthouse North

Inspector Name

Dan Tulcewicz

Damper I.D. #

PH.1-RA

Damper Type

Vertical Fire Damper

Damper Size

108x48

Damper Manufacturer

Ruskin

Damper Model #

IBD2

Fusible Link Temperature

165 Degrees

Access Door Size

24x24

Pass / Fail / Abandoned

Pass

Comments / Corrections

None

Exterior Picture of Damper



Interior Picture of Damper



Picture of Damper I.D. Label



VISUAL CUYAHOGA COUNTY DAMPER INSPECTION REPORT

Date of Inspection

2022-07-25

Facility Location

Virgil E Brown Center

Damper Location

Penthouse South

Inspector Name

Dan Tulcewicz

Damper I.D. #

PH.2-OA1

Damper Type

Vertical Fire Damper

Damper Size

114x48

Damper Manufacturer

Ruskin

Damper Model #

IBD2

Fusible Link Temperature

212 Degrees

Access Door Size

24x20

Pass / Fail / Abandoned

Pass

Comments / Corrections

None

Exterior Picture of Damper



Interior Picture of Damper



Picture of Damper I.D. Label



VISUAL CUYAHOGA COUNTY DAMPER INSPECTION REPORT

Date of Inspection

2022-07-25

Facility Location

Virgil E Brown Center

Damper Location

Penthouse South

Inspector Name

Dan Tulcewicz

Damper I.D. #

PH.2-OA2

Damper Type

Vertical Fire Damper

Damper Size

96x48

Damper Manufacturer

Ruskin

Damper Model #

IBD2

Fusible Link Temperature

212 Degrees

Access Door Size

24x20

Pass / Fail / Abandoned

Pass

Comments / Corrections

None

Exterior Picture of Damper



Interior Picture of Damper



Picture of Damper I.D. Label



Duct Fabricators, Inc.

883 Addison Rd. Cleveland, Ohio
P: 216-391-2400 F: 216-391-2492



NEMI Certified HVAC Fire Life Safety Technicians



VISUAL CUYAHOGA COUNTY DAMPER INSPECTION REPORT

Date of Inspection

2022-07-29

Facility Location

Virgil E Brown Center

Damper Location

Elevator room penthouse South

Inspector Name

Dan Tulcewicz

Damper I.D.

PH.2-OA-3

Damper Type

Vertical Fire Damper

Damper Size

48x48

Damper Manufacturer

Ruskin

Damper Model

Unknown

Fusible Link Temperature

212 Degrees

Access Door Size

Thru the grill

Pass / Fail / Abandoned

Pass

Comments / Corrections

None


Exterior Picture of Damper



Interior Picture of Damper



Picture of Damper I.D. Label



VISUAL CUYAHOGA COUNTY DAMPER INSPECTION REPORT

Date of Inspection

2022-07-25

Facility Location

Virgil E Brown Center

Damper Location

Penthouse South

Inspector Name

Dan Tulcewicz

Damper I.D. #

PH.2-RA

Damper Type

Vertical Fire Damper

Damper Size

108x48

Damper Manufacturer

Ruskin

Damper Model #

IBD2

Fusible Link Temperature

212 Degrees

Access Door Size

24x24

Pass / Fail / Abandoned

Pass

Comments / Corrections

None


Exterior Picture of Damper



Interior Picture of Damper



Picture of Damper I.D. Label



Report Date: September 2, 2022

Project: Virgil E Brown

Inspector(s): Julie Gue, Certified Technician
Dan Tulcewicz, Certified, Technician

Inspection and Test Date(s):

- July 18, 2022 – August 26, 2022

Duct Fabricators, Inc. "Fire Safety Division" Visually inspected Two hundred and fifty-nine fire dampers for proper installation. The dampers were then visually inspected and photographed exteriorly and interiorly to confirm that the dampers are in proper working condition.

All 259 dampers have passed inspection

NOTES: NFPA 80, NFPA 101 and NFPA 105 require newly installed dampers to be inspected and tested one year after initial installation. Thereafter, dampers are to be visually inspected every two years and functionally tested every four years.

Additionally, the information contained herein verified whether the dampers were functional at the time of testing. This verification process does not represent any form of a guarantee that the dampers will properly perform in the future.

Duct Fabricators, Inc.
 883 Addison Rd. Cleveland, Ohio
 P: 216-391-2400 F: 216-391-2492



Fire / Smoke / Fire & Smoke Damper
Composite Inspection Report

	<u>FD/SD/FSD</u>	<u>I.D.#</u>	<u>Size</u>	<u>Manufacturer</u>	<u>Model</u>	<u>Visual</u>	<u>Functional</u>	<u>Comments</u>
1	FD	AHU1.1-S1	56x16	Ruskin	IBD2	Pass	N/A	None
2	FD	AHU1.1-S2	56x16	Ruskin	IBD2	Pass	N/A	None
3	FD	AHU1.1-S3	8x10	Ruskin	IBD2	Pass	N/A	None
4	FD	AHU1.1-S4	8x10	Ruskin	IBD2	Pass	N/A	None
5	FD	AHU1.1-S5	11x8 Oval	Ruskin	IBD2	Pass	N/A	None
6	FD	AHU1.1-S6	56x16	Ruskin	IBD2	Pass	N/A	None
7	FD	AHU1.1-S7	56x16	Ruskin	IBD2	Pass	N/A	None
8	FD	AHU1.1-S8	6" round	Ruskin	IBD2	Pass	N/A	None
9	FD	AHU1.1-S9	56x16	Ruskin	IBD2	Pass	N/A	None
10	FD	AHU1.1-S10	8x10	Ruskin	IBD2	Pass	N/A	None
11	FD	AHU1.1-S11	56x16	Ruskin	IBD2	Pass	N/A	None
12	FD	AHU1.1-OA	96x24	Ruskin	IBD2	Pass	N/A	None
13	FD	AHU1.1-RA	96x60	Ruskin	IBD2	Pass	N/A	None
14	FD	AHU1.2-S1	36x8	Ruskin	IBD2	Pass	N/A	None
15	FD	AHU1.2-S2	36x8	Ruskin	IBD2	Pass	N/A	None
16	FD	AHU1.2-S3	56x16	Ruskin	IBD2	Pass	N/A	None
17	FD	AHU1.2-S4	56x16	Ruskin	IBD2	Pass	N/A	None
18	FD	AHU1.2-S5	8x10	Ruskin	IBD2	Pass	N/A	None
19	FD	AHU1.2-S6	17x8 oval	Ruskin	IBD2	Pass	N/A	None
20	FD	AHU1.2-S7	17x8 oval	Ruskin	IBD2	Pass	N/A	None

Inspector: Julie Gue/ Dan Tulcewicz
Inspection Dates: July 18, 2022 - August 26, 2022
Facility: Virgil E Brown

SA = Supply Air FD = Fire Damper
 RA = Relief Air EF = Exhaust Fan
 OA = Outside Air TA = Transfer Air

Duct Fabricators, Inc.
 883 Addison Rd. Cleveland, Ohio
 P: 216-391-2400 F: 216-391-2492



Fire / Smoke / Fire & Smoke Damper
Composite Inspection Report

	<u>FD/SD/FSD</u>	<u>I.D.#</u>	<u>Size</u>	<u>Manufacturer</u>	<u>Model</u>	<u>Visual</u>	<u>Functional</u>	<u>Comments</u>
21	FD	AHU1.2-S8	14x8 oval	Ruskin	IBD2	Pass	N/A	None
22	FD	AHU1.2-S9	17x8 oval	Ruskin	IBD2	Pass	N/A	None
23	FD	AHU1.2-S10	16x10	Ruskin	IBD2	Pass	N/A	None
24	FD	AHU1.2-S11	36x16	Ruskin	IBD2	Pass	N/A	None
25	FD	AHU1.2-S12	42x16	Ruskin	IBD2	Pass	N/A	None
26	FD	AHU1.2-S13	42x16	Ruskin	IBD2	Pass	N/A	None
27	FD	AHU1.2-S14	36x16	Ruskin	IBD2	Pass	N/A	None
28	FD	AHU1.2-S15	28x10	Ruskin	IBD2	Pass	N/A	None
29	FD	AHU1.2-S16	8" Round	Ruskin	IBD2	Pass	N/A	None
30	FD	AHU1.2-S17	18x10	Ruskin	IBD2	Pass	N/A	None
31	FD	AHU1.2-S18	20x8	Ruskin	IBD2	Pass	N/A	None
32	FD	AHU1.2-S19	8x10	Ruskin	IBD2	Pass	N/A	None
33	FD	AHU1.2-S20	56x16	Ruskin	IBD2	Pass	N/A	None
34	FD	AHU1.2-S21	8" Round	Ruskin	IBD2	Pass	N/A	None
35	FD	AHU1.2-OA	96x24	Ruskin	IBD2	Pass	N/A	None
36	FD	AHU1.2-RA	96x60	Ruskin	IBD2	Pass	N/A	None

Inspector: Julie Gue/ Dan Tulcewicz
Inspection Dates: July 20, 2022 - August 26, 2022
Facility: Virgil E Brown

SA = Supply Air FD = Fire Damper
 RA = Relief Air EF = Exhaust Fan
 OA = Outside Air TA = Transfer Air

Duct Fabricators, Inc.
 883 Addison Rd. Cleveland, Ohio
 P: 216-391-2400 F: 216-391-2492



Fire / Smoke / Fire & Smoke Damper
Composite Inspection Report

	<u>FD/SD/FSD</u>	<u>I.D.#</u>	<u>Size</u>	<u>Manufacturer</u>	<u>Model</u>	<u>Visual</u>	<u>Functional</u>	<u>Comments</u>
37	FD	AHU2.1-S1	56x16	Ruskin	IBD2	Pass	N/A	None
38	FD	AHU2.1-S2	12" oval	Ruskin	IBD2	Pass	N/A	None
39	FD	AHU2.1-S3	56x16	Ruskin	IBD2	Pass	N/A	None
40	FD	AHU2.1-S4	8x10	Ruskin	IBD2	Pass	N/A	None
41	FD	AHU2.1-S5	6"round	Ruskin	IBD2	Pass	N/A	None
42	FD	AHU2.1-S6	20x8 oval	Ruskin	IBD2	Pass	N/A	None
43	FD	AHU2.1-S7	28x10	Ruskin	IBD2	Pass	N/A	None
44	FD	AHU2.1-S8	6" Round	Ruskin	IBD2	Pass	N/A	None
45	FD	AHU2.1-S9	10" Round	Ruskin	IBD2	Pass	N/A	None
46	FD	AHU2.1-S10	8" Round	Ruskin	IBD2	Pass	N/A	None
47	FD	AHU2.1-S11	34x19	Ruskin	IBD2	Pass	N/A	None
48	FD	AHU2.1-S12	20x8 oval	Ruskin	IBD2	Pass	N/A	None
49	FD	AHU2.1-S13	6" Round	Ruskin	IBD2	Pass	N/A	None
50	FD	AHU2.1-S14	56x16	Ruskin	IBD2	Pass	N/A	None
51	FD	AHU2.1-S15	8x10	Ruskin	IBD2	Pass	N/A	None
52	FD	AHU2.1-S16	56x16	Ruskin	IBD2	Pass	N/A	None
53	FD	AHU2.1-OA	96x24	Ruskin	IBD2	Pass	N/A	None
54	FD	AHU2.1-RA	96x60	Ruskin	IBD2	Pass	N/A	None
55	FD	AHU2.2-S1	38x8	Ruskin	IBD2OW	Pass	N/A	None
56	FD	AHU2.2-S2	38x8	Ruskin	IBD2OW	Pass	N/A	None

Inspector: Julie Gue/ Dan Tulcewicz
Inspection Dates: July 25, 2022 - August 26, 2022
Facility: Virgil E Brown

SA = Supply Air FD = Fire Damper
 RA = Relief Air EF = Exhaust Fan
 OA = Outside Air TA = Transfer Air

Duct Fabricators, Inc.
 883 Addison Rd. Cleveland, Ohio
 P: 216-391-2400 F: 216-391-2492



Fire / Smoke / Fire & Smoke Damper
Composite Inspection Report

	<u>FD/SD/FSD</u>	<u>I.D.#</u>	<u>Size</u>	<u>Manufacturer</u>	<u>Model</u>	<u>Visual</u>	<u>Functional</u>	<u>Comments</u>
57	FD	AHU2.2-S3	56x16	Ruskin	IBD2	Pass	N/A	None
58	FD	AHU2.2-S4	56x16	Ruskin	IBD2	Pass	N/A	None
59	FD	AHU2.2-S5	8x10	Ruskin	IBD2	Pass	N/A	None
60	FD	AHU2.2-S6	6" Round	Ruskin	IBD2	Pass	N/A	None
61	FD	AHU2.2-S7	16" Oval	Ruskin	IBD2	Pass	N/A	None
62	FD	AHU2.2-S8	6" Round	Ruskin	IBD2	Pass	N/A	None
63	FD	AHU2.2-S9	32x10	Ruskin	IBD2	Pass	N/A	None
64	FD	AHU2.2-S10	12" Round	Ruskin	IBD2	Pass	N/A	None
65	FD	AHU2.2-S11	12" Oval	Ruskin	IBD2	Pass	N/A	None
66	FD	AHU2.2-S12	34x10	Ruskin	IBD2	Pass	N/A	None
67	FD	AHU2.2-S13	6" Round	Ruskin	IBD2	Pass	N/A	None
68	FD	AHU2.2-S14	6" Round	Ruskin	IBD2	Pass	N/A	None
69	FD	AHU2.2-S15	56x16	Ruskin	IBD2	Pass	N/A	None
70	FD	AHU2.2-S16	8x10	Ruskin	IBD2	Pass	N/A	None
71	FD	AHU2.2-S17	56x16	Ruskin	IBD2	Pass	N/A	None
72	FD	AHU2.2-S18	18x10	Ruskin	IBD2	Pass	N/A	None
73	FD	AHU2.2-OA	96x24	Ruskin	IBD2	Pass	N/A	None
74	FD	AHU2.2-RA	96x60	Ruskin	IBD2	Pass	N/A	None

Inspector: Julie Gue / Dan Tulcewicz
Inspection Dates: July 25, 2022 - August 26, 2022
Facility: Virgil E Brown

SA = Supply Air FD = Fire Damper
 RA = Relief Air EF = Exhaust Fan
 OA = Outside Air TA = Transfer Air

Duct Fabricators, Inc.
 883 Addison Rd. Cleveland, Ohio
 P: 216-391-2400 F: 216-391-2492



Fire / Smoke / Fire & Smoke Damper
Composite Inspection Report

	<u>FD/SD/FSD</u>	<u>I.D.#</u>	<u>Size</u>	<u>Manufacturer</u>	<u>Model</u>	<u>Visual</u>	<u>Functional</u>	<u>Comments</u>
75	FD	AHU3.1-S1	56x16	Ruskin	IBD2	Pass	N/A	None
76	FD	AHU3.1-S2	56x16	Ruskin	IBD2	Pass	N/A	None
77	FD	AHU3.1-S3	56x16	Ruskin	IBD2	Pass	N/A	None
78	FD	AHU3.1-S4	8"Round	Ruskin	IBD2	Pass	N/A	None
79	FD	AHU3.1-S5	40x12	Ruskin	IBD2	Pass	N/A	None
80	FD	AHU3.1-S6	56x12	Ruskin	IBD2	Pass	N/A	None
81	FD	AHU3.1-S7	56x16	Ruskin	IBD2	Pass	N/A	None
82	FD	AHU3.1-S8	20x10	Ruskin	IBD2	Pass	N/A	None
83	FD	AHU3.1-S9	16" oval	Ruskin	IBD2	Pass	N/A	None
84	FD	AHU3.1-S10	6" Round	Ruskin	IBD2	Pass	N/A	None
85	FD	AHU3.1-S11	56x16	Ruskin	IBD2	Pass	N/A	None
86	FD	AHU3.1-S12	8x10	Ruskin	IBD2	Pass	N/A	None
87	FD	AHU3.1-S13	56x16	Ruskin	IBD2	Pass	N/A	None
88	FD	AHU3.1-S14	20x10	Ruskin	IBD2	Pass	N/A	None
89	FD	AHU3.1-OA	96x24	Ruskin	IBD2	Pass	N/A	None
90	FD	AHU3.1-RA	96x60	Ruskin	IBD2	Pass	N/A	None
91	FD	AHU3.2-S1	36x8	Ruskin	IBD2OW	Pass	N/A	None
92	FD	AHU3.2-S2	36x8	Ruskin	IBD2OW	Pass	N/A	None
93	FD	AHU3.2-S3	56x16	Ruskin	IBD2	Pass	N/A	None
94	FD	AHU3.2-S4	56x16	Ruskin	IBD2	Pass	N/A	None

Inspector: Julie Gue / Dan Tulcewicz
Inspection Dates: July 25, 2022 - August 26, 2022
Facility: Virgil E Brown

SA = Supply Air FD = Fire Damper
 RA = Relief Air EF = Exhaust Fan
 OA = Outside Air

Duct Fabricators, Inc.
 883 Addison Rd. Cleveland, Ohio
 P: 216-391-2400 F: 216-391-2492



Fire / Smoke / Fire & Smoke Damper
Composite Inspection Report

	<u>FD/SD/FSD</u>	<u>I.D.#</u>	<u>Size</u>	<u>Manufacturer</u>	<u>Model</u>	<u>Visual</u>	<u>Functional</u>	<u>Comments</u>
95	FD	AHU3.2-S5	8x10	Ruskin	IBD2	Pass	N/A	None
96	FD	AHU3.2-S6	14x8 Oval	Ruskin	IBD2	Pass	N/A	None
97	FD	AHU3.2-S7	6" Round	Ruskin	IBD2	Pass	N/A	None
98	FD	AHU3.2-S8	56x16	Ruskin	IBD2	Pass	N/A	None
99	FD	AHU3.2-S9	56x16	Ruskin	IBD2	Pass	N/A	None
100	FD	AHU3.2-S10	56x16	Ruskin	IBD2	Pass	N/A	None
101	FD	AHU3.2-S11	6" Round	Ruskin	IBD2	Pass	N/A	None
102	FD	AHU3.2-S12	56x16	Ruskin	IBD2	Pass	N/A	None
103	FD	AHU3.2-S13	8x10	Ruskin	IBD2	Pass	N/A	None
104	FD	AHU3.2-S14	56x16	Ruskin	IBD2	Pass	N/A	None
105	FD	AHU3.2-S15	14" oval	Ruskin	IBD2	Pass	N/A	None
106	FD	AHU3.2-S16	14" oval	Ruskin	IBD2	Pass	N/A	None
107	FD	AHU3.2-OA	96x34	Ruskin	IBD2	Pass	N/A	None
108	FD	AHU3.2-RA	96x60	Ruskin	IBD2	Pass	N/A	None

Inspector: Julie Gue / Dan Tulcewicz
Inspection Dates: July 25, 2022 - August 26, 2022
Facility: Virgil E Brown

SA = Supply Air FD = Fire Damper
 RA = Relief Air EF = Exhaust Fan
 OA = Outside Air

Duct Fabricators, Inc.
 883 Addison Rd. Cleveland, Ohio
 P: 216-391-2400 F: 216-391-2492



Fire / Smoke / Fire & Smoke Damper
Composite Inspection Report

	<u>FD/SD/FSD</u>	<u>I.D.#</u>	<u>Size</u>	<u>Manufacturer</u>	<u>Model</u>	<u>Visual</u>	<u>Functional</u>	<u>Comments</u>
109	FD	AHU4.1-S1	56x16	Ruskin	IBD2	Pass	N/A	None
110	FD	AHU4.1-S2	56x16	Ruskin	IBD2	Pass	N/A	None
111	FD	AHU4.1-S3	8x10	Ruskin	IBD2	Pass	N/A	None
112	FD	AHU4.1-S4	5" Round	Ruskin	IBD2	Pass	N/A	None
113	FD	AHU4.1-S5	16" Oval	Ruskin	IBD2	Pass	N/A	None
114	FD	AHU4.1-S6	56x16	Ruskin	IBD2	Pass	N/A	None
115	FD	AHU4.1-S7	56x16	Ruskin	IBD2	Pass	N/A	None
116	FD	AHU4.1-S8	8" Round	Ruskin	IBD2	Pass	N/A	None
117	FD	AHU4.1-S9	16" oval	Ruskin	IBD2	Pass	N/A	None
118	FD	AHU4.1-S10	56x16	Ruskin	IBD2	Pass	N/A	None
119	FD	AHU4.1-S11	8x10	Ruskin	IBD2	Pass	N/A	None
120	FD	AHU4.1-S12	56x16	Ruskin	IBD2	Pass	N/A	None
121	FD	AHU4.1-OA	96x24	Ruskin	IBD2	Pass	N/A	None
122	FD	AHU4.1-RA	96x60	Ruskin	IBD2	Pass	N/A	None
123	FD	AHU4.2-S1	56x16	Ruskin	IBD2	Pass	N/A	None
124	FD	AHU4.2-S2	56x16	Ruskin	IBD2	Pass	N/A	None
125	FD	AHU4.2-S3	8x10	Ruskin	IBD2	Pass	N/A	None
126	FD	AHU4.2-S4	56x16	Ruskin	IBD2	Pass	N/A	None
127	FD	AHU4.2-S5	16" oval	Ruskin	IBD2	Pass	N/A	None
128	FD	AHU4.2-S6	6" Round	Ruskin	IBD2	Pass	N/A	None

Inspector: Julie Gue / Dan Tulcewicz
Inspection Dates: July 25, 2022 - August 26, 2022
Facility: Virgil E Brown

SA = Supply Air FD = Fire Damper
 RA = Relief Air EF = Exhaust Fan
 OA = Outside Air TA = Transfer Air

Duct Fabricators, Inc.
 883 Addison Rd. Cleveland, Ohio
 P: 216-391-2400 F: 216-391-2492



Fire / Smoke / Fire & Smoke Damper
Composite Inspection Report

	<u>FD/SD/FSD</u>	<u>I.D.#</u>	<u>Size</u>	<u>Manufacturer</u>	<u>Model</u>	<u>Visual</u>	<u>Functional</u>	<u>Comments</u>
129	FD	AHU4.2-S7	56x16	Ruskin	IBD2	Pass	N/A	None
130	FD	AHU4.2-S8	8x10	Ruskin	IBD2	Pass	N/A	None
131	FD	AHU4.2-S9	56x16	Ruskin	IBD2	Pass	N/A	None
132	FD	AHU4.2-S10	56x16	Ruskin	IBD2	Pass	N/A	None
133	FD	AHU4.2-S11	36x8	Ruskin	IBD2OW	Pass	N/A	None
134	FD	AHU4.2-S12	36x8	Ruskin	IBD2OW	Pass	N/A	None
135	FD	AHU4.2-OA	96x24	Ruskin	IBD2	Pass	N/A	None
136	FD	AHU4.2-RA	96x60	Ruskin	IBD2	Pass	N/A	None

Inspector: Julie Gue / Dan Tulcewicz
Inspection Dates: July 25, 2022 - August 26, 2022
Facility: Virgil E Brown

SA = Supply Air FD = Fire Damper
 RA = Relief Air EF = Exhaust Fan
 OA = Outside Air

Duct Fabricators, Inc.
 883 Addison Rd. Cleveland, Ohio
 P: 216-391-2400 F: 216-391-2492



Fire / Smoke / Fire & Smoke Damper
Composite Inspection Report

	<u>FD/SD/FSD</u>	<u>I.D.#</u>	<u>Size</u>	<u>Manufacturer</u>	<u>Model</u>	<u>Visual</u>	<u>Functional</u>	<u>Comments</u>
137	FD	AHU5.1-S1	56x18	Ruskin	IBD2	Pass	N/A	None
138	FD	AHU5.1-S2	56x18	Ruskin	IBD2	Pass	N/A	None
139	FD	AHU5.1-S3	36x18	Ruskin	IBD2	Pass	N/A	None
140	FD	AHU5.1-S4	36x18	Ruskin	IBD2	Pass	N/A	None
141	FD	AHU5.1-S5	56x18	Ruskin	IBD2	Pass	N/A	None
142	FD	AHU5.1-S6	56x18	Ruskin	IBD2	Pass	N/A	None
143	FD	AHU5.1-S7	8x10	Ruskin	IBD2	Pass	N/A	None
144	FD	AHU5.1-S8	8x10	Ruskin	IBD2	Pass	N/A	None
145	FD	AHU5.1-S9	10" Oval	Ruskin	IBD2	Pass	N/A	None
146	FD	AHU5.1-S10	40x10	Ruskin	IBD2	Pass	N/A	None
147	FD	AHU5.1-S11	34x10	Ruskin	IBD2	Pass	N/A	None
148	FD	AHU5.1-S12	10" oval	Ruskin	IBD2	Pass	N/A	None
149	FD	AHU5.1-S13	34x10	Ruskin	IBD2	Pass	N/A	None
150	FD	AHU5.1-OA	96x36	Ruskin	IBD2	Pass	N/A	None
151	FD	AHU5.1-RA	96x84	Ruskin	IBD2	Pass	N/A	None
152	FD	AHU5.2-S1	56x18	Ruskin	IBD2	Pass	N/A	None
153	FD	AHU5.2-S2	56x18	Ruskin	IBD2	Pass	N/A	None
154	FD	AHU5.2-S3	36x18	Ruskin	IBD2	Pass	N/A	None
155	FD	AHU5.2-S4	36x18	Ruskin	IBD2	Pass	N/A	None
156	FD	AHU5.2-S5	56x18	Ruskin	IBD2	Pass	N/A	None

Inspector: Julie Gue / Dan Tulcewicz
Inspection Dates: July 25, 2022 - August 26, 2022
Facility: Virgil E Brown

SA = Supply Air FD = Fire Damper
 RA = Relief Air EF = Exhaust Fan
 OA = Outside Air TA = Transfer Air

Duct Fabricators, Inc.
 883 Addison Rd. Cleveland, Ohio
 P: 216-391-2400 F: 216-391-2492



Fire / Smoke / Fire & Smoke Damper
Composite Inspection Report

	<u>FD/SD/FSD</u>	<u>I.D.#</u>	<u>Size</u>	<u>Manufacturer</u>	<u>Model</u>	<u>Visual</u>	<u>Functional</u>	<u>Comments</u>
157	FD	AHU5.2-S6	56x18	Ruskin	IBD2	Pass	N/A	None
158	FD	AHU5.2-S7	8x10	Ruskin	IBD2	Pass	N/A	None
159	FD	AHU5.2-S8	8x10	Ruskin	IBD2	Pass	N/A	None
160	FD	AHU5.2-S9	16" oval	Ruskin	IBD2	Pass	N/A	None
161	FD	AHU5.2-S10	16" oval	Ruskin	IBD2	Pass	N/A	None
162	FD	AHU5.2-S11	8" oval	Ruskin	IBD2	Pass	N/A	None
163	FD	AHU5.2-S12	44x12	Ruskin	IBD2	Pass	N/A	None
164	FD	AHU5.2-S13	45x10	Ruskin	IBD2	Pass	N/A	None
165	FD	AHU5.2-S14	8" round	Ruskin	IBD2	Pass	N/A	None
166	FD	AHU5.2-S15	16" oval	Ruskin	IBD2	Pass	N/A	None
167	FD	AHU5.2-S16	6" round	Ruskin	IBD2	Pass	N/A	None
168	FD	AHU5.2-S17	20x10	Ruskin	IBD2	Pass	N/A	None
169	FD	AHU5.2-OA	96x36	Ruskin	IBD2	Pass	N/A	None
170	FD	AHU5.2-RA	96x84	Ruskin	IBD2	Pass	N/A	None
171	FD	AHU5.2-S18	144x6	Ruskin	IBD2	Pass	N/A	None

Inspector: Julie Gue / Dan Tucewicz
Inspection Dates: July 25, 2022 - August 26, 2022
Facility: Virgil E Brown

SA = Supply Air FD = Fire Damper
 RA = Relief Air EF = Exhaust Fan
 OA = Outside Air TA = Transfer Air

Duct Fabricators, Inc.
 883 Addison Rd. Cleveland, Ohio
 P: 216-391-2400 F: 216-391-2492



Fire / Smoke / Fire & Smoke Damper
Composite Inspection Report

	<u>FD/SD/FSD</u>	<u>I.D.#</u>	<u>Size</u>	<u>Manufacturer</u>	<u>Model</u>	<u>Visual</u>	<u>Functional</u>	<u>Comments</u>
172	FD	AHUG.1-S1	12" Oval	Ruskin	IBD2	Pass	N/A	None
173	FD	AHUG.1-S2	46x16	Ruskin	IBD2	Pass	N/A	None
174	FD	AHUG.1-S3	46x16	Ruskin	IBD2	Pass	N/A	None
175	FD	AHUG.1-S4	8x10	Ruskin	IBD2	Pass	N/A	None
176	FD	AHUG.1-S5	6" Round	Ruskin	IBD2	Pass	N/A	None
177	FD	AHUG.1-S6	6" Round	Ruskin	IBD2	Pass	N/A	None
178	FD	AHUG.1-S7	14" Oval	Ruskin	IBD2	Pass	N/A	None
179	FD	AHUG.1-S8	6" Round	Ruskin	IBD2	Pass	N/A	None
180	FD	AHUG.1-S9	28x10	Ruskin	IBD2	Pass	N/A	None
181	FD	AHUG.1-S10	10" Oval	Ruskin	IBD2	Pass	N/A	None
182	FD	AHUG.1-S11	5" Round	Ruskin	IBD2	Pass	N/A	None
183	FD	AHUG.1-S12	6" Round	Ruskin	IBD2	Pass	N/A	None
184	FD	AHUG.1-S13	46x16	Ruskin	IBD2	Pass	N/A	None
185	FD	AHUG.1-S14	8x10	Ruskin	IBD2	Pass	N/A	None
186	FD	AHUG.1-S15	46x16	Ruskin	IBD2	Pass	N/A	None
187	FD	AHUG.1-S16	6" Round	Ruskin	IBD2	Pass	N/A	None
188	FD	AHUG.1-OA	96x20	Ruskin	IBD2	Pass	N/A	None
189	FD	AHUG.1-RA	96x48	Ruskin	IBD2	Pass	N/A	None
190	FD	AHUG.2- S1	12" Oval	Ruskin	IBD2	Pass	N/A	<u>None</u>

Inspector: Julie Gue / Dan Tucewicz
Inspection Dates: July 25, 2022 - August 26, 2022
Facility: Virgil E Brown

SA = Supply Air FD = Fire Damper
 RA = Relief Air EF = Exhaust Fan
 OA = Outside Air TA = Transfer Air

Duct Fabricators, Inc.
 883 Addison Rd. Cleveland, Ohio
 P: 216-391-2400 F: 216-391-2492



Fire / Smoke / Fire & Smoke Damper
Composite Inspection Report

	<u>FD/SD/FSD</u>	<u>I.D.#</u>	<u>Size</u>	<u>Manufacturer</u>	<u>Model</u>	<u>Visual</u>	<u>Functional</u>	<u>Comments</u>
191	FD	AHUG.2-S2	46x16	Ruskin	IBD2	Pass	N/A	None
192	FD	AHUG.2-S3	46x16	Ruskin	IBD2	Pass	N/A	None
193	FD	AHUG.2-S4	8x10	Ruskin	IBD2	Pass	N/A	None
194	FD	AHUG.2-S5	36x12	Ruskin	IBD2	Pass	N/A	None
195	FD	AHUG.2-S6	14" oval	Ruskin	IBD2	Pass	N/A	None
196	FD	AHUG.2-S7	24x19	Ruskin	IBD2	Pass	N/A	None
197	FD	AHUG.2-S8	46x16	Ruskin	IBD2	Pass	N/A	None
198	FD	AHUG.2-S9	8x10	Ruskin	IBD2	Pass	N/A	None
199	FD	AHUG.2-S10	46x16	Ruskin	IBD2	Pass	N/A	None
200	FD	AHUG.2-S11	16" oval	Ruskin	IBD2	Pass	N/A	None
201	FD	AHUG.2-S12	6" round	Ruskin	IBD2	Pass	N/A	None
202	FD	AHUG.2-OA	96x20	Ruskin	IBD2	Pass	N/A	None
203	FD	AHUG.2-RA	96x48	Ruskin	IBD2	Pass	N/A	None
204	FD	AHUG.3-S1	16x12	Ruskin	IBD2	Pass	N/A	None
205	FD	AHUG.3-S2	16x12	Ruskin	IBD2	Pass	N/A	None
206	FD	AHUG.3-S3	26x8	Ruskin	IBD2	Pass	N/A	None
207	FD	AHUG.3-S4	14x10	Ruskin	IBD2	Pass	N/A	None
208	FD	AHUG.3-R1	54x18	Ruskin	IBD2	Pass	N/A	None
209	FD	AHUG.3-R2	18x16	Ruskin	IBD2	Pass	N/A	None

Inspector:

Julie Gue / Dan Tulcewicz

SA = Supply Air

FD = Fire Damper

Inspection Dates:

July 25, 2022 - August 26, 2022

RA = Relief Air

EF = Exhaust Fan

Facility:

Virgil E Brown

OA = Outside Air

Duct Fabricators, Inc.
 883 Addison Rd. Cleveland, Ohio
 P: 216-391-2400 F: 216-391-2492



Fire / Smoke / Fire & Smoke Damper
Composite Inspection Report

	<u>FD/SD/FSD</u>	<u>I.D.#</u>	<u>Size</u>	<u>Manufacturer</u>	<u>Model</u>	<u>Visual</u>	<u>Functional</u>	<u>Comments</u>
								None
								None
209	FD	AHUG.3-R1	54x18	Ruskin	IBD2	Pass	N/A	None
210	FD	AHUG.3-R2	18x16	Ruskin	IBD2	Pass	N/A	None
211	FD	EF7-GND	20x14	Ruskin	IBD2	Pass	N/A	None
212	FD	EF7-1	22x16	Ruskin	IBD2	Pass	N/A	None
213	FD	EF7-2	26x18	Ruskin	IBD2	Pass	N/A	None
214	FD	EF7-3	36x20	Ruskin	IBD2	Pass	N/A	None
215	FD	EF7-4	36x20	Ruskin	IBD2	Pass	N/A	None
216	FD	EF7-5	40x20	Ruskin	IBD2	Pass	N/A	None
217	FD	EF7-PH	48x18	Ruskin	IBD2	Pass	N/A	None
218	FD	EF10-GND	14x20	Ruskin	IBD2	Pass	N/A	None
219	FD	EF10-1	22x16	Ruskin	IBD2	Pass	N/A	None
220	FD	EF10-2	26x18	Ruskin	IBD2	Pass	N/A	None
221	FD	EF10-3	36x18	Ruskin	IBD2	Pass	N/A	None
222	FD	EF10-4	36x20	Ruskin	IBD2	Pass	N/A	None
223	FD	EF10-5	40x18	Ruskin	IBD2	Pass	N/A	None
224	FD	EF18-1	12x12	Ruskin	IBD2	Pass	N/A	None
225	FD	EF18-2	12x12	Ruskin	IBD2	Pass	N/A	None
226	FD	E18-3F	12x14	Ruskin	IBD2	Pass	N/A	None

Inspector:

Julie Gue / Dan Tulcewicz

Inspection Dates:

July 25, 2022 - August 26, 2022

Facility:

Virgil E Brown

SA = Supply Air

FD = Fire Damper

RA = Relief Air

EF = Exhaust Fan

OA = Outside Air

TA = Transfer Air

Duct Fabricators, Inc.
 883 Addison Rd. Cleveland, Ohio
 P: 216-391-2400 F: 216-391-2492



Fire / Smoke / Fire & Smoke Damper
Composite Inspection Report

	<u>FD/SD/FSD</u>	<u>I.D.#</u>	<u>Size</u>	<u>Manufacturer</u>	<u>Model</u>	<u>Visual</u>	<u>Functional</u>	<u>Comments</u>
227	FD	EF18-OA	40x24	Ruskin	IBD2	Pass	N/A	None
228	FD	EF18-1	12x12	Ruskin	IBD2	Pass	N/A	None
229	FD	EF18-2	12x12	Ruskin	IBD2	Pass	N/A	None
230	FD	EF18-3	12x12	Ruskin	IBD2	Pass	N/A	None
231	FD	EF25-1	12x12	Ruskin	IBD2	Pass	N/A	None
232	FD	LL-RA-1	24x28	Ruskin	IBD2	Pass	N/A	None
233	FD	LL-RA-2	48x66	Ruskin	IBD2	Pass	N/A	None
234	FD	LL-RA-3	24x28	Ruskin	IBD2	Pass	N/A	None
235	FD	LL-RA-4	60x84	Ruskin	IBD2	Pass	N/A	None
236	FD	LL-TA-1	48x18	Ruskin	IBD2	Pass	N/A	None
237	FD	LL-TA-2	12x12	Ruskin	IBD2	Pass	N/A	None
238	FD	LL.1-S1	8x10	Ruskin	IBD2	Pass	N/A	None
239	FD	LL.1-S2	8x10	Ruskin	IBD2	Pass	N/A	None
240	FD	LL.1-OA	96x18	Ruskin	IBD2	Pass	N/A	None
241	FD	LL.1-RA	96x32	Ruskin	IBD2	Pass	N/A	None
242	FD	LL.2-S1	8x10	Ruskin	IBD2	Pass	N/A	None
243	FD	LL.2-S2	18x12	Ruskin	IBD2	Pass	N/A	None
244	FD	LL.2-S3	22x10	Ruskin	IBD2	Pass	N/A	None
245	FD	LL.2-S4	10" round	Ruskin	IBD2	Pass	N/A	none

Inspector:

Julie Gue \ Dan Tulcewicz

SA = Supply Air

FD = Fire Damper

Inspection Dates:

July 25, 2022 - August 26, 2022

RA = Relief Air

EF = Exhaust Fan

Facility:

Virgil E Brown

OA = Outside Air

TA = Transfer Air

Cuyahoga County
Virgil E Brown

641 Payne Ave
Cleveland, Ohio 44114

Fire Damper Inspection Report
September 2, 2022

Duct Fabricators, Inc.
FIRE SAFETY DIVISION



Report Date: September 2, 2022

Project: Virgil E Brown

Inspector(s): Julie Gue, Certified Technician
Dan Tulcewicz, Certified, Technician

Inspection and Test Date(s):

- July 18, 2022 – August 26, 2022

Duct Fabricators, Inc. "Fire Safety Division" Visually inspected Two hundred and fifty-nine fire dampers for proper installation. The dampers were then visually inspected and photographed exteriorly and interiorly to confirm that the dampers are in proper working condition.

All 259 dampers have passed inspection

NOTES: NFPA 80, NFPA 101 and NFPA 105 require newly installed dampers to be inspected and tested one year after initial installation. Thereafter, dampers are to be visually inspected every two years and functionally tested every four years.

Additionally, the information contained herein verified whether the dampers were functional at the time of testing. This verification process does not represent any form of a guarantee that the dampers will properly perform in the future.

Duct Fabricators, Inc.
 883 Addison Rd. Cleveland, Ohio
 P: 216-391-2400 F: 216-391-2492



Fire / Smoke / Fire & Smoke Damper
Composite Inspection Report

	<u>FD/SD/FSD</u>	<u>I.D.#</u>	<u>Size</u>	<u>Manufacturer</u>	<u>Model</u>	<u>Visual</u>	<u>Functional</u>	<u>Comments</u>
1	FD	AHU1.1-S1	56x16	Ruskin	IBD2	Pass	N/A	None
2	FD	AHU1.1-S2	56x16	Ruskin	IBD2	Pass	N/A	None
3	FD	AHU1.1-S3	8x10	Ruskin	IBD2	Pass	N/A	None
4	FD	AHU1.1-S4	8x10	Ruskin	IBD2	Pass	N/A	None
5	FD	AHU1.1-S5	11x8 Oval	Ruskin	IBD2	Pass	N/A	None
6	FD	AHU1.1-S6	56x16	Ruskin	IBD2	Pass	N/A	None
7	FD	AHU1.1-S7	56x16	Ruskin	IBD2	Pass	N/A	None
8	FD	AHU1.1-S8	6" round	Ruskin	IBD2	Pass	N/A	None
9	FD	AHU1.1-S9	56x16	Ruskin	IBD2	Pass	N/A	None
10	FD	AHU1.1-S10	8x10	Ruskin	IBD2	Pass	N/A	None
11	FD	AHU1.1-S11	56x16	Ruskin	IBD2	Pass	N/A	None
12	FD	AHU1.1-OA	96x24	Ruskin	IBD2	Pass	N/A	None
13	FD	AHU1.1-RA	96x60	Ruskin	IBD2	Pass	N/A	None
14	FD	AHU1.2-S1	36x8	Ruskin	IBD2	Pass	N/A	None
15	FD	AHU1.2-S2	36x8	Ruskin	IBD2	Pass	N/A	None
16	FD	AHU1.2-S3	56x16	Ruskin	IBD2	Pass	N/A	None
17	FD	AHU1.2-S4	56x16	Ruskin	IBD2	Pass	N/A	None
18	FD	AHU1.2-S5	8x10	Ruskin	IBD2	Pass	N/A	None
19	FD	AHU1.2-S6	17x8 oval	Ruskin	IBD2	Pass	N/A	None
20	FD	AHU1.2-S7	17x8 oval	Ruskin	IBD2	Pass	N/A	None

Inspector: Julie Gue/ Dan Tulcewicz
Inspection Dates: July 18, 2022 - August 26, 2022
Facility: Virgil E Brown

SA = Supply Air FD = Fire Damper
 RA = Relief Air EF = Exhaust Fan
 OA = Outside Air TA = Transfer Air

Duct Fabricators, Inc.
 883 Addison Rd. Cleveland, Ohio
 P: 216-391-2400 F: 216-391-2492



Fire / Smoke / Fire & Smoke Damper
Composite Inspection Report

	<u>FD/SD/FSD</u>	<u>I.D.#</u>	<u>Size</u>	<u>Manufacturer</u>	<u>Model</u>	<u>Visual</u>	<u>Functional</u>	<u>Comments</u>
21	FD	AHU1.2-S8	14x8 oval	Ruskin	IBD2	Pass	N/A	None
22	FD	AHU1.2-S9	17x8 oval	Ruskin	IBD2	Pass	N/A	None
23	FD	AHU1.2-S10	16x10	Ruskin	IBD2	Pass	N/A	None
24	FD	AHU1.2-S11	36x16	Ruskin	IBD2	Pass	N/A	None
25	FD	AHU1.2-S12	42x16	Ruskin	IBD2	Pass	N/A	None
26	FD	AHU1.2-S13	42x16	Ruskin	IBD2	Pass	N/A	None
27	FD	AHU1.2-S14	36x16	Ruskin	IBD2	Pass	N/A	None
28	FD	AHU1.2-S15	28x10	Ruskin	IBD2	Pass	N/A	None
29	FD	AHU1.2-S16	8" Round	Ruskin	IBD2	Pass	N/A	None
30	FD	AHU1.2-S17	18x10	Ruskin	IBD2	Pass	N/A	None
31	FD	AHU1.2-S18	20x8	Ruskin	IBD2	Pass	N/A	None
32	FD	AHU1.2-S19	8x10	Ruskin	IBD2	Pass	N/A	None
33	FD	AHU1.2-S20	56x16	Ruskin	IBD2	Pass	N/A	None
34	FD	AHU1.2-S21	8" Round	Ruskin	IBD2	Pass	N/A	None
35	FD	AHU1.2-OA	96x24	Ruskin	IBD2	Pass	N/A	None
36	FD	AHU1.2-RA	96x60	Ruskin	IBD2	Pass	N/A	None

Inspector: Julie Gue/ Dan Tulcewicz
Inspection Dates: July 20, 2022 - August 26, 2022
Facility: Virgil E Brown

SA = Supply Air FD = Fire Damper
 RA = Relief Air EF = Exhaust Fan
 OA = Outside Air TA = Transfer Air

Duct Fabricators, Inc.
 883 Addison Rd. Cleveland, Ohio
 P: 216-391-2400 F: 216-391-2492



Fire / Smoke / Fire & Smoke Damper
Composite Inspection Report

	<u>FD/SD/FSD</u>	<u>I.D.#</u>	<u>Size</u>	<u>Manufacturer</u>	<u>Model</u>	<u>Visual</u>	<u>Functional</u>	<u>Comments</u>
37	FD	AHU2.1-S1	56x16	Ruskin	IBD2	Pass	N/A	None
38	FD	AHU2.1-S2	12" oval	Ruskin	IBD2	Pass	N/A	None
39	FD	AHU2.1-S3	56x16	Ruskin	IBD2	Pass	N/A	None
40	FD	AHU2.1-S4	8x10	Ruskin	IBD2	Pass	N/A	None
41	FD	AHU2.1-S5	6"round	Ruskin	IBD2	Pass	N/A	None
42	FD	AHU2.1-S6	20x8 oval	Ruskin	IBD2	Pass	N/A	None
43	FD	AHU2.1-S7	28x10	Ruskin	IBD2	Pass	N/A	None
44	FD	AHU2.1-S8	6" Round	Ruskin	IBD2	Pass	N/A	None
45	FD	AHU2.1-S9	10" Round	Ruskin	IBD2	Pass	N/A	None
46	FD	AHU2.1-S10	8" Round	Ruskin	IBD2	Pass	N/A	None
47	FD	AHU2.1-S11	34x19	Ruskin	IBD2	Pass	N/A	None
48	FD	AHU2.1-S12	20x8 oval	Ruskin	IBD2	Pass	N/A	None
49	FD	AHU2.1-S13	6" Round	Ruskin	IBD2	Pass	N/A	None
50	FD	AHU2.1-S14	56x16	Ruskin	IBD2	Pass	N/A	None
51	FD	AHU2.1-S15	8x10	Ruskin	IBD2	Pass	N/A	None
52	FD	AHU2.1-S16	56x16	Ruskin	IBD2	Pass	N/A	None
53	FD	AHU2.1-OA	96x24	Ruskin	IBD2	Pass	N/A	None
54	FD	AHU2.1-RA	96x60	Ruskin	IBD2	Pass	N/A	None
55	FD	AHU2.2-S1	38x8	Ruskin	IBD2OW	Pass	N/A	None
56	FD	AHU2.2-S2	38x8	Ruskin	IBD2OW	Pass	N/A	None

Inspector: Julie Gue/ Dan Tulcewicz
Inspection Dates: July 25, 2022 - August 26, 2022
Facility: Virgil E Brown

SA = Supply Air FD = Fire Damper
 RA = Relief Air EF = Exhaust Fan
 OA = Outside Air TA = Transfer Air

Duct Fabricators, Inc.
 883 Addison Rd. Cleveland, Ohio
 P: 216-391-2400 F: 216-391-2492



Fire / Smoke / Fire & Smoke Damper
 Composite Inspection Report

	<u>FD/SD/FSD</u>	<u>I.D.#</u>	<u>Size</u>	<u>Manufacturer</u>	<u>Model</u>	<u>Visual</u>	<u>Functional</u>	<u>Comments</u>
57	FD	AHU2.2-S3	56x16	Ruskin	IBD2	Pass	N/A	None
58	FD	AHU2.2-S4	56x16	Ruskin	IBD2	Pass	N/A	None
59	FD	AHU2.2-S5	8x10	Ruskin	IBD2	Pass	N/A	None
60	FD	AHU2.2-S6	6" Round	Ruskin	IBD2	Pass	N/A	None
61	FD	AHU2.2-S7	16" Oval	Ruskin	IBD2	Pass	N/A	None
62	FD	AHU2.2-S8	6" Round	Ruskin	IBD2	Pass	N/A	None
63	FD	AHU2.2-S9	32x10	Ruskin	IBD2	Pass	N/A	None
64	FD	AHU2.2-S10	12" Round	Ruskin	IBD2	Pass	N/A	None
65	FD	AHU2.2-S11	12" Oval	Ruskin	IBD2	Pass	N/A	None
66	FD	AHU2.2-S12	34x10	Ruskin	IBD2	Pass	N/A	None
67	FD	AHU2.2-S13	6" Round	Ruskin	IBD2	Pass	N/A	None
68	FD	AHU2.2-S14	6" Round	Ruskin	IBD2	Pass	N/A	None
69	FD	AHU2.2-S15	56x16	Ruskin	IBD2	Pass	N/A	None
70	FD	AHU2.2-S16	8x10	Ruskin	IBD2	Pass	N/A	None
71	FD	AHU2.2-S17	56x16	Ruskin	IBD2	Pass	N/A	None
72	FD	AHU2.2-S18	18x10	Ruskin	IBD2	Pass	N/A	None
73	FD	AHU2.2-OA	96x24	Ruskin	IBD2	Pass	N/A	None
74	FD	AHU2.2-RA	96x60	Ruskin	IBD2	Pass	N/A	None

Inspector: Julie Gue / Dan Tulcewicz
Inspection Dates: July 25, 2022 - August 26, 2022
Facility: Virgil E Brown

SA = Supply Air FD = Fire Damper
 RA = Relief Air EF = Exhaust Fan
 OA = Outside Air TA = Transfer Air

Duct Fabricators, Inc.
 883 Addison Rd. Cleveland, Ohio
 P: 216-391-2400 F: 216-391-2492



Fire / Smoke / Fire & Smoke Damper
Composite Inspection Report

	<u>FD/SD/FSD</u>	<u>I.D.#</u>	<u>Size</u>	<u>Manufacturer</u>	<u>Model</u>	<u>Visual</u>	<u>Functional</u>	<u>Comments</u>
75	FD	AHU3.1-S1	56x16	Ruskin	IBD2	Pass	N/A	None
76	FD	AHU3.1-S2	56x16	Ruskin	IBD2	Pass	N/A	None
77	FD	AHU3.1-S3	56x16	Ruskin	IBD2	Pass	N/A	None
78	FD	AHU3.1-S4	8"Round	Ruskin	IBD2	Pass	N/A	None
79	FD	AHU3.1-S5	40x12	Ruskin	IBD2	Pass	N/A	None
80	FD	AHU3.1-S6	56x12	Ruskin	IBD2	Pass	N/A	None
81	FD	AHU3.1-S7	56x16	Ruskin	IBD2	Pass	N/A	None
82	FD	AHU3.1-S8	20x10	Ruskin	IBD2	Pass	N/A	None
83	FD	AHU3.1-S9	16" oval	Ruskin	IBD2	Pass	N/A	None
84	FD	AHU3.1-S10	6" Round	Ruskin	IBD2	Pass	N/A	None
85	FD	AHU3.1-S11	56x16	Ruskin	IBD2	Pass	N/A	None
86	FD	AHU3.1-S12	8x10	Ruskin	IBD2	Pass	N/A	None
87	FD	AHU3.1-S13	56x16	Ruskin	IBD2	Pass	N/A	None
88	FD	AHU3.1-S14	20x10	Ruskin	IBD2	Pass	N/A	None
89	FD	AHU3.1-OA	96x24	Ruskin	IBD2	Pass	N/A	None
90	FD	AHU3.1-RA	96x60	Ruskin	IBD2	Pass	N/A	None
91	FD	AHU3.2-S1	36x8	Ruskin	IBD2OW	Pass	N/A	None
92	FD	AHU3.2-S2	36x8	Ruskin	IBD2OW	Pass	N/A	None
93	FD	AHU3.2-S3	56x16	Ruskin	IBD2	Pass	N/A	None
94	FD	AHU3.2-S4	56x16	Ruskin	IBD2	Pass	N/A	None

Inspector:

Julie Gue / Dan Tulcewicz

SA = Supply Air

FD = Fire Damper

Inspection Dates:

July 25, 2022 - August 26, 2022

RA = Relief Air

EF = Exhaust Fan

Facility:

Virgil E Brown

OA = Outside Air

Duct Fabricators, Inc.
 883 Addison Rd. Cleveland, Ohio
 P: 216-391-2400 F: 216-391-2492



Fire / Smoke / Fire & Smoke Damper
Composite Inspection Report

	<u>FD/SD/FSD</u>	<u>I.D.#</u>	<u>Size</u>	<u>Manufacturer</u>	<u>Model</u>	<u>Visual</u>	<u>Functional</u>	<u>Comments</u>
95	FD	AHU3.2-S5	8x10	Ruskin	IBD2	Pass	N/A	None
96	FD	AHU3.2-S6	14x8 Oval	Ruskin	IBD2	Pass	N/A	None
97	FD	AHU3.2-S7	6" Round	Ruskin	IBD2	Pass	N/A	None
98	FD	AHU3.2-S8	56x16	Ruskin	IBD2	Pass	N/A	None
99	FD	AHU3.2-S9	56x16	Ruskin	IBD2	Pass	N/A	None
100	FD	AHU3.2-S10	56x16	Ruskin	IBD2	Pass	N/A	None
101	FD	AHU3.2-S11	6" Round	Ruskin	IBD2	Pass	N/A	None
102	FD	AHU3.2-S12	56x16	Ruskin	IBD2	Pass	N/A	None
103	FD	AHU3.2-S13	8x10	Ruskin	IBD2	Pass	N/A	None
104	FD	AHU3.2-S14	56x16	Ruskin	IBD2	Pass	N/A	None
105	FD	AHU3.2-S15	14" oval	Ruskin	IBD2	Pass	N/A	None
106	FD	AHU3.2-S16	14" oval	Ruskin	IBD2	Pass	N/A	None
107	FD	AHU3.2-OA	96x34	Ruskin	IBD2	Pass	N/A	None
108	FD	AHU3.2-RA	96x60	Ruskin	IBD2	Pass	N/A	None

Inspector: Julie Gue / Dan Tulcewicz
Inspection Dates: July 25, 2022 - August 26, 2022
Facility: Virgil E Brown

SA = Supply Air FD = Fire Damper
 RA = Relief Air EF = Exhaust Fan
 OA = Outside Air

Duct Fabricators, Inc.
 883 Addison Rd. Cleveland, Ohio
 P: 216-391-2400 F: 216-391-2492



Fire / Smoke / Fire & Smoke Damper
Composite Inspection Report

	<u>FD/SD/FSD</u>	<u>I.D.#</u>	<u>Size</u>	<u>Manufacturer</u>	<u>Model</u>	<u>Visual</u>	<u>Functional</u>	<u>Comments</u>
109	FD	AHU4.1-S1	56x16	Ruskin	IBD2	Pass	N/A	None
110	FD	AHU4.1-S2	56x16	Ruskin	IBD2	Pass	N/A	None
111	FD	AHU4.1-S3	8x10	Ruskin	IBD2	Pass	N/A	None
112	FD	AHU4.1-S4	5" Round	Ruskin	IBD2	Pass	N/A	None
113	FD	AHU4.1-S5	16" Oval	Ruskin	IBD2	Pass	N/A	None
114	FD	AHU4.1-S6	56x16	Ruskin	IBD2	Pass	N/A	None
115	FD	AHU4.1-S7	56x16	Ruskin	IBD2	Pass	N/A	None
116	FD	AHU4.1-S8	8" Round	Ruskin	IBD2	Pass	N/A	None
117	FD	AHU4.1-S9	16" oval	Ruskin	IBD2	Pass	N/A	None
118	FD	AHU4.1-S10	56x16	Ruskin	IBD2	Pass	N/A	None
119	FD	AHU4.1-S11	8x10	Ruskin	IBD2	Pass	N/A	None
120	FD	AHU4.1-S12	56x16	Ruskin	IBD2	Pass	N/A	None
121	FD	AHU4.1-OA	96x24	Ruskin	IBD2	Pass	N/A	None
122	FD	AHU4.1-RA	96x60	Ruskin	IBD2	Pass	N/A	None
123	FD	AHU4.2-S1	56x16	Ruskin	IBD2	Pass	N/A	None
124	FD	AHU4.2-S2	56x16	Ruskin	IBD2	Pass	N/A	None
125	FD	AHU4.2-S3	8x10	Ruskin	IBD2	Pass	N/A	None
126	FD	AHU4.2-S4	56x16	Ruskin	IBD2	Pass	N/A	None
127	FD	AHU4.2-S5	16" oval	Ruskin	IBD2	Pass	N/A	None
128	FD	AHU4.2-S6	6" Round	Ruskin	IBD2	Pass	N/A	None

Inspector: Julie Gue / Dan Tulcewicz
Inspection Dates: July 25, 2022 - August 26, 2022
Facility: Virgil E Brown

SA = Supply Air FD = Fire Damper
 RA = Relief Air EF = Exhaust Fan
 OA = Outside Air TA = Transfer Air

Duct Fabricators, Inc.
 883 Addison Rd. Cleveland, Ohio
 P: 216-391-2400 F: 216-391-2492



Fire / Smoke / Fire & Smoke Damper
Composite Inspection Report

	<u>FD/SD/FSD</u>	<u>I.D.#</u>	<u>Size</u>	<u>Manufacturer</u>	<u>Model</u>	<u>Visual</u>	<u>Functional</u>	<u>Comments</u>
129	FD	AHU4.2-S7	56x16	Ruskin	IBD2	Pass	N/A	None
130	FD	AHU4.2-S8	8x10	Ruskin	IBD2	Pass	N/A	None
131	FD	AHU4.2-S9	56x16	Ruskin	IBD2	Pass	N/A	None
132	FD	AHU4.2-S10	56x16	Ruskin	IBD2	Pass	N/A	None
133	FD	AHU4.2-S11	36x8	Ruskin	IBD2OW	Pass	N/A	None
134	FD	AHU4.2-S12	36x8	Ruskin	IBD2OW	Pass	N/A	None
135	FD	AHU4.2-OA	96x24	Ruskin	IBD2	Pass	N/A	None
136	FD	AHU4.2-RA	96x60	Ruskin	IBD2	Pass	N/A	None

Inspector: Julie Gue / Dan Tulcewicz
Inspection Dates: July 25, 2022 - August 26, 2022
Facility: Virgil E Brown

SA = Supply Air FD = Fire Damper
 RA = Relief Air EF = Exhaust Fan
 OA = Outside Air

Duct Fabricators, Inc.
 883 Addison Rd. Cleveland, Ohio
 P: 216-391-2400 F: 216-391-2492



Fire / Smoke / Fire & Smoke Damper
Composite Inspection Report

	<u>FD/SD/FSD</u>	<u>I.D.#</u>	<u>Size</u>	<u>Manufacturer</u>	<u>Model</u>	<u>Visual</u>	<u>Functional</u>	<u>Comments</u>
137	FD	AHU5.1-S1	56x18	Ruskin	IBD2	Pass	N/A	None
138	FD	AHU5.1-S2	56x18	Ruskin	IBD2	Pass	N/A	None
139	FD	AHU5.1-S3	36x18	Ruskin	IBD2	Pass	N/A	None
140	FD	AHU5.1-S4	36x18	Ruskin	IBD2	Pass	N/A	None
141	FD	AHU5.1-S5	56x18	Ruskin	IBD2	Pass	N/A	None
142	FD	AHU5.1-S6	56x18	Ruskin	IBD2	Pass	N/A	None
143	FD	AHU5.1-S7	8x10	Ruskin	IBD2	Pass	N/A	None
144	FD	AHU5.1-S8	8x10	Ruskin	IBD2	Pass	N/A	None
145	FD	AHU5.1-S9	10" Oval	Ruskin	IBD2	Pass	N/A	None
146	FD	AHU5.1-S10	40x10	Ruskin	IBD2	Pass	N/A	None
147	FD	AHU5.1-S11	34x10	Ruskin	IBD2	Pass	N/A	None
148	FD	AHU5.1-S12	10" oval	Ruskin	IBD2	Pass	N/A	None
149	FD	AHU5.1-S13	34x10	Ruskin	IBD2	Pass	N/A	None
150	FD	AHU5.1-OA	96x36	Ruskin	IBD2	Pass	N/A	None
151	FD	AHU5.1-RA	96x84	Ruskin	IBD2	Pass	N/A	None
152	FD	AHU5.2-S1	56x18	Ruskin	IBD2	Pass	N/A	None
153	FD	AHU5.2-S2	56x18	Ruskin	IBD2	Pass	N/A	None
154	FD	AHU5.2-S3	36x18	Ruskin	IBD2	Pass	N/A	None
155	FD	AHU5.2-S4	36x18	Ruskin	IBD2	Pass	N/A	None
156	FD	AHU5.2-S5	56x18	Ruskin	IBD2	Pass	N/A	None

Inspector: Julie Gue / Dan Tulcewicz
Inspection Dates: July 25, 2022 - August 26, 2022
Facility: Virgil E Brown

SA = Supply Air FD = Fire Damper
 RA = Relief Air EF = Exhaust Fan
 OA = Outside Air TA = Transfer Air

Duct Fabricators, Inc.
 883 Addison Rd. Cleveland, Ohio
 P: 216-391-2400 F: 216-391-2492



Fire / Smoke / Fire & Smoke Damper
Composite Inspection Report

	<u>FD/SD/FSD</u>	<u>I.D.#</u>	<u>Size</u>	<u>Manufacturer</u>	<u>Model</u>	<u>Visual</u>	<u>Functional</u>	<u>Comments</u>
157	FD	AHU5.2-S6	56x18	Ruskin	IBD2	Pass	N/A	None
158	FD	AHU5.2-S7	8x10	Ruskin	IBD2	Pass	N/A	None
159	FD	AHU5.2-S8	8x10	Ruskin	IBD2	Pass	N/A	None
160	FD	AHU5.2-S9	16" oval	Ruskin	IBD2	Pass	N/A	None
161	FD	AHU5.2-S10	16" oval	Ruskin	IBD2	Pass	N/A	None
162	FD	AHU5.2-S11	8" oval	Ruskin	IBD2	Pass	N/A	None
163	FD	AHU5.2-S12	44x12	Ruskin	IBD2	Pass	N/A	None
164	FD	AHU5.2-S13	45x10	Ruskin	IBD2	Pass	N/A	None
165	FD	AHU5.2-S14	8" round	Ruskin	IBD2	Pass	N/A	None
166	FD	AHU5.2-S15	16" oval	Ruskin	IBD2	Pass	N/A	None
167	FD	AHU5.2-S16	6" round	Ruskin	IBD2	Pass	N/A	None
168	FD	AHU5.2-S17	20x10	Ruskin	IBD2	Pass	N/A	None
169	FD	AHU5.2-OA	96x36	Ruskin	IBD2	Pass	N/A	None
170	FD	AHU5.2-RA	96x84	Ruskin	IBD2	Pass	N/A	None
171	FD	AHU5.2-S18	144x6	Ruskin	IBD2	Pass	N/A	None

Inspector: Julie Gue / Dan Tucewicz
Inspection Dates: July 25, 2022 - August 26, 2022
Facility: Virgil E Brown

SA = Supply Air FD = Fire Damper
 RA = Relief Air EF = Exhaust Fan
 OA = Outside Air TA = Transfer Air

Duct Fabricators, Inc.
 883 Addison Rd. Cleveland, Ohio
 P: 216-391-2400 F: 216-391-2492



Fire / Smoke / Fire & Smoke Damper
Composite Inspection Report

	<u>FD/SD/FSD</u>	<u>I.D.#</u>	<u>Size</u>	<u>Manufacturer</u>	<u>Model</u>	<u>Visual</u>	<u>Functional</u>	<u>Comments</u>
172	FD	AHUG.1-S1	12" Oval	Ruskin	IBD2	Pass	N/A	None
173	FD	AHUG.1-S2	46x16	Ruskin	IBD2	Pass	N/A	None
174	FD	AHUG.1-S3	46x16	Ruskin	IBD2	Pass	N/A	None
175	FD	AHUG.1-S4	8x10	Ruskin	IBD2	Pass	N/A	None
176	FD	AHUG.1-S5	6" Round	Ruskin	IBD2	Pass	N/A	None
177	FD	AHUG.1-S6	6" Round	Ruskin	IBD2	Pass	N/A	None
178	FD	AHUG.1-S7	14" Oval	Ruskin	IBD2	Pass	N/A	None
179	FD	AHUG.1-S8	6" Round	Ruskin	IBD2	Pass	N/A	None
180	FD	AHUG.1-S9	28x10	Ruskin	IBD2	Pass	N/A	None
181	FD	AHUG.1-S10	10" Oval	Ruskin	IBD2	Pass	N/A	None
182	FD	AHUG.1-S11	5" Round	Ruskin	IBD2	Pass	N/A	None
183	FD	AHUG.1-S12	6" Round	Ruskin	IBD2	Pass	N/A	None
184	FD	AHUG.1-S13	46x16	Ruskin	IBD2	Pass	N/A	None
185	FD	AHUG.1-S14	8x10	Ruskin	IBD2	Pass	N/A	None
186	FD	AHUG.1-S15	46x16	Ruskin	IBD2	Pass	N/A	None
187	FD	AHUG.1-S16	6" Round	Ruskin	IBD2	Pass	N/A	None
188	FD	AHUG.1-OA	96x20	Ruskin	IBD2	Pass	N/A	None
189	FD	AHUG.1-RA	96x48	Ruskin	IBD2	Pass	N/A	None
190	FD	AHUG.2- S1	12" Oval	Ruskin	IBD2	Pass	N/A	<u>None</u>

Inspector: Julie Gue / Dan Tucewicz
Inspection Dates: July 25, 2022 - August 26, 2022
Facility: Virgil E Brown

SA = Supply Air FD = Fire Damper
 RA = Relief Air EF = Exhaust Fan
 OA = Outside Air TA = Transfer Air

Duct Fabricators, Inc.
 883 Addison Rd. Cleveland, Ohio
 P: 216-391-2400 F: 216-391-2492



Fire / Smoke / Fire & Smoke Damper
Composite Inspection Report

	<u>FD/SD/FSD</u>	<u>I.D.#</u>	<u>Size</u>	<u>Manufacturer</u>	<u>Model</u>	<u>Visual</u>	<u>Functional</u>	<u>Comments</u>
191	FD	AHUG.2-S2	46x16	Ruskin	IBD2	Pass	N/A	None
192	FD	AHUG.2-S3	46x16	Ruskin	IBD2	Pass	N/A	None
193	FD	AHUG.2-S4	8x10	Ruskin	IBD2	Pass	N/A	None
194	FD	AHUG.2-S5	36x12	Ruskin	IBD2	Pass	N/A	None
195	FD	AHUG.2-S6	14" oval	Ruskin	IBD2	Pass	N/A	None
196	FD	AHUG.2-S7	24x19	Ruskin	IBD2	Pass	N/A	None
197	FD	AHUG.2-S8	46x16	Ruskin	IBD2	Pass	N/A	None
198	FD	AHUG.2-S9	8x10	Ruskin	IBD2	Pass	N/A	None
199	FD	AHUG.2-S10	46x16	Ruskin	IBD2	Pass	N/A	None
200	FD	AHUG.2-S11	16" oval	Ruskin	IBD2	Pass	N/A	None
201	FD	AHUG.2-S12	6" round	Ruskin	IBD2	Pass	N/A	None
202	FD	AHUG.2-OA	96x20	Ruskin	IBD2	Pass	N/A	None
203	FD	AHUG.2-RA	96x48	Ruskin	IBD2	Pass	N/A	None
204	FD	AHUG.3-S1	16x12	Ruskin	IBD2	Pass	N/A	None
205	FD	AHUG.3-S2	16x12	Ruskin	IBD2	Pass	N/A	None
206	FD	AHUG.3-S3	26x8	Ruskin	IBD2	Pass	N/A	None
207	FD	AHUG.3-S4	14x10	Ruskin	IBD2	Pass	N/A	None
208	FD	AHUG.3-R1	54x18	Ruskin	IBD2	Pass	N/A	None
209	FD	AHUG.3-R2	18x16	Ruskin	IBD2	Pass	N/A	None

Inspector: Julie Gue / Dan Tulcewicz
Inspection Dates: July 25, 2022 - August 26, 2022
Facility: Virgil E Brown

SA = Supply Air FD = Fire Damper
 RA = Relief Air EF = Exhaust Fan
 OA = Outside Air

Duct Fabricators, Inc.
 883 Addison Rd. Cleveland, Ohio
 P: 216-391-2400 F: 216-391-2492



Fire / Smoke / Fire & Smoke Damper
Composite Inspection Report

	<u>FD/SD/FSD</u>	<u>I.D.#</u>	<u>Size</u>	<u>Manufacturer</u>	<u>Model</u>	<u>Visual</u>	<u>Functional</u>	<u>Comments</u>
								None
								None
209	FD	AHUG.3-R1	54x18	Ruskin	IBD2	Pass	N/A	None
210	FD	AHUG.3-R2	18x16	Ruskin	IBD2	Pass	N/A	None
211	FD	EF7-GND	20x14	Ruskin	IBD2	Pass	N/A	None
212	FD	EF7-1	22x16	Ruskin	IBD2	Pass	N/A	None
213	FD	EF7-2	26x18	Ruskin	IBD2	Pass	N/A	None
214	FD	EF7-3	36x20	Ruskin	IBD2	Pass	N/A	None
215	FD	EF7-4	36x20	Ruskin	IBD2	Pass	N/A	None
216	FD	EF7-5	40x20	Ruskin	IBD2	Pass	N/A	None
217	FD	EF7-PH	48x18	Ruskin	IBD2	Pass	N/A	None
218	FD	EF10-GND	14x20	Ruskin	IBD2	Pass	N/A	None
219	FD	EF10-1	22x16	Ruskin	IBD2	Pass	N/A	None
220	FD	EF10-2	26x18	Ruskin	IBD2	Pass	N/A	None
221	FD	EF10-3	36x18	Ruskin	IBD2	Pass	N/A	None
222	FD	EF10-4	36x20	Ruskin	IBD2	Pass	N/A	None
223	FD	EF10-5	40x18	Ruskin	IBD2	Pass	N/A	None
224	FD	EF18-1	12x12	Ruskin	IBD2	Pass	N/A	None
225	FD	EF18-2	12x12	Ruskin	IBD2	Pass	N/A	None
226	FD	E18-3F	12x14	Ruskin	IBD2	Pass	N/A	None

Inspector:

Julie Gue / Dan Tulcewicz

Inspection Dates:

July 25, 2022 - August 26, 2022

Facility:

Virgil E Brown

SA = Supply Air

FD = Fire Damper

RA = Relief Air

EF = Exhaust Fan

OA = Outside Air

TA = Transfer Air

Duct Fabricators, Inc.
 883 Addison Rd. Cleveland, Ohio
 P: 216-391-2400 F: 216-391-2492



Fire / Smoke / Fire & Smoke Damper
Composite Inspection Report

	<u>FD/SD/FSD</u>	<u>I.D.#</u>	<u>Size</u>	<u>Manufacturer</u>	<u>Model</u>	<u>Visual</u>	<u>Functional</u>	<u>Comments</u>
227	FD	EF18-OA	40x24	Ruskin	IBD2	Pass	N/A	None
228	FD	EF18-1	12x12	Ruskin	IBD2	Pass	N/A	None
229	FD	EF18-2	12x12	Ruskin	IBD2	Pass	N/A	None
230	FD	EF18-3	12x12	Ruskin	IBD2	Pass	N/A	None
231	FD	EF25-1	12x12	Ruskin	IBD2	Pass	N/A	None
232	FD	LL-RA-1	24x28	Ruskin	IBD2	Pass	N/A	None
233	FD	LL-RA-2	48x66	Ruskin	IBD2	Pass	N/A	None
234	FD	LL-RA-3	24x28	Ruskin	IBD2	Pass	N/A	None
235	FD	LL-RA-4	60x84	Ruskin	IBD2	Pass	N/A	None
236	FD	LL-TA-1	48x18	Ruskin	IBD2	Pass	N/A	None
237	FD	LL-TA-2	12x12	Ruskin	IBD2	Pass	N/A	None
238	FD	LL.1-S1	8x10	Ruskin	IBD2	Pass	N/A	None
239	FD	LL.1-S2	8x10	Ruskin	IBD2	Pass	N/A	None
240	FD	LL.1-OA	96x18	Ruskin	IBD2	Pass	N/A	None
241	FD	LL.1-RA	96x32	Ruskin	IBD2	Pass	N/A	None
242	FD	LL.2-S1	8x10	Ruskin	IBD2	Pass	N/A	None
243	FD	LL.2-S2	18x12	Ruskin	IBD2	Pass	N/A	None
244	FD	LL.2-S3	22x10	Ruskin	IBD2	Pass	N/A	None
245	FD	LL.2-S4	10" round	Ruskin	IBD2	Pass	N/A	none

Inspector:

Julie Gue \ Dan Tulcewicz

SA = Supply Air

FD = Fire Damper

Inspection Dates:

July 25, 2022 - August 26, 2022

RA = Relief Air

EF = Exhaust Fan

Facility:

Virgil E Brown

OA = Outside Air

TA = Transfer Air

Duct Fabricators, Inc.
 883 Addison Rd. Cleveland, Ohio
 P: 216-391-2400 F: 216-391-2492



Fire / Smoke / Fire & Smoke Damper
Composite Inspection Report

	<u>FD/SD/FSD</u>	<u>I.D.#</u>	<u>Size</u>	<u>Manufacturer</u>	<u>Model</u>	<u>Visual</u>	<u>Functional</u>	<u>Comments</u>
246	FD	AHULL.2-S5	28X12	Ruskin	IBD2	Pass	N/A	None
247	FD	AHULL.2S6	8X10	Ruskin	IBD2	Pass	N/A	None
248	FD	AHULL.2-S7	8X6	Ruskin	IBD2	Pass	N/A	None
249	FD	AHULL.2-OA	96X18	Ruskin	IBD2	Pass	N/A	None
250	FD	AHULL.2-RA	96X32	Ruskin	IBD2	Pass	N/A	None
251	FD	Dock EA-1	30x13	Ruskin	IBD2	Pass	N/A	None
252	FD	Dock EA-2	30x12	Ruskin	IBD2	Pass	N/A	None
253	FD	Dock EA-3	48x12	Ruskin	IBD2	Pass	N/A	None
254	FD	PH.1-OA	120X48	Ruskin	IBD2	Pass	N/A	None
255	FD	PH.1-RA	108X49	Ruskin	IBD2	Pass	N/A	None
256	FD	PH.2-OA-1	114X48	Ruskin	IBD2	Pass	N/A	None
257	FD	PH.2-OA-2	96X48	Ruskin	IBD2	Pass	N/A	None
258	FD	PH.2-OA-3	48X48	Ruskin	IBD2	Pass	N/A	None
259	FD	PH2-RA	108X48	Ruskin	IBD2	Pass	N/A	None

Inspector: Julie Gue
Inspection Dates: October 22, 2020 - January 20, 2021
Facility: Virgil E Brown

SA = Supply Air FD = Fire Damper
 RA = Relief Air EF = Exhaust Fan
 OA = Outside Air TA = Transfer Air

VISUAL CUYAHOGA COUNTY DAMPER INSPECTION REPORT

Date of Inspection

2022-08-15

Facility Location

Virgil E Brown Center

Damper Location

Northwest corridor

Inspector Name

Julie Gue

Damper I.D. #

AHU1.1-S7

Damper Type

Vertical Fire Damper

Damper Size

56x16

Damper Manufacturer

Ruskin

Damper Model #

IBD2

Fusible Link Temperature

212 Degrees

Access Door Size

18x18

Pass / Fail / Abandoned

Pass

Comments / Corrections

None

Exterior Picture of Damper



Interior Picture of Damper



Picture of Damper I.D. Label



VISUAL CUYAHOGA COUNTY DAMPER INSPECTION REPORT

Date of Inspection

2022-08-10

Facility Location

Virgil E Brown Center

Damper Location

North mechanical room

Inspector Name

Julie Gue

Damper I.D. #

AHU1.1-RA

Damper Type

Vertical Fire Damper

Damper Size

96x60

Damper Manufacturer

Ruskin

Damper Model #

IBD2

Fusible Link Temperature

212 Degrees

Access Door Size

Open duct

Pass / Fail / Abandoned

Pass

Comments / Corrections

None


Exterior Picture of Damper



Interior Picture of Damper



Picture of Damper I.D. Label



VISUAL CUYAHOGA COUNTY DAMPER INSPECTION REPORT

Date of Inspection

2022-08-15

Facility Location

Virgil E Brown Center

Damper Location

Ground mechanical room

Inspector Name

Julie Gue

Damper I.D. #

AHU1.1-S1

Damper Type

Vertical Fire Damper

Damper Size

16x12

Damper Manufacturer

Ruskin

Damper Model #

IBD2

Fusible Link Temperature

212 Degrees

Access Door Size

14x14

Pass / Fail / Abandoned

Pass

Comments / Corrections

None


Exterior Picture of Damper



Interior Picture of Damper



Picture of Damper I.D. Label



Duct Fabricators, Inc.

883 Addison Rd. Cleveland, Ohio
P: 216-391-2400 F: 216-391-2492

FIRE SAFETY DIVISION
NEMI Certified HVAC Fire Life Safety Technicians



VISUAL CUYAHOGA COUNTY DAMPER INSPECTION REPORT

Date of Inspection

2022-08-15

Facility Location

Virgil E Brown Center

Damper Location

Northeast corridor

Inspector Name

Julie Gue

Damper I.D. #

AHU1.1-S2

Damper Type

Vertical Fire Damper

Damper Size

56x16

Damper Manufacturer

Ruskin

Damper Model #

IBD2

Fusible Link Temperature

212 Degrees

Access Door Size

18x18

Pass / Fail / Abandoned

Pass

Comments / Corrections

None


Exterior Picture of Damper



Interior Picture of Damper



Picture of Damper I.D. Label



VISUAL CUYAHOGA COUNTY DAMPER INSPECTION REPORT

Date of Inspection

2022-08-15

Facility Location

Virgil E Brown Center

Damper Location

Northeast corridor

Inspector Name

Julie Gue

Damper I.D. #

AHU1.1-S4

Damper Type

Vertical Fire Damper

Damper Size

12x9.5 oval

Damper Manufacturer

Ruskin

Damper Model #

IBD2

Fusible Link Temperature

212 Degrees

Access Door Size

18x18

Pass / Fail / Abandoned

Pass


Comments / Corrections

None

Exterior Picture of Damper



Interior Picture of Damper



Picture of Damper I.D. Label



VISUAL CUYAHOGA COUNTY DAMPER INSPECTION REPORT

Date of Inspection

2022-08-15

Facility Location

Virgil E Brown Center

Damper Location

Northeast mechanical room

Inspector Name

Julie Gue

Damper I.D. #

AHU1.1-S5

Damper Type

Vertical Fire Damper

Damper Size

10" oval

Damper Manufacturer

Ruskin

Damper Model #

IBD2

Fusible Link Temperature

212 Degrees

Access Door Size

18x18

Pass / Fail / Abandoned

Pass

Comments / Corrections

None

Exterior Picture of Damper



Interior Picture of Damper



Picture of Damper I.D. Label



VISUAL CUYAHOGA COUNTY DAMPER INSPECTION REPORT

Date of Inspection

2022-08-15

Facility Location

Virgil E Brown Center

Damper Location

Northeast corridor

Inspector Name

Julie Gue

Damper I.D. #

AHU1.1-S6

Damper Type

Vertical Fire Damper

Damper Size

56x16

Damper Manufacturer

Ruskin

Damper Model #

IBD2

Fusible Link Temperature

212 Degrees

Access Door Size

18x18

Pass / Fail / Abandoned

Pass

Comments / Corrections

None


Exterior Picture of Damper



Interior Picture of Damper



Picture of Damper I.D. Label



VISUAL CUYAHOGA COUNTY DAMPER INSPECTION REPORT

Date of Inspection

2022-08-10

Facility Location

Virgil E Brown Center

Damper Location

North mechanical room

Inspector Name

Julie Gue

Damper I.D. #

AHU1.1-OA

Damper Type

Vertical Fire Damper

Damper Size

96x24

Damper Manufacturer

Ruskin

Damper Model #

IBD2

Fusible Link Temperature

212 Degrees

Access Door Size

16x16

Pass / Fail / Abandoned

Pass

Comments / Corrections

None

Exterior Picture of Damper



Interior Picture of Damper



Picture of Damper I.D. Label



VISUAL CUYAHOGA COUNTY DAMPER INSPECTION REPORT

Date of Inspection

2022-08-15

Facility Location

Virgil E Brown Center

Damper Location

Northwest corridor

Inspector Name

Julie Gue

Damper I.D. #

AHU1.1-S8

Damper Type

Vertical Fire Damper

Damper Size

6" Round

Damper Manufacturer

Ruskin

Damper Model #

IBD2

Fusible Link Temperature

212 Degrees

Access Door Size

18x18

Pass / Fail / Abandoned

Pass

Comments / Corrections

None

Exterior Picture of Damper



Interior Picture of Damper



Picture of Damper I.D. Label



VISUAL CUYAHOGA COUNTY DAMPER INSPECTION REPORT

Date of Inspection

2022-08-15

Facility Location

Virgil E Brown Center

Damper Location

Northwest corridor

Inspector Name

Julie Gue

Damper I.D. #

AHU1.1-S9

Damper Type

Vertical Fire Damper

Damper Size

56x16

Damper Manufacturer

Ruskin

Damper Model #

IBD2

Fusible Link Temperature

212 Degrees

Access Door Size

18x18

Pass / Fail / Abandoned

Pass

Comments / Corrections

None

Exterior Picture of Damper



Interior Picture of Damper



Picture of Damper I.D. Label



VISUAL CUYAHOGA COUNTY DAMPER INSPECTION REPORT

Date of Inspection

2022-08-10

Facility Location

Virgil E Brown Center

Damper Location

Northwest comm room

Inspector Name

Julie Gue

Damper I.D. #

AHU1.1-S10

Damper Type

Vertical Fire Damper

Damper Size

8x12

Damper Manufacturer

Ruskin

Damper Model #

IBD2

Fusible Link Temperature

212 Degrees

Access Door Size

Open duct

Pass / Fail / Abandoned

Pass

Comments / Corrections

None

Exterior Picture of Damper



Interior Picture of Damper



Picture of Damper I.D. Label



VISUAL CUYAHOGA COUNTY DAMPER INSPECTION REPORT

Date of Inspection

2022-08-15

Facility Location

Virgil E Brown Center

Damper Location

Northwest corridor

Inspector Name

Julie Gue

Damper I.D. #

AHU1.1-S11

Damper Type

Vertical Fire Damper

Damper Size

56x16

Damper Manufacturer

Ruskin

Damper Model #

IBD2

Fusible Link Temperature

212 Degrees

Access Door Size

16x16

Pass / Fail / Abandoned

Pass

Comments / Corrections

None


Exterior Picture of Damper



Interior Picture of Damper



Picture of Damper I.D. Label



Duct Fabricators, Inc.

883 Addison Rd. Cleveland, Ohio
P: 216-391-2400 F: 216-391-2492

FIRE SAFETY DIVISION

NEMI Certified HVAC Fire Life Safety Technicians



VISUAL CUYAHOGA COUNTY DAMPER INSPECTION REPORT

Date of Inspection

2022-08-16

Facility Location

Virgil E Brown Center

Damper Location

Front lobby

Inspector Name

Julie Gue

Damper I.D.

AHU1.1-S12

Damper Type

Vertical Fire Damper

Damper Size

46x16

Damper Manufacturer

Ruskin

Damper Model

IBD2

Fusible Link Temperature

212 Degrees

Access Door Size

Grille access

Pass / Fail / Abandoned

Pass

Comments / Corrections

None


Exterior Picture of Damper



Interior Picture of Damper



Picture of Damper I.D. Label



VISUAL CUYAHOGA COUNTY DAMPER INSPECTION REPORT

Date of Inspection

2022-08-10

Facility Location

Virgil E Brown Center

Damper Location

South mechanical room

Inspector Name

Julie Gue

Damper I.D. #

AHU1.2-OA

Damper Type

Vertical Fire Damper

Damper Size

96x24

Damper Manufacturer

Ruskin

Damper Model #

IBD2

Fusible Link Temperature

212 Degrees

Access Door Size

16x16

Pass / Fail / Abandoned

Pass

Comments / Corrections

None


Exterior Picture of Damper



Interior Picture of Damper



Picture of Damper I.D. Label



VISUAL CUYAHOGA COUNTY DAMPER INSPECTION REPORT

Date of Inspection

2022-08-10

Facility Location

Virgil E Brown Center

Damper Location

South mechanical room

Inspector Name

Julie Gue

Damper I.D. #

AHU1.2-RA

Damper Type

Vertical Fire Damper

Damper Size

96x60

Damper Manufacturer

Ruskin

Damper Model #

IBD2

Fusible Link Temperature

212 Degrees

Access Door Size

Open duct

Pass / Fail / Abandoned

Pass

Comments / Corrections

None

Exterior Picture of Damper



Interior Picture of Damper



Picture of Damper I.D. Label



VISUAL CUYAHOGA COUNTY DAMPER INSPECTION REPORT

Date of Inspection

2022-08-16

Facility Location

Virgil E Brown Center

Damper Location

RM180

Inspector Name

Julie Gue

Damper I.D. #

AHU1.2-S1

Damper Type

Vertical Fire Damper

Damper Size

36x8

Damper Manufacturer

Ruskin

Damper Model #

IBD2

Fusible Link Temperature

212 Degrees

Access Door Size

12x12

Pass / Fail / Abandoned

Pass

Comments / Corrections

None

Exterior Picture of Damper



Interior Picture of Damper



Picture of Damper I.D. Label



VISUAL CUYAHOGA COUNTY DAMPER INSPECTION REPORT

Date of Inspection

2022-08-16

Facility Location

Virgil E Brown Center

Damper Location

State Hearing Room

Inspector Name

Julie Gue

Damper I.D. #

AHU1.2-S2

Damper Type

Vertical Fire Damper

Damper Size

36x8

Damper Manufacturer

Ruskin

Damper Model #

IBD2

Fusible Link Temperature

212 Degrees

Access Door Size

12x12

Pass / Fail / Abandoned

Pass

Comments / Corrections

None


Exterior Picture of Damper



Interior Picture of Damper



Picture of Damper I.D. Label



VISUAL CUYAHOGA COUNTY DAMPER INSPECTION REPORT

Date of Inspection

2022-08-16

Facility Location

Virgil E Brown Center

Damper Location

Southwest corridor

Inspector Name

Julie Gue

Damper I.D. #

AHU1.2-S3

Damper Type

Vertical Fire Damper

Damper Size

56x16

Damper Manufacturer

Ruskin

Damper Model #

IBD2

Fusible Link Temperature

212 Degrees

Access Door Size

18x18

Pass / Fail / Abandoned

Pass

Comments / Corrections

None


Exterior Picture of Damper



Interior Picture of Damper



Picture of Damper I.D. Label



VISUAL CUYAHOGA COUNTY DAMPER INSPECTION REPORT

Date of Inspection

2022-08-10

Facility Location

Virgil E Brown Center

Damper Location

Southwest com room

Inspector Name

Julie Gue

Damper I.D. #

AHU1.2-S5

Damper Type

Vertical Fire Damper

Damper Size

8x12

Damper Manufacturer

Ruskin

Damper Model #

IBD2

Fusible Link Temperature

212 Degrees

Access Door Size

Open duct

Pass / Fail / Abandoned

Pass

Comments / Corrections

None


Exterior Picture of Damper



Interior Picture of Damper



Picture of Damper I.D. Label



VISUAL CUYAHOGA COUNTY DAMPER INSPECTION REPORT

Date of Inspection

2022-08-16

Facility Location

Virgil E Brown Center

Damper Location

Southwest corridor

Inspector Name

Julie Gue

Damper I.D. #

AHU1.2-S6

Damper Type

Vertical Fire Damper

Damper Size

17x8

Damper Manufacturer

Ruskin

Damper Model #

IBD2

Fusible Link Temperature

212 Degrees

Access Door Size

18x18

Pass / Fail / Abandoned

Pass

Comments / Corrections

None

Exterior Picture of Damper



Interior Picture of Damper



Picture of Damper I.D. Label



VISUAL CUYAHOGA COUNTY DAMPER INSPECTION REPORT

Date of Inspection

2022-08-16

Facility Location

Virgil E Brown Center

Damper Location

180 main lobby

Inspector Name

Julie Gue

Damper I.D. #

AHU1.2-S7

Damper Type

Vertical Fire Damper

Damper Size

17x8 oval

Damper Manufacturer

Ruskin

Damper Model #

IBD2

Fusible Link Temperature

212 Degrees

Access Door Size

18x18

Pass / Fail / Abandoned

Pass

Comments / Corrections

None

Exterior Picture of Damper



Interior Picture of Damper



Picture of Damper I.D. Label



VISUAL CUYAHOGA COUNTY DAMPER INSPECTION REPORT

Date of Inspection

2022-08-16

Facility Location

Virgil E Brown Center

Damper Location

Southwest of lobby

Inspector Name

Julie Gue

Damper I.D. #

AHU1.2-S8

Damper Type

Vertical Fire Damper

Damper Size

14x8 oval

Damper Manufacturer

Ruskin

Damper Model #

IBD2

Fusible Link Temperature

212 Degrees

Access Door Size

18x18

Pass / Fail / Abandoned

Pass

Comments / Corrections

None

Exterior Picture of Damper



Interior Picture of Damper



Picture of Damper I.D. Label



VISUAL CUYAHOGA COUNTY DAMPER INSPECTION REPORT

Date of Inspection

2022-08-16

Facility Location

Virgil E Brown Center

Damper Location

Southwest of lobby

Inspector Name

Julie Gue

Damper I.D. #

AHU1.2-S9

Damper Type

Vertical Fire Damper

Damper Size

17x8 oval

Damper Manufacturer

Ruskin

Damper Model #

IBD2

Fusible Link Temperature

212 Degrees

Access Door Size

18x18

Pass / Fail / Abandoned

Pass

Comments / Corrections

None

Exterior Picture of Damper



Interior Picture of Damper



Picture of Damper I.D. Label



Duct Fabricators, Inc.

883 Addison Rd. Cleveland, Ohio
P: 216-391-2400 F: 216-391-2492



NEMI Certified HVAC Fire Life Safety Technicians



VISUAL CUYAHOGA COUNTY DAMPER INSPECTION REPORT

Date of Inspection

2022-08-16

Facility Location

Virgil E Brown Center

Damper Location

Southwest of lobby

Inspector Name

Julie Gue

Damper I.D. #

AHU1.2-S10

Damper Type

Vertical Fire Damper

Damper Size

16x10

Damper Manufacturer

Ruskin

Damper Model #

IBD2

Fusible Link Temperature

212 Degrees

Access Door Size

18x18

Pass / Fail / Abandoned

Pass

Comments / Corrections

None


Exterior Picture of Damper



Interior Picture of Damper



Picture of Damper I.D. Label



VISUAL CUYAHOGA COUNTY DAMPER INSPECTION REPORT

Date of Inspection

2022-08-16

Facility Location

Virgil E Brown Center

Damper Location

Southwest of lobby

Inspector Name

Julie Gue

Damper I.D. #

AHU1.2-S11

Damper Type

Vertical Fire Damper

Damper Size

36x16

Damper Manufacturer

Ruskin

Damper Model #

IBD2

Fusible Link Temperature

212 Degrees

Access Door Size

18x18

Pass / Fail / Abandoned

Pass

Comments / Corrections

None


Exterior Picture of Damper



Interior Picture of Damper



Picture of Damper I.D. Label



Duct Fabricators, Inc.

883 Addison Rd. Cleveland, Ohio
P: 216-391-2400 F: 216-391-2492

FIRE SAFETY DIVISION
NEMI Certified HVAC Fire Life Safety Technicians



VISUAL CUYAHOGA COUNTY DAMPER INSPECTION REPORT

Date of Inspection

2022-08-16

Facility Location

Virgil E Brown Center

Damper Location

Front lobby

Inspector Name

Julie Gue

Damper I.D. #

AHU1.2-S13

Damper Type

Vertical Fire Damper

Damper Size

42x16

Damper Manufacturer

Ruskin

Damper Model #

IBD2

Fusible Link Temperature

212 Degrees

Access Door Size

Grille access

Pass / Fail / Abandoned

Pass

Comments / Corrections

None


Exterior Picture of Damper



Interior Picture of Damper



Picture of Damper I.D. Label



VISUAL CUYAHOGA COUNTY DAMPER INSPECTION REPORT

Date of Inspection

2022-08-16

Facility Location

Virgil E Brown Center

Damper Location

Southeast

Inspector Name

Julie Gue

Damper I.D. #

AHU1.2-S14

Damper Type

Vertical Fire Damper

Damper Size

56x16

Damper Manufacturer

Ruskin

Damper Model #

IBD2

Fusible Link Temperature

212 Degrees

Access Door Size

16x16

Pass / Fail / Abandoned

Pass

Comments / Corrections

None

Exterior Picture of Damper



Interior Picture of Damper



Picture of Damper I.D. Label



Duct Fabricators, Inc.

883 Addison Rd. Cleveland, Ohio
P: 216-391-2400 F: 216-391-2492



NEMI Certified HVAC Fire Life Safety Technicians



VISUAL CUYAHOGA COUNTY DAMPER INSPECTION REPORT

Date of Inspection

2022-08-16

Facility Location

Virgil E Brown Center

Damper Location

RM170

Inspector Name

Julie Gue

Damper I.D.

AHU1.2-S15

Damper Type

Vertical Fire Damper

Damper Size

28x10

Damper Manufacturer

Ruskin

Damper Model

IBD2

Fusible Link Temperature

212 Degrees

Access Door Size

20x20

Pass / Fail / Abandoned

Pass

Comments / Corrections

None


Exterior Picture of Damper



Interior Picture of Damper



Picture of Damper I.D. Label



VISUAL CUYAHOGA COUNTY DAMPER INSPECTION REPORT

Date of Inspection

2022-08-16

Facility Location

Virgil E Brown Center

Damper Location

Protective services

Inspector Name

Julie Gue

Damper I.D. #

AHU1.2-S16

Damper Type

Vertical Fire Damper

Damper Size

8" Round

Damper Manufacturer

Ruskin

Damper Model #

IBD2

Fusible Link Temperature

212 Degrees

Access Door Size

18x18

Pass / Fail / Abandoned

Pass

Comments / Corrections

None


Exterior Picture of Damper



Interior Picture of Damper



Picture of Damper I.D. Label



VISUAL CUYAHOGA COUNTY DAMPER INSPECTION REPORT

Date of Inspection

2022-08-16

Facility Location

Virgil E Brown Center

Damper Location

Protective services

Inspector Name

Julie Gue

Damper I.D. #

AHU1.2-S17

Damper Type

Vertical Fire Damper

Damper Size

18x10

Damper Manufacturer

Ruskin

Damper Model #

IBD2

Fusible Link Temperature

212 Degrees

Access Door Size

8x8

Pass / Fail / Abandoned

Pass

Comments / Corrections

None


Exterior Picture of Damper



Interior Picture of Damper



Picture of Damper I.D. Label



VISUAL CUYAHOGA COUNTY DAMPER INSPECTION REPORT

Date of Inspection

2022-08-16

Facility Location

Virgil E Brown Center

Damper Location

Southeast corridor

Inspector Name

Julie Gue

Damper I.D. #

AHU1.2-S18

Damper Type

Vertical Fire Damper

Damper Size

56x16

Damper Manufacturer

Ruskin

Damper Model #

IBD2

Fusible Link Temperature

212 Degrees

Access Door Size

18x18

Pass / Fail / Abandoned

Pass

Comments / Corrections

None

Exterior Picture of Damper



Interior Picture of Damper



Picture of Damper I.D. Label



Duct Fabricators, Inc.

883 Addison Rd. Cleveland, Ohio
P: 216-391-2400 F: 216-391-2492

FIRE SAFETY DIVISION

NEMI Certified HVAC Fire Life Safety Technicians



VISUAL CUYAHOGA COUNTY DAMPER INSPECTION REPORT

Date of Inspection

2022-08-10

Facility Location

Virgil E Brown Center

Damper Location

Southeast com room

Inspector Name

Julie Gue

Damper I.D. #

AHU1.2-S19

Damper Type

Vertical Fire Damper

Damper Size

8x12

Damper Manufacturer

Ruskin

Damper Model #

IBD2

Fusible Link Temperature

212 Degrees

Access Door Size

Open duct

Pass / Fail / Abandoned

Pass

Comments / Corrections

None

Exterior Picture of Damper



Interior Picture of Damper



Picture of Damper I.D. Label



VISUAL CUYAHOGA COUNTY DAMPER INSPECTION REPORT

Date of Inspection

2022-08-16

Facility Location

Virgil E Brown Center

Damper Location

Southeast corridor

Inspector Name

Julie Gue

Damper I.D. #

AHU1.2-S20

Damper Type

Vertical Fire Damper

Damper Size

56x16

Damper Manufacturer

Ruskin

Damper Model #

IBD2

Fusible Link Temperature

212 Degrees

Access Door Size

18x18

Pass / Fail / Abandoned

Pass

Comments / Corrections

None


Exterior Picture of Damper



Interior Picture of Damper



Picture of Damper I.D. Label



VISUAL CUYAHOGA COUNTY DAMPER INSPECTION REPORT

Date of Inspection

2022-08-16

Facility Location

Virgil E Brown Center

Damper Location

RM150

Inspector Name

Julie Gue

Damper I.D. #

AHU1.2-S21

Damper Type

Vertical Fire Damper

Damper Size

8" Round

Damper Manufacturer

Ruskin

Damper Model #

IBD2

Fusible Link Temperature

212 Degrees

Access Door Size

8" oval

Pass / Fail / Abandoned

Pass

Comments / Corrections

None


Exterior Picture of Damper



Interior Picture of Damper



Picture of Damper I.D. Label



VISUAL CUYAHOGA COUNTY DAMPER INSPECTION REPORT

Date of Inspection

2022-08-10

Facility Location

Virgil E Brown Center

Damper Location

Mechanical room

Inspector Name

Julie Gue

Damper I.D. #

AHU2.1-OA

Damper Type

Vertical Fire Damper

Damper Size

96x24

Damper Manufacturer

Ruskin

Damper Model #

IBD2

Fusible Link Temperature

212 Degrees

Access Door Size

16x16

Pass / Fail / Abandoned

Pass

Comments / Corrections

None


Exterior Picture of Damper



Interior Picture of Damper



Picture of Damper I.D. Label



VISUAL CUYAHOGA COUNTY DAMPER INSPECTION REPORT

Date of Inspection

2022-08-10

Facility Location

Virgil E Brown Center

Damper Location

Mechanical room

Inspector Name

Julie Gue

Damper I.D. #

AHU2.1-RA

Damper Type

Vertical Fire Damper

Damper Size

96x60

Damper Manufacturer

Ruskin

Damper Model #

IBD2

Fusible Link Temperature

212 Degrees

Access Door Size

Open duct

Pass / Fail / Abandoned

Pass

Comments / Corrections

None

Exterior Picture of Damper



Interior Picture of Damper



Picture of Damper I.D. Label



VISUAL CUYAHOGA COUNTY DAMPER INSPECTION REPORT

Date of Inspection

2022-08-08

Facility Location

Virgil E Brown Center

Damper Location

Northeast corridor

Inspector Name

Julie Gue

Damper I.D. #

AHU2.1-S1

Damper Type

Vertical Fire Damper

Damper Size

56x16

Damper Manufacturer

Ruskin

Damper Model #

IBD2

Fusible Link Temperature

212 Degrees

Access Door Size

18x18

Pass / Fail / Abandoned

Pass

Comments / Corrections

None


Exterior Picture of Damper



Interior Picture of Damper



Picture of Damper I.D. Label



VISUAL CUYAHOGA COUNTY DAMPER INSPECTION REPORT

Date of Inspection

2022-08-08

Facility Location

Virgil E Brown Center

Damper Location

Northeast corridor

Inspector Name

Julie Gue

Damper I.D. #

AHU2.1-S3

Damper Type

Vertical Fire Damper

Damper Size

56x16

Damper Manufacturer

Ruskin

Damper Model #

IBD2

Fusible Link Temperature

212 Degrees

Access Door Size

18x18

Pass / Fail / Abandoned

Pass

Comments / Corrections

None


Exterior Picture of Damper



Interior Picture of Damper



Picture of Damper I.D. Label



VISUAL CUYAHOGA COUNTY DAMPER INSPECTION REPORT

Date of Inspection

2022-08-10

Facility Location

Virgil E Brown Center

Damper Location

Northeast comm room

Inspector Name

Julie Gue

Damper I.D. #

AHU2.1-S4

Damper Type

Vertical Fire Damper

Damper Size

8x12

Damper Manufacturer

Ruskin

Damper Model #

IBD2

Fusible Link Temperature

212 Degrees

Access Door Size

Open duct

Pass / Fail / Abandoned

Pass

Comments / Corrections

None

Exterior Picture of Damper



Interior Picture of Damper



Picture of Damper I.D. Label



VISUAL CUYAHOGA COUNTY DAMPER INSPECTION REPORT

Date of Inspection

2022-08-08

Facility Location

Virgil E Brown Center

Damper Location

Northeast corridor

Inspector Name

Julie Gue

Damper I.D. #

AHU2.1-S5

Damper Type

Vertical Fire Damper

Damper Size

6" Round

Damper Manufacturer

Ruskin

Damper Model #

IBD2

Fusible Link Temperature

212 Degrees

Access Door Size

24x24

Pass / Fail / Abandoned

Pass

Comments / Corrections

None


Exterior Picture of Damper



Interior Picture of Damper



Picture of Damper I.D. Label



VISUAL CUYAHOGA COUNTY DAMPER INSPECTION REPORT

Date of Inspection

2022-08-08

Facility Location

Justice Center Court Towers

Damper Location

Northeast corridor

Inspector Name

Julie Gue

Damper I.D. #

AHU2.1-S6

Damper Type

Vertical Fire Damper

Damper Size

20x8 Oval

Damper Manufacturer

Ruskin

Damper Model #

IBD2

Fusible Link Temperature

212 Degrees

Access Door Size

18x18

Pass / Fail / Abandoned

Pass

Comments / Corrections

None


Exterior Picture of Damper



Interior Picture of Damper



Picture of Damper I.D. Label



Duct Fabricators, Inc.

883 Addison Rd. Cleveland, Ohio
P: 216-391-2400 F: 216-391-2492

FIRE SAFETY DIVISION

NEMI Certified HVAC Fire Life Safety Technicians



VISUAL CUYAHOGA COUNTY DAMPER INSPECTION REPORT

Date of Inspection

2022-08-08

Facility Location

Virgil E Brown Center

Damper Location

Northeast corridor

Inspector Name

Julie Gue

Damper I.D.

AHU2.1-S7

Damper Type

Vertical Fire Damper

Damper Size

28x10

Damper Manufacturer

Ruskin

Damper Model

IBD2

Fusible Link Temperature

212 Degrees

Access Door Size

20x20

Pass / Fail / Abandoned

Pass

Comments / Corrections

None

Exterior Picture of Damper



Interior Picture of Damper



Picture of Damper I.D. Label



VISUAL CUYAHOGA COUNTY DAMPER INSPECTION REPORT

Date of Inspection

2022-08-08

Facility Location

Virgil E Brown Center

Damper Location

AB322

Inspector Name

Julie Gue

Damper I.D. #

AHU2.1-S8

Damper Type

Vertical Fire Damper

Damper Size

6" Round

Damper Manufacturer

Ruskin

Damper Model #

IBD2

Fusible Link Temperature

212 Degrees

Access Door Size

18x18

Pass / Fail / Abandoned

Pass

Comments / Corrections

None


Exterior Picture of Damper



Interior Picture of Damper



Picture of Damper I.D. Label



VISUAL CUYAHOGA COUNTY DAMPER INSPECTION REPORT

Date of Inspection

2022-08-08

Facility Location

Virgil E Brown Center

Damper Location

Conference room 2A

Inspector Name

Julie Gue

Damper I.D. #

AHU2.1-S9

Damper Type

Vertical Fire Damper

Damper Size

10" Round

Damper Manufacturer

Ruskin

Damper Model #

IBD2

Fusible Link Temperature

212 Degrees

Access Door Size

18x18

Pass / Fail / Abandoned

Pass

Comments / Corrections

None

Exterior Picture of Damper



Interior Picture of Damper



Picture of Damper I.D. Label



VISUAL CUYAHOGA COUNTY DAMPER INSPECTION REPORT

Date of Inspection

2022-08-08

Facility Location

Virgil E Brown Center

Damper Location

RM 209

Inspector Name

Julie Gue

Damper I.D. #

AHU2.1-S10

Damper Type

Vertical Fire Damper

Damper Size

8" Round

Damper Manufacturer

Ruskin

Damper Model #

IBD2

Fusible Link Temperature

212 Degrees

Access Door Size

18x18

Pass / Fail / Abandoned

Pass

Comments / Corrections

None

Exterior Picture of Damper



Interior Picture of Damper



Picture of Damper I.D. Label



VISUAL CUYAHOGA COUNTY DAMPER INSPECTION REPORT

Date of Inspection

2022-08-08

Facility Location

Virgil E Brown Center

Damper Location

Northwest corridor

Inspector Name

Julie Gue

Damper I.D. #

AHU2.1-S11

Damper Type

Vertical Fire Damper

Damper Size

34x10

Damper Manufacturer

Ruskin

Damper Model #

IBD2

Fusible Link Temperature

212 Degrees

Access Door Size

18x18

Pass / Fail / Abandoned

Pass

Comments / Corrections

None

Exterior Picture of Damper



Interior Picture of Damper



Picture of Damper I.D. Label



VISUAL CUYAHOGA COUNTY DAMPER INSPECTION REPORT

Date of Inspection

2022-08-08

Facility Location

Virgil E Brown Center

Damper Location

Northwest corridor

Inspector Name

Julie Gue

Damper I.D. #

AHU2.1-S12

Damper Type

Vertical Fire Damper

Damper Size

20x8

Damper Manufacturer

Ruskin

Damper Model #

IBD2

Fusible Link Temperature

165 Degrees

Access Door Size

18x18

Pass / Fail / Abandoned

Pass

Comments / Corrections

None

Exterior Picture of Damper



Interior Picture of Damper



Picture of Damper I.D. Label



VISUAL CUYAHOGA COUNTY DAMPER INSPECTION REPORT

Date of Inspection

2022-08-08

Facility Location

Virgil E Brown Center

Damper Location

Northwest corridor

Inspector Name

Julie Gue

Damper I.D. #

AHU2.1-S13

Damper Type

Vertical Fire Damper

Damper Size

6" Round

Damper Manufacturer

Ruskin

Damper Model #

IBD2

Fusible Link Temperature

212 Degrees

Access Door Size

18x18

Pass / Fail / Abandoned

Pass

Comments / Corrections

None


Exterior Picture of Damper



Interior Picture of Damper



Picture of Damper I.D. Label



VISUAL CUYAHOGA COUNTY DAMPER INSPECTION REPORT

Date of Inspection

2022-08-08

Facility Location

Virgil E Brown Center

Damper Location

Northwest corridor

Inspector Name

Julie Gue

Damper I.D. #

AHU2.1-S14

Damper Type

Vertical Fire Damper

Damper Size

56x16

Damper Manufacturer

Ruskin

Damper Model #

IBD2

Fusible Link Temperature

212 Degrees

Access Door Size

18x18

Pass / Fail / Abandoned

Pass

Comments / Corrections

None


Exterior Picture of Damper



Interior Picture of Damper



Picture of Damper I.D. Label



VISUAL CUYAHOGA COUNTY DAMPER INSPECTION REPORT

Date of Inspection

2022-08-10

Facility Location

Virgil E Brown Center

Damper Location

Northwest comm room

Inspector Name

Julie Gue

Damper I.D. #

AHU2.1-S15

Damper Type

Vertical Fire Damper

Damper Size

8x12

Damper Manufacturer

Ruskin

Damper Model #

IBD2

Fusible Link Temperature

212 Degrees

Access Door Size

Open

Pass / Fail / Abandoned

Pass

Comments / Corrections

None


Exterior Picture of Damper



Interior Picture of Damper



Picture of Damper I.D. Label



VISUAL CUYAHOGA COUNTY DAMPER INSPECTION REPORT

Date of Inspection

2022-08-08

Facility Location

Virgil E Brown Center

Damper Location

Northwest corridor

Inspector Name

Julie Gue

Damper I.D. #

AHU2.1-S16

Damper Type

Vertical Fire Damper

Damper Size

56x16

Damper Manufacturer

Ruskin

Damper Model #

IBD2

Fusible Link Temperature

212 Degrees

Access Door Size

18x18

Pass / Fail / Abandoned

Pass

Comments / Corrections

None

Exterior Picture of Damper



Interior Picture of Damper



Picture of Damper I.D. Label



Duct Fabricators, Inc.

883 Addison Rd. Cleveland, Ohio
P: 216-391-2400 F: 216-391-2492

FIRE SAFETY DIVISION

NEMI Certified HVAC Fire Life Safety Technicians



VISUAL CUYAHOGA COUNTY DAMPER INSPECTION REPORT

Date of Inspection

2022-08-10

Facility Location

Virgil E Brown Center

Damper Location

Mechanical South

Inspector Name

Julie Gue

Damper I.D.

AHU2.2-OA

Damper Type

Vertical Fire Damper

Damper Size

96x24

Damper Manufacturer

Ruskin

Damper Model

IBD2

Fusible Link Temperature

212 Degrees

Access Door Size

16x16

Pass / Fail / Abandoned

Pass

Comments / Corrections

None


Exterior Picture of Damper



Interior Picture of Damper



Picture of Damper I.D. Label



VISUAL CUYAHOGA COUNTY DAMPER INSPECTION REPORT

Date of Inspection

2022-08-10

Facility Location

Virgil E Brown Center

Damper Location

Mechanical South

Inspector Name

Julie Gue

Damper I.D. #

AHU2.2-RA

Damper Type

Vertical Fire Damper

Damper Size

96x60

Damper Manufacturer

Ruskin

Damper Model #

IBD2

Fusible Link Temperature

212 Degrees

Access Door Size

Open duct

Pass / Fail / Abandoned

Pass

Comments / Corrections

None


Exterior Picture of Damper



Interior Picture of Damper



Picture of Damper I.D. Label



VISUAL CUYAHOGA COUNTY DAMPER INSPECTION REPORT

Date of Inspection

2022-08-08

Facility Location

Virgil E Brown Center

Damper Location

By break room

Inspector Name

Julie Gue

Damper I.D. #

AHU2.2-S1

Damper Type

Vertical Fire Damper

Damper Size

38x8

Damper Manufacturer

Ruskin

Damper Model #

IBD2 OW

Fusible Link Temperature

165 Degrees

Access Door Size

12x12


Pass / Fail / Abandoned

Pass

Comments / Corrections

None


Exterior Picture of Damper



Interior Picture of Damper



Picture of Damper I.D. Label



VISUAL CUYAHOGA COUNTY DAMPER INSPECTION REPORT

Date of Inspection
2022-08-08

Facility Location
Virgil E Brown Center

Damper Location
Break room

Inspector Name
Julie Gue

Damper I.D. #
AHU2.2-S2

Damper Type
Vertical Fire Damper

Damper Size
38x8

Damper Manufacturer
Ruskin

Damper Model #
IBD2 OW

Fusible Link Temperature
165 Degrees

Access Door Size
12x12

Pass / Fail / Abandoned
Pass

Comments / Corrections
None


Exterior Picture of Damper



Interior Picture of Damper



Picture of Damper I.D. Label



VISUAL CUYAHOGA COUNTY DAMPER INSPECTION REPORT

Date of Inspection

2022-08-08

Facility Location

Virgil E Brown Center

Damper Location

Southwest corridor

Inspector Name

Julie Gue

Damper I.D. #

AHU2.2-S3

Damper Type

Vertical Fire Damper

Damper Size

56x16

Damper Manufacturer

Ruskin

Damper Model #

IBD2

Fusible Link Temperature

212 Degrees

Access Door Size

18x18

Pass / Fail / Abandoned

Pass

Comments / Corrections

None


Exterior Picture of Damper



Interior Picture of Damper



Picture of Damper I.D. Label



VISUAL CUYAHOGA COUNTY DAMPER INSPECTION REPORT

Date of Inspection

2022-08-08

Facility Location

Virgil E Brown Center

Damper Location

Southwest corridor

Inspector Name

Julie Gue

Damper I.D. #

AHU2.2-S4

Damper Type

Vertical Fire Damper

Damper Size

56x16

Damper Manufacturer

Ruskin

Damper Model #

IBD2

Fusible Link Temperature

165 Degrees

Access Door Size

18x18

Pass / Fail / Abandoned

Pass

Comments / Corrections

None


Exterior Picture of Damper



Interior Picture of Damper



Picture of Damper I.D. Label



VISUAL CUYAHOGA COUNTY DAMPER INSPECTION REPORT

Date of Inspection

2022-08-10

Facility Location

Virgil E Brown Center

Damper Location

Southwest comm room

Inspector Name

Julie Gue

Damper I.D. #

AHU2.2-S5

Damper Type

Vertical Fire Damper

Damper Size

8x12

Damper Manufacturer

Ruskin

Damper Model #

IBD2

Fusible Link Temperature

212 Degrees

Access Door Size

Open duct

Pass / Fail / Abandoned

Pass

Comments / Corrections

None


Exterior Picture of Damper



Interior Picture of Damper



Picture of Damper I.D. Label



VISUAL CUYAHOGA COUNTY DAMPER INSPECTION REPORT

Date of Inspection
2022-08-08

Facility Location
Virgil E Brown Center

Damper Location
Southwest corridor

Inspector Name
Julie Gue

Damper I.D. #
AHU2.2-S6

Damper Type
Vertical Fire Damper

Damper Size
6" Round

Damper Manufacturer
Ruskin

Damper Model #
IBD2

Fusible Link Temperature
212 Degrees

Access Door Size
18x18

Pass / Fail / Abandoned
Pass

Comments / Corrections
None

Exterior Picture of Damper



Interior Picture of Damper



Picture of Damper I.D. Label

FIRE DAMPER	
<i>Visual inspection</i>	
Inspection Date: 8/8/22	Reference I.D.#
Inspected By: GUE	AHU22-S6
Next Inspect. By: 8/8/24	

Duct Fabricators, Inc.
883 Addison Rd. Cleveland, Ohio
P: 216-391-2400 F: 216-391-2492

FIRE SAFETY DIVISION
NEMI Certified HVAC Fire Life Safety Technicians

MEMBER
NFPA

VISUAL CUYAHOGA COUNTY DAMPER INSPECTION REPORT

Date of Inspection

2022-08-08

Facility Location

Virgil E Brown Center

Damper Location

Southwest corridor

Inspector Name

Julie Gue

Damper I.D. #

AHU2.2-S7

Damper Type

Vertical Fire Damper

Damper Size

16" oval

Damper Manufacturer

Ruskin

Damper Model #

IBD2

Fusible Link Temperature

165 Degrees

Access Door Size

18x18

Pass / Fail / Abandoned

Pass


Comments / Corrections

None


Exterior Picture of Damper



Interior Picture of Damper



Picture of Damper I.D. Label



VISUAL CUYAHOGA COUNTY DAMPER INSPECTION REPORT

Date of Inspection

2022-08-08

Facility Location

Virgil E Brown Center

Damper Location

RM260

Inspector Name

Julie Gue

Damper I.D. #

AHU2.2-S8

Damper Type

Vertical Fire Damper

Damper Size

6" Round

Damper Manufacturer

Ruskin

Damper Model #

IBD2

Fusible Link Temperature

212 Degrees

Access Door Size

18x18

Pass / Fail / Abandoned

Pass

Comments / Corrections

None


Exterior Picture of Damper



Interior Picture of Damper



Picture of Damper I.D. Label



VISUAL CUYAHOGA COUNTY DAMPER INSPECTION REPORT

Date of Inspection

2022-08-08

Facility Location

Virgil E Brown Center

Damper Location

RM260A

Inspector Name

Julie Gue

Damper I.D. #

AHU2.2-S9

Damper Type

Vertical Fire Damper

Damper Size

32x10

Damper Manufacturer

Ruskin

Damper Model #

IBD2

Fusible Link Temperature

212 Degrees

Access Door Size

18x18

Pass / Fail / Abandoned

Pass

Comments / Corrections

None


Exterior Picture of Damper



Interior Picture of Damper



Picture of Damper I.D. Label



VISUAL CUYAHOGA COUNTY DAMPER INSPECTION REPORT

Date of Inspection

2022-08-08

Facility Location

Virgil E Brown Center

Damper Location

Conference room 2C

Inspector Name

Julie Gue

Damper I.D. #

AHU2.2-S10

Damper Type

Vertical Fire Damper

Damper Size

12" Round

Damper Manufacturer

Ruskin

Damper Model #

IBD2

Fusible Link Temperature

165 Degrees

Access Door Size

18x18

Pass / Fail / Abandoned

Pass

Comments / Corrections

None

Exterior Picture of Damper



Interior Picture of Damper



Picture of Damper I.D. Label



VISUAL CUYAHOGA COUNTY DAMPER INSPECTION REPORT

Date of Inspection

2022-08-08

Facility Location

Virgil E Brown Center

Damper Location

Conference room 2B

Inspector Name

Julie Gue

Damper I.D. #

AHU2.2-S11

Damper Type

Vertical Fire Damper

Damper Size

12" oval

Damper Manufacturer

Ruskin

Damper Model #

IBD2

Fusible Link Temperature

212 Degrees

Access Door Size

18x18

Pass / Fail / Abandoned

Pass

Comments / Corrections

None

Exterior Picture of Damper



Interior Picture of Damper



Picture of Damper I.D. Label



VISUAL CUYAHOGA COUNTY DAMPER INSPECTION REPORT

Date of Inspection

2022-08-09

Facility Location

Virgil E Brown Center

Damper Location

Lactation room

Inspector Name

Julie Gue

Damper I.D. #

AHU2.2-S12

Damper Type

Vertical Fire Damper

Damper Size

34x19

Damper Manufacturer

Ruskin

Damper Model #

IBD2

Fusible Link Temperature

165 Degrees

Access Door Size

18x18

Pass / Fail / Abandoned

Pass

Comments / Corrections

None


Exterior Picture of Damper



Interior Picture of Damper



Picture of Damper I.D. Label



VISUAL CUYAHOGA COUNTY DAMPER INSPECTION REPORT

Date of Inspection

2022-08-09

Facility Location

Virgil E Brown Center

Damper Location

Southeast

Inspector Name

Julie Gue

Damper I.D. #

AHU2.2-S13

Damper Type

Vertical Fire Damper

Damper Size

6" Round

Damper Manufacturer

Ruskin

Damper Model #

IBD2

Fusible Link Temperature

165 Degrees

Access Door Size

18x18

Pass / Fail / Abandoned

Pass

Comments / Corrections

None


Exterior Picture of Damper



Interior Picture of Damper



Picture of Damper I.D. Label



VISUAL CUYAHOGA COUNTY DAMPER INSPECTION REPORT

Date of Inspection

2022-08-09

Facility Location

Virgil E Brown Center

Damper Location

Southeast corridor

Inspector Name

Julie Gue

Damper I.D. #

AHU2.2-S14

Damper Type

Vertical Fire Damper

Damper Size

6" Round

Damper Manufacturer

Ruskin

Damper Model #

IBD2

Fusible Link Temperature

165 Degrees

Access Door Size

18x18

Pass / Fail / Abandoned

Pass

Comments / Corrections

None


Exterior Picture of Damper



Interior Picture of Damper



Picture of Damper I.D. Label



VISUAL CUYAHOGA COUNTY DAMPER INSPECTION REPORT

Date of Inspection

2022-08-09

Facility Location

Virgil E Brown Center

Damper Location

Southeast corridor

Inspector Name

Julie Gue

Damper I.D. #

AHU2.2-S15

Damper Type

Vertical Fire Damper

Damper Size

56x16

Damper Manufacturer

Ruskin

Damper Model #

IBD2

Fusible Link Temperature

212 Degrees

Access Door Size

18x18

Pass / Fail / Abandoned

Pass

Comments / Corrections

None


Exterior Picture of Damper



Interior Picture of Damper



Picture of Damper I.D. Label



VISUAL CUYAHOGA COUNTY DAMPER INSPECTION REPORT

Date of Inspection

2022-08-10

Facility Location

Virgil E Brown Center

Damper Location

Southeast com room

Inspector Name

Julie Gue

Damper I.D. #

AHU2.2-S16

Damper Type

Vertical Fire Damper

Damper Size

8x12

Damper Manufacturer

Ruskin

Damper Model #

IBD2

Fusible Link Temperature

212 Degrees

Access Door Size

Open access

Pass / Fail / Abandoned

Pass

Comments / Corrections

None


Exterior Picture of Damper



Interior Picture of Damper



Picture of Damper I.D. Label



VISUAL CUYAHOGA COUNTY DAMPER INSPECTION REPORT

Date of Inspection

2022-08-09

Facility Location

Virgil E Brown Center

Damper Location

Southeast corridor

Inspector Name

Julie Gue

Damper I.D. #

AHU2.2-S17

Damper Type

Vertical Fire Damper

Damper Size

56x16

Damper Manufacturer

Ruskin

Damper Model #

IBD2

Fusible Link Temperature

212 Degrees

Access Door Size

18x18

Pass / Fail / Abandoned

Pass

Comments / Corrections

None


Exterior Picture of Damper



Interior Picture of Damper



Picture of Damper I.D. Label



VISUAL CUYAHOGA COUNTY DAMPER INSPECTION REPORT

Date of Inspection
2022-08-09

Facility Location
Virgil E Brown Center

Damper Location
Lobby 240

Inspector Name
Julie Gue

Damper I.D. #
AHU2.2-S18

Damper Type
Vertical Fire Damper

Damper Size
18x10

Damper Manufacturer
Ruskin

Damper Model #
IBD2

Fusible Link Temperature
212 Degrees

Access Door Size
2x12

Pass / Fail / Abandoned
Pass

Comments / Corrections
None


Exterior Picture of Damper



Interior Picture of Damper



Picture of Damper I.D. Label



VISUAL CUYAHOGA COUNTY DAMPER INSPECTION REPORT

Date of Inspection

2022-08-04

Facility Location

Virgil E Brown Center

Damper Location

3rd floor mechanical room north

Inspector Name

Dan Tulcewicz

Damper I.D. #

AHU3.1- 0A

Damper Type

Vertical Fire Damper

Damper Size

96x24

Damper Manufacturer

Ruskin

Damper Model #

IBD2

Fusible Link Temperature

212 Degrees

Access Door Size

16x16

Pass / Fail / Abandoned

Pass

Comments / Corrections

None


Exterior Picture of Damper



Interior Picture of Damper



Picture of Damper I.D. Label



VISUAL CUYAHOGA COUNTY DAMPER INSPECTION REPORT

Date of Inspection

2022-08-05

Facility Location

Virgil E Brown Center

Damper Location

3rd floor north

Inspector Name

Dan Tulcewicz

Damper I.D. #

AHU3.1-S1

Damper Type

Vertical Fire Damper

Damper Size

56x16

Damper Manufacturer

Ruskin

Damper Model #

IBD2

Fusible Link Temperature

212 Degrees

Access Door Size

18x18

Pass / Fail / Abandoned

Pass

Comments / Corrections

None


Exterior Picture of Damper



Interior Picture of Damper



Picture of Damper I.D. Label



VISUAL CUYAHOGA COUNTY DAMPER INSPECTION REPORT

Date of Inspection

2022-08-05

Facility Location

Virgil E Brown Center

Damper Location

3rd floor north

Inspector Name

Dan Tulcewicz

Damper I.D. #

AHU3.1-S2

Damper Type

Vertical Fire Damper

Damper Size

56x16

Damper Manufacturer

Ruskin

Damper Model #

IBD2

Fusible Link Temperature

212 Degrees

Access Door Size

18x18

Pass / Fail / Abandoned

Pass

Comments / Corrections

None


Exterior Picture of Damper



Interior Picture of Damper



Picture of Damper I.D. Label



VISUAL CUYAHOGA COUNTY DAMPER INSPECTION REPORT

Date of Inspection

2022-08-03

Facility Location

Virgil E Brown Center

Damper Location

North telephone room

Inspector Name

Dan Tulcewicz

Damper I.D. #

AHU3.1-S3

Damper Type

Vertical Fire Damper

Damper Size

12x8

Damper Manufacturer

Ruskin

Damper Model #

IBD2

Fusible Link Temperature

212 Degrees

Access Door Size

Open

Pass / Fail / Abandoned

Pass

Comments / Corrections

None

Exterior Picture of Damper



Interior Picture of Damper



Picture of Damper I.D. Label



VISUAL CUYAHOGA COUNTY DAMPER INSPECTION REPORT

Date of Inspection
2022-08-09

Facility Location
Virgil E Brown Center

Damper Location
Northeast corridor

Inspector Name
Julie Gue

Damper I.D. #
AHU3.1-S4

Damper Type
Vertical Fire Damper

Damper Size
8" Round

Damper Manufacturer
Ruskin

Damper Model #
IBD2

Fusible Link Temperature
165 Degrees

Access Door Size
14x14

Pass / Fail / Abandoned
Pass

Comments / Corrections
None


Exterior Picture of Damper



Interior Picture of Damper



Picture of Damper I.D. Label



VISUAL CUYAHOGA COUNTY DAMPER INSPECTION REPORT

Date of Inspection

2022-08-05

Facility Location

Virgil E Brown Center

Damper Location

3rd floor north

Inspector Name

Dan Tulcewicz

Damper I.D. #

AHU3.1-S5

Damper Type

Vertical Fire Damper

Damper Size

40x12

Damper Manufacturer

Ruskin

Damper Model #

IBD2

Fusible Link Temperature

212 Degrees

Access Door Size

18x18

Pass / Fail / Abandoned

Pass

Comments / Corrections

None

Exterior Picture of Damper



Interior Picture of Damper



Picture of Damper I.D. Label



Duct Fabricators, Inc.

883 Addison Rd. Cleveland, Ohio
P: 216-391-2400 F: 216-391-2492

FIRE SAFETY DIVISION
NEMI Certified HVAC Fire Life Safety Technicians



VISUAL CUYAHOGA COUNTY DAMPER INSPECTION REPORT

Date of Inspection

2022-08-05

Facility Location

Virgil E Brown Center

Damper Location

3rd floor north

Inspector Name

Dan Tulcewicz

Damper I.D.

AHU3.1-S6

Damper Type

Vertical Fire Damper

Damper Size

56x16

Damper Manufacturer

Ruskin

Damper Model

IBD2

Fusible Link Temperature

212 Degrees

Access Door Size

18x18

Pass / Fail / Abandoned

Pass

Comments / Corrections

None

Exterior Picture of Damper



Interior Picture of Damper



Picture of Damper I.D. Label



Duct Fabricators, Inc.

883 Addison Rd. Cleveland, Ohio
P: 216-391-2400 F: 216-391-2492



VISUAL CUYAHOGA COUNTY DAMPER INSPECTION REPORT

Date of Inspection

2022-08-05

Facility Location

Virgil E Brown Center

Damper Location

3rd floor north

Inspector Name

Dan Tulcewicz

Damper I.D. #

AHU3.1-S7

Damper Type

Vertical Fire Damper

Damper Size

56x16

Damper Manufacturer

Ruskin

Damper Model #

IBD2

Fusible Link Temperature

212 Degrees

Access Door Size

18x18

Pass / Fail / Abandoned

Pass

Comments / Corrections

None


Exterior Picture of Damper



Interior Picture of Damper



Picture of Damper I.D. Label



VISUAL CUYAHOGA COUNTY DAMPER INSPECTION REPORT

Date of Inspection

2022-08-05

Facility Location

Virgil E Brown Center

Damper Location

3rd floor north

Inspector Name

Dan Tulcewicz

Damper I.D. #

AHU3.1-S8

Damper Type

Vertical Fire Damper

Damper Size

20x10

Damper Manufacturer

Ruskin

Damper Model #

IBD2

Fusible Link Temperature

212 Degrees

Access Door Size

18x18

Pass / Fail / Abandoned

Pass

Comments / Corrections

None

Exterior Picture of Damper



Interior Picture of Damper



Picture of Damper I.D. Label



VISUAL CUYAHOGA COUNTY DAMPER INSPECTION REPORT

Date of Inspection

2022-08-05

Facility Location

Virgil E Brown Center

Damper Location

3rd floor north

Inspector Name

Dan Tulcewicz

Damper I.D. #

AHU3.1-S9

Damper Type

Vertical Fire Damper

Damper Size

16"Oval

Damper Manufacturer

Ruskin

Damper Model #

IBD2

Fusible Link Temperature

212 Degrees

Access Door Size

18x18

Pass / Fail / Abandoned

Pass

Comments / Corrections

None

Exterior Picture of Damper



Interior Picture of Damper



Picture of Damper I.D. Label



VISUAL CUYAHOGA COUNTY DAMPER INSPECTION REPORT

Date of Inspection

2022-08-05

Facility Location

Virgil E Brown Center

Damper Location

3rd floor north

Inspector Name

Dan Tulcewicz

Damper I.D. #

AHU3.1-S10

Damper Type

Vertical Fire Damper

Damper Size

6" Round

Damper Manufacturer

Ruskin

Damper Model #

IBD2

Fusible Link Temperature

212 Degrees

Access Door Size

18x18

Pass / Fail / Abandoned

Pass

Comments / Corrections

None

Exterior Picture of Damper



Interior Picture of Damper



Picture of Damper I.D. Label



VISUAL CUYAHOGA COUNTY DAMPER INSPECTION REPORT

Date of Inspection

2022-08-05

Facility Location

Virgil E Brown Center

Damper Location

3rd floor north

Inspector Name

Dan Tulcewicz

Damper I.D. #

AHU3.1-S11

Damper Type

Vertical Fire Damper

Damper Size

56x16

Damper Manufacturer

Ruskin

Damper Model #

IBD2

Fusible Link Temperature

212 Degrees

Access Door Size

18x18

Pass / Fail / Abandoned

Pass

Comments / Corrections

None


Exterior Picture of Damper



Interior Picture of Damper



Picture of Damper I.D. Label



Duct Fabricators, Inc.

883 Addison Rd. Cleveland, Ohio
P: 216-391-2400 F: 216-391-2492

FIRE SAFETY DIVISION

NEMI Certified HVAC Fire Life Safety Technicians



VISUAL CUYAHOGA COUNTY DAMPER INSPECTION REPORT

Date of Inspection

2022-08-03

Facility Location

Virgil E Brown Center

Damper Location

3rd floor north telephone room

Inspector Name

Dan Tulcewicz

Damper I.D.

AHU3.1-S12

Damper Type

Vertical Fire Damper

Damper Size

8x12

Damper Manufacturer

Ruskin

Damper Model

IBD2

Fusible Link Temperature

212 Degrees

Access Door Size

Open

Pass / Fail / Abandoned

Pass

Comments / Corrections

None

Exterior Picture of Damper



Interior Picture of Damper



Picture of Damper I.D. Label



VISUAL CUYAHOGA COUNTY DAMPER INSPECTION REPORT

Date of Inspection

2022-08-05

Facility Location

Virgil E Brown Center

Damper Location

3rd floor north

Inspector Name

Dan Tulcewicz

Damper I.D. #

AHU3.1-S13

Damper Type

Vertical Fire Damper

Damper Size

56x16

Damper Manufacturer

Ruskin

Damper Model #

IBD2

Fusible Link Temperature

212 Degrees

Access Door Size

18x18

Pass / Fail / Abandoned

Pass

Comments / Corrections

None


Exterior Picture of Damper



Interior Picture of Damper



Picture of Damper I.D. Label



VISUAL CUYAHOGA COUNTY DAMPER INSPECTION REPORT

Date of Inspection

2022-08-09

Facility Location

Virgil E Brown Center

Damper Location

Southeast corridor

Inspector Name

Julie Gue

Damper I.D. #

AHU3.1-S14

Damper Type

Vertical Fire Damper

Damper Size

14" oval

Damper Manufacturer

Ruskin

Damper Model #

IBD2

Fusible Link Temperature

165 Degrees

Access Door Size

8x8

Pass / Fail / Abandoned

Pass

Comments / Corrections

None

Exterior Picture of Damper



Interior Picture of Damper



Picture of Damper I.D. Label



Duct Fabricators, Inc.

883 Addison Rd. Cleveland, Ohio
P: 216-391-2400 F: 216-391-2492

FIRE SAFETY DIVISION

NEMI Certified HVAC Fire Life Safety Technicians



VISUAL CUYAHOGA COUNTY DAMPER INSPECTION REPORT

Date of Inspection

2022-08-09

Facility Location

Virgil E Brown Center

Damper Location

AHU3.2 South

Inspector Name

Dan Tulcewicz

Damper I.D. #

AHU3.2-14

Damper Type

Vertical Fire Damper

Damper Size

56x16

Damper Manufacturer

Ruskin

Damper Model #

IBD2

Fusible Link Temperature

212 Degrees

Access Door Size

18x18

Pass / Fail / Abandoned

Pass

Comments / Corrections

None


Exterior Picture of Damper



Interior Picture of Damper



Picture of Damper I.D. Label



Duct Fabricators, Inc.

883 Addison Rd. Cleveland, Ohio
P: 216-391-2400 F: 216-391-2492



NEMI Certified HVAC Fire Life Safety Technicians



VISUAL CUYAHOGA COUNTY DAMPER INSPECTION REPORT

Date of Inspection

2022-08-04

Facility Location

Virgil E Brown Center

Damper Location

3rd floor mechanical room South

Inspector Name

Dan Tulcewicz

Damper I.D.

AHU3.2-OA

Damper Type

Vertical Fire Damper

Damper Size

96x24

Damper Manufacturer

Ruskin

Damper Model

IBD2

Fusible Link Temperature

212 Degrees

Access Door Size

16x16

Pass / Fail / Abandoned

Pass

Comments / Corrections

None

Exterior Picture of Damper



Interior Picture of Damper



Picture of Damper I.D. Label

Visual Insp

FIRE
DAMPER

Inspection Date: 8-4-2022	Reference I.D. #: AHU3.2-OA
Inspected By: TULCEWICZ	
Next Inspect. By: 8-4-2024	

Duct Fabricators, Inc.
883 Addison Rd. Cleveland, Ohio
P: 216-391-2400 F: 216-391-2492

FIRE SAFETY DIVISION
NEMI Certified HVAC Fire Life Safety Technicians

MEMBER
NFPA

Duct Fabricators, Inc.

883 Addison Rd. Cleveland, Ohio
P: 216-391-2400 F: 216-391-2492



NEMI Certified HVAC Fire Life Safety Technicians



VISUAL CUYAHOGA COUNTY DAMPER INSPECTION REPORT

Date of Inspection

2022-08-04

Facility Location

Virgil E Brown Center

Damper Location

3rd floor mechanical room north

Inspector Name

Dan Tulcewicz

Damper I.D.

AHU3.2-RA

Damper Type

Vertical Fire Damper

Damper Size

96x60

Damper Manufacturer

Ruskin

Damper Model

IBD2

Fusible Link Temperature

212 Degrees

Access Door Size

Open

Pass / Fail / Abandoned

Pass

Comments / Corrections

None

Exterior Picture of Damper



Interior Picture of Damper



Picture of Damper I.D. Label

Visual Insp. **FIRE DAMPER**

Inspection Date: 8-4-2022	Reference I.D.#:
Inspected By: TULCEWICZ	AHU3.2-RA
Next Inspect. By: 8-4-2024	

Duct Fabricators, Inc. 883 Addison Rd. Cleveland, Ohio P: 216-391-2400 F: 216-391-2492

FIRE SAFETY DIVISION
NEMI Certified HVAC Fire Life Safety Technicians

MEMBER
NFPA

VISUAL CUYAHOGA COUNTY DAMPER INSPECTION REPORT

Date of Inspection

2022-08-09

Facility Location

Virgil E Brown Center

Damper Location

RM 390

Inspector Name

Julie Gue

Damper I.D. #

AHU3.2-S1

Damper Type

Vertical Fire Damper

Damper Size

36x8

Damper Manufacturer

Ruskin

Damper Model #

IBD20W

Fusible Link Temperature

212 Degrees

Access Door Size

12x12

Pass / Fail / Abandoned

Pass

Comments / Corrections

None


Exterior Picture of Damper



Interior Picture of Damper



Picture of Damper I.D. Label



VISUAL CUYAHOGA COUNTY DAMPER INSPECTION REPORT

Date of Inspection

2022-08-09

Facility Location

Virgil E Brown Center

Damper Location

RM390

Inspector Name

Julie Gue

Damper I.D. #

AHU3.2-S2

Damper Type

Vertical Fire Damper

Damper Size

36x8

Damper Manufacturer

Ruskin

Damper Model #

IBD2 OW

Fusible Link Temperature

212 Degrees

Access Door Size

12x12

Pass / Fail / Abandoned

Pass

Comments / Corrections

None


Exterior Picture of Damper



Interior Picture of Damper



Picture of Damper I.D. Label



VISUAL CUYAHOGA COUNTY DAMPER INSPECTION REPORT

Date of Inspection

2022-08-05

Facility Location

Virgil E Brown Center

Damper Location

3rd floor South

Inspector Name

Dan Tulcewicz

Damper I.D. #

AHU3.2-S3

Damper Type

Vertical Fire Damper

Damper Size

56x16

Damper Manufacturer

Ruskin

Damper Model #

IBD2

Fusible Link Temperature

212 Degrees

Access Door Size

18x18

Pass / Fail / Abandoned

Pass

Comments / Corrections

None

Exterior Picture of Damper



Interior Picture of Damper



Picture of Damper I.D. Label



VISUAL CUYAHOGA COUNTY DAMPER INSPECTION REPORT

Date of Inspection

2022-08-05

Facility Location

Virgil E Brown Center

Damper Location

3rd floor South

Inspector Name

Dan Tulcewicz

Damper I.D. #

AHU3.2-S4

Damper Type

Vertical Fire Damper

Damper Size

56x16

Damper Manufacturer

Ruskin

Damper Model #

IBD2

Fusible Link Temperature

212 Degrees

Access Door Size

18x18

Pass / Fail / Abandoned

Pass

Comments / Corrections

None

Exterior Picture of Damper



Interior Picture of Damper



Picture of Damper I.D. Label



VISUAL CUYAHOGA COUNTY DAMPER INSPECTION REPORT

Date of Inspection

2022-08-03

Facility Location

Virgil E Brown Center

Damper Location

South Telephone Room

Inspector Name

Dan Tulcewicz

Damper I.D. #

AHU3.2-S5

Damper Type

Vertical Fire Damper

Damper Size

8x12

Damper Manufacturer

Ruskin

Damper Model #

IBD2

Fusible Link Temperature

212 Degrees

Access Door Size

Open

Pass / Fail / Abandoned

Pass

Comments / Corrections

None

Exterior Picture of Damper



Interior Picture of Damper



Picture of Damper I.D. Label



VISUAL CUYAHOGA COUNTY DAMPER INSPECTION REPORT

Date of Inspection

2022-08-05

Facility Location

Virgil E Brown Center

Damper Location

3rd floor South

Inspector Name

Dan Tulcewicz

Damper I.D. #

AHU3.2-S6

Damper Type

Vertical Fire Damper

Damper Size

14x8 Oval

Damper Manufacturer

Ruskin

Damper Model #

IBD2

Fusible Link Temperature

212 Degrees

Access Door Size

18x18

Pass / Fail / Abandoned

Pass


Comments / Corrections

None


Exterior Picture of Damper



Interior Picture of Damper



Picture of Damper I.D. Label



VISUAL CUYAHOGA COUNTY DAMPER INSPECTION REPORT

Date of Inspection

2022-08-05

Facility Location

Virgil E Brown Center

Damper Location

3rd floor South

Inspector Name

Dan Tulcewicz

Damper I.D. #

AHU3.2-S7

Damper Type

Vertical Fire Damper

Damper Size

6" Round

Damper Manufacturer

Ruskin

Damper Model #

IBD2

Fusible Link Temperature

212 Degrees

Access Door Size

18x18

Pass / Fail / Abandoned

Pass

Comments / Corrections

None


Exterior Picture of Damper



Interior Picture of Damper



Picture of Damper I.D. Label



VISUAL CUYAHOGA COUNTY DAMPER INSPECTION REPORT

Date of Inspection

2022-08-05

Facility Location

Virgil E Brown Center

Damper Location

3rd floor South

Inspector Name

Dan Tulcewicz

Damper I.D. #

AHU3.2-S8

Damper Type

Vertical Fire Damper

Damper Size

56x18

Damper Manufacturer

Ruskin

Damper Model #

IBD2

Fusible Link Temperature

212 Degrees

Access Door Size

18x18

Pass / Fail / Abandoned

Pass

Comments / Corrections

None

Exterior Picture of Damper



Interior Picture of Damper



Picture of Damper I.D. Label



VISUAL CUYAHOGA COUNTY DAMPER INSPECTION REPORT

Date of Inspection

2022-08-05

Facility Location

Virgil E Brown Center

Damper Location

3rd floor South

Inspector Name

Dan Tulcewicz

Damper I.D. #

AHU3.2-S9

Damper Type

Vertical Fire Damper

Damper Size

56x16

Damper Manufacturer

Ruskin

Damper Model #

IBD2

Fusible Link Temperature

212 Degrees

Access Door Size

18x18

Pass / Fail / Abandoned

Pass

Comments / Corrections

None

Exterior Picture of Damper



Interior Picture of Damper



Picture of Damper I.D. Label



VISUAL CUYAHOGA COUNTY DAMPER INSPECTION REPORT

Date of Inspection

2022-08-05

Facility Location

Virgil E Brown Center

Damper Location

3rd floor South

Inspector Name

Dan Tulcewicz

Damper I.D. #

AHU3.2-S10

Damper Type

Vertical Fire Damper

Damper Size

20x8 Oval

Damper Manufacturer

Ruskin

Damper Model #

IBD2

Fusible Link Temperature

212 Degrees

Access Door Size

18x18

Pass / Fail / Abandoned

Pass

Comments / Corrections

None


Exterior Picture of Damper



Interior Picture of Damper



Picture of Damper I.D. Label



Duct Fabricators, Inc.

883 Addison Rd. Cleveland, Ohio
P: 216-391-2400 F: 216-391-2492



NEMI Certified HVAC Fire Life Safety Technicians



VISUAL CUYAHOGA COUNTY DAMPER INSPECTION REPORT

Date of Inspection

2022-08-05

Facility Location

Virgil E Brown Center

Damper Location

3rd floor South

Inspector Name

Dan Tulcewicz

Damper I.D.

AHU3.2-S11

Damper Type

Vertical Fire Damper

Damper Size

6" Round

Damper Manufacturer

Ruskin

Damper Model

IBD2

Fusible Link Temperature

212 Degrees

Access Door Size

18x18

Pass / Fail / Abandoned

Pass

Comments / Corrections

None

Exterior Picture of Damper



Interior Picture of Damper



Picture of Damper I.D. Label

Visual Insp. **FIRE DAMPER**

Inspection Date: <u>8-5-2022</u>	Reference I.D.#: <u>AHU3.2-S11</u>
Inspected By: <u>TULCEWICZ</u>	
Next Inspect. By: <u>8-5-2024</u>	

Duct Fabricators, Inc.
883 Addison Rd. Cleveland, Ohio
P: 216-391-2400 F: 216-391-2492

FIRE SAFETY DIVISION
NEMI Certified HVAC Fire Life Safety Technicians

MEMBER
NFPA

VISUAL CUYAHOGA COUNTY DAMPER INSPECTION REPORT

Date of Inspection

2022-08-05

Facility Location

Virgil E Brown Center

Damper Location

3rd floor South

Inspector Name

Dan Tulcewicz

Damper I.D. #

AHU3.2-S12

Damper Type

Vertical Fire Damper

Damper Size

56x16

Damper Manufacturer

Ruskin

Damper Model #

IBD2

Fusible Link Temperature

212 Degrees

Access Door Size

18x18

Pass / Fail / Abandoned

Pass

Comments / Corrections

None


Exterior Picture of Damper



Interior Picture of Damper



Picture of Damper I.D. Label



VISUAL CUYAHOGA COUNTY DAMPER INSPECTION REPORT

Date of Inspection

2022-08-03

Facility Location

Virgil E Brown Center

Damper Location

3rd floor South Telephone Room

Inspector Name

Dan Tulcewicz

Damper I.D. #

AHU3.2-S13

Damper Type

Vertical Fire Damper

Damper Size

8x12

Damper Manufacturer

Ruskin

Damper Model #

IBD2

Fusible Link Temperature

212 Degrees

Access Door Size

Open

Pass / Fail / Abandoned

Pass

Comments / Corrections

None


Exterior Picture of Damper



Interior Picture of Damper



Picture of Damper I.D. Label



VISUAL CUYAHOGA COUNTY DAMPER INSPECTION REPORT

Date of Inspection

2022-08-09

Facility Location

Virgil E Brown Center

Damper Location

RM 350

Inspector Name

Dan Tulcewicz

Damper I.D. #

AHU3.2-S15

Damper Type

Vertical Fire Damper

Damper Size

14" oval

Damper Manufacturer

Ruskin

Damper Model #

IBD2

Fusible Link Temperature

212 Degrees

Access Door Size

Flex

Pass / Fail / Abandoned

Pass

Comments / Corrections

None


Exterior Picture of Damper



Interior Picture of Damper



Picture of Damper I.D. Label



VISUAL CUYAHOGA COUNTY DAMPER INSPECTION REPORT

Date of Inspection

2022-08-05

Facility Location

Virgil E Brown Center

Damper Location

3rd floor South

Inspector Name

Dan Tulcewicz

Damper I.D. #

AHU3.2-S16

Damper Type

Vertical Fire Damper

Damper Size

14" Oval

Damper Manufacturer

Ruskin

Damper Model #

IBD2

Fusible Link Temperature

212 Degrees

Access Door Size

10x10

Pass / Fail / Abandoned

Pass

Comments / Corrections

None

Exterior Picture of Damper



Interior Picture of Damper



Picture of Damper I.D. Label



Duct Fabricators, Inc.

883 Addison Rd. Cleveland, Ohio
P: 216-391-2400 F: 216-391-2492



NEMI Certified HVAC Fire Life Safety Technicians



VISUAL CUYAHOGA COUNTY DAMPER INSPECTION REPORT

Date of Inspection

2022-07-26

Facility Location

Virgil E Brown Center

Damper Location

4th floor mechanical room north

Inspector Name

Dan Tulcewicz

Damper I.D.

AHU4.1-OA

Damper Type

Vertical Fire Damper

Damper Size

96x24

Damper Manufacturer

Ruskin

Damper Model

IBD2

Fusible Link Temperature

212 Degrees

Access Door Size

16x16

Pass / Fail / Abandoned

Pass

Comments / Corrections

None


Exterior Picture of Damper



Interior Picture of Damper



Picture of Damper I.D. Label



Duct Fabricators, Inc.

883 Addison Rd. Cleveland, Ohio
P: 216-391-2400 F: 216-391-2492



VISUAL CUYAHOGA COUNTY DAMPER INSPECTION REPORT

Date of Inspection

2022-07-26

Facility Location

Virgil E Brown Center

Damper Location

4th floor mechanical room north

Inspector Name

Dan Tulcewicz

Damper I.D.

AHU4.1-RA

Damper Type

Vertical Fire Damper

Damper Size

96x60

Damper Manufacturer

Ruskin

Damper Model

IBD2

Fusible Link Temperature

212 Degrees

Access Door Size

Open

Pass / Fail / Abandoned

Pass

Comments / Corrections

None


Exterior Picture of Damper



Interior Picture of Damper



Picture of Damper I.D. Label



VISUAL CUYAHOGA COUNTY DAMPER INSPECTION REPORT

Date of Inspection

2022-08-03

Facility Location

Virgil E Brown Center

Damper Location

4th floor north

Inspector Name

Dan Tulcewicz

Damper I.D. #

AHU4.1-S1

Damper Type

Vertical Fire Damper

Damper Size

56x16

Damper Manufacturer

Ruskin

Damper Model #

IBC2

Fusible Link Temperature

212 Degrees

Access Door Size

18x18

Pass / Fail / Abandoned

Pass

Comments / Corrections

None


Exterior Picture of Damper



Interior Picture of Damper



Picture of Damper I.D. Label



Duct Fabricators, Inc.

883 Addison Rd. Cleveland, Ohio
P: 216-391-2400 F: 216-391-2492



VISUAL CUYAHOGA COUNTY DAMPER INSPECTION REPORT

Date of Inspection

2022-08-03

Facility Location

Virgil E Brown Center

Damper Location

4th floor north

Inspector Name

Dan Tulcewicz

Damper I.D. #

AHU4.1-S2

Damper Type

Vertical Fire Damper

Damper Size

56x16

Damper Manufacturer

Ruskin

Damper Model #

IBD2

Fusible Link Temperature

212 Degrees

Access Door Size

18x18

Pass / Fail / Abandoned

Pass

Comments / Corrections

None


Exterior Picture of Damper



Interior Picture of Damper



Picture of Damper I.D. Label



Duct Fabricators, Inc.

883 Addison Rd. Cleveland, Ohio
P: 216-391-2400 F: 216-391-2492

FIRE SAFETY DIVISION

NEMI Certified HVAC Fire Life Safety Technicians



VISUAL CUYAHOGA COUNTY DAMPER INSPECTION REPORT

Date of Inspection

2022-08-02

Facility Location

Virgil E Brown Center

Damper Location

4th floor north telephone room

Inspector Name

Dan Tulcewicz

Damper I.D.

AHU4.1-S3

Damper Type

Vertical Fire Damper

Damper Size

8x12

Damper Manufacturer

Ruskin

Damper Model

IBD2

Fusible Link Temperature

212 Degrees

Access Door Size

Open

Pass / Fail / Abandoned

Pass

Comments / Corrections

None


Exterior Picture of Damper



Interior Picture of Damper



Picture of Damper I.D. Label



VISUAL CUYAHOGA COUNTY DAMPER INSPECTION REPORT

Date of Inspection

2022-08-03

Facility Location

Virgil E Brown Center

Damper Location

4th floor north

Inspector Name

Dan Tulcewicz

Damper I.D. #

AHU4.1-S4

Damper Type

Vertical Fire Damper

Damper Size

5" Round

Damper Manufacturer

Ruskin

Damper Model #

IBD2

Fusible Link Temperature

212 Degrees

Access Door Size

18x18

Pass / Fail / Abandoned

Pass

Comments / Corrections

None

Exterior Picture of Damper



Interior Picture of Damper



Picture of Damper I.D. Label

Visual Insp. **FIRE DAMPER**

Inspection Date: 8-3-2022	Reference I.D. #: AHU4.1-S4
Inspected By: TULCEWICZ	
Next Inspect. By: 8-3-2024	

Duct Fabricators, Inc. 883 Addison Rd. Cleveland, Ohio P: 216-391-2400 F: 216-391-2492 **FIRE SAFETY DIVISION** NEMI Certified HVAC Fire Life Safety Technicians **NFPA**

VISUAL CUYAHOGA COUNTY DAMPER INSPECTION REPORT

Date of Inspection

2022-08-03

Facility Location

Virgil E Brown Center

Damper Location

4th floor north

Inspector Name

Dan Tulcewicz

Damper I.D. #

AHU4.1-S5

Damper Type

Vertical Fire Damper

Damper Size

16"Oval

Damper Manufacturer

Ruskin

Damper Model #

IBD2

Fusible Link Temperature

212 Degrees

Access Door Size

18x18

Pass / Fail / Abandoned

Pass

Comments / Corrections

None

Exterior Picture of Damper



Interior Picture of Damper



Picture of Damper I.D. Label

Visual Insp **FIRE DAMPER**

Inspection Date: 8-3-2022	Reference I.D.#: AHU4.1-S5
Inspected By: TULCEWICZ	
Next Inspect. By: 8-3-2024	

Duct Fabricators, Inc.
883 Addison Rd. Cleveland, Ohio
P: 216-391-2400 F: 216-391-2492

FIRE SAFETY DIVISION
NEMI Certified HVAC Fire Life Safety Technicians

MEMBER
NFPA

VISUAL CUYAHOGA COUNTY DAMPER INSPECTION REPORT

Date of Inspection

2022-08-03

Facility Location

Virgil E Brown Center

Damper Location

4th floor north

Inspector Name

Dan Tulcewicz

Damper I.D. #

AHU4.1-S6

Damper Type

Vertical Fire Damper

Damper Size

56x16

Damper Manufacturer

Ruskin

Damper Model #

IBD2

Fusible Link Temperature

212 Degrees

Access Door Size

18x18

Pass / Fail / Abandoned

Pass

Comments / Corrections

None

Exterior Picture of Damper



Interior Picture of Damper



Picture of Damper I.D. Label



VISUAL CUYAHOGA COUNTY DAMPER INSPECTION REPORT

Date of Inspection

2022-08-03

Facility Location

Virgil E Brown Center

Damper Location

4th floor north

Inspector Name

Dan Tulcewicz

Damper I.D. #

AHU4.1-S7

Damper Type

Vertical Fire Damper

Damper Size

56x16

Damper Manufacturer

Ruskin

Damper Model #

IBD2

Fusible Link Temperature

212 Degrees

Access Door Size

18x18

Pass / Fail / Abandoned

Pass

Comments / Corrections

None


Exterior Picture of Damper



Interior Picture of Damper



Picture of Damper I.D. Label



Duct Fabricators, Inc.

883 Addison Rd. Cleveland, Ohio
P: 216-391-2400 F: 216-391-2492

FIRE SAFETY DIVISION

NEMI Certified HVAC Fire Life Safety Technicians



VISUAL CUYAHOGA COUNTY DAMPER INSPECTION REPORT

Date of Inspection

2022-08-03

Facility Location

Virgil E Brown Center

Damper Location

4th floor north

Inspector Name

Dan Tulcewicz

Damper I.D. #

AHU4.1-S8

Damper Type

Vertical Fire Damper

Damper Size

11"x8"Oval

Damper Manufacturer

Ruskin

Damper Model #

IBD2

Fusible Link Temperature

212 Degrees

Access Door Size

18x18

Pass / Fail / Abandoned

Pass

Comments / Corrections

None


Exterior Picture of Damper



Interior Picture of Damper



Picture of Damper I.D. Label



VISUAL CUYAHOGA COUNTY DAMPER INSPECTION REPORT

Date of Inspection

2022-08-03

Facility Location

Virgil E Brown Center

Damper Location

4th floor north

Inspector Name

Dan Tulcewicz

Damper I.D. #

AHU4.1-S9

Damper Type

Vertical Fire Damper

Damper Size

16" Oval

Damper Manufacturer

Ruskin

Damper Model #

IBD2

Fusible Link Temperature

212 Degrees

Access Door Size

18x18

Pass / Fail / Abandoned

Pass

Comments / Corrections

None

Exterior Picture of Damper



Interior Picture of Damper



Picture of Damper I.D. Label



VISUAL CUYAHOGA COUNTY DAMPER INSPECTION REPORT

Date of Inspection

2022-08-03

Facility Location

Virgil E Brown Center

Damper Location

4th floor north

Inspector Name

Dan Tulcewicz

Damper I.D. #

AHU4.1-S10

Damper Type

Vertical Fire Damper

Damper Size

56x16

Damper Manufacturer

Ruskin

Damper Model #

IBD2

Fusible Link Temperature

212 Degrees

Access Door Size

18x18

Pass / Fail / Abandoned

Pass

Comments / Corrections

None


Exterior Picture of Damper



Interior Picture of Damper



Picture of Damper I.D. Label



Duct Fabricators, Inc.

883 Addison Rd. Cleveland, Ohio
P: 216-391-2400 F: 216-391-2492

FIRE SAFETY DIVISION

NEMI Certified HVAC Fire Life Safety Technicians



VISUAL CUYAHOGA COUNTY DAMPER INSPECTION REPORT

Date of Inspection

2022-08-02

Facility Location

Virgil E Brown Center

Damper Location

4th floor north telephone room

Inspector Name

Dan Tulcewicz

Damper I.D.

AHU4.1-S11

Damper Type

Vertical Fire Damper

Damper Size

8x12

Damper Manufacturer

Ruskin

Damper Model

IBD2

Fusible Link Temperature

212 Degrees

Access Door Size

Open

Pass / Fail / Abandoned

Pass

Comments / Corrections

None


Exterior Picture of Damper



Interior Picture of Damper



Picture of Damper I.D. Label



VISUAL CUYAHOGA COUNTY DAMPER INSPECTION REPORT

Date of Inspection

2022-08-03

Facility Location

Virgil E Brown Center

Damper Location

4th floor north

Inspector Name

Dan Tulcewicz

Damper I.D. #

AHU4.1-S12

Damper Type

Vertical Fire Damper

Damper Size

56x16

Damper Manufacturer

Ruskin

Damper Model #

IBD2

Fusible Link Temperature

212 Degrees

Access Door Size

18x18

Pass / Fail / Abandoned

Pass

Comments / Corrections

None

Exterior Picture of Damper



Interior Picture of Damper



Picture of Damper I.D. Label



VISUAL CUYAHOGA COUNTY DAMPER INSPECTION REPORT

Date of Inspection

2022-07-26

Facility Location

Virgil E Brown Center

Damper Location

Mechanical room South

Inspector Name

Dan Tulcewicz

Damper I.D. #

AHU4.2-OA

Damper Type

Vertical Fire Damper

Damper Size

96x36

Damper Manufacturer

Ruskin

Damper Model #

IBD2

Fusible Link Temperature

212 Degrees

Access Door Size

16x16

Pass / Fail / Abandoned

Pass

Comments / Corrections

None

Exterior Picture of Damper



Interior Picture of Damper



Picture of Damper I.D. Label



Duct Fabricators, Inc.

883 Addison Rd. Cleveland, Ohio
P: 216-391-2400 F: 216-391-2492



NEMI Certified HVAC Fire Life Safety Technicians



VISUAL CUYAHOGA COUNTY DAMPER INSPECTION REPORT

Date of Inspection

2022-07-26

Facility Location

Virgil E Brown Center

Damper Location

4t floor mechanical room South

Inspector Name

Dan Tulcewicz

Damper I.D.

AHU4.2-RA

Damper Type

Vertical Fire Damper

Damper Size

96x60

Damper Manufacturer

Ruskin

Damper Model

IBD2

Fusible Link Temperature

212 Degrees

Access Door Size

Open

Pass / Fail / Abandoned

Pass

Comments / Corrections

None

Exterior Picture of Damper



Interior Picture of Damper



Picture of Damper I.D. Label



Duct Fabricators, Inc.

883 Addison Rd. Cleveland, Ohio
P: 216-391-2400 F: 216-391-2492



VISUAL CUYAHOGA COUNTY DAMPER INSPECTION REPORT

Date of Inspection

2022-08-04

Facility Location

Virgil E Brown Center

Damper Location

4th floor South

Inspector Name

Dan Tulcewicz

Damper I.D. #

AHU4.2-S1

Damper Type

Vertical Fire Damper

Damper Size

56x16

Damper Manufacturer

Ruskin

Damper Model #

IBD2

Fusible Link Temperature

212 Degrees

Access Door Size

18x18

Pass / Fail / Abandoned

Pass

Comments / Corrections

None

Exterior Picture of Damper



Interior Picture of Damper



Picture of Damper I.D. Label



VISUAL CUYAHOGA COUNTY DAMPER INSPECTION REPORT

Date of Inspection

2022-08-04

Facility Location

Virgil E Brown Center

Damper Location

4th floor South

Inspector Name

Dan Tulcewicz

Damper I.D. #

AHU4.2-S2

Damper Type

Vertical Fire Damper

Damper Size

56x16

Damper Manufacturer

Ruskin

Damper Model #

IBD2

Fusible Link Temperature

212 Degrees

Access Door Size

23x17

Pass / Fail / Abandoned

Pass

Comments / Corrections

None

Exterior Picture of Damper



Interior Picture of Damper



Picture of Damper I.D. Label



Duct Fabricators, Inc.

883 Addison Rd. Cleveland, Ohio
P: 216-391-2400 F: 216-391-2492

FIRE SAFETY DIVISION
NEMI Certified HVAC Fire Life Safety Technicians



VISUAL CUYAHOGA COUNTY DAMPER INSPECTION REPORT

Date of Inspection

2022-08-02

Facility Location

Virgil E Brown Center

Damper Location

4th floor South Telephone Room

Inspector Name

Dan Tulcewicz

Damper I.D. #

AHU4.2-S3

Damper Type

Vertical Fire Damper

Damper Size

8x12

Damper Manufacturer

Ruskin

Damper Model #

IBD2

Fusible Link Temperature

212 Degrees

Access Door Size

Open

Pass / Fail / Abandoned

Pass

Comments / Corrections

None

Exterior Picture of Damper



Interior Picture of Damper



Picture of Damper I.D. Label



VISUAL CUYAHOGA COUNTY DAMPER INSPECTION REPORT

Date of Inspection

2022-08-04

Facility Location

Virgil E Brown Center

Damper Location

4th floor South

Inspector Name

Dan Tulcewicz

Damper I.D. #

AHU4.2-S4

Damper Type

Vertical Fire Damper

Damper Size

56x16

Damper Manufacturer

Ruskin

Damper Model #

IBD2

Fusible Link Temperature

212 Degrees

Access Door Size

18x18

Pass / Fail / Abandoned

Pass

Comments / Corrections

None

Exterior Picture of Damper



Interior Picture of Damper



Picture of Damper I.D. Label



VISUAL CUYAHOGA COUNTY DAMPER INSPECTION REPORT

Date of Inspection

2022-08-04

Facility Location

Virgil E Brown Center

Damper Location

4th floor South

Inspector Name

Dan Tulcewicz

Damper I.D. #

AHU4.2-S5

Damper Type

Vertical Fire Damper

Damper Size

56x16

Damper Manufacturer

Ruskin

Damper Model #

IBD2

Fusible Link Temperature

212 Degrees

Access Door Size

18x18

Pass / Fail / Abandoned

Pass

Comments / Corrections

Drywall issues

Exterior Picture of Damper



Interior Picture of Damper



Picture of Damper I.D. Label



Duct Fabricators, Inc.

883 Addison Rd. Cleveland, Ohio
P: 216-391-2400 F: 216-391-2492



NEMI Certified HVAC Fire Life Safety Technicians



VISUAL CUYAHOGA COUNTY DAMPER INSPECTION REPORT

Date of Inspection

2022-08-04

Facility Location

Virgil E Brown Center

Damper Location

4th floor South

Inspector Name

Dan Tulcewicz

Damper I.D. #

AHU4.2-S6

Damper Type

Vertical Fire Damper

Damper Size

6"Round

Damper Manufacturer

Ruskin

Damper Model #

IBD2

Fusible Link Temperature

212 Degrees

Access Door Size

18x18

Pass / Fail / Abandoned

Pass

Comments / Corrections

None


Exterior Picture of Damper



Interior Picture of Damper



Picture of Damper I.D. Label



VISUAL CUYAHOGA COUNTY DAMPER INSPECTION REPORT

Date of Inspection

2022-08-04

Facility Location

Virgil E Brown Center

Damper Location

4th floor South

Inspector Name

Dan Tulcewicz

Damper I.D. #

AHU4.2-S7

Damper Type

Vertical Fire Damper

Damper Size

56x16

Damper Manufacturer

Ruskin

Damper Model #

IBD2

Fusible Link Temperature

212 Degrees

Access Door Size

18x18

Pass / Fail / Abandoned

Pass

Comments / Corrections

None

Exterior Picture of Damper



Interior Picture of Damper



Picture of Damper I.D. Label



VISUAL CUYAHOGA COUNTY DAMPER INSPECTION REPORT

Date of Inspection

2022-08-02

Facility Location

Virgil E Brown Center

Damper Location

South Telephone Room

Inspector Name

Dan Tulcewicz

Damper I.D. #

AHU4.2-S8

Damper Type

Vertical Fire Damper

Damper Size

8x12

Damper Manufacturer

Ruskin

Damper Model #

IBD2

Fusible Link Temperature

212 Degrees

Access Door Size

Open

Pass / Fail / Abandoned

Pass

Comments / Corrections

None


Exterior Picture of Damper



Interior Picture of Damper



Picture of Damper I.D. Label



VISUAL CUYAHOGA COUNTY DAMPER INSPECTION REPORT

Date of Inspection

2022-08-04

Facility Location

Virgil E Brown Center

Damper Location

4th floor South

Inspector Name

Dan Tulcewicz

Damper I.D. #

AHU4.2-S9

Damper Type

Vertical Fire Damper

Damper Size

20x8 Oval

Damper Manufacturer

Ruskin

Damper Model #

IBD2

Fusible Link Temperature

212 Degrees

Access Door Size

14x14

Pass / Fail / Abandoned

Pass

Comments / Corrections

None


Exterior Picture of Damper



Interior Picture of Damper



Picture of Damper I.D. Label



VISUAL CUYAHOGA COUNTY DAMPER INSPECTION REPORT

Date of Inspection

2022-08-04

Facility Location

Virgil E Brown Center

Damper Location

4th floor South

Inspector Name

Dan Tulcewicz

Damper I.D.

c

Damper Type

Vertical Fire Damper

Damper Size

56x16

Damper Manufacturer

Ruskin

Damper Model

IBD2

Fusible Link Temperature

212 Degrees

Access Door Size

18x18

Pass / Fail / Abandoned

Fail

Comments / Corrections

Drywall needs to be repaired
and needs retaining angle


Exterior Picture of Damper



Interior Picture of Damper



Picture of Damper I.D. Label



VISUAL CUYAHOGA COUNTY DAMPER INSPECTION REPORT

Date of Inspection

2022-08-04

Facility Location

Virgil E Brown Center

Damper Location

4th floor South

Inspector Name

Dan Tulcewicz

Damper I.D. #

AHU4.2-S11

Damper Type

Vertical Fire Damper

Damper Size

36x8

Damper Manufacturer

Ruskin

Damper Model #

IBD2

Fusible Link Temperature

165 Degrees

Access Door Size

12x12

Pass / Fail / Abandoned

Pass

Comments / Corrections

None


Exterior Picture of Damper



Interior Picture of Damper



Picture of Damper I.D. Label



VISUAL CUYAHOGA COUNTY DAMPER INSPECTION REPORT

Date of Inspection

2022-08-04

Facility Location

Virgil E Brown Center

Damper Location

4th floor South

Inspector Name

Dan Tulcewicz

Damper I.D. #

AHU4.2-S12

Damper Type

Vertical Fire Damper

Damper Size

36x8

Damper Manufacturer

Ruskin

Damper Model #

IBD2

Fusible Link Temperature

165 Degrees

Access Door Size

12x12

Pass / Fail / Abandoned

Pass

Comments / Corrections

None


Exterior Picture of Damper



Interior Picture of Damper



Picture of Damper I.D. Label



Duct Fabricators, Inc.
883 Addison Rd. Cleveland, Ohio
P: 216-391-2400 F: 216-391-2492

FIRE SAFETY DIVISION
NEMI Certified HVAC Fire Life Safety Technicians



VISUAL CUYAHOGA COUNTY DAMPER INSPECTION REPORT

Date of Inspection

2022-07-26

Facility Location

Virgil E Brown Center

Damper Location

5th floor north

Inspector Name

Dan Tulcewicz

Damper I.D.

AHU5.1 S-4

Damper Type

Vertical Fire Damper

Damper Size

36x18

Damper Manufacturer

Ruskin

Damper Model

IBD2

Fusible Link Temperature

212 Degrees

Access Door Size

18x18

Pass / Fail / Abandoned

Pass

Comments / Corrections

None

Exterior Picture of Damper



Interior Picture of Damper



Picture of Damper I.D. Label



Duct Fabricators, Inc.

883 Addison Rd. Cleveland, Ohio
P: 216-391-2400 F: 216-391-2492

FIRE SAFETY DIVISION

NEMI Certified HVAC Fire Life Safety Technicians



VISUAL CUYAHOGA COUNTY DAMPER INSPECTION REPORT

Date of Inspection

2022-08-02

Facility Location

Virgil E Brown Center

Damper Location

5th floor north

Inspector Name

Dan Tulcewicz

Damper I.D. #

AHU5.1 S-6

Damper Type

Vertical Fire Damper

Damper Size

56x18

Damper Manufacturer

Ruskin

Damper Model #

IBD2

Fusible Link Temperature

212 Degrees

Access Door Size

18x18

Pass / Fail / Abandoned

Pass

Comments / Corrections

None

Exterior Picture of Damper



Interior Picture of Damper



Picture of Damper I.D. Label



VISUAL CUYAHOGA COUNTY DAMPER INSPECTION REPORT

Date of Inspection

2022-07-25

Facility Location

Virgil E Brown Center

Damper Location

5th Floor Mechanical North

Inspector Name

Dan Tulcewicz

Damper I.D. #

AHU5.1-OA

Damper Type

Vertical Fire Damper

Damper Size

96x36

Damper Manufacturer

Ruskin

Damper Model #

IBD2

Fusible Link Temperature

212 Degrees

Access Door Size

16x16


Pass / Fail / Abandoned

Pass

Comments / Corrections

None


Exterior Picture of Damper



Interior Picture of Damper



Picture of Damper I.D. Label

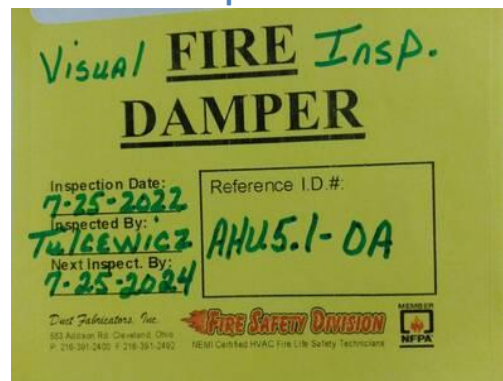

Duct Fabricators, Inc.

883 Addison Rd. Cleveland, Ohio
P: 216-391-2400 F: 216-391-2492



VISUAL CUYAHOGA COUNTY DAMPER INSPECTION REPORT

Date of Inspection

2022-07-25

Facility Location

Virgil E Brown Center

Damper Location

5th Floor Mechanical North

Inspector Name

Dan Tulcewicz

Damper I.D.

AHU5.1-RA

Damper Type

Vertical Fire Damper

Damper Size

96x84

Damper Manufacturer

Ruskin

Damper Model

IBD2

Fusible Link Temperature

212 Degrees

Access Door Size

Open

Pass / Fail / Abandoned

Pass

Comments / Corrections

None

Exterior Picture of Damper



Interior Picture of Damper



Picture of Damper I.D. Label



VISUAL CUYAHOGA COUNTY DAMPER INSPECTION REPORT

Date of Inspection

2022-07-25

Facility Location

Virgil E Brown Center

Damper Location

5th floor north

Inspector Name

Dan Tulcewicz

Damper I.D. #

AHU5.1-S1

Damper Type

Vertical Fire Damper

Damper Size

56x18

Damper Manufacturer

Ruskin

Damper Model #

IBD2

Fusible Link Temperature

212 Degrees

Access Door Size

18x18

Pass / Fail / Abandoned

Pass

Comments / Corrections

None

Exterior Picture of Damper



Interior Picture of Damper



Picture of Damper I.D. Label



VISUAL CUYAHOGA COUNTY DAMPER INSPECTION REPORT

Date of Inspection

2022-07-26

Facility Location

Virgil E Brown Center

Damper Location

5th Floor North

Inspector Name

Dan Tulcewicz

Damper I.D. #

AHU5.1-S2

Damper Type

Vertical Fire Damper

Damper Size

56x18

Damper Manufacturer

Ruskin

Damper Model #

IBD2

Fusible Link Temperature

212 Degrees

Access Door Size

18x18

Pass / Fail / Abandoned

Pass

Comments / Corrections

None

Exterior Picture of Damper



Interior Picture of Damper



Picture of Damper I.D. Label



VISUAL CUYAHOGA COUNTY DAMPER INSPECTION REPORT

Date of Inspection

2022-07-26

Facility Location

Virgil E Brown Center

Damper Location

5th Floor North

Inspector Name

Dan Tulcewicz

Damper I.D. #

AHU5.1-S3

Damper Type

Vertical Fire Damper

Damper Size

36x18

Damper Manufacturer

Ruskin

Damper Model #

IBD2

Fusible Link Temperature

212 Degrees

Access Door Size

18x18

Pass / Fail / Abandoned

Pass

Comments / Corrections

None


Exterior Picture of Damper



Interior Picture of Damper



Picture of Damper I.D. Label



VISUAL CUYAHOGA COUNTY DAMPER INSPECTION REPORT

Date of Inspection

2022-08-09

Facility Location

Virgil E Brown Center

Damper Location

Northwest corridor

Inspector Name

Dan Tulcewicz

Damper I.D. #

AHU5.1-S5

Damper Type

Vertical Fire Damper

Damper Size

56x18

Damper Manufacturer

Ruskin

Damper Model #

IBD2

Fusible Link Temperature

212 Degrees

Access Door Size

18x18

Pass / Fail / Abandoned

Pass

Comments / Corrections

None

Exterior Picture of Damper



Interior Picture of Damper



Picture of Damper I.D. Label



VISUAL CUYAHOGA COUNTY DAMPER INSPECTION REPORT

Date of Inspection

2022-08-02

Facility Location

Virgil E Brown Center

Damper Location

5th floor north

Inspector Name

Dan Tulcewicz

Damper I.D. #

AHU5.1-S6

Damper Type

Vertical Fire Damper

Damper Size

56x18

Damper Manufacturer

Ruskin

Damper Model #

IBD2

Fusible Link Temperature

212 Degrees

Access Door Size

18x18

Pass / Fail / Abandoned

Pass

Comments / Corrections

None

Exterior Picture of Damper



Interior Picture of Damper



Picture of Damper I.D. Label



VISUAL CUYAHOGA COUNTY DAMPER INSPECTION REPORT

Date of Inspection

2022-08-02

Facility Location

Virgil E Brown Center

Damper Location

North telephone room

Inspector Name

Dan Tulcewicz

Damper I.D. #

AHU5.1-S7

Damper Type

Vertical Fire Damper

Damper Size

8x12

Damper Manufacturer

Ruskin

Damper Model #

IBD2

Fusible Link Temperature

212 Degrees

Access Door Size

Open

Pass / Fail / Abandoned

Pass

Comments / Corrections

None


Exterior Picture of Damper



Interior Picture of Damper



Picture of Damper I.D. Label



Duct Fabricators, Inc.

883 Addison Rd. Cleveland, Ohio
P: 216-391-2400 F: 216-391-2492



VISUAL CUYAHOGA COUNTY DAMPER INSPECTION REPORT

Date of Inspection

2022-08-02

Facility Location

Virgil E Brown Center

Damper Location

North telephone room

Inspector Name

Dan Tulcewicz

Damper I.D.

AHU5.1-S8

Damper Type

Vertical Fire Damper

Damper Size

8x12

Damper Manufacturer

Ruskin

Damper Model

IBD2

Fusible Link Temperature

212 Degrees

Access Door Size

Open

Pass / Fail / Abandoned

Pass

Comments / Corrections

None


Exterior Picture of Damper



Interior Picture of Damper



Picture of Damper I.D. Label



VISUAL CUYAHOGA COUNTY DAMPER INSPECTION REPORT

Date of Inspection
2022-08-09

Facility Location
Virgil E Brown Center

Damper Location
Room 510

Inspector Name
Julie Gue

Damper I.D. #
AHU5.1-S9

Damper Type
Vertical Fire Damper

Damper Size
10" oval

Damper Manufacturer
Ruskin

Damper Model #
IBD2

Fusible Link Temperature
212 Degrees

Access Door Size
18x18

Pass / Fail / Abandoned
Pass

Comments / Corrections
None


Exterior Picture of Damper



Interior Picture of Damper



Picture of Damper I.D. Label



VISUAL CUYAHOGA COUNTY DAMPER INSPECTION REPORT

Date of Inspection

2022-08-19

Facility Location

Virgil E Brown Center

Damper Location

RM510

Inspector Name

Julie Gue

Damper I.D. #

AHU5.1-S10

Damper Type

Vertical Fire Damper

Damper Size

38x10

Damper Manufacturer

Ruskin

Damper Model #

IBD2

Fusible Link Temperature

212 Degrees

Access Door Size

16x16


Pass / Fail / Abandoned

Pass

Comments / Corrections

None

Exterior Picture of Damper



Interior Picture of Damper



Picture of Damper I.D. Label



Duct Fabricators, Inc.
883 Addison Rd. Cleveland, Ohio
P: 216-391-2400 F: 216-391-2492

FIRE SAFETY DIVISION
NEMI Certified HVAC Fire Life Safety Technicians



VISUAL CUYAHOGA COUNTY DAMPER INSPECTION REPORT

Date of Inspection

2022-07-26

Facility Location

Virgil E Brown Center

Damper Location

5th Floor North

Inspector Name

Dan Tulcewicz

Damper I.D.

AHU5.1-S11

Damper Type

Vertical Fire Damper

Damper Size

18x10

Damper Manufacturer

Unknown

Damper Model

IBD2

Fusible Link Temperature

212 Degrees

Access Door Size

18x18

Pass / Fail / Abandoned

Pass

Comments / Corrections

None

Exterior Picture of Damper



Interior Picture of Damper



Picture of Damper I.D. Label



VISUAL CUYAHOGA COUNTY DAMPER INSPECTION REPORT

Date of Inspection

2022-07-26

Facility Location

Virgil E Brown Center

Damper Location

5th Floor North

Inspector Name

Dan Tulcewicz

Damper I.D. #

AHU5.1-S12

Damper Type

Vertical Fire Damper

Damper Size

12x8 Oval

Damper Manufacturer

Ruskin

Damper Model #

IBD2

Fusible Link Temperature

212 Degrees

Access Door Size

18x18

Pass / Fail / Abandoned

Pass

Comments / Corrections

None


Exterior Picture of Damper



Interior Picture of Damper



Picture of Damper I.D. Label



VISUAL CUYAHOGA COUNTY DAMPER INSPECTION REPORT

Date of Inspection

2022-07-26

Facility Location

Virgil E Brown Center

Damper Location

5th Floor North

Inspector Name

Dan Tulcewicz

Damper I.D. #

AHU5.1-S13

Damper Type

Vertical Fire Damper

Damper Size

34x10

Damper Manufacturer

Ruskin

Damper Model #

IBD2

Fusible Link Temperature

212 Degrees

Access Door Size

16x16

Pass / Fail / Abandoned

Pass

Comments / Corrections

None


Exterior Picture of Damper



Interior Picture of Damper



Picture of Damper I.D. Label



VISUAL CUYAHOGA COUNTY DAMPER INSPECTION REPORT

Date of Inspection

2022-07-25

Facility Location

Virgil E Brown Center

Damper Location

5th Floor Mechanical South

Inspector Name

Dan Tulcewicz

Damper I.D. #

AHU5.2-OA

Damper Type

Vertical Fire Damper

Damper Size

96x36

Damper Manufacturer

Ruskin

Damper Model #

IBD2

Fusible Link Temperature

212 Degrees

Access Door Size

16x16

Pass / Fail / Abandoned

Pass

Comments / Corrections

None


Exterior Picture of Damper



Interior Picture of Damper



Picture of Damper I.D. Label



VISUAL CUYAHOGA COUNTY DAMPER INSPECTION REPORT

Date of Inspection

2022-08-09

Facility Location

Virgil E Brown Center

Damper Location

Copy room

Inspector Name

Julie Gue

Damper I.D. #

AHU5.2-R1

Damper Type

Vertical Fire Damper

Damper Size

24x18

Damper Manufacturer

Ruskin

Damper Model #

IBD2

Fusible Link Temperature

212 Degrees

Access Door Size

18x18

Pass / Fail / Abandoned

Pass

Comments / Corrections

None


Exterior Picture of Damper



Interior Picture of Damper



Picture of Damper I.D. Label



VISUAL CUYAHOGA COUNTY DAMPER INSPECTION REPORT

Date of Inspection

2022-07-25

Facility Location

Virgil E Brown Center

Damper Location

5th Floor Mechanical South

Inspector Name

Dan Tulcewicz

Damper I.D. #

AHU5.2-RA

Damper Type

Vertical Fire Damper

Damper Size

96x84

Damper Manufacturer

Ruskin

Damper Model #

IBD2

Fusible Link Temperature

212 Degrees

Access Door Size

Open

Pass / Fail / Abandoned

Pass

Comments / Corrections

None

Exterior Picture of Damper



Interior Picture of Damper



Picture of Damper I.D. Label



VISUAL CUYAHOGA COUNTY DAMPER INSPECTION REPORT

Date of Inspection

2022-08-02

Facility Location

Virgil E Brown Center

Damper Location

5th floor South

Inspector Name

Dan Tulcewicz

Damper I.D. #

AHU5.2-S1

Damper Type

Vertical Fire Damper

Damper Size

56x18

Damper Manufacturer

Ruskin

Damper Model #

IBD2

Fusible Link Temperature

212 Degrees

Access Door Size

18x18

Pass / Fail / Abandoned

Pass

Comments / Corrections

None


Exterior Picture of Damper



Interior Picture of Damper



Picture of Damper I.D. Label



VISUAL CUYAHOGA COUNTY DAMPER INSPECTION REPORT

Date of Inspection

2022-08-02

Facility Location

Virgil E Brown Center

Damper Location

5th floor South

Inspector Name

Dan Tulcewicz

Damper I.D. #

AHU5.2-S2

Damper Type

Vertical Fire Damper

Damper Size

56x18

Damper Manufacturer

Ruskin

Damper Model #

IBD2

Fusible Link Temperature

212 Degrees

Access Door Size

18x18

Pass / Fail / Abandoned

Pass

Comments / Corrections

None


Exterior Picture of Damper



Interior Picture of Damper



Picture of Damper I.D. Label



VISUAL CUYAHOGA COUNTY DAMPER INSPECTION REPORT

Date of Inspection

2022-08-02

Facility Location

Virgil E Brown Center

Damper Location

5th floor South

Inspector Name

Dan Tulcewicz

Damper I.D. #

AHU5.2-S3

Damper Type

Vertical Fire Damper

Damper Size

36x18

Damper Manufacturer

Ruskin

Damper Model #

IBD2

Fusible Link Temperature

212 Degrees

Access Door Size

18x18

Pass / Fail / Abandoned

Pass

Comments / Corrections

None


Exterior Picture of Damper



Interior Picture of Damper



Picture of Damper I.D. Label



Duct Fabricators, Inc.

883 Addison Rd. Cleveland, Ohio
P: 216-391-2400 F: 216-391-2492



NEMI Certified HVAC Fire Life Safety Technicians



VISUAL CUYAHOGA COUNTY DAMPER INSPECTION REPORT

Date of Inspection

2022-08-02

Facility Location

Virgil E Brown Center

Damper Location

5th floor South

Inspector Name

Dan Tulcewicz

Damper I.D.

AHU5.2-S4

Damper Type

Vertical Fire Damper

Damper Size

36x18

Damper Manufacturer

Ruskin

Damper Model

IBD2

Fusible Link Temperature

212 Degrees

Access Door Size

18x18

Pass / Fail / Abandoned

Pass

Comments / Corrections

None


Exterior Picture of Damper



Interior Picture of Damper



Picture of Damper I.D. Label



VISUAL CUYAHOGA COUNTY DAMPER INSPECTION REPORT

Date of Inspection

2022-08-02

Facility Location

Virgil E Brown Center

Damper Location

5th floor South

Inspector Name

Dan Tulcewicz

Damper I.D. #

AHU5.2-S5

Damper Type

Vertical Fire Damper

Damper Size

56x18

Damper Manufacturer

Ruskin

Damper Model #

IBD2

Fusible Link Temperature

212 Degrees

Access Door Size

16x16

Pass / Fail / Abandoned

Pass

Comments / Corrections

None


Exterior Picture of Damper



Interior Picture of Damper



Picture of Damper I.D. Label



Duct Fabricators, Inc.

883 Addison Rd. Cleveland, Ohio
P: 216-391-2400 F: 216-391-2492

FIRE SAFETY DIVISION
NEMI Certified HVAC Fire Life Safety Technicians



VISUAL CUYAHOGA COUNTY DAMPER INSPECTION REPORT

Date of Inspection

2022-08-02

Facility Location

Virgil E Brown Center

Damper Location

5th floor South

Inspector Name

Dan Tulcewicz

Damper I.D.

AHU5.2-S6

Damper Type

Vertical Fire Damper

Damper Size

56x18

Damper Manufacturer

Ruskin

Damper Model

IBD2

Fusible Link Temperature

212 Degrees

Access Door Size

18x18

Pass / Fail / Abandoned

Pass

Comments / Corrections

None

Exterior Picture of Damper



Interior Picture of Damper



Picture of Damper I.D. Label



VISUAL CUYAHOGA COUNTY DAMPER INSPECTION REPORT

Date of Inspection
2022-08-02

Facility Location
Virgil E Brown Center

Damper Location
South Telephone Room

Inspector Name
Dan Tulcewicz

Damper I.D. #
AHU5.2-S7

Damper Type
Vertical Fire Damper

Damper Size
8x12

Damper Manufacturer
Ruskin

Damper Model #
IBD2

Fusible Link Temperature
212 Degrees

Access Door Size
Open

Pass / Fail / Abandoned
Pass

Comments / Corrections
None


Exterior Picture of Damper



Interior Picture of Damper



Picture of Damper I.D. Label



VISUAL CUYAHOGA COUNTY DAMPER INSPECTION REPORT

Date of Inspection

2022-08-02

Facility Location

Virgil E Brown Center

Damper Location

5th floor South Telephone Room

Inspector Name

Dan Tulcewicz

Damper I.D. #

AHU5.2-S8

Damper Type

Vertical Fire Damper

Damper Size

12x8

Damper Manufacturer

Ruskin

Damper Model #

IBD2

Fusible Link Temperature

212 Degrees

Access Door Size

Open

Pass / Fail / Abandoned

Pass

Comments / Corrections

None


Exterior Picture of Damper



Interior Picture of Damper



Picture of Damper I.D. Label



VISUAL CUYAHOGA COUNTY DAMPER INSPECTION REPORT

Date of Inspection

2022-08-09

Facility Location

Virgil E Brown Center

Damper Location

Copy room

Inspector Name

Julie Gue

Damper I.D. #

AHU5.2-S9

Damper Type

Vertical Fire Damper

Damper Size

16" oval

Damper Manufacturer

Ruskin

Damper Model #

IBD2

Fusible Link Temperature

212 Degrees

Access Door Size

18x18

Pass / Fail / Abandoned

Pass

Comments / Corrections

None


Exterior Picture of Damper



Interior Picture of Damper



Picture of Damper I.D. Label



VISUAL CUYAHOGA COUNTY DAMPER INSPECTION REPORT

Date of Inspection
2022-08-09

Facility Location
Virgil E Brown Center

Damper Location
Copy room

Inspector Name
Julie Gue

Damper I.D. #
AHU5.2-S10

Damper Type
Vertical Fire Damper

Damper Size
16" oval

Damper Manufacturer
Ruskin

Damper Model #
IBD2

Fusible Link Temperature
165 Degrees

Access Door Size
18x18


Pass / Fail / Abandoned
Pass

Comments / Corrections
None

Exterior Picture of Damper



Interior Picture of Damper



Picture of Damper I.D. Label



VISUAL CUYAHOGA COUNTY DAMPER INSPECTION REPORT

Date of Inspection

2022-08-09

Facility Location

Virgil E Brown Center

Damper Location

Copy room

Inspector Name

Julie Gue

Damper I.D. #

AHU5.2-S11

Damper Type

Vertical Fire Damper

Damper Size

8" Round

Damper Manufacturer

Ruskin

Damper Model #

IBD2

Fusible Link Temperature

165 Degrees

Access Door Size

Flex access

Pass / Fail / Abandoned

Pass

Comments / Corrections

None


Exterior Picture of Damper



Interior Picture of Damper



Picture of Damper I.D. Label



VISUAL CUYAHOGA COUNTY DAMPER INSPECTION REPORT

Date of Inspection

2022-08-02

Facility Location

Virgil E Brown Center

Damper Location

5th floor South

Inspector Name

Dan Tulcewicz

Damper I.D. #

AHU5.2-S12

Damper Type

Vertical Fire Damper

Damper Size

44x12

Damper Manufacturer

Ruskin

Damper Model #

IBD2

Fusible Link Temperature

212 Degrees

Access Door Size

16x16

Pass / Fail / Abandoned

Pass

Comments / Corrections

None


Exterior Picture of Damper



Interior Picture of Damper



Picture of Damper I.D. Label



Duct Fabricators, Inc.

883 Addison Rd. Cleveland, Ohio
P: 216-391-2400 F: 216-391-2492

FIRE SAFETY DIVISION
NEMI Certified HVAC Fire Life Safety Technicians



VISUAL CUYAHOGA COUNTY DAMPER INSPECTION REPORT

Date of Inspection

2022-08-02

Facility Location

Virgil E Brown Center

Damper Location

5th floor South

Inspector Name

Dan Tulcewicz

Damper I.D.

AHU5.2-S13

Damper Type

Vertical Fire Damper

Damper Size

45x10

Damper Manufacturer

Ruskin

Damper Model

IBD2

Fusible Link Temperature

212 Degrees

Access Door Size

16x16

Pass / Fail / Abandoned

Pass

Comments / Corrections

None

Exterior Picture of Damper



Interior Picture of Damper



Picture of Damper I.D. Label

Visual Insp. **FIRE DAMPER**

Inspection Date: 8-2-2022	Reference I.D. #: AHU5.2-S13
Inspected By: TULCEWICZ	
Next Inspect. By: 8-2-2024	

Duct Fabricators, Inc.
883 Addison Rd. Cleveland, Ohio
P: 216-391-2400 F: 216-391-2492

FIRE SAFETY DIVISION
NEMI Certified HVAC Fire Life Safety Technicians

MEMBER
NFPA

Duct Fabricators, Inc.

883 Addison Rd. Cleveland, Ohio
P: 216-391-2400 F: 216-391-2492



NEMI Certified HVAC Fire Life Safety Technicians



VISUAL CUYAHOGA COUNTY DAMPER INSPECTION REPORT

Date of Inspection

2022-08-02

Facility Location

Virgil E Brown Center

Damper Location

5th floor South

Inspector Name

Dan Tulcewicz

Damper I.D.

AHU5.2-S14

Damper Type

Vertical Fire Damper

Damper Size

8" Round

Damper Manufacturer

Ruskin

Damper Model

IBD2

Fusible Link Temperature

212 Degrees

Access Door Size

20x20

Pass / Fail / Abandoned

Pass

Comments / Corrections

None

Exterior Picture of Damper



Interior Picture of Damper



Picture of Damper I.D. Label



VISUAL CUYAHOGA COUNTY DAMPER INSPECTION REPORT

Date of Inspection

2022-08-02

Facility Location

Virgil E Brown Center

Damper Location

5th floor South

Inspector Name

Dan Tulcewicz

Damper I.D. #

AHU5.2-S15

Damper Type

Vertical Fire Damper

Damper Size

16"Oval

Damper Manufacturer

Ruskin

Damper Model #

IBD2

Fusible Link Temperature

212 Degrees

Access Door Size

18x18

Pass / Fail / Abandoned

Pass

Comments / Corrections

None


Exterior Picture of Damper



Interior Picture of Damper



Picture of Damper I.D. Label



Duct Fabricators, Inc.

883 Addison Rd. Cleveland, Ohio
P: 216-391-2400 F: 216-391-2492

FIRE SAFETY DIVISION

NEMI Certified HVAC Fire Life Safety Technicians



VISUAL CUYAHOGA COUNTY DAMPER INSPECTION REPORT

Date of Inspection

2022-08-02

Facility Location

Virgil E Brown Center

Damper Location

5th floor South

Inspector Name

Dan Tulcewicz

Damper I.D.

AHU5.2-S16

Damper Type

Vertical Fire Damper

Damper Size

6" Round

Damper Manufacturer

Ruskin

Damper Model

IBD2

Fusible Link Temperature

212 Degrees

Access Door Size

18x18

Pass / Fail / Abandoned

Pass

Comments / Corrections

None


Exterior Picture of Damper



Interior Picture of Damper



Picture of Damper I.D. Label



VISUAL CUYAHOGA COUNTY DAMPER INSPECTION REPORT

Date of Inspection

2022-08-02

Facility Location

Virgil E Brown Center

Damper Location

5th floor South

Inspector Name

Dan Tulcewicz

Damper I.D. #

AHU5.2-S17

Damper Type

Vertical Fire Damper

Damper Size

20x10

Damper Manufacturer

Ruskin

Damper Model #

IBD2

Fusible Link Temperature

212 Degrees

Access Door Size

14x14

Pass / Fail / Abandoned

Pass

Comments / Corrections

None


Exterior Picture of Damper



Interior Picture of Damper



Picture of Damper I.D. Label



VISUAL CUYAHOGA COUNTY DAMPER INSPECTION REPORT

Date of Inspection

2022-08-15

Facility Location

Virgil E Brown Center

Damper Location

Southeast corridor

Inspector Name

Julie Gue

Damper I.D. #

AHUG .2-S8

Damper Type

Vertical Fire Damper

Damper Size

46x16

Damper Manufacturer

Ruskin

Damper Model #

IBD2

Fusible Link Temperature

212 Degrees

Access Door Size

18x17

Pass / Fail / Abandoned

Pass

Comments / Corrections

None


Exterior Picture of Damper



Interior Picture of Damper



Picture of Damper I.D. Label



VISUAL CUYAHOGA COUNTY DAMPER INSPECTION REPORT

Date of Inspection

2022-08-10

Facility Location

Virgil E Brown Center

Damper Location

South mechanical room

Inspector Name

Julie Gue

Damper I.D. #

AHUG 2-RA

Damper Type

Vertical Fire Damper

Damper Size

96x48

Damper Manufacturer

Ruskin

Damper Model #

IBD2

Fusible Link Temperature

212 Degrees

Access Door Size

Open duct

Pass / Fail / Abandoned

Pass

Comments / Corrections

None


Exterior Picture of Damper



Interior Picture of Damper



Picture of Damper I.D. Label



VISUAL CUYAHOGA COUNTY DAMPER INSPECTION REPORT

Date of Inspection

2022-08-15

Facility Location

Virgil E Brown Center

Damper Location

Southwest corridor

Inspector Name

Julie Gue

Damper I.D. #

AHUG 2-S1

Damper Type

Vertical Fire Damper

Damper Size

14x8 oval

Damper Manufacturer

Ruskin

Damper Model #

IBD2

Fusible Link Temperature

212 Degrees

Access Door Size

16x16

Pass / Fail / Abandoned

Pass

Comments / Corrections

None


Exterior Picture of Damper



Interior Picture of Damper



Picture of Damper I.D. Label



VISUAL CUYAHOGA COUNTY DAMPER INSPECTION REPORT

Date of Inspection

2022-08-15

Facility Location

Virgil E Brown Center

Damper Location

Southwest corridor

Inspector Name

Julie Gue

Damper I.D. #

AHUG 2-S3

Damper Type

Vertical Fire Damper

Damper Size

46x16

Damper Manufacturer

Ruskin

Damper Model #

IBD2

Fusible Link Temperature

212 Degrees

Access Door Size

18x18

Pass / Fail / Abandoned

Pass

Comments / Corrections

None


Exterior Picture of Damper



Interior Picture of Damper



Picture of Damper I.D. Label



Duct Fabricators, Inc.

883 Addison Rd. Cleveland, Ohio
P: 216-391-2400 F: 216-391-2492

FIRE SAFETY DIVISION

NEMI Certified HVAC Fire Life Safety Technicians



VISUAL CUYAHOGA COUNTY DAMPER INSPECTION REPORT

Date of Inspection

2022-08-15

Facility Location

Virgil E Brown Center

Damper Location

Southwest corridor

Inspector Name

Julie Gue

Damper I.D.

AHUG 2-S5

Damper Type

Vertical Fire Damper

Damper Size

36x12

Damper Manufacturer

Ruskin

Damper Model

IBD2

Fusible Link Temperature

212 Degrees

Access Door Size

18x18

Pass / Fail / Abandoned

Pass

Comments / Corrections

None


Exterior Picture of Damper



Interior Picture of Damper



Picture of Damper I.D. Label



VISUAL CUYAHOGA COUNTY DAMPER INSPECTION REPORT

Date of Inspection

2022-08-15

Facility Location

Virgil E Brown Center

Damper Location

South corridor

Inspector Name

Julie Gue

Damper I.D. #

AHUG 2-S6

Damper Type

Vertical Fire Damper

Damper Size

18x10 oval

Damper Manufacturer

Ruskin

Damper Model #

IBD2

Fusible Link Temperature

212 Degrees

Access Door Size

16x16

Pass / Fail / Abandoned

Pass

Comments / Corrections

None


Exterior Picture of Damper



Interior Picture of Damper



Picture of Damper I.D. Label



VISUAL CUYAHOGA COUNTY DAMPER INSPECTION REPORT

Date of Inspection

2022-08-10

Facility Location

Virgil E Brown Center

Damper Location

Southeast com room

Inspector Name

Julie Gue

Damper I.D. #

AHUG 2-S9

Damper Type

Vertical Fire Damper

Damper Size

8x12

Damper Manufacturer

Ruskin

Damper Model #

IBD2

Fusible Link Temperature

212 Degrees

Access Door Size

Open duct

Pass / Fail / Abandoned

Pass

Comments / Corrections

None


Exterior Picture of Damper



Interior Picture of Damper



Picture of Damper I.D. Label



VISUAL CUYAHOGA COUNTY DAMPER INSPECTION REPORT

Date of Inspection

2022-08-10

Facility Location

Virgil E Brown Center

Damper Location

North mechanical room

Inspector Name

Julie Gue

Damper I.D. #

AHUG.1 OA

Damper Type

Vertical Fire Damper

Damper Size

96x20

Damper Manufacturer

Ruskin

Damper Model #

IBD2

Fusible Link Temperature

212 Degrees

Access Door Size

18x18

Pass / Fail / Abandoned

Pass

Comments / Corrections

None


Exterior Picture of Damper



Interior Picture of Damper



Picture of Damper I.D. Label



VISUAL CUYAHOGA COUNTY DAMPER INSPECTION REPORT

Date of Inspection

2022-08-10

Facility Location

Virgil E Brown Center

Damper Location

North mechanical room

Inspector Name

Julie Gue

Damper I.D. #

AHUG.1 RA

Damper Type

Vertical Fire Damper

Damper Size

96x48

Damper Manufacturer

Ruskin

Damper Model #

IBD2

Fusible Link Temperature

212 Degrees

Access Door Size

Open duct

Pass / Fail / Abandoned

Pass

Comments / Corrections

None


Exterior Picture of Damper



Interior Picture of Damper



Picture of Damper I.D. Label



VISUAL CUYAHOGA COUNTY DAMPER INSPECTION REPORT

Date of Inspection

2022-08-15

Facility Location

Virgil E Brown Center

Damper Location

Northeast corridor

Inspector Name

Julie Gue

Damper I.D. #

AHUG.1-S1

Damper Type

Vertical Fire Damper

Damper Size

56x16

Damper Manufacturer

Ruskin

Damper Model #

IBD2

Fusible Link Temperature

212 Degrees

Access Door Size

30x18

Pass / Fail / Abandoned

Pass

Comments / Corrections

None

Exterior Picture of Damper



Interior Picture of Damper



Picture of Damper I.D. Label



Duct Fabricators, Inc.

883 Addison Rd. Cleveland, Ohio
P: 216-391-2400 F: 216-391-2492

FIRE SAFETY DIVISION

NEMI Certified HVAC Fire Life Safety Technicians



VISUAL CUYAHOGA COUNTY DAMPER INSPECTION REPORT

Date of Inspection

2022-08-15

Facility Location

Virgil E Brown Center

Damper Location

Southwest corridor

Inspector Name

Julie Gue

Damper I.D. #

AHUG.1-S2

Damper Type

Vertical Fire Damper

Damper Size

46x16

Damper Manufacturer

Ruskin

Damper Model #

IBD2

Fusible Link Temperature

212 Degrees

Access Door Size

16x16

Pass / Fail / Abandoned

Pass

Comments / Corrections

None


Exterior Picture of Damper



Interior Picture of Damper



Picture of Damper I.D. Label



VISUAL CUYAHOGA COUNTY DAMPER INSPECTION REPORT

Date of Inspection

2022-08-11

Facility Location

Virgil E Brown Center

Damper Location

Northeast corridor

Inspector Name

Julie Gue

Damper I.D. #

AHUG.1-S3

Damper Type

Vertical Fire Damper

Damper Size

46x16

Damper Manufacturer

Ruskin

Damper Model #

IBD2

Fusible Link Temperature

212 Degrees

Access Door Size

18x18

Pass / Fail / Abandoned

Pass

Comments / Corrections

None


Exterior Picture of Damper



Interior Picture of Damper



Picture of Damper I.D. Label

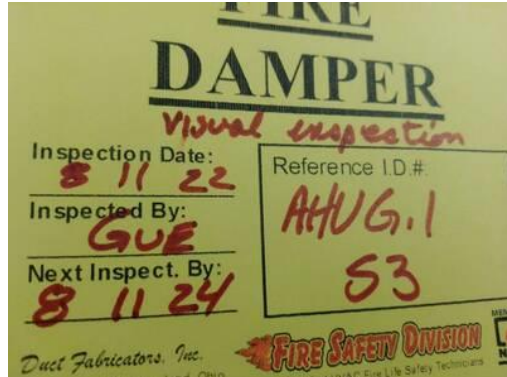

VISUAL CUYAHOGA COUNTY DAMPER INSPECTION REPORT

Date of Inspection

2022-08-10

Facility Location

Virgil E Brown Center

Damper Location

Northeast com room

Inspector Name

Julie Gue

Damper I.D. #

AHUG.1-S4

Damper Type

Vertical Fire Damper

Damper Size

8x12

Damper Manufacturer

Ruskin

Damper Model #

IBD2

Fusible Link Temperature

212 Degrees

Access Door Size

Open duct

Pass / Fail / Abandoned

Pass

Comments / Corrections

None

Exterior Picture of Damper



Interior Picture of Damper



Picture of Damper I.D. Label



VISUAL CUYAHOGA COUNTY DAMPER INSPECTION REPORT

Date of Inspection

2022-08-11

Facility Location

Virgil E Brown Center

Damper Location

RM 88

Inspector Name

Julie Gue

Damper I.D. #

AHUG.1-S5

Damper Type

Vertical Fire Damper

Damper Size

6" Round

Damper Manufacturer

Ruskin

Damper Model #

IBD2

Fusible Link Temperature

212 Degrees

Access Door Size

6x6

Pass / Fail / Abandoned

Pass

Comments / Corrections

None


Exterior Picture of Damper



Interior Picture of Damper



Picture of Damper I.D. Label



VISUAL CUYAHOGA COUNTY DAMPER INSPECTION REPORT

Date of Inspection

2022-08-11

Facility Location

Virgil E Brown Center

Damper Location

Front desk

Inspector Name

Julie Gue

Damper I.D. #

AHUG.1-S6

Damper Type

Vertical Fire Damper

Damper Size

6" Round

Damper Manufacturer

Ruskin

Damper Model #

IBD2

Fusible Link Temperature

212 Degrees

Access Door Size

18x18

Pass / Fail / Abandoned

Pass

Comments / Corrections

None


Exterior Picture of Damper



Interior Picture of Damper



Picture of Damper I.D. Label



VISUAL CUYAHOGA COUNTY DAMPER INSPECTION REPORT

Date of Inspection

2022-08-11

Facility Location

Virgil E Brown Center

Damper Location

Superior Lobby

Inspector Name

Julie Gue

Damper I.D. #

AHUG.1-S7

Damper Type

Vertical Fire Damper

Damper Size

14" oval

Damper Manufacturer

Ruskin

Damper Model #

IBD2

Fusible Link Temperature

212 Degrees

Access Door Size

16x16

Pass / Fail / Abandoned

Pass

Comments / Corrections

None


Exterior Picture of Damper



Interior Picture of Damper



Picture of Damper I.D. Label



VISUAL CUYAHOGA COUNTY DAMPER INSPECTION REPORT

Date of Inspection

2022-08-11

Facility Location

Virgil E Brown Center

Damper Location

Superior Lobby

Inspector Name

Julie Gue

Damper I.D. #

AHUG.1-S8

Damper Type

Vertical Fire Damper

Damper Size

6" Round

Damper Manufacturer

Ruskin

Damper Model #

IBD2

Fusible Link Temperature

212 Degrees

Access Door Size

16x16

Pass / Fail / Abandoned

Pass

Comments / Corrections

None


Exterior Picture of Damper



Interior Picture of Damper



Picture of Damper I.D. Label



VISUAL CUYAHOGA COUNTY DAMPER INSPECTION REPORT

Date of Inspection

2022-08-11

Facility Location

Virgil E Brown Center

Damper Location

X-ray machine

Inspector Name

Julie Gue

Damper I.D. #

AHUG.1-S9

Damper Type

Vertical Fire Damper

Damper Size

28x10

Damper Manufacturer

Ruskin

Damper Model #

IBD2

Fusible Link Temperature

212 Degrees

Access Door Size

16x16

Pass / Fail / Abandoned

Pass

Comments / Corrections

None

Exterior Picture of Damper



Interior Picture of Damper



Picture of Damper I.D. Label



VISUAL CUYAHOGA COUNTY DAMPER INSPECTION REPORT

Date of Inspection

2022-08-11

Facility Location

Virgil E Brown Center

Damper Location

Direct service

Inspector Name

Julie Gue

Damper I.D. #

AHUG.1-S10

Damper Type

Vertical Fire Damper

Damper Size

14x8 oval

Damper Manufacturer

Ruskin

Damper Model #

IBD2

Fusible Link Temperature

212 Degrees

Access Door Size

16x16

Pass / Fail / Abandoned

Pass

Comments / Corrections

None


Exterior Picture of Damper



Interior Picture of Damper



Picture of Damper I.D. Label



VISUAL CUYAHOGA COUNTY DAMPER INSPECTION REPORT

Date of Inspection

2022-08-11

Facility Location

Virgil E Brown Center

Damper Location

Direct service

Inspector Name

Julie Gue

Damper I.D. #

AHUG.1-S11

Damper Type

Vertical Fire Damper

Damper Size

6" Round

Damper Manufacturer

Ruskin

Damper Model #

IBD2

Fusible Link Temperature

212 Degrees

Access Door Size

16x16

Pass / Fail / Abandoned

Pass

Comments / Corrections

None


Exterior Picture of Damper



Interior Picture of Damper



Picture of Damper I.D. Label



VISUAL CUYAHOGA COUNTY DAMPER INSPECTION REPORT

Date of Inspection

2022-08-11

Facility Location

Virgil E Brown Center

Damper Location

Genetic testing

Inspector Name

Julie Gue

Damper I.D. #

AHUG.1-S12

Damper Type

Vertical Fire Damper

Damper Size

6" Round

Damper Manufacturer

Ruskin

Damper Model #

IBD2

Fusible Link Temperature

212 Degrees

Access Door Size

Flex

Pass / Fail / Abandoned

Pass

Comments / Corrections

None

Exterior Picture of Damper



Interior Picture of Damper



Picture of Damper I.D. Label



VISUAL CUYAHOGA COUNTY DAMPER INSPECTION REPORT

Date of Inspection

2022-08-11

Facility Location

Virgil E Brown Center

Damper Location

Northwest corridor

Inspector Name

Julie Gue

Damper I.D. #

AHUG.1-S13

Damper Type

Vertical Fire Damper

Damper Size

48x16

Damper Manufacturer

Ruskin

Damper Model #

IBD2

Fusible Link Temperature

212 Degrees

Access Door Size

16x16

Pass / Fail / Abandoned

Pass

Comments / Corrections

None


Exterior Picture of Damper



Interior Picture of Damper



Picture of Damper I.D. Label



VISUAL CUYAHOGA COUNTY DAMPER INSPECTION REPORT

Date of Inspection

2022-08-10

Facility Location

Virgil E Brown Center

Damper Location

Northwest com room

Inspector Name

Julie Gue

Damper I.D. #

AHUG.1-S14

Damper Type

Vertical Fire Damper

Damper Size

8x12

Damper Manufacturer

Ruskin

Damper Model #

IBD2

Fusible Link Temperature

212 Degrees

Access Door Size

Open duct

Pass / Fail / Abandoned

Pass

Comments / Corrections

None


Exterior Picture of Damper



Interior Picture of Damper



Picture of Damper I.D. Label



VISUAL CUYAHOGA COUNTY DAMPER INSPECTION REPORT

Date of Inspection

2022-08-15

Facility Location

Virgil E Brown Center

Damper Location

Northwest corridor

Inspector Name

Julie Gue

Damper I.D. #

AHUG.1-S15

Damper Type

Vertical Fire Damper

Damper Size

46x16

Damper Manufacturer

Ruskin

Damper Model #

IBD2

Fusible Link Temperature

212 Degrees

Access Door Size

16x16

Pass / Fail / Abandoned

Pass

Comments / Corrections

None

Exterior Picture of Damper



Interior Picture of Damper



Picture of Damper I.D. Label



VISUAL CUYAHOGA COUNTY DAMPER INSPECTION REPORT

Date of Inspection

2022-08-15

Facility Location

Virgil E Brown Center

Damper Location

Brazetin office

Inspector Name

Julie Gue

Damper I.D. #

AHUG.1-S16

Damper Type

Vertical Fire Damper

Damper Size

6" Round

Damper Manufacturer

Ruskin

Damper Model #

IBD2

Fusible Link Temperature

212 Degrees

Access Door Size

Flex

Pass / Fail / Abandoned

Pass

Comments / Corrections

None

Exterior Picture of Damper



Interior Picture of Damper



Picture of Damper I.D. Label



Duct Fabricators, Inc.

883 Addison Rd. Cleveland, Ohio
P: 216-391-2400 F: 216-391-2492



NEMI Certified HVAC Fire Life Safety Technicians



VISUAL CUYAHOGA COUNTY DAMPER INSPECTION REPORT

Date of Inspection

2022-08-10

Facility Location

Virgil E Brown Center

Damper Location

South mechanical room

Inspector Name

Julie Gue

Damper I.D. #

AHUG.2-OA

Damper Type

Vertical Fire Damper

Damper Size

96x20

Damper Manufacturer

Ruskin

Damper Model #

IBD2

Fusible Link Temperature

212 Degrees

Access Door Size

16x16

Pass / Fail / Abandoned

Pass

Comments / Corrections

None

Exterior Picture of Damper



Interior Picture of Damper



Picture of Damper I.D. Label



VISUAL CUYAHOGA COUNTY DAMPER INSPECTION REPORT

Date of Inspection

2022-08-15

Facility Location

Virgil E Brown Center

Damper Location

Ground mechanical room

Inspector Name

Julie Gue

Damper I.D. #

AHUG.2-S1

Damper Type

Vertical Fire Damper

Damper Size

16x12

Damper Manufacturer

Ruskin

Damper Model #

IBD2

Fusible Link Temperature

165 Degrees

Access Door Size

14x14

Pass / Fail / Abandoned

Pass

Comments / Corrections

None


Exterior Picture of Damper



Interior Picture of Damper



Picture of Damper I.D. Label



VISUAL CUYAHOGA COUNTY DAMPER INSPECTION REPORT

Date of Inspection

2022-08-15

Facility Location

Virgil E Brown Center

Damper Location

Southwest corridor

Inspector Name

Julie Gue

Damper I.D. #

AHUG.2-S3

Damper Type

Vertical Fire Damper

Damper Size

46x16

Damper Manufacturer

Ruskin

Damper Model #

IBD2

Fusible Link Temperature

212 Degrees

Access Door Size

18x18

Pass / Fail / Abandoned

Pass

Comments / Corrections

None


Exterior Picture of Damper



Interior Picture of Damper



Picture of Damper I.D. Label



VISUAL CUYAHOGA COUNTY DAMPER INSPECTION REPORT

Date of Inspection

2022-08-10

Facility Location

Virgil E Brown Center

Damper Location

Southwest com room

Inspector Name

Julie Gue

Damper I.D. #

AHUG.2-S4

Damper Type

Vertical Fire Damper

Damper Size

8x12

Damper Manufacturer

Ruskin

Damper Model #

IBD2

Fusible Link Temperature

212 Degrees

Access Door Size

Open duct

Pass / Fail / Abandoned

Pass

Comments / Corrections

None


Exterior Picture of Damper



Interior Picture of Damper



Picture of Damper I.D. Label



VISUAL CUYAHOGA COUNTY DAMPER INSPECTION REPORT

Date of Inspection

2022-08-15

Facility Location

Virgil E Brown Center

Damper Location

RM77

Inspector Name

Julie Gue

Damper I.D. #

AHUG.2-S7

Damper Type

Vertical Fire Damper

Damper Size

20x10

Damper Manufacturer

Ruskin

Damper Model #

IBD2

Fusible Link Temperature

212 Degrees

Access Door Size

8x8

Pass / Fail / Abandoned

Pass

Comments / Corrections

None

Exterior Picture of Damper



Interior Picture of Damper



Picture of Damper I.D. Label



VISUAL CUYAHOGA COUNTY DAMPER INSPECTION REPORT

Date of Inspection

2022-08-15

Facility Location

Virgil E Brown Center

Damper Location

Southeast corridor

Inspector Name

Julie Gue

Damper I.D. #

AHUG.2-S8

Damper Type

Vertical Fire Damper

Damper Size

46x16

Damper Manufacturer

Ruskin

Damper Model #

IBD2

Fusible Link Temperature

212 Degrees

Access Door Size

18x17

Pass / Fail / Abandoned

Pass

Comments / Corrections

None


Exterior Picture of Damper



Interior Picture of Damper



Picture of Damper I.D. Label



VISUAL CUYAHOGA COUNTY DAMPER INSPECTION REPORT

Date of Inspection

2022-08-15

Facility Location

Virgil E Brown Center

Damper Location

Southeast corridor

Inspector Name

Julie Gue

Damper I.D. #

AHUG.2-S10

Damper Type

Vertical Fire Damper

Damper Size

46x16

Damper Manufacturer

Ruskin

Damper Model #

IBD2

Fusible Link Temperature

212 Degrees

Access Door Size

18x18

Pass / Fail / Abandoned

Pass

Comments / Corrections

None


Exterior Picture of Damper



Interior Picture of Damper



Picture of Damper I.D. Label



VISUAL CUYAHOGA COUNTY DAMPER INSPECTION REPORT

Date of Inspection

2022-08-15

Facility Location

Virgil E Brown Center

Damper Location

Southeast corridor

Inspector Name

Julie Gue

Damper I.D. #

AHUG.2-S11

Damper Type

Vertical Fire Damper

Damper Size

16" oval

Damper Manufacturer

Ruskin

Damper Model #

IBD2

Fusible Link Temperature

212 Degrees

Access Door Size

18x18

Pass / Fail / Abandoned

Pass

Comments / Corrections

None

Exterior Picture of Damper



Interior Picture of Damper



Picture of Damper I.D. Label



VISUAL CUYAHOGA COUNTY DAMPER INSPECTION REPORT

Date of Inspection

2022-08-15

Facility Location

Virgil E Brown Center

Damper Location

Southeast corridor

Inspector Name

Julie Gue

Damper I.D. #

AHUG.2-S12

Damper Type

Vertical Fire Damper

Damper Size

6" Round

Damper Manufacturer

Ruskin

Damper Model #

IBD2

Fusible Link Temperature

212 Degrees

Access Door Size

18x18

Pass / Fail / Abandoned

Pass

Comments / Corrections

None


Exterior Picture of Damper



Interior Picture of Damper



Picture of Damper I.D. Label



VISUAL CUYAHOGA COUNTY DAMPER INSPECTION REPORT

Date of Inspection

2022-08-16

Facility Location

Virgil E Brown Center

Damper Location

Under lobby stairs

Inspector Name

Julie Gue

Damper I.D. #

AHUG.3-RA1

Damper Type

Horizontal Fire Damper

Damper Size

54x18

Damper Manufacturer

Ruskin

Damper Model #

IBD2

Fusible Link Temperature

212 Degrees

Access Door Size

Screen access

Pass / Fail / Abandoned

Pass

Comments / Corrections

None

Exterior Picture of Damper



Interior Picture of Damper



Picture of Damper I.D. Label



Duct Fabricators, Inc.

883 Addison Rd. Cleveland, Ohio
P: 216-391-2400 F: 216-391-2492

FIRE SAFETY DIVISION

NEMI Certified HVAC Fire Life Safety Technicians

MEMBER



VISUAL CUYAHOGA COUNTY DAMPER INSPECTION REPORT

Date of Inspection

2022-08-15

Facility Location

Virgil E Brown Center

Damper Location

Ground mechanical room

Inspector Name

Julie Gue

Damper I.D.

AHUG.3-RA2

Damper Type

Horizontal Fire Damper

Damper Size

18x16

Damper Manufacturer

Ruskin

Damper Model

IBD2

Fusible Link Temperature

212 Degrees

Access Door Size

12x12

Pass / Fail / Abandoned

Pass

Comments / Corrections

None


Exterior Picture of Damper



Interior Picture of Damper



Picture of Damper I.D. Label



VISUAL CUYAHOGA COUNTY DAMPER INSPECTION REPORT

Date of Inspection

2022-08-15

Facility Location

Virgil E Brown Center

Damper Location

Ground mechanical room

Inspector Name

Julie Gue

Damper I.D. #

AHUG.3-S2

Damper Type

Vertical Fire Damper

Damper Size

16x12

Damper Manufacturer

Ruskin

Damper Model #

IBD2

Fusible Link Temperature

212 Degrees

Access Door Size

14x14

Pass / Fail / Abandoned

Pass

Comments / Corrections

None


Exterior Picture of Damper



Interior Picture of Damper



Picture of Damper I.D. Label



VISUAL CUYAHOGA COUNTY DAMPER INSPECTION REPORT

Date of Inspection

2022-08-15

Facility Location

Virgil E Brown Center

Damper Location

Lobby Mechanical Room

Inspector Name

Julie Gue

Damper I.D. #

AHUG.3-S3

Damper Type

Vertical Fire Damper

Damper Size

26x10

Damper Manufacturer

Ruskin

Damper Model #

IBD2

Fusible Link Temperature

165 Degrees

Access Door Size

14x14

Pass / Fail / Abandoned

Pass

Comments / Corrections

None


Exterior Picture of Damper



Interior Picture of Damper



Picture of Damper I.D. Label



VISUAL CUYAHOGA COUNTY DAMPER INSPECTION REPORT

Date of Inspection

2022-08-15

Facility Location

Virgil E Brown Center

Damper Location

Ground mechanical room

Inspector Name

Julie Gue

Damper I.D. #

AHUG.3-S4

Damper Type

Vertical Fire Damper

Damper Size

14x10

Damper Manufacturer

Ruskin

Damper Model #

IBD2

Fusible Link Temperature

165 Degrees

Access Door Size

12x12

Pass / Fail / Abandoned

Pass

Comments / Corrections

None

Exterior Picture of Damper



Interior Picture of Damper



Picture of Damper I.D. Label



VISUAL CUYAHOGA COUNTY DAMPER INSPECTION REPORT

Date of Inspection

2022-08-10

Facility Location

Virgil E Brown Center

Damper Location

North mechanical room

Inspector Name

Julie Gue

Damper I.D. #

AHUL.1-RA

Damper Type

Vertical Fire Damper

Damper Size

96x32

Damper Manufacturer

Ruskin

Damper Model #

IBD2

Fusible Link Temperature

212 Degrees

Access Door Size

Open access

Pass / Fail / Abandoned

Pass

Comments / Corrections

None


Exterior Picture of Damper



Interior Picture of Damper



Picture of Damper I.D. Label



VISUAL CUYAHOGA COUNTY DAMPER INSPECTION REPORT

Date of Inspection

2022-08-10

Facility Location

Virgil E Brown Center

Damper Location

South mechanical room

Inspector Name

Julie Gue

Damper I.D. #

AHULL 2- OA

Damper Type

Vertical Fire Damper

Damper Size

96x18

Damper Manufacturer

Ruskin

Damper Model #

IBD2

Fusible Link Temperature

212 Degrees

Access Door Size

16x16

Pass / Fail / Abandoned

Pass

Comments / Corrections

None

Exterior Picture of Damper



Interior Picture of Damper



Picture of Damper I.D. Label



VISUAL CUYAHOGA COUNTY DAMPER INSPECTION REPORT

Date of Inspection

2022-08-11

Facility Location

Virgil E Brown Center

Damper Location

Record room

Inspector Name

Julie Gue

Damper I.D. #

AHULL 2-S2

Damper Type

Vertical Fire Damper

Damper Size

18x12

Damper Manufacturer

Ruskin

Damper Model #

IBD2

Fusible Link Temperature

212 Degrees

Access Door Size

12x12

Pass / Fail / Abandoned

Pass

Comments / Corrections

None

Exterior Picture of Damper



Interior Picture of Damper



Picture of Damper I.D. Label



VISUAL CUYAHOGA COUNTY DAMPER INSPECTION REPORT

Date of Inspection

2022-08-11

Facility Location

Virgil E Brown Center

Damper Location

Break room

Inspector Name

Julie Gue

Damper I.D. #

AHULL 2-S3

Damper Type

Vertical Fire Damper

Damper Size

22x10

Damper Manufacturer

Ruskin

Damper Model #

IBD2

Fusible Link Temperature

212 Degrees

Access Door Size

18x18

Pass / Fail / Abandoned

Pass

Comments / Corrections

None


Exterior Picture of Damper



Interior Picture of Damper



Picture of Damper I.D. Label



Duct Fabricators, Inc.

883 Addison Rd. Cleveland, Ohio
P: 216-391-2400 F: 216-391-2492

FIRE SAFETY DIVISION
NEMI Certified HVAC Fire Life Safety Technicians



VISUAL CUYAHOGA COUNTY DAMPER INSPECTION REPORT

Date of Inspection

2022-08-10

Facility Location

Virgil E Brown Center

Damper Location

North mechanical room

Inspector Name

Julie Gue

Damper I.D.

AHULL.1-OA

Damper Type

Vertical Fire Damper

Damper Size

96x18

Damper Manufacturer

Ruskin

Damper Model

IBD2

Fusible Link Temperature

212 Degrees

Access Door Size

16x16

Pass / Fail / Abandoned

Pass

Comments / Corrections

None

Exterior Picture of Damper



Interior Picture of Damper



Picture of Damper I.D. Label



VISUAL CUYAHOGA COUNTY DAMPER INSPECTION REPORT

Date of Inspection

2022-08-11

Facility Location

Virgil E Brown Center

Damper Location

Northeast

Inspector Name

Julie Gue

Damper I.D. #

AHULL.1-S1

Damper Type

Vertical Fire Damper

Damper Size

8x12

Damper Manufacturer

Ruskin

Damper Model #

IBD2

Fusible Link Temperature

212 Degrees

Access Door Size

Open duct

Pass / Fail / Abandoned

Pass

Comments / Corrections

None

Exterior Picture of Damper



Interior Picture of Damper



Picture of Damper I.D. Label



VISUAL CUYAHOGA COUNTY DAMPER INSPECTION REPORT

Date of Inspection

2022-08-11

Facility Location

Virgil E Brown Center

Damper Location

Northwest com room

Inspector Name

Julie Gue

Damper I.D. #

AHULL.1-S2

Damper Type

Vertical Fire Damper

Damper Size

8x12

Damper Manufacturer

Ruskin

Damper Model #

IBD2

Fusible Link Temperature

212 Degrees

Access Door Size

Open

Pass / Fail / Abandoned

Pass

Comments / Corrections

None


Exterior Picture of Damper



Interior Picture of Damper



Picture of Damper I.D. Label



VISUAL CUYAHOGA COUNTY DAMPER INSPECTION REPORT

Date of Inspection

2022-08-10

Facility Location

Virgil E Brown Center

Damper Location

South mechanical room

Inspector Name

Julie Gue

Damper I.D. #

AHULL.2-RA

Damper Type

Vertical Fire Damper

Damper Size

96x32

Damper Manufacturer

Ruskin

Damper Model #

IBD2

Fusible Link Temperature

212 Degrees

Access Door Size

Open duct

Pass / Fail / Abandoned

Pass

Comments / Corrections

None


Exterior Picture of Damper



Interior Picture of Damper



Picture of Damper I.D. Label



VISUAL CUYAHOGA COUNTY DAMPER INSPECTION REPORT

Date of Inspection
2022-08-11

Facility Location
Virgil E Brown Center

Damper Location
Southwest

Inspector Name
Julie Gue

Damper I.D. #
AHULL.2-S1

Damper Type
Vertical Fire Damper

Damper Size
24x12

Damper Manufacturer
Ruskin

Damper Model #
IBD2

Fusible Link Temperature
212 Degrees

Access Door Size
Open

Pass / Fail / Abandoned
Pass

Comments / Corrections
None

Exterior Picture of Damper



Interior Picture of Damper



Picture of Damper I.D. Label



VISUAL CUYAHOGA COUNTY DAMPER INSPECTION REPORT

Date of Inspection

2022-08-19

Facility Location

Virgil E Brown

Damper Location

File room

Inspector Name

Julie Gue

Damper I.D. #

AHULL.2-S4

Damper Type

Vertical Fire Damper

Damper Size

10" Round

Damper Manufacturer

Ruskin

Damper Model #

IBD2

Fusible Link Temperature

212 Degrees

Access Door Size

10" oval

Pass / Fail / Abandoned

Pass

Comments / Corrections

None

Exterior Picture of Damper



Interior Picture of Damper



Picture of Damper I.D. Label



VISUAL CUYAHOGA COUNTY DAMPER INSPECTION REPORT

Date of Inspection

2022-08-11

Facility Location

Virgil E Brown Center

Damper Location

Document room

Inspector Name

Julie Gue

Damper I.D. #

AHULL.2-S5

Damper Type

Vertical Fire Damper

Damper Size

28x12

Damper Manufacturer

Ruskin

Damper Model #

IBD2

Fusible Link Temperature

212 Degrees

Access Door Size

12x12

Pass / Fail / Abandoned

Pass

Comments / Corrections

None


Exterior Picture of Damper



Interior Picture of Damper



Picture of Damper I.D. Label



VISUAL CUYAHOGA COUNTY DAMPER INSPECTION REPORT

Date of Inspection

2022-08-11

Facility Location

Virgil E Brown Center

Damper Location

Southeast com room

Inspector Name

Julie Gue

Damper I.D. #

AHULL.2-S6

Damper Type

Vertical Fire Damper

Damper Size

8x12

Damper Manufacturer

Ruskin

Damper Model #

IBD2

Fusible Link Temperature

212 Degrees

Access Door Size

Open

Pass / Fail / Abandoned

Pass

Comments / Corrections

None


Exterior Picture of Damper



Interior Picture of Damper



Picture of Damper I.D. Label



VISUAL CUYAHOGA COUNTY DAMPER INSPECTION REPORT

Date of Inspection

2022-08-11

Facility Location

Virgil E Brown Center

Damper Location

Custodial office

Inspector Name

Julie Gue

Damper I.D. #

AHULL.2-S7

Damper Type

Vertical Fire Damper

Damper Size

8x8

Damper Manufacturer

Ruskin

Damper Model #

IBD2

Fusible Link Temperature

212 Degrees

Access Door Size

6x6

Pass / Fail / Abandoned

Pass

Comments / Corrections

None

Exterior Picture of Damper



Interior Picture of Damper



Picture of Damper I.D. Label



VISUAL CUYAHOGA COUNTY DAMPER INSPECTION REPORT

Date of Inspection

2022-08-04

Facility Location

Virgil E Brown Center

Damper Location

3rd floor mechanical room South

Inspector Name

Dan Tulcewicz

Damper I.D. #

EF 7-3

Damper Type

Horizontal Fire Damper

Damper Size

36x18

Damper Manufacturer

Ruskin

Damper Model #

IBD2

Fusible Link Temperature

212 Degrees

Access Door Size

24x24

Pass / Fail / Abandoned

Pass

Comments / Corrections

None


Exterior Picture of Damper



Interior Picture of Damper



Picture of Damper I.D. Label



VISUAL CUYAHOGA COUNTY DAMPER INSPECTION REPORT

Date of Inspection

2022-08-10

Facility Location

Virgil E Brown Center

Damper Location

South mechanical room

Inspector Name

Julie Gue

Damper I.D. #

EF7-1

Damper Type

Vertical Fire Damper

Damper Size

22x16

Damper Manufacturer

Ruskin

Damper Model #

IBD2

Fusible Link Temperature

212 Degrees

Access Door Size

18x18

Pass / Fail / Abandoned

Pass

Comments / Corrections

None


Exterior Picture of Damper



Interior Picture of Damper



Picture of Damper I.D. Label



VISUAL CUYAHOGA COUNTY DAMPER INSPECTION REPORT

Date of Inspection

2022-08-10

Facility Location

Virgil E Brown Center

Damper Location

South mechanical room

Inspector Name

Julie Gue

Damper I.D. #

EF7-2

Damper Type

Vertical Fire Damper

Damper Size

26x18

Damper Manufacturer

Ruskin

Damper Model #

IBD2

Fusible Link Temperature

212 Degrees

Access Door Size

20x20

Pass / Fail / Abandoned

Pass

Comments / Corrections

None


Exterior Picture of Damper



Interior Picture of Damper



Picture of Damper I.D. Label



Duct Fabricators, Inc.

883 Addison Rd. Cleveland, Ohio
P: 216-391-2400 F: 216-391-2492



NEMI Certified HVAC Fire Life Safety Technicians



VISUAL CUYAHOGA COUNTY DAMPER INSPECTION REPORT

Date of Inspection

2022-08-04

Facility Location

Virgil E Brown Center

Damper Location

3rd floor mechanical room South

Inspector Name

Dan Tulcewicz

Damper I.D.

EF7-3

Damper Type

Horizontal Fire Damper

Damper Size

36x18

Damper Manufacturer

Ruskin

Damper Model

IBD2

Fusible Link Temperature

212 Degrees

Access Door Size

24x24

Pass / Fail / Abandoned

Pass

Comments / Corrections

None


Exterior Picture of Damper



Interior Picture of Damper



Picture of Damper I.D. Label



Duct Fabricators, Inc.

883 Addison Rd. Cleveland, Ohio
P: 216-391-2400 F: 216-391-2492

FIRE SAFETY DIVISION
NEMI Certified HVAC Fire Life Safety Technicians



VISUAL CUYAHOGA COUNTY DAMPER INSPECTION REPORT

Date of Inspection

2022-07-26

Facility Location

Virgil E Brown Center

Damper Location

4th floor mechanical room South

Inspector Name

Dan Tulcewicz

Damper I.D. #

EF7-4

Damper Type

Horizontal Fire Damper

Damper Size

36x20

Damper Manufacturer

Ruskin

Damper Model #

IBD2

Fusible Link Temperature

212 Degrees

Access Door Size

24x24

Pass / Fail / Abandoned

Pass

Comments / Corrections

None

Exterior Picture of Damper



Interior Picture of Damper



Picture of Damper I.D. Label



VISUAL CUYAHOGA COUNTY DAMPER INSPECTION REPORT

Date of Inspection

2022-08-10

Facility Location

Virgil E Brown Center

Damper Location

South mechanical room

Inspector Name

Julie Gue

Damper I.D. #

EF7-GRD

Damper Type

Horizontal Fire Damper

Damper Size

20x14

Damper Manufacturer

Ruskin

Damper Model #

IBD2

Fusible Link Temperature

212 Degrees

Access Door Size

18x18

Pass / Fail / Abandoned

Pass

Comments / Corrections

None

Exterior Picture of Damper



Interior Picture of Damper



Picture of Damper I.D. Label



VISUAL CUYAHOGA COUNTY DAMPER INSPECTION REPORT

Date of Inspection

2022-07-25

Facility Location

Virgil E Brown Center

Damper Location

Penthouse South

Inspector Name

Dan Tulcewicz

Damper I.D. #

EF7-PH

Damper Type

Horizontal Fire Damper

Damper Size

48x18

Damper Manufacturer

Ruskin

Damper Model #

IBD2

Fusible Link Temperature

212 Degrees

Access Door Size

24x24

Pass / Fail / Abandoned

Pass

Comments / Corrections

None

Exterior Picture of Damper



Interior Picture of Damper



Picture of Damper I.D. Label



Duct Fabricators, Inc.

883 Addison Rd. Cleveland, Ohio
P: 216-391-2400 F: 216-391-2492



VISUAL CUYAHOGA COUNTY DAMPER INSPECTION REPORT

Date of Inspection

2022-07-25

Facility Location

Virgil E Brown Center

Damper Location

5th Floor Mechanical South

Inspector Name

Dan Tulcewicz

Damper I.D.

EF7-S5

Damper Type

Horizontal Fire Damper

Damper Size

40x20

Damper Manufacturer

Ruskin

Damper Model

IBD2

Fusible Link Temperature

212 Degrees

Access Door Size

24x24

Pass / Fail / Abandoned

Pass

Comments / Corrections

None

Exterior Picture of Damper



Interior Picture of Damper



Picture of Damper I.D. Label



VISUAL CUYAHOGA COUNTY DAMPER INSPECTION REPORT

Date of Inspection

2022-08-10

Facility Location

Virgil E Brown Center

Damper Location

North mechanical room

Inspector Name

Julie Gue

Damper I.D. #

EF10-1

Damper Type

Vertical Fire Damper

Damper Size

22x16

Damper Manufacturer

Ruskin

Damper Model #

IBD2

Fusible Link Temperature

212 Degrees

Access Door Size

18x18

Pass / Fail / Abandoned

Pass

Comments / Corrections

None


Exterior Picture of Damper



Interior Picture of Damper



Picture of Damper I.D. Label



VISUAL CUYAHOGA COUNTY DAMPER INSPECTION REPORT

Date of Inspection

2022-08-10

Facility Location

Virgil E Brown Center

Damper Location

Mechanical room

Inspector Name

Julie Gue

Damper I.D. #

EF10-2

Damper Type

Vertical Fire Damper

Damper Size

26x18

Damper Manufacturer

Ruskin

Damper Model #

IBD2

Fusible Link Temperature

212 Degrees

Access Door Size

20x20

Pass / Fail / Abandoned

Pass

Comments / Corrections

None


Exterior Picture of Damper



Interior Picture of Damper



Picture of Damper I.D. Label



Duct Fabricators, Inc.

883 Addison Rd. Cleveland, Ohio
P: 216-391-2400 F: 216-391-2492



NEMI Certified HVAC Fire Life Safety Technicians



VISUAL CUYAHOGA COUNTY DAMPER INSPECTION REPORT

Date of Inspection

2022-08-04

Facility Location

Virgil E Brown Center

Damper Location

3rd floor mechanical room north

Inspector Name

Dan Tulcewicz

Damper I.D.

EF10-3

Damper Type

Horizontal Fire Damper

Damper Size

36x18

Damper Manufacturer

Ruskin

Damper Model

IBD2

Fusible Link Temperature

212 Degrees

Access Door Size

24x24

Pass / Fail / Abandoned

Pass

Comments / Corrections

None


Exterior Picture of Damper



Interior Picture of Damper



Picture of Damper I.D. Label



Duct Fabricators, Inc.

883 Addison Rd. Cleveland, Ohio
P: 216-391-2400 F: 216-391-2492



NEMI Certified HVAC Fire Life Safety Technicians

MEMBER



VISUAL CUYAHOGA COUNTY DAMPER INSPECTION REPORT

Date of Inspection

2022-07-26

Facility Location

Virgil E Brown Center

Damper Location

4th floor mechanical room north

Inspector Name

Dan Tulcewicz

Damper I.D.

EF10-4

Damper Type

Horizontal Fire Damper

Damper Size

36x20

Damper Manufacturer

Ruskin

Damper Model

IBD2

Fusible Link Temperature

212 Degrees

Access Door Size

18x18

Pass / Fail / Abandoned

Pass

Comments / Corrections

None


Exterior Picture of Damper



Interior Picture of Damper



Picture of Damper I.D. Label



Duct Fabricators, Inc.

883 Addison Rd. Cleveland, Ohio
P: 216-391-2400 F: 216-391-2492

FIRE SAFETY DIVISION
NEMI Certified HVAC Fire Life Safety Technicians



VISUAL CUYAHOGA COUNTY DAMPER INSPECTION REPORT

Date of Inspection

2022-07-25

Facility Location

Virgil E Brown Center

Damper Location

5th Floor Mechanical North

Inspector Name

Dan Tulcewicz

Damper I.D.

EF10-5

Damper Type

Horizontal Fire Damper

Damper Size

40x20

Damper Manufacturer

Ruskin

Damper Model

IBD2

Fusible Link Temperature

212 Degrees

Access Door Size

24x24

Pass / Fail / Abandoned

Pass

Comments / Corrections

None


Exterior Picture of Damper



Interior Picture of Damper



Picture of Damper I.D. Label



Duct Fabricators, Inc.

883 Addison Rd. Cleveland, Ohio
P: 216-391-2400 F: 216-391-2492

FIRE SAFETY DIVISION
NEMI Certified HVAC Fire Life Safety Technicians



VISUAL CUYAHOGA COUNTY DAMPER INSPECTION REPORT

Date of Inspection

2022-08-10

Facility Location

Virgil E Brown Center

Damper Location

North mechanical room

Inspector Name

Julie Gue

Damper I.D. #

EF10-G

Damper Type

Horizontal Fire Damper

Damper Size

14x20

Damper Manufacturer

Ruskin

Damper Model #

IBD2

Fusible Link Temperature

212 Degrees

Access Door Size

18x18

Pass / Fail / Abandoned

Pass

Comments / Corrections

None


Exterior Picture of Damper



Interior Picture of Damper



Picture of Damper I.D. Label



VISUAL CUYAHOGA COUNTY DAMPER INSPECTION REPORT

Date of Inspection

2022-08-08

Facility Location

Virgil E Brown Center

Damper Location

Lower level mechanical room

Inspector Name

Julie Gue

Damper I.D. #

EF18-1

Damper Type

Vertical Fire Damper

Damper Size

12x12

Damper Manufacturer

Ruskin

Damper Model #

IBD2

Fusible Link Temperature

212 Degrees

Access Door Size

8x8

Pass / Fail / Abandoned

Pass

Comments / Corrections

None


Exterior Picture of Damper



Interior Picture of Damper



Picture of Damper I.D. Label



VISUAL CUYAHOGA COUNTY DAMPER INSPECTION REPORT

Date of Inspection

2022-08-08

Facility Location

Virgil E Brown Center

Damper Location

Lower level
Mechanical room

Inspector Name

Julie Gue

Damper I.D. #

EF18-OA

Damper Type

Vertical Fire Damper

Damper Size

40x24

Damper Manufacturer

Ruskin

Damper Model #

IBD2

Fusible Link Temperature

165 Degrees

Access Door Size

18x18

Pass / Fail / Abandoned

Pass

Comments / Corrections

None


Exterior Picture of Damper



Interior Picture of Damper



Picture of Damper I.D. Label

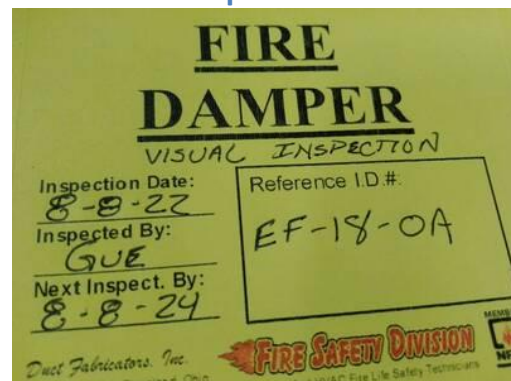

VISUAL CUYAHOGA COUNTY DAMPER INSPECTION REPORT

Date of Inspection

2022-08-08

Facility Location

Virgil E Brown Center

Damper Location

Lower level

Inspector Name

Julie Gue

Damper I.D. #

EF-25-1

Damper Type

Vertical Fire Damper

Damper Size

12x12

Damper Manufacturer

Ruskin

Damper Model #

IBD2

Fusible Link Temperature

212 Degrees

Access Door Size

10x8


Pass / Fail / Abandoned

Pass

Comments / Corrections

None

Exterior Picture of Damper



Interior Picture of Damper



Picture of Damper I.D. Label



Duct Fabricators, Inc.

883 Addison Rd. Cleveland, Ohio
P: 216-391-2400 F: 216-391-2492

FIRE SAFETY DIVISION
NEMI Certified HVAC Fire Life Safety Technicians



VISUAL CUYAHOGA COUNTY DAMPER INSPECTION REPORT

Date of Inspection

2022-08-11

Facility Location

Virgil E Brown Center

Damper Location

Mechanical room

Inspector Name

Julie Gue

Damper I.D. #

LL RA3

Damper Type

Vertical Fire Damper

Damper Size

24x24

Damper Manufacturer

Ruskin

Damper Model #

IBD2

Fusible Link Temperature

212 Degrees

Access Door Size

Grille

Pass / Fail / Abandoned

Pass

Comments / Corrections

None


Exterior Picture of Damper



Interior Picture of Damper



Picture of Damper I.D. Label



VISUAL CUYAHOGA COUNTY DAMPER INSPECTION REPORT

Date of Inspection

2022-08-08

Facility Location

Virgil E Brown Center

Damper Location

Mechanical room

Inspector Name

Julie Gue

Damper I.D. #

LL-RA 4

Damper Type

Vertical Fire Damper

Damper Size

60x84

Damper Manufacturer

Ruskin

Damper Model #

IBD2

Fusible Link Temperature

212 Degrees

Access Door Size

Grille access

Pass / Fail / Abandoned

Pass

Comments / Corrections

None


Exterior Picture of Damper



Interior Picture of Damper



Picture of Damper I.D. Label



Duct Fabricators, Inc.

883 Addison Rd. Cleveland, Ohio
P: 216-391-2400 F: 216-391-2492

FIRE SAFETY DIVISION
NEMI Certified HVAC Fire Life Safety Technicians



VISUAL CUYAHOGA COUNTY DAMPER INSPECTION REPORT

Date of Inspection

2022-08-08

Facility Location

Virgil E Brown Center

Damper Location

Lower level mechanical room

Inspector Name

Julie Gue

Damper I.D. #

LL-RA1

Damper Type

Vertical Fire Damper

Damper Size

24x28

Damper Manufacturer

Ruskin

Damper Model #

IBD2

Fusible Link Temperature

212 Degrees

Access Door Size

Grille access

Pass / Fail / Abandoned

Pass

Comments / Corrections

None


Exterior Picture of Damper



Interior Picture of Damper



Picture of Damper I.D. Label



VISUAL CUYAHOGA COUNTY DAMPER INSPECTION REPORT

Date of Inspection

2022-08-11

Facility Location

Virgil E Brown Center

Damper Location

Mechanical room

Inspector Name

Julie Gue

Damper I.D. #

LL-RA2

Damper Type

Vertical Fire Damper

Damper Size

48x60

Damper Manufacturer

Ruskin

Damper Model #

IBD2

Fusible Link Temperature

212 Degrees

Access Door Size

Grille access

Pass / Fail / Abandoned

Pass

Comments / Corrections

None

Exterior Picture of Damper



Interior Picture of Damper



Picture of Damper I.D. Label



VISUAL CUYAHOGA COUNTY DAMPER INSPECTION REPORT

Date of Inspection

2022-08-08

Facility Location

Virgil E Brown Center

Damper Location

Lower level mechanical room

Inspector Name

Julie Gue

Damper I.D.

LL-RA4

Damper Type

Vertical Fire Damper

Damper Size

60x84

Damper Manufacturer

Ruskin

Damper Model

IBD2

Fusible Link Temperature

165 Degrees

Access Door Size

Grille access

Pass / Fail / Abandoned

Pass

Comments / Corrections

None


Exterior Picture of Damper



Interior Picture of Damper



Picture of Damper I.D. Label

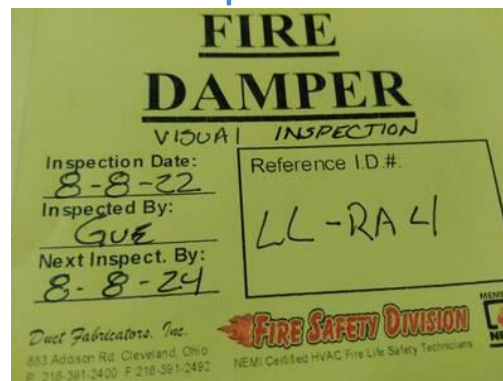

VISUAL CUYAHOGA COUNTY DAMPER INSPECTION REPORT

Date of Inspection

2022-08-08

Facility Location

Virgil E Brown Center

Damper Location

Lower level mechanical room

Inspector Name

Julie Gue

Damper I.D. #

LL-TA-1

Damper Type

Vertical Fire Damper

Damper Size

48x18

Damper Manufacturer

Ruskin

Damper Model #

IBD2

Fusible Link Temperature

165 Degrees

Access Door Size

Screen access

Pass / Fail / Abandoned

Pass

Comments / Corrections

None


Exterior Picture of Damper



Interior Picture of Damper



Picture of Damper I.D. Label



Duct Fabricators, Inc.

883 Addison Rd. Cleveland, Ohio
P: 216-391-2400 F: 216-391-2492

FIRE SAFETY DIVISION

NEMI Certified HVAC Fire Life Safety Technicians



VISUAL CUYAHOGA COUNTY DAMPER INSPECTION REPORT

Date of Inspection

2022-08-08

Facility Location

Virgil E Brown Center

Damper Location

Lower level mechanical room

Inspector Name

Julie Gue

Damper I.D. #

LL-TA-2

Damper Type

Vertical Fire Damper

Damper Size

12x12

Damper Manufacturer

Ruskin

Damper Model #

IBD2

Fusible Link Temperature

165 Degrees

Access Door Size

Screen access

Pass / Fail / Abandoned

Pass

Comments / Corrections

None


Exterior Picture of Damper



Interior Picture of Damper



Picture of Damper I.D. Label



VISUAL CUYAHOGA COUNTY DAMPER INSPECTION REPORT

Date of Inspection

2022-07-25

Facility Location

Virgil E Brown Center

Damper Location

Penthouse North

Inspector Name

Dan Tulcewicz

Damper I.D. #

PH.1-RA

Damper Type

Vertical Fire Damper

Damper Size

108x48

Damper Manufacturer

Ruskin

Damper Model #

IBD2

Fusible Link Temperature

165 Degrees

Access Door Size

24x24

Pass / Fail / Abandoned

Pass

Comments / Corrections

None

Exterior Picture of Damper



Interior Picture of Damper



Picture of Damper I.D. Label



VISUAL CUYAHOGA COUNTY DAMPER INSPECTION REPORT

Date of Inspection

2022-07-25

Facility Location

Virgil E Brown Center

Damper Location

Penthouse South

Inspector Name

Dan Tulcewicz

Damper I.D. #

PH.2-OA1

Damper Type

Vertical Fire Damper

Damper Size

114x48

Damper Manufacturer

Ruskin

Damper Model #

IBD2

Fusible Link Temperature

212 Degrees

Access Door Size

24x20

Pass / Fail / Abandoned

Pass

Comments / Corrections

None

Exterior Picture of Damper



Interior Picture of Damper



Picture of Damper I.D. Label



VISUAL CUYAHOGA COUNTY DAMPER INSPECTION REPORT

Date of Inspection

2022-07-25

Facility Location

Virgil E Brown Center

Damper Location

Penthouse South

Inspector Name

Dan Tulcewicz

Damper I.D.

PH.2-OA2

Damper Type

Vertical Fire Damper

Damper Size

96x48

Damper Manufacturer

Ruskin

Damper Model

IBD2

Fusible Link Temperature

212 Degrees

Access Door Size

24x20

Pass / Fail / Abandoned

Pass

Comments / Corrections

None

Exterior Picture of Damper



Interior Picture of Damper



Picture of Damper I.D. Label



Duct Fabricators, Inc.

883 Addison Rd. Cleveland, Ohio
P: 216-391-2400 F: 216-391-2492



VISUAL CUYAHOGA COUNTY DAMPER INSPECTION REPORT

Date of Inspection

2022-07-29

Facility Location

Virgil E Brown Center

Damper Location

Elevator room penthouse South

Inspector Name

Dan Tulcewicz

Damper I.D. #

PH.2-OA-3

Damper Type

Vertical Fire Damper

Damper Size

48x48

Damper Manufacturer

Ruskin

Damper Model #

Unknown

Fusible Link Temperature

212 Degrees

Access Door Size

Thru the grill

Pass / Fail / Abandoned

Pass

Comments / Corrections

None

Exterior Picture of Damper



Interior Picture of Damper



Picture of Damper I.D. Label



VISUAL CUYAHOGA COUNTY DAMPER INSPECTION REPORT

Date of Inspection

2022-07-25

Facility Location

Virgil E Brown Center

Damper Location

Penthouse South

Inspector Name

Dan Tulcewicz

Damper I.D. #

PH.2-RA

Damper Type

Vertical Fire Damper

Damper Size

108x48

Damper Manufacturer

Ruskin

Damper Model #

IBD2

Fusible Link Temperature

212 Degrees

Access Door Size

24x24

Pass / Fail / Abandoned

Pass

Comments / Corrections

None

Exterior Picture of Damper



Interior Picture of Damper



Picture of Damper I.D. Label

